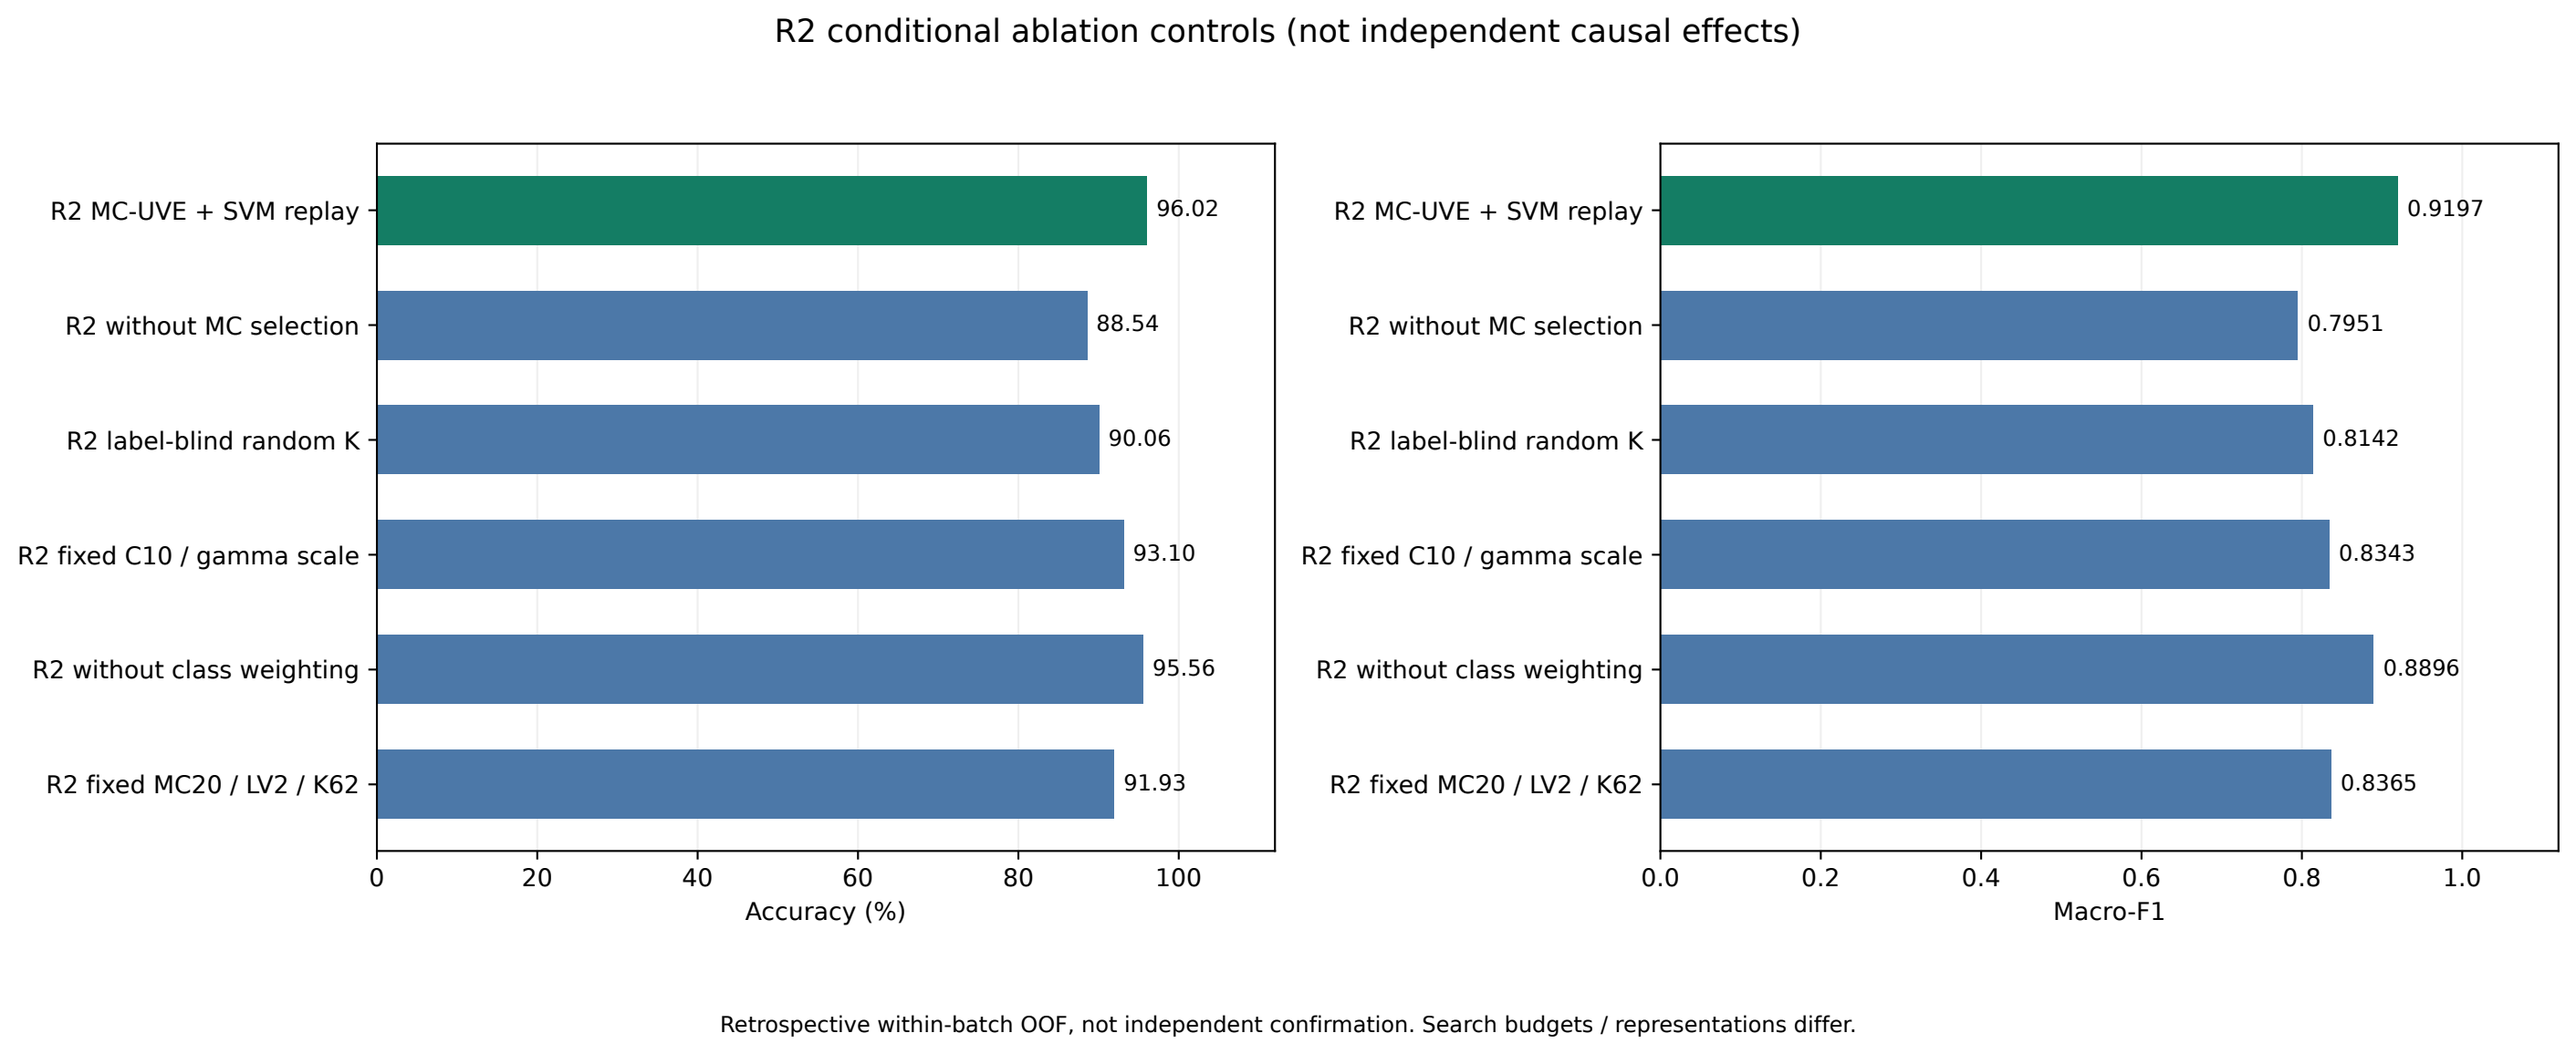
R2 conditional ablation controls (not independent causal effects)
R2 MC-UVE + SVM replay
R2 without MC selection
R2 label-blind random K
R2 fixed C10 / gamma scale
R2 without class weighting
R2 fixed MC20 / LV2 / K62
96.02
88.54
90.06
93.10
95.56
91.93
0
20
40
60
80
100
Accuracy (%)
0.9197
0.7951
0.8142
0.8343
0.8896
0.8365
0.0
0.2
0.4
0.6
0.8
1.0
Macro-F1
Retrospective within-batch OOF, not independent confirmation. Search budgets / representations differ.