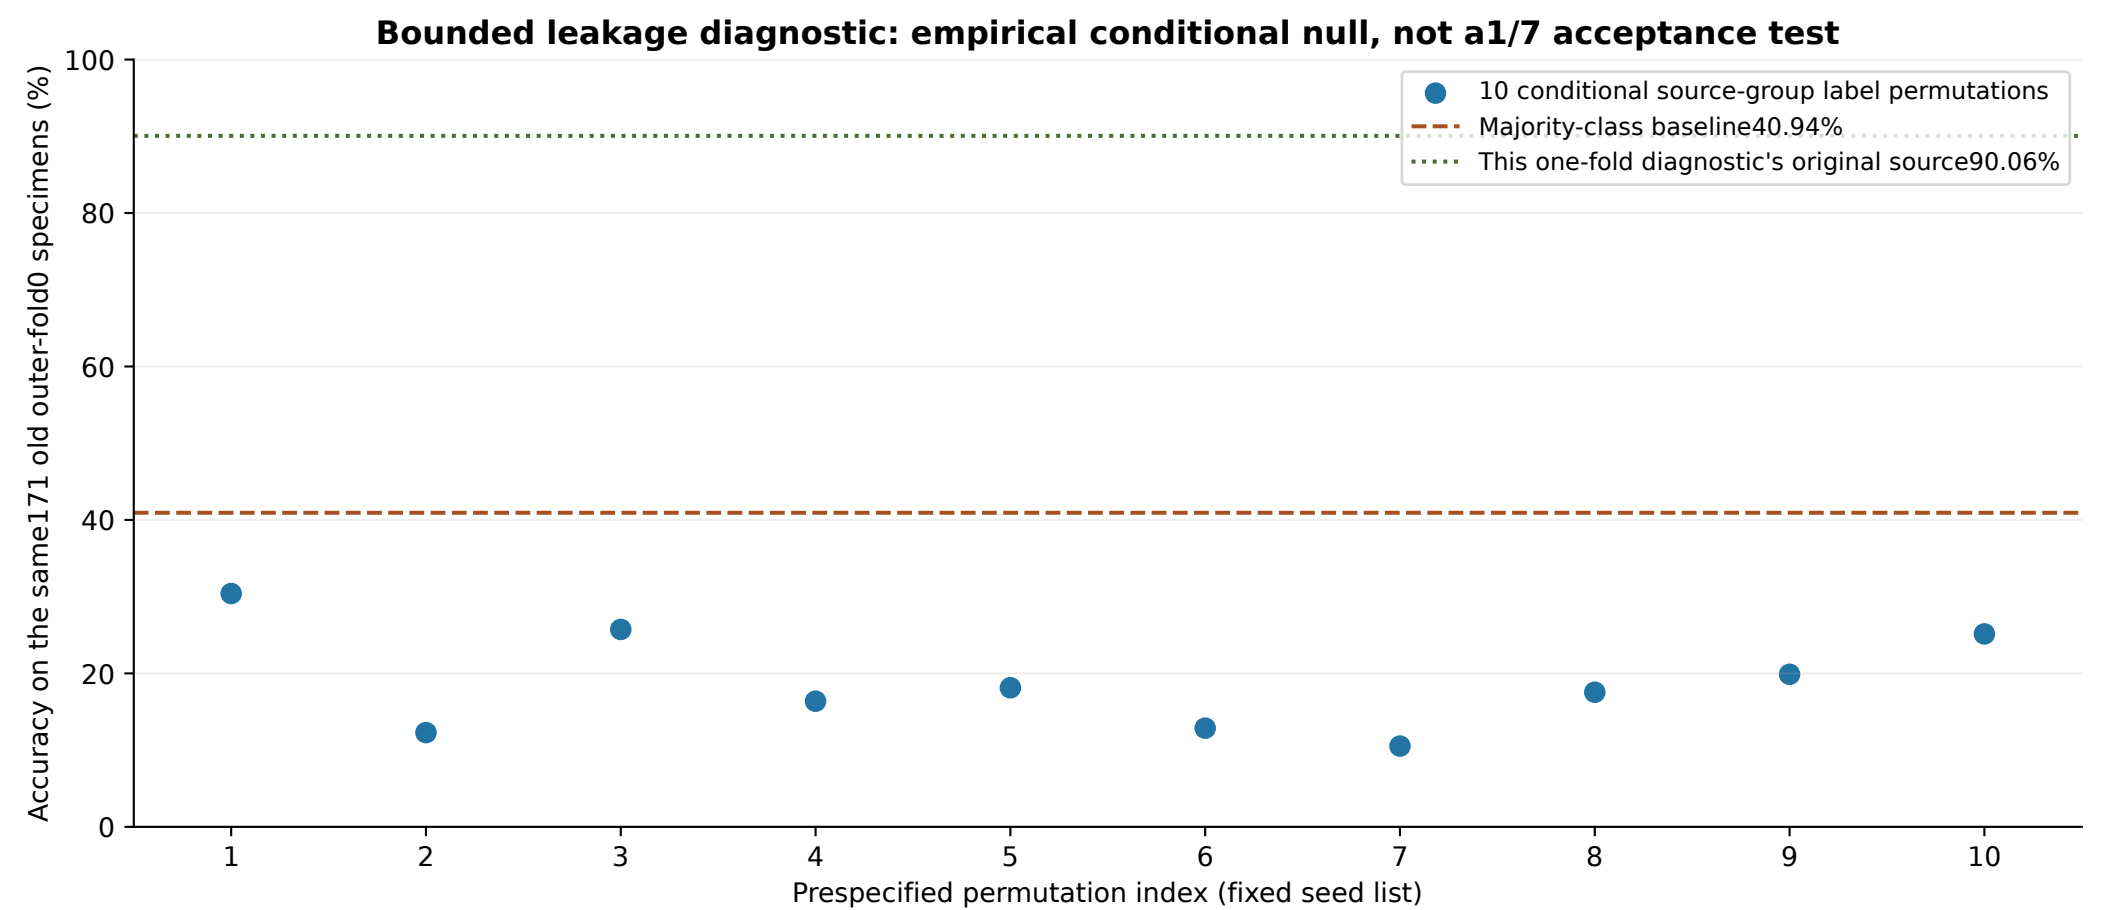

Each permutation reruns source-only MC-UVE and inner SVM selection. Repeated171 query specimens are not new samples.
10 permutations give coarse plus-one resolution1/11; no biological or cross-batch significance certification.