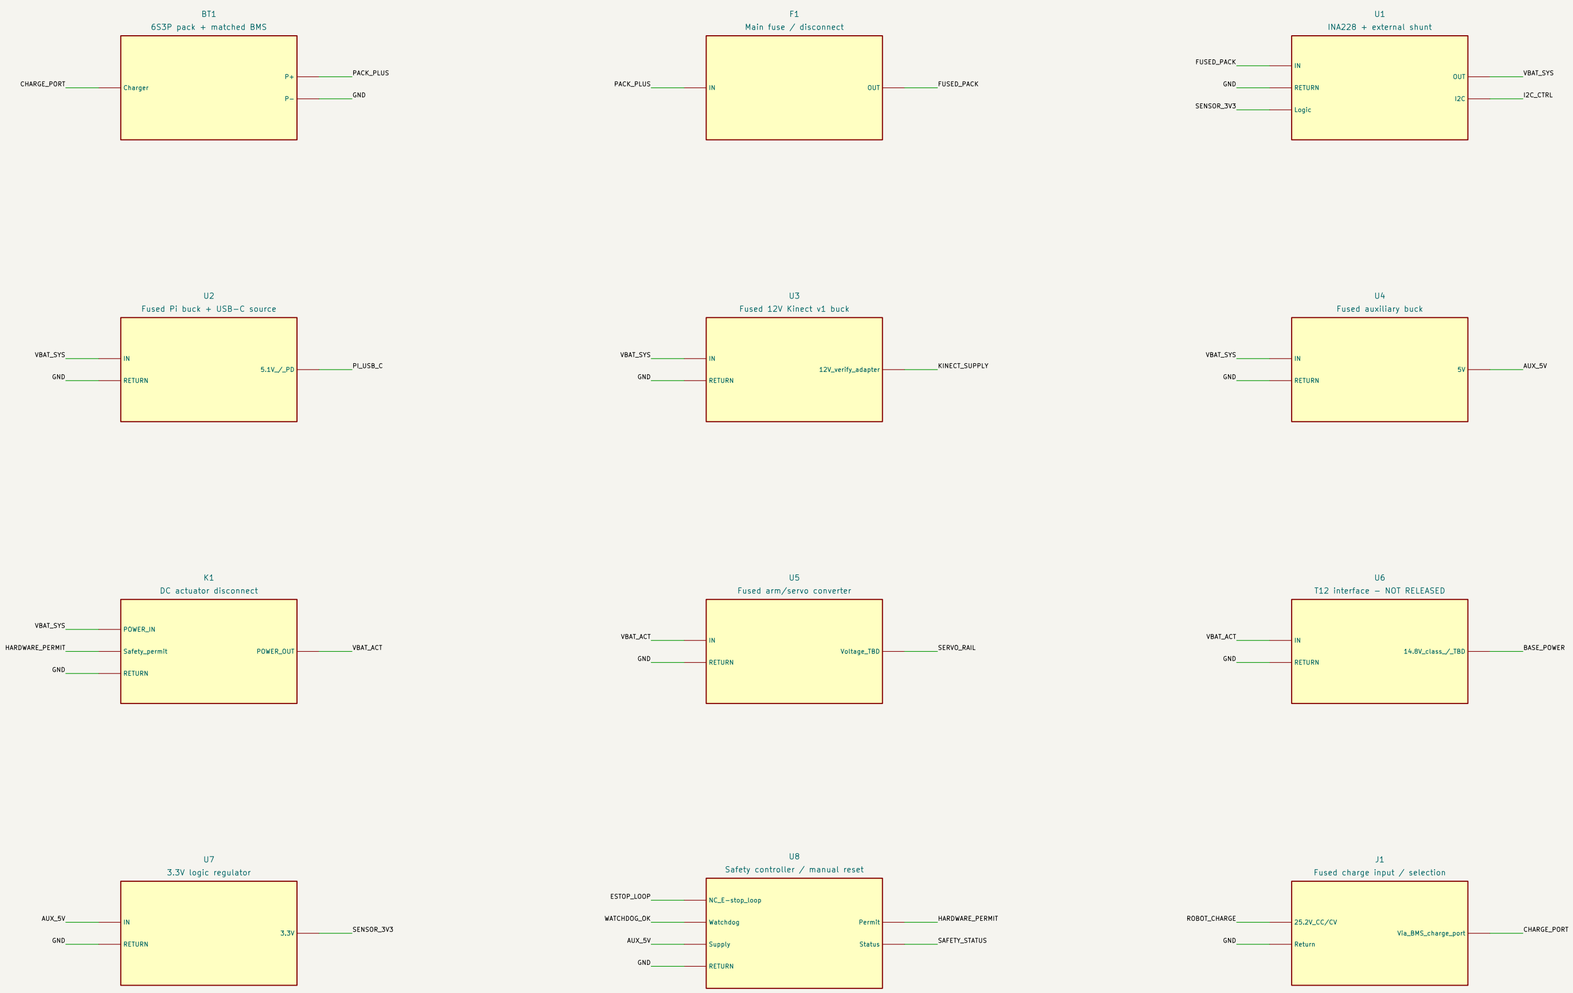


6S3P retained. P42A nominal specification: 21.6 V / 12.6 Ah typical; 25.2 V full. 266 Wh is the planning budget.

Every converter block includes a branch fuse. Ratings, protection parts, connectors and physical pinouts remain TBD.

K1 is a normally-open DC-rated power disconnect controlled by a hardware stop/reset circuit, not a GPIO relay sketch.

BMS charge/discharge port topology must be followed. GND means protected system return, never bypass BMS at cell B−.

T12 is rated 14.8 V, charging input 20 V. Neither its battery terminals nor dock accept direct 25.2 V.

Kinect supply is provisional: identify version, adapter voltage, polarity and current before wiring.

Separate charging drawing shows dock and roof solar. Charge currently bypasses INA228: use BMS for total pack coulomb count.

No component footprints or physical connector pin assignments are specified. This is an architecture review draft.

Symbol terminal numbers are logical IDs, NOT connector pin numbers
MODULE INTERCONNECTIONS ONLY — NOT FOR PCB FABRICATION

Sheet: /
File: underbot_power.kicad_sch

Title: UnderBot 6S power architecture — provisional

Size: A2	Date: 2026-09-29	**Rev: 0.1 DRAFT**
KiCad E.D.A. 10.0.6		Id: 1/1