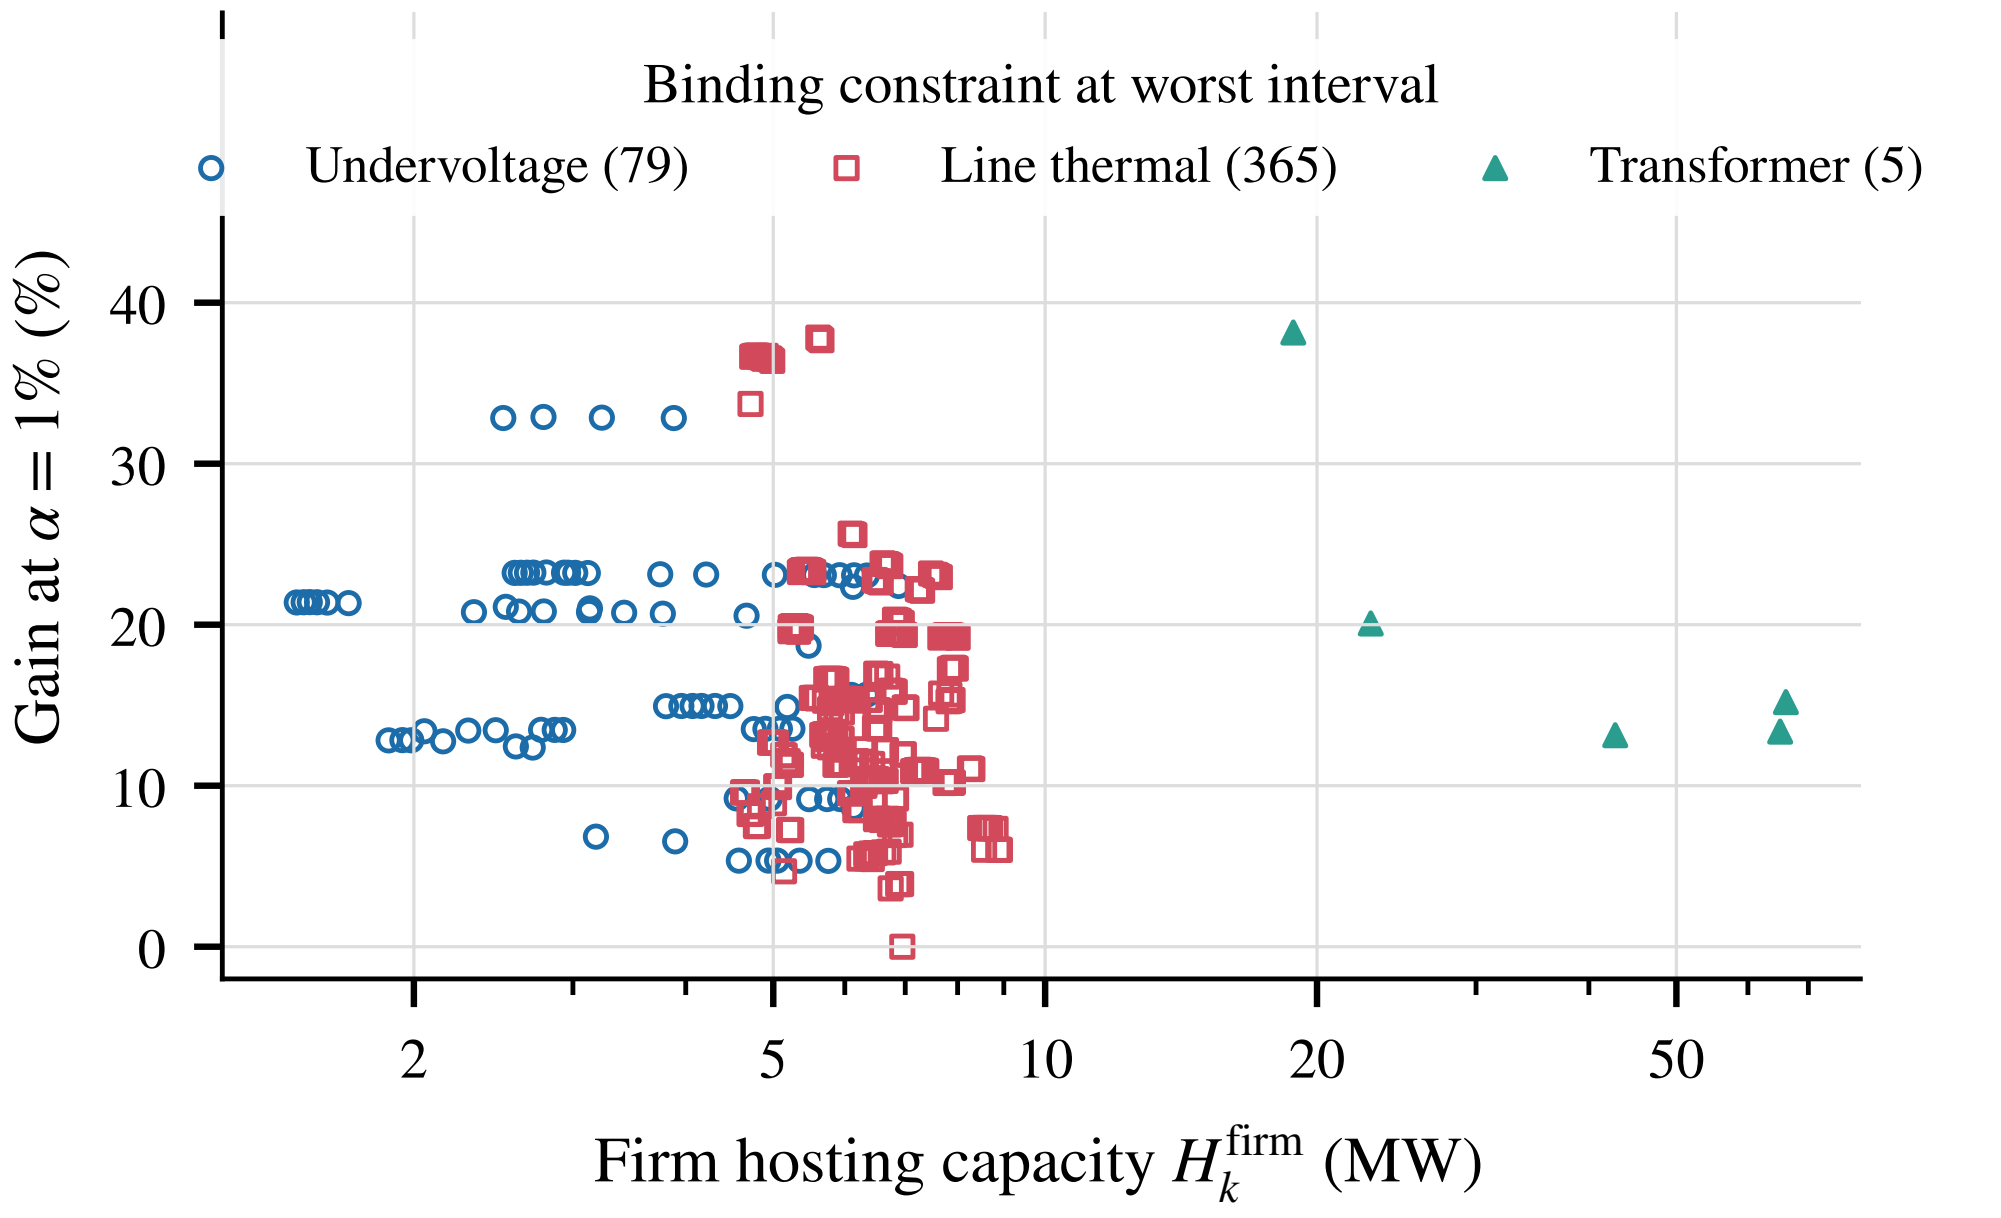
Binding constraint at worst interval
Undervoltage (79)
Line thermal (365)
Transformer (5)
Gain at $\alpha = 1\%$ (%)
0
10
20
30
40
2
5
10
20
50
Firm hosting capacity H_k^{firm} (MW)