SIAM $N_b = 4$ observable screening snapshot


hybridization quench, $t \in [0, 1]$

DIAGNOSTIC ONLY — CURRENT PAIR REJECTED AS ACCURACY-CONFOUNDED; NO COST COMPARISON IS ADMISSIBLE

Source aggregate	Row count: 2 locked exact-scored trajectory JSONs: `sources/siam_avqds_cluster9714484_score.json` (SHA-256 `8c6125f7...35614614`) and `sources/siam_apm_cluster9715147_score.json` (SHA-256 `25414cc6...19a6f2e7`).
Scheduler identities	AVQDS `9714484.0`, cut 10^{-3}; Full APM `9715147.0`, cut 10^{-5}, exchange policy. Each score contains 101 shared time samples on $t = 0, 0.01, \ldots, 1$. Evidence revision `d5590449`; run code `36c40d52`.
Identity audit	**PASS_DIAGNOSTIC_COMPARISON_IDENTITY**: identical grid, seed, Hamiltonian/physics fingerprint, comparison fingerprint, observable contract, exact observable arrays, and exact-energy arrays.
Observable definitions	$m_d = \langle n_{d\uparrow} - n_{d\downarrow} \rangle$, $D_d = \langle n_{d\uparrow} n_{d\downarrow} \rangle$, $C_j = \langle \mathbf{S}_d \cdot \mathbf{S}_j \rangle$ including transverse exchange, and Sigma-v2 $\Sigma_r = \langle S_d^2 \rangle + \sum_{j=1}^{r} C_j$, with $\langle S_d^2 \rangle = \frac{3}{4}(N_d - 2D_d)$.
Interpretation	Exact evolution is reporting-only and was not used by either controller. Neither trajectory passes the individual 5% primitive-response target. Full APM fails the 15% broad guard in the tiny-response C_3 channel, so the pair is accuracy-confounded. Qiskit compilation was not performed.

SIAM primitive observable trajectories


$N_b = 4$, 101 shared points on $t \in [0, 1]$ | AVQDS 9714484 (cut 10^{-3}) | Full APM 9715147 (cut 10^{-5}; exchange policy)

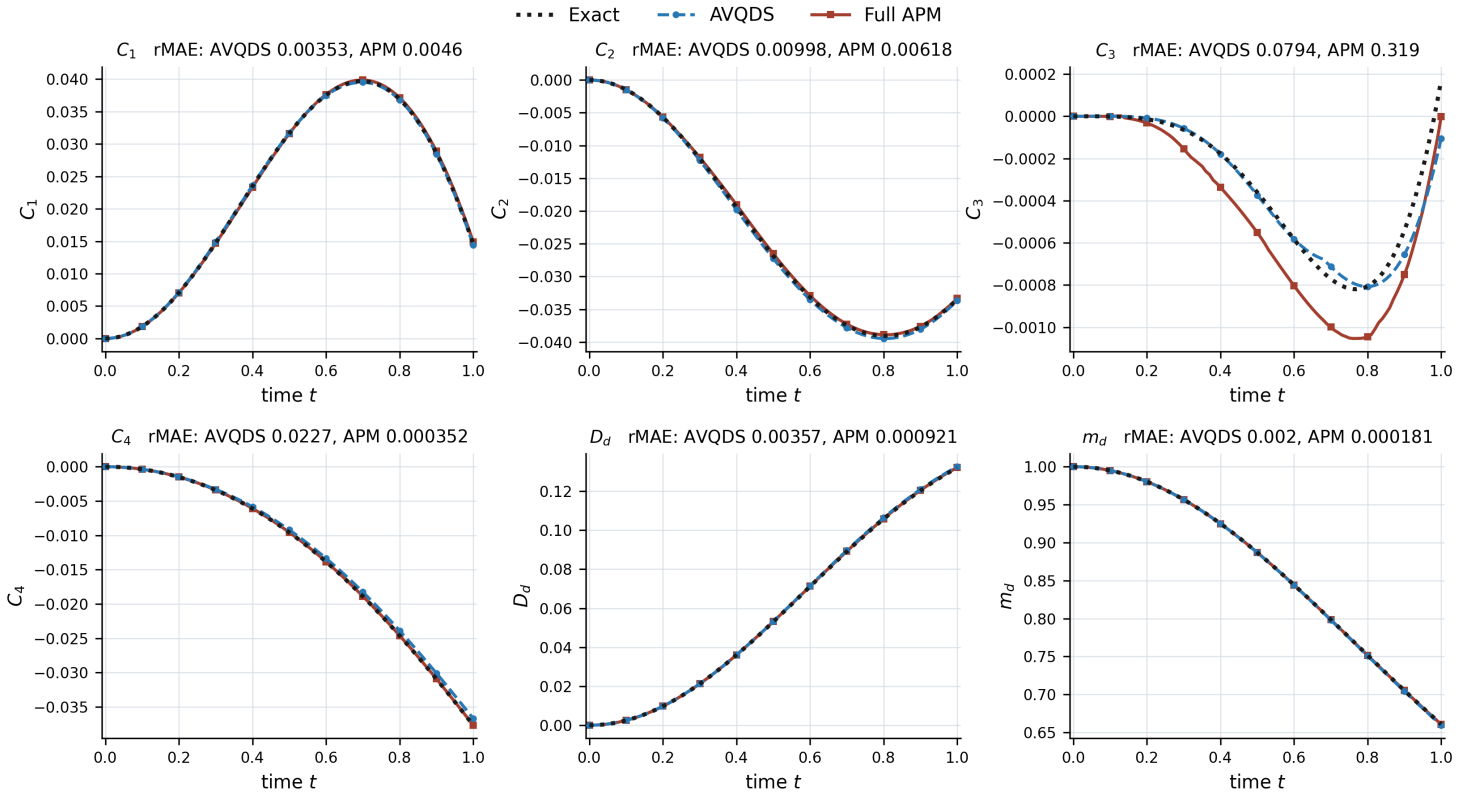

Diagnostic exact-reference comparison only | pair verdict: rejected, accuracy-confounded | exact data were not used by either controller

SIAM primitive observable absolute errors


Physical error against the shared exact diagnostic trajectory; each panel reports the time-mean absolute error

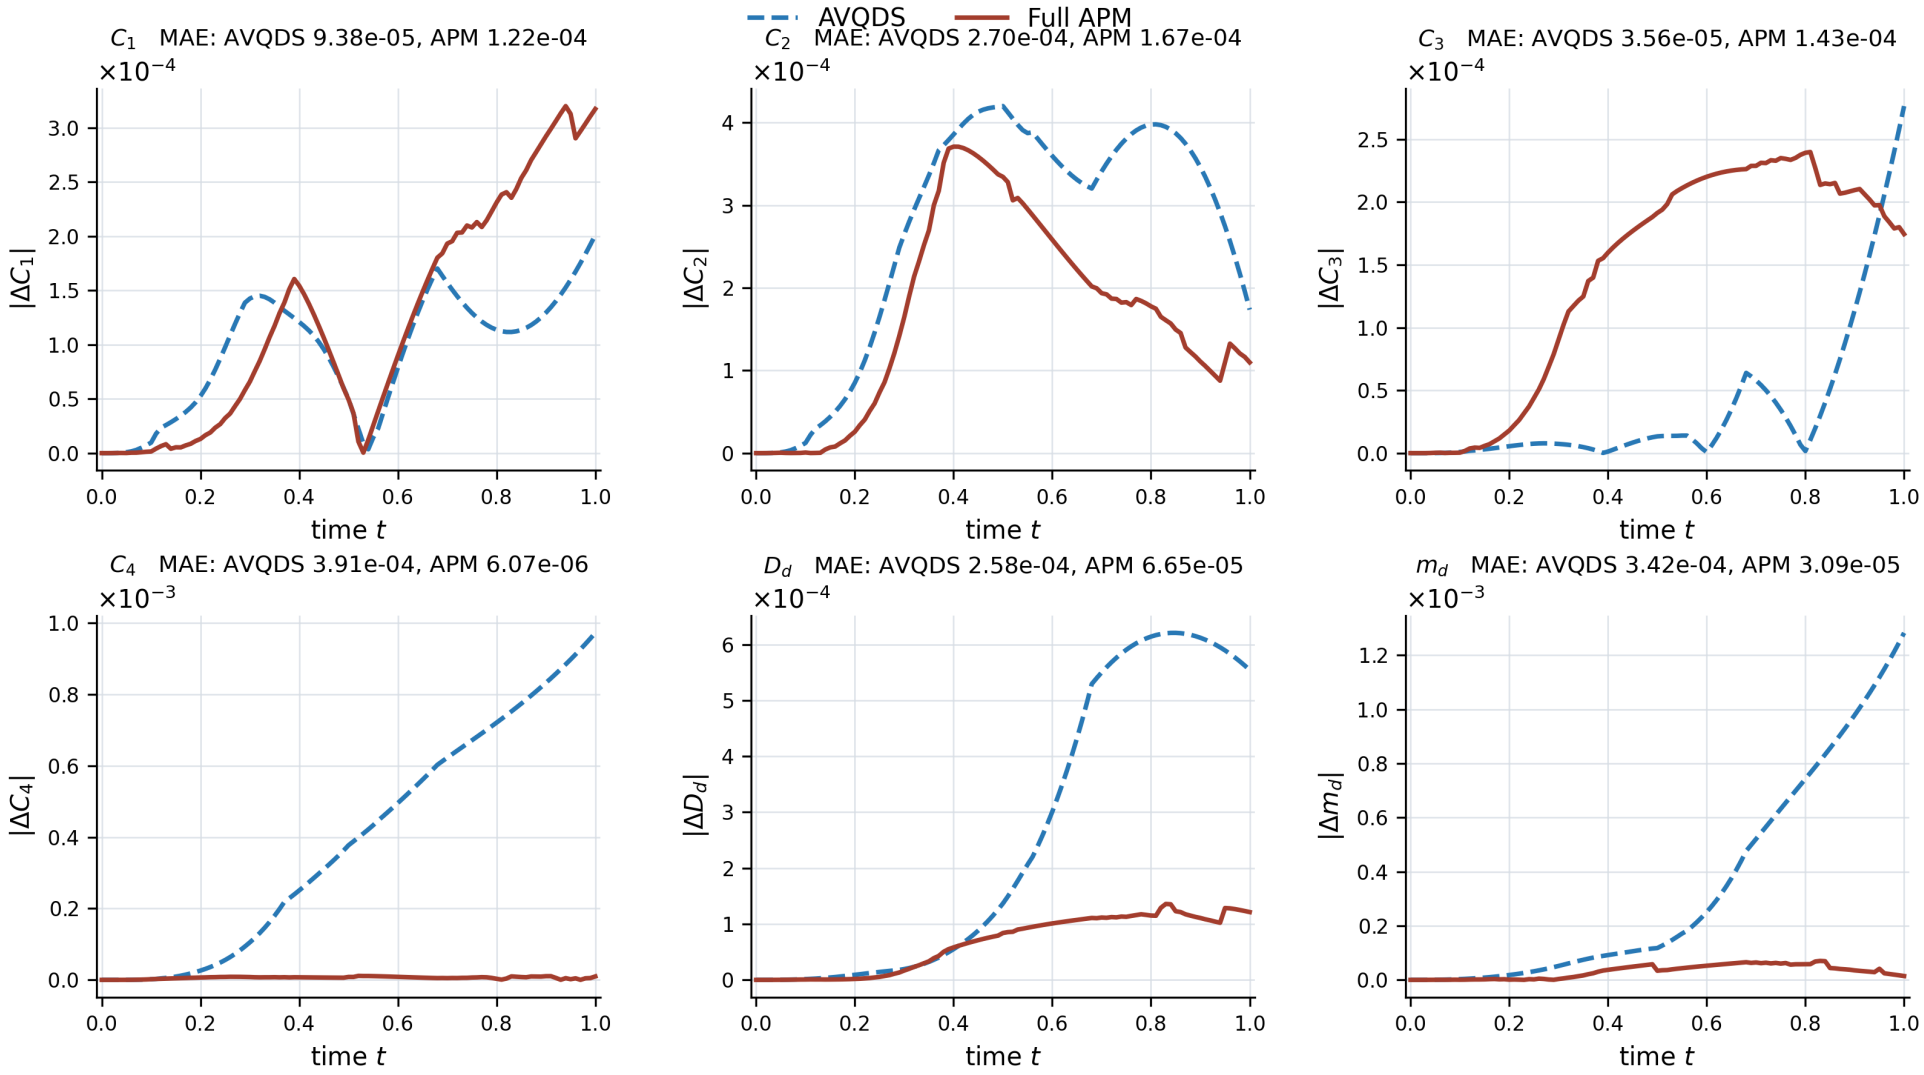

Diagnostic exact-reference comparison only | pair verdict: rejected, accuracy-confounded | exact data were not used by either controller

SIAM derived observables and accuracy diagnostics

Derived screening observables Σ_1--Σ_4, physical energy error, and state infidelity

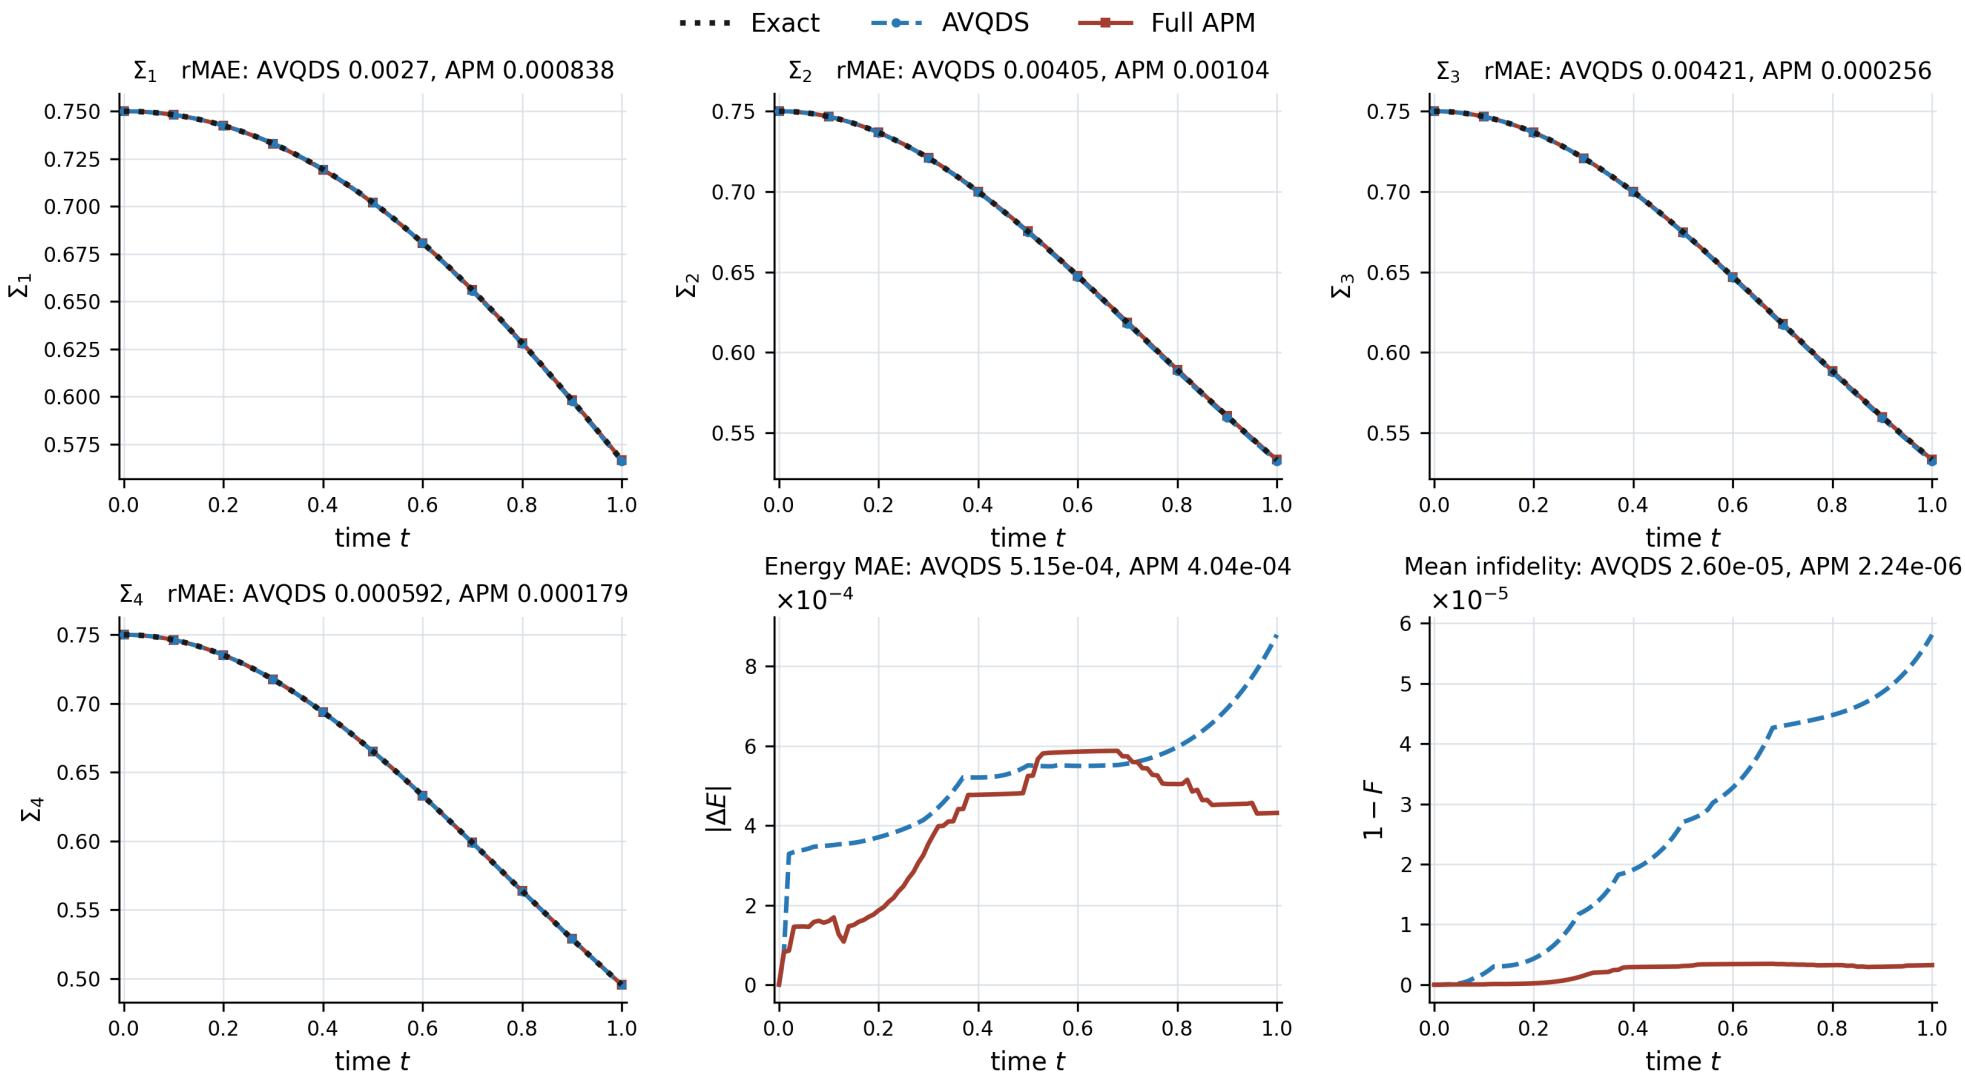

Diagnostic exact-reference comparison only | pair verdict: rejected, accuracy-confounded | exact data were not used by either controller