OPTUS

DATE OF ISSUE		28.06.18	09.04.21
DRAWING PACKAGE VERSION		1	2
GENERAL			
H8097-G1	SITE SPECIFICATIONS	A	AB
H8097-G2	OVERALL SITE PLAN	A	AB
H8097-G3	SITE LAYOUT AND SETOUT PLAN	A	AB
H8097-G4	SITE ELEVATION	A	AB
ANTENNAS & TRANSMISSION			
H8097-A1	PANEL ANTENNA SYSTEM CONFIGURATION	A	AB
H8097-A2	RF PLUMBING DIAGRAM	A	AB
H8097-T1	SITE TRANSMISSION DETAILS	A	AB
STRUCTURAL			
H8097-S1	SHELTER FOUNDATION DETAILS	A	AB
H8097-S2	TIMBER STEP DETAIL	A	AB
ELECTRICAL			
H8097-E1	SITE POWER DETAILS	A	AB
H8097-E2	SINGLE LINE DIAGRAM	A	AB
H8097-E3	SITE EARTHING PLAN	A	AB
SHELTER / FITOUT			
H8097-F1	EQUIPMENT SHELTER LAYOUT PLAN - SHEET 1 OF 2	A	AB
H8097-F1-1	EQUIPMENT SHELTER LAYOUT PLAN - SHEET 2 OF 2	A	AB
EME EXCLUSION ZONES			
LEASE / LICENCE			
METAS19-1101201	LEASE DETAIL SURVEY PLAN	0	-
DISTRIBUTION			
OPTUS	SAFAET HOSSAIN	1	1
OPTUS (OPERATIONS)	FOPS	1	1
OPTUS VENDOR	IRFAN KHAN (HUAWEI)	1	1

OPTUS SITE - H8097

AUSTINS FERRY

TELSTRA CO-LOCATION
PIOMENA RESERVE
2 PLAN 158154 WAKEHURST ROAD
AUSTINS FERRY, TAS 7011

eJV GREENFIELD PROJECT

OPTUS WORK AUTHORITY Nº 372842

HUAWEI

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380

SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533

MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

AS BUILT

Drawing No.
H8097 - 00

CAD File: C:\USERS\SELVAMURUGAN\ONEDRIVE - ALL TELECOS PTY LTD\CPS WORKING\NEW BATCH 2025\H8097 AUSTINS FERRY\3 PH2\1 PH2 INS\H8097-160126-CHILD1.DWG Plot Date: 28.07.2016 9:42 AM

A3

DATE OF ISSUE		28.06.18	09.04.21
DRAWING PACKAGE VERSION		1	2

REFERENCE DOCUMENTS

OSD-010	OPTUS CONSTRUCTION SPECIFICATION	13	-
OSD-020	OPTUS EARTHING SPECIFICATION	12	-
OSD-060	OPTUS ACCESS SPECIFICATION	11	-
OSD-100	STANDARD CONSTRUCTION NOTES	B	-
OSD-140	SITE BOUNDARY FENCE & GATE DETAILS	B	-
OSD-170	SITE SIGNAGE TYPICAL GROUND SITE	B	-
OSD-191	OPTUS EME SAFETY SIGNAGE REQUIREMENTS	A	-
OSD-340	PARABOLIC ANTENNA STRAP MOUNTS ON MONOPOLES	A	-
OSD-510	ELEVATED CABLE LADDER SUPPORT DETAILS SHEET 1	A	-
OSD-520	ELEVATED CABLE LADDER SUPPORT DETAILS SHEET 2	B	-
OSD-530	CABLE RISER FIXING TO MONOPOLES	B	-
OSD-750	TYPICAL GROUND SITE EARTHING DETAILS SHEET 1	B	-
OSD-760	TYPICAL GROUND SITE EARTHING DETAILS SHEET 2	B	-
OSD-830	EARTH BAR DETAILS	B	-
OSD-831	SINGLE POINT EARTH BAR DETAILS	A	-
STD-HW-005	COLLAR MOUNT DETAILS - SHEET 1 OF 2	A	-
STD-HW-006	COLLAR MOUNT DETAILS - SHEET 2 OF 2	A	-
STD-HW-210	OPTUS ZONECOOL SHELTER PIER FOOTING DETAILS	A	-
MSD-E101	EARTHING POINT CONNECTION - GALVANISED STEEL HOST GRID	02	-
MSD-E103	EARTHING POINT CONNECTION - CO-LOCATION SITES	02	-
MSD-S430	FREESTANDING MSB SUPPORTING FRAME	1	-
H8097-1-7011007	METASITE STRUCTURAL CERTIFICATE DATED 28/06/2018	1	-
28272-1	ROCLA MONOPOLE CERTIFICATE DATED 01/06/2018	0	-
5203	GAMCORP FOUNDATION CERTIFICATE DATED 28/05/2018	0	-
017866P203-11	CO-LOCATE TELSTRA SITE USING MOBILES LOW IMPACT SHELTER	2	-

OPTUS

OPTUS SITE - H8097

AUSTINS FERRY

TELSTRA SITE ID: 286936

TELSTRA CO-LOCATION

PIOMENA RESERVE

2 PLAN 158154 WAKEHURST ROAD

AUSTINS FERRY, TAS 7011

eJV GREENFIELD PROJECT

OPTUS WORK AUTHORITY Nº 372842

HUAWEI

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380

SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533

MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

AS BUILT

Drawing No.
H8097 - 00

A3

CAD File: C:\USERS\SELVAMURUGAN\ONEDRIVE - ALL TELECOS PTY LTD\CPS WORKING\NEW BATCH 2025\H8097 AUSTINS FERRY\3 PH2\1 PH2 INS\H8097-160126-CHILD1.DWG Plot Date: 28.07.2016 9:42 AM

SITE ADDRESS

TELSTRA CO-SITE, PIOMENA RESERVE,
2 PLAN 158154 WAKEHURST ROAD
AUSTINS FERRY, TAS 7011

OPTUS SITE H8097
(RFNSA No. 7011007)

N

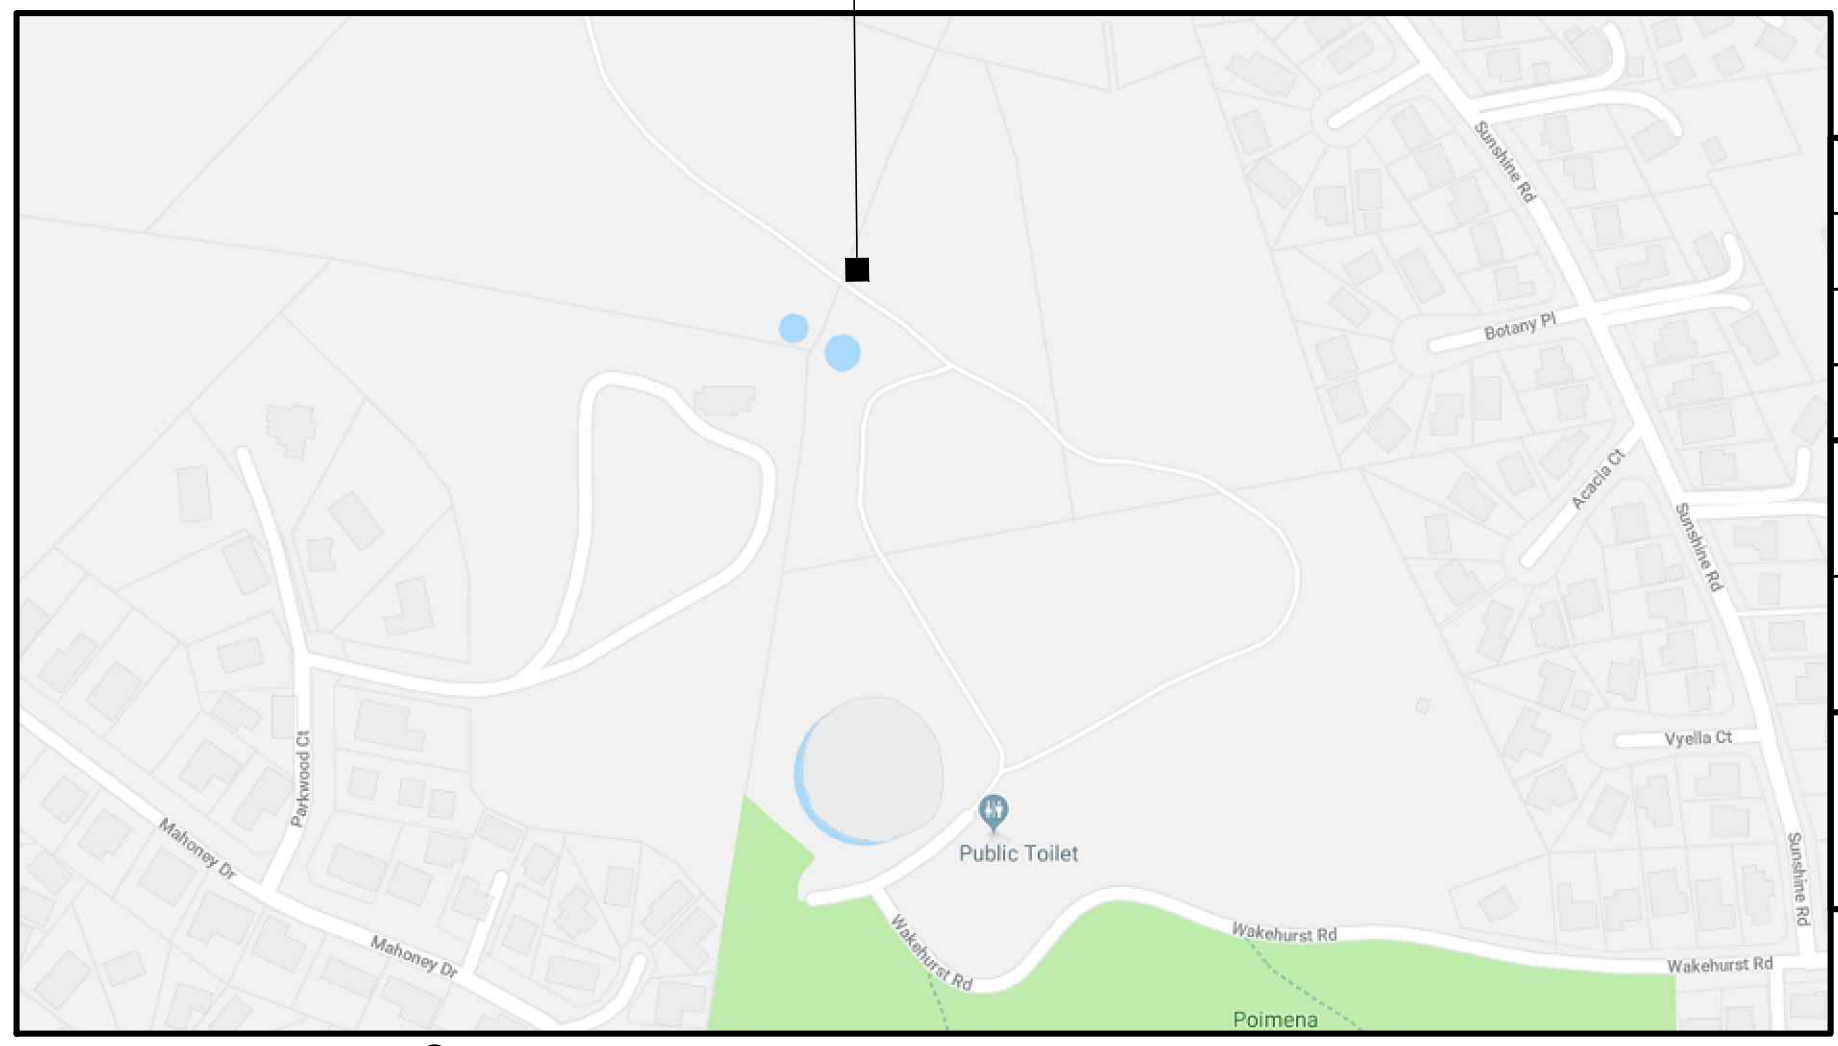

SITE LOCATION DATA	
SOURCE: SURVEY	
DATUM: MGA (GDA94)	ZONE: 55
REF LOCATION:	℄ MONOPOLE
EASTING	520 051
NORTHING	5 263 789
LATITUDE	-42.77817°
LONGITUDE	147.24512°
WGS84 DATUM (USED BY GOOGLE EARTH® AND GPS DEVICES) CAN BE CONSIDERED SAME AS GDA94 (SOURCE: "GEOCENTRIC DATUM OF AUSTRALIA TECHNICAL MANUAL" VERSION 2.3)	

EXISTING TELSTRA MONOPOLE

1. EXISTING OPTUS 27m HIGH CONCRETE MONOPOLE (SR3-BM27-585). MONOPOLE AND FOUNDATION DESIGN, INCLUDING CERTIFICATION PROVIDED BY OTHERS.
   NOTE: POLE PREVIOUSLY OWNED BY TELSTRA. POLE OWNER SHIP HAS NOW BEEN TRANSFERRED TO OPTUS AS PART OF AN OPTUS AND TELSTRA "BUY BACK" AGREEMENT.
2. OPTUS CLAMP ON HEADFRAME TO SUPPORT PANEL ANTENNAS AT EL. 23.9m AND MOUNT TO SUPPORT PARABOLIC ANTENNA AT EL 20.9m.
3. ALL EXISTING OH/UG INFRASTRUCTURE ACCURATELY LOCATED PRIOR TO CONSTRUCTION.
4. ANTENNA MAINTENANCE ACCESS BY QUALIFIED RIGGER PERSONNEL ONLY USING EWP.
5. STRUCTURAL ADEQUACY OF MONOPOLE CONFIRMED BY ROCLA. REFER TO CERTIFICATE 28272-1 DATED 01/06/2018.
6. STRUCTURAL ADEQUACY OF MONOPOLE FOUNDATION CONFIRMED BY ROCLA. REFER TO CERTIFICATE 5203 DATED 28/05/2018.
7. STRUCTURAL ADEQUACY OF HEADFRAME AND PARABOLIC ANTENNA MOUNTS CONFIRMED BY METASITE. REFER TO STRUCTURAL ADEQUACY STATEMENT H8097-1-7011007 DATED 28/06/2018.

EQUIPMENT SHELTER / FITOUT

1. OPTUS ZONECOOL C3 (3.0m x 2.5m) EQUIPMENT SHELTER.
2. OPTUS SHELTER COLOURED COLORBOND "PALE EUCALYPT".
3. SHELTER SUPPORTED ON STRIP FOOTINGS AND PIERS. REFER TO DRG'S H8097-G4 AND H8097-S1 FOR FOOTING DETAILS.
4. STRUCTURAL ADEQUACY OF PIER FOOTINGS SUPPORT SHELTER CONFIRMED BY METASITE. REFER TO CERTIFICATE H8097-1-1011007 DATED 15/06/2018.

TRANSMISSION

1. THIS SITE LINKED TO THE NETWORK VIA RADIO IN ACCORDANCE WITH DRAWING H8097-T1.
2. WORKS AT THE LINK SITE CARRIED OUT IN ACCORDANCE WITH LINK SITE'S TRANSMISSION DRAWINGS, ISSUED SEPARATELY.

SITE HAZARDS

1. FOR IDENTIFIED SITE HAZARD, RISK TREATMENTS AND RESIDUAL RISK FOR THE PROJECT ELEMENTS DESIGNED BY METASITE. REFER TO THE SAFETY IN DESIGN REPORT AND ASSOCIATED RISK REGISTER.
2. PARTIES WHO ACCESS THIS SITE COMPLETE THEIR OWN HAZARD IDENTIFICATION. THE RISK ASSESSMENT AND THE ABOVE REGISTER DOES NOT ALLEVIATE THIS RESPONSIBILITY.

CONSTRUCTION SITE ACCESS

1. ENTER POIMENA RESERVE FROM WAKEHURST ROAD AND TRAVEL TO UPPER CARPARK. OPTUS TO DAISY CHAIN LOCK INTO GATE TO GAIN ACCESS TO GATE.
2. TRAVEL UP EXISTING ACCESS TRACK TO TELSTRA FACILITY.
   (NOTE: ACCESS TRACK IS ON/NEXT TO FRISBEE GOLF COURSE, CAUTION SHOULD BE TAKEN)

SITE SIGNAGE

1. SITE SIGNAGE IS IN ACCORDANCE WITH OSD-170 (GROUND SITE).
2. REFER TO OSD-191 FOR OPTUS EME SAFETY SIGNAGE REQUIREMENTS.

EME EXCLUSION ZONES

REFER TO EME GUIDE FOR LATEST EME EXCLUSION ZONES FOR ANTENNAS AT THIS SITE.

ELECTRICAL INSTALLATION

REFER TO SITE POWER DETAILS DRAWINGS H8097-E1, H8097-E2 AND TO ELECTRICAL ASSET LOCATION ON DRAWINGS H8097-G2 AND H8097-G3.

SITE EARTHING

OPTUS SITE EARTHING COMPLIES WITH OPTUS EARTHING SPECIFICATION DOCUMENT OSD-020, TELSTRA STANDARD DRAWING 016866P203 SHEET 11, METASITE STANDARD DRAWING MSD-E101, MSD-E103 AND THE SITE SPECIFIC EARTHING DRAWING H8097-E3.

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI
HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: SITE SPECIFICATIONS

Drawing Status: AS BUILT

Drawing No. H8097-G1

Revision AB

20 10 0 10 20 30 40 50mm A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Plot Date: 28.07.2016 9:42 AM

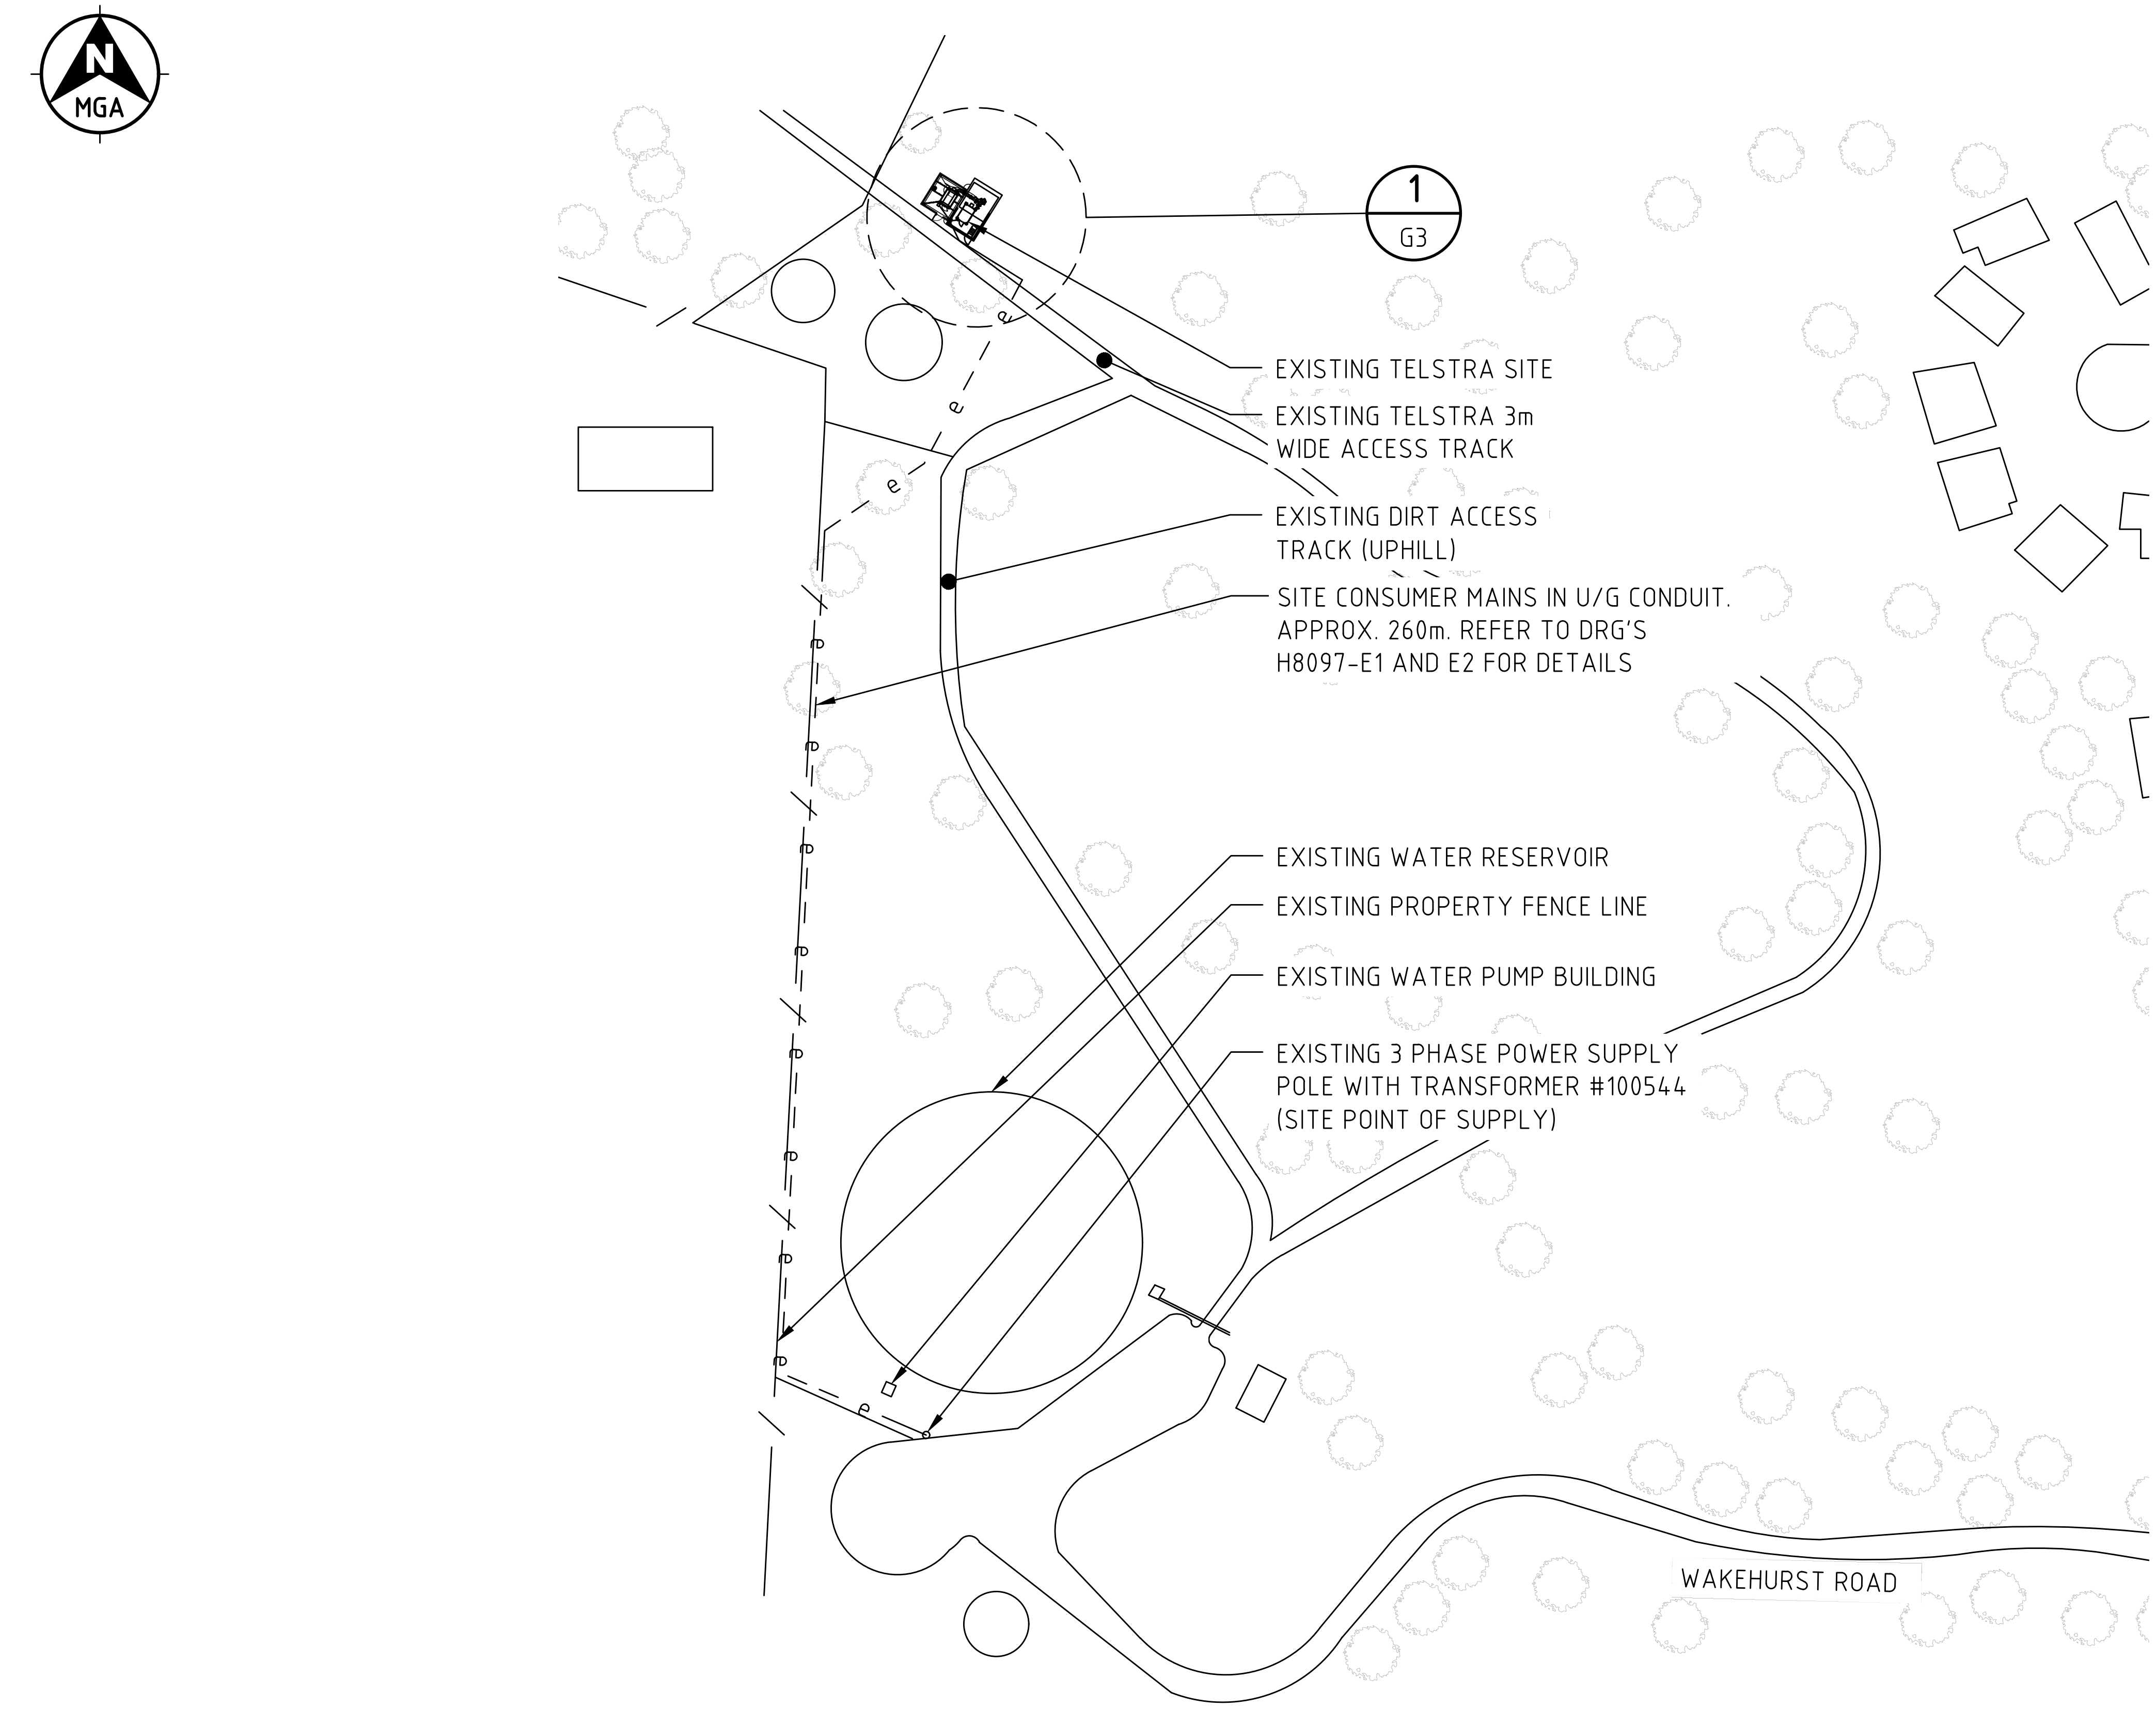

OVERALL SITE PLAN

SCALE 1:1500

LEGEND

——— · · · ———	PROPERTY BOUNDARY
— / — / — / —	FENCE LINE
— — e — — e — — e —	U/G CONSUMER MAINS
—— 0 e —— 0 e ——	OPTUS U/G POWER SUPPLY
+ RL XXX.X	EXISTING LEVEL
——— XXX.X ———	EXISTING CONTOUR

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380

SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533

MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: OVERALL SITE PLAN

Drawing Status: AS BUILT

Drawing No. H8097-G2

Revision AB

20 10 0 10 20 30 40 50mm

A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:42 AM

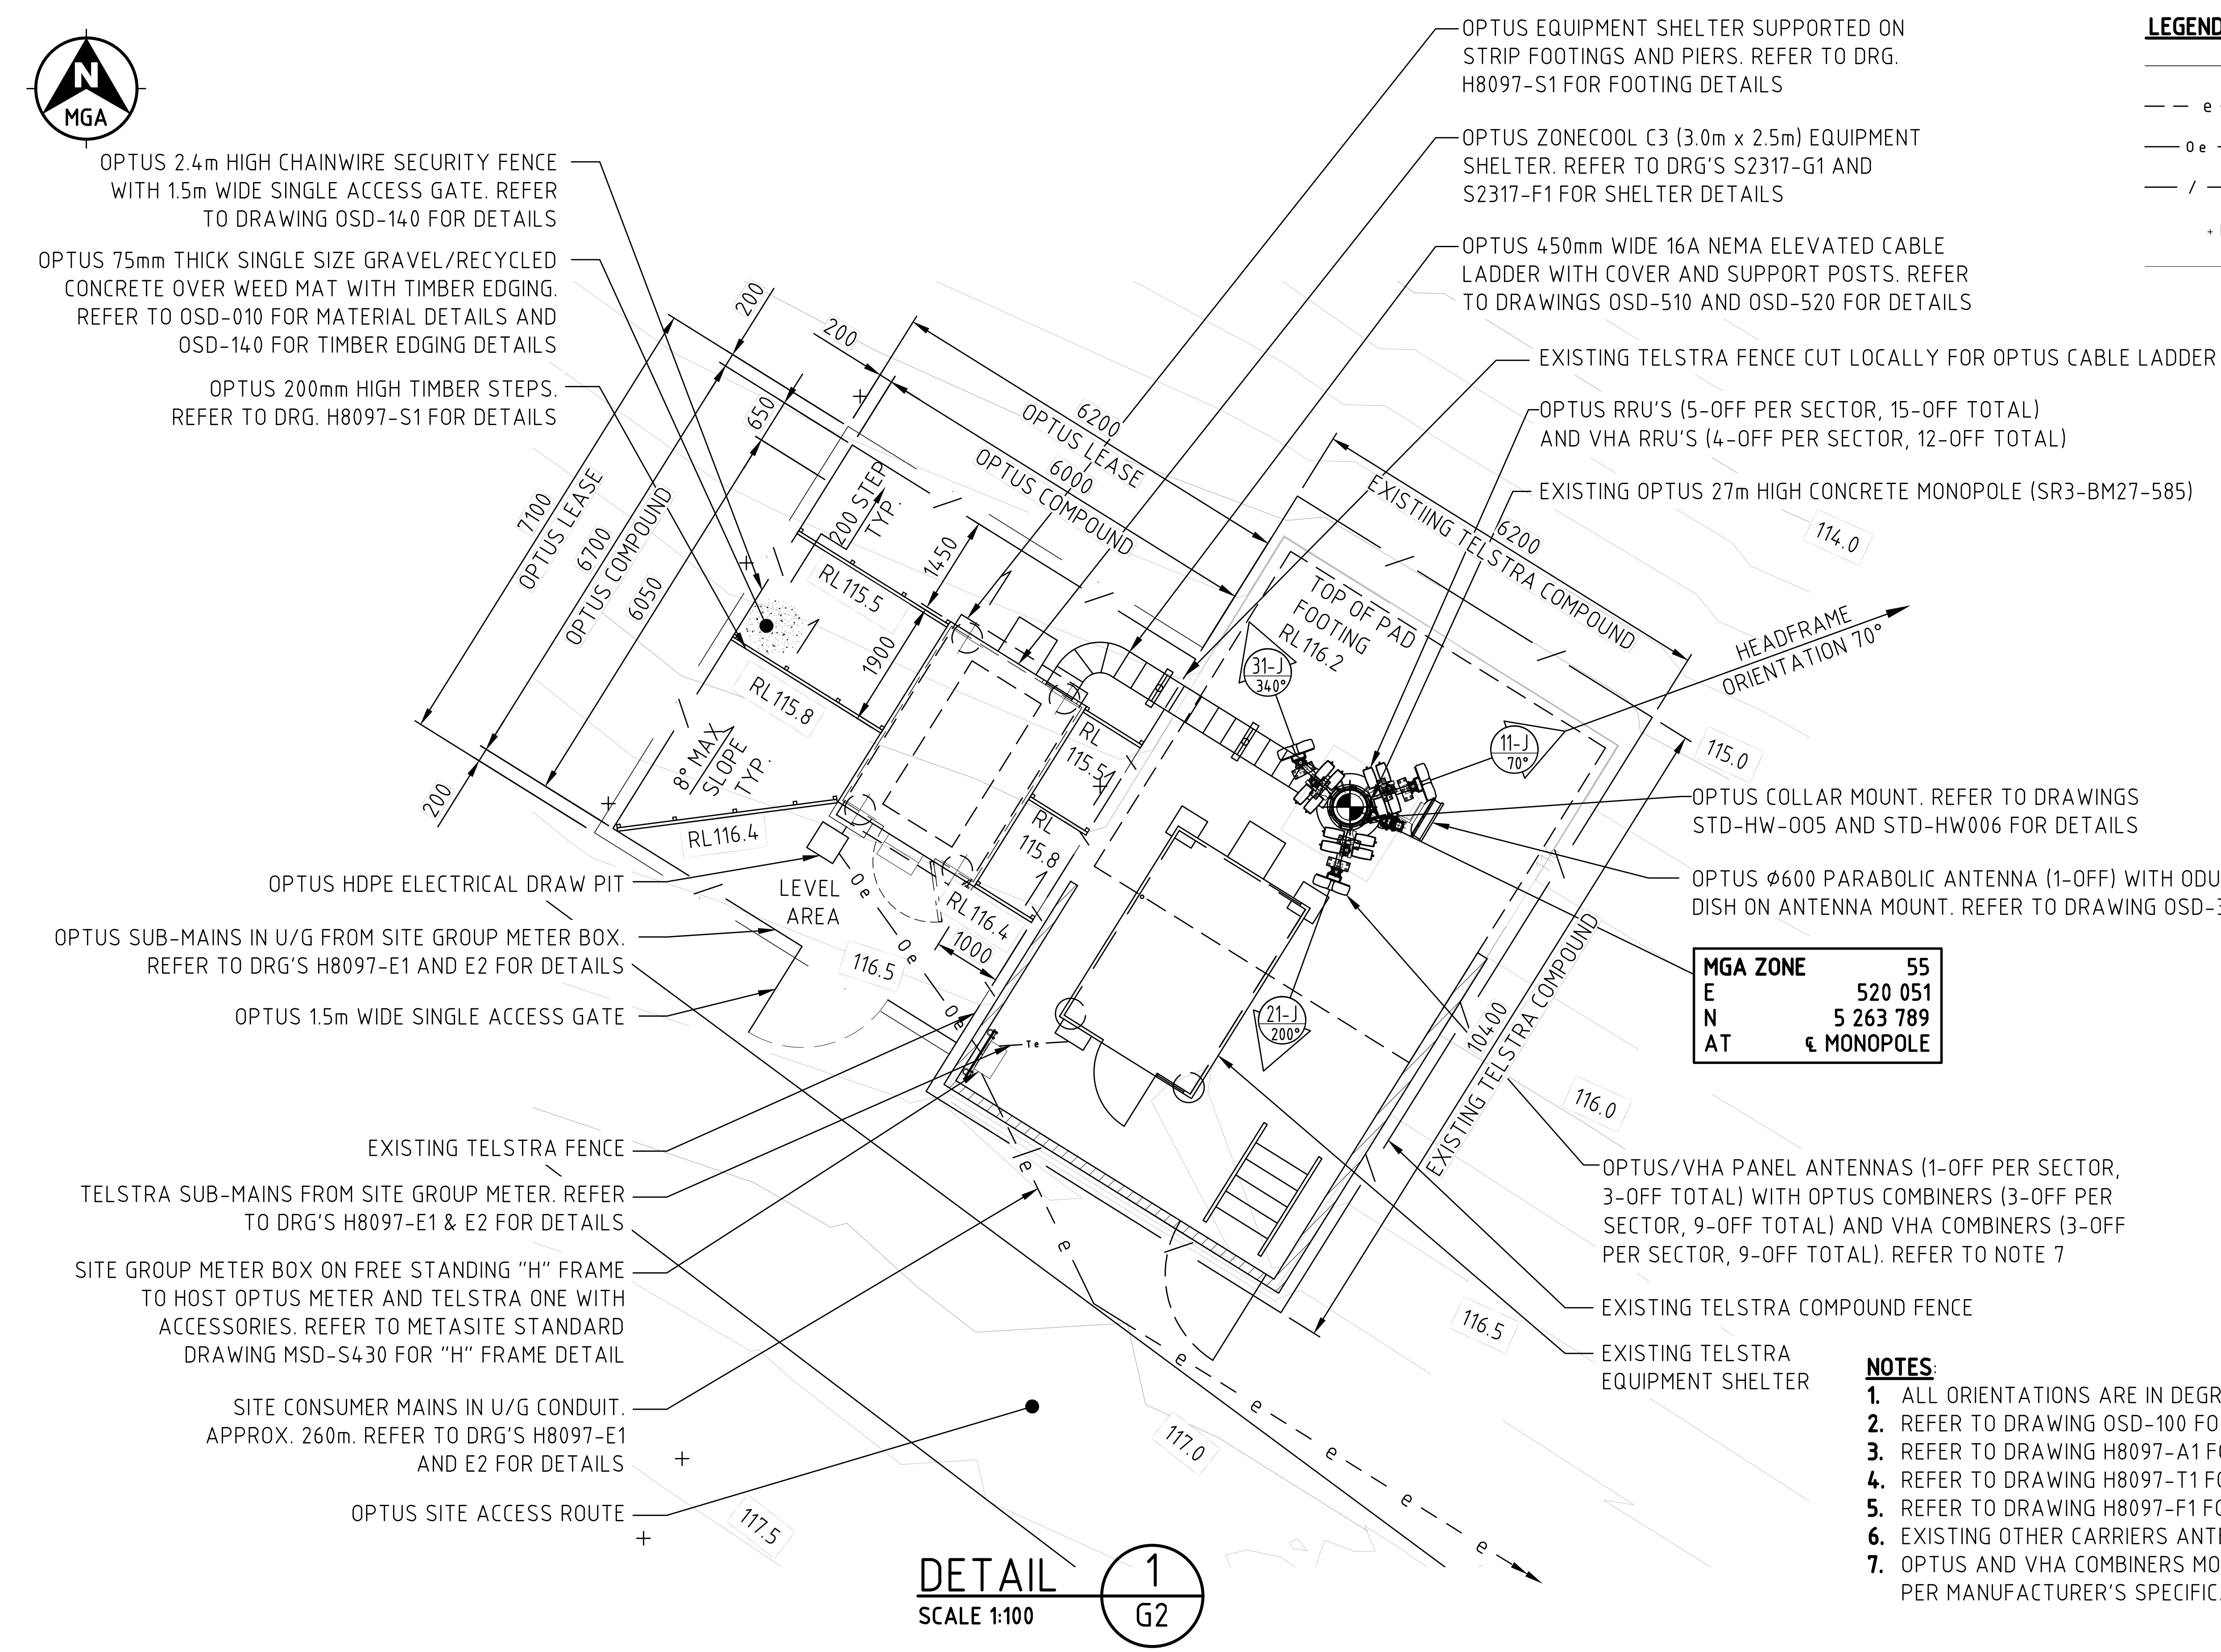

LEGEND

— · · · —	PROPERTY BOUNDARY
— e — e —	U/G CONSUMER MAINS
— 0e — 0e —	OPTUS U/G ELECTRICAL
— / — / —	FENCE LINE
+ RL XXX.X	EXISTING LEVEL
— XXX.X —	EXISTING CONTOUR

ANTENNA LEGEND

ID AZI° EXISTING

NOTES:

1. ALL ORIENTATIONS ARE IN DEGREES RELATIVE TO M.G.A. NORTH.
2. REFER TO DRAWING OSD-100 FOR STANDARD CONSTRUCTION NOTES.
3. REFER TO DRAWING H8097-A1 FOR ANTENNA SYSTEM CONFIGURATION.
4. REFER TO DRAWING H8097-T1 FOR SITE TRANSMISSION DETAILS.
5. REFER TO DRAWING H8097-F1 FOR EQUIPMENT SHELTER/OTC LAYOUT.
6. EXISTING OTHER CARRIERS ANTENNAS ARE NOT SHOWN FOR CLARITY.
7. OPTUS AND VHA COMBINERS MOUNTED BEHIND PANEL ANTENNAS AS PER MANUFACTURER'S SPECIFICATIONS.

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: SITE LAYOUT AND SETOUT PLAN

Drawing Status: AS BUILT

Drawing No. H8097-G3

Revision AB

20 10 0 10 20 30 40 50mm A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry V3 Ph2V1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:42 AM

NOTES:
1. REFER TO DRAWING OSD-100 FOR STANDARD CONSTRUCTION NOTES.
2. REFER TO DRAWING H8097-A1 FOR ANTENNA SYSTEM CONFIGURATION.
3. REFER TO DRAWING H8097-T1 FOR SITE TRANSMISSION DETAILS.
4. REFER TO DRAWING H8097-F1 FOR EQUIPMENT SHELTER LAYOUT.
5. EXISTING OTHER CARRIERS ANTENNAS ARE NOT SHOWN FOR CLARITY.
6. OPTUS AND VHA COMBINERS ARE MOUNTED BEHIND PANEL ANTENNAS AS PER MANUFACTURER'S SPECIFICATIONS.

NOTE:
THIS DRAWING IS DIAGRAMMATIC ONLY AND SHOULD NOT BE SCALED.

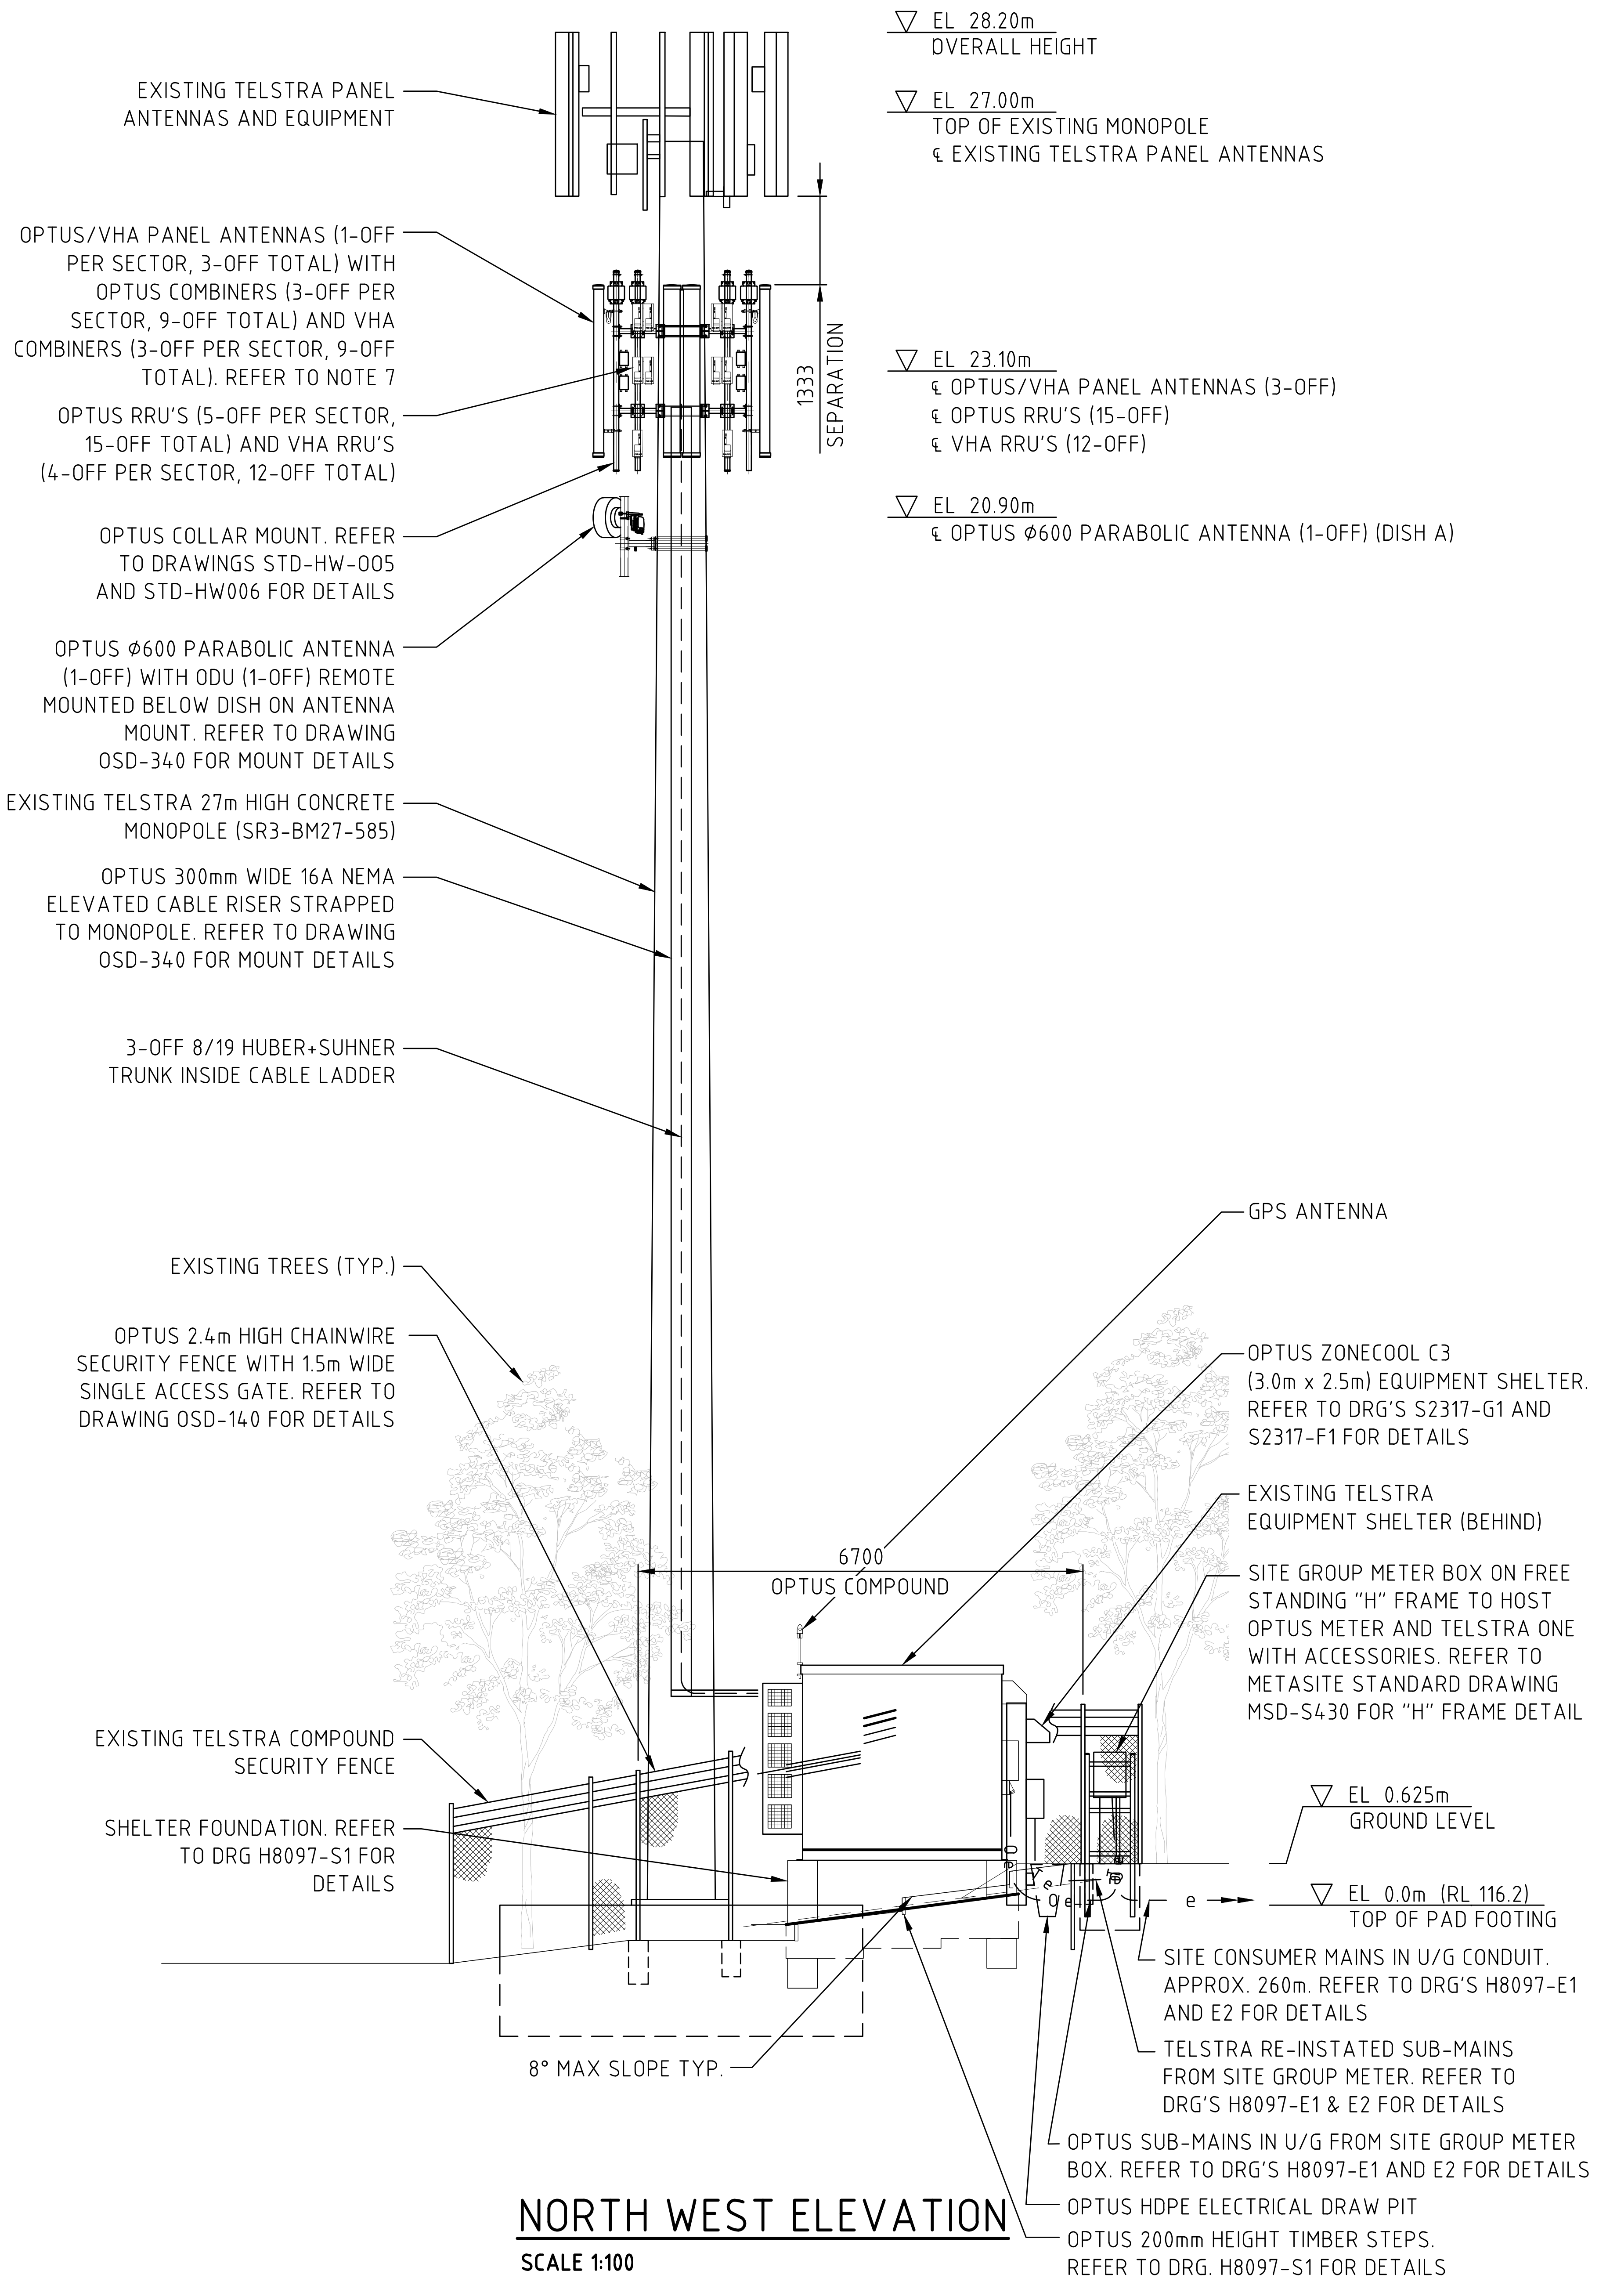

NORTH WEST ELEVATION

SCALE 1:100

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: SITE ELEVATION

Drawing Status: AS BUILT

Drawing No. H8097-G4

Revision AB

A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:42 AM

ANTENNA	OPERATOR	OPTUS/VHA						OPTUS/VHA						OPTUS/VHA					
	SECTOR	SECTOR 1						SECTOR 2						SECTOR 3					
	IDENTITY Nº (SAO)	11-J						21-J						31-J					
	STATUS	EXISTING						EXISTING						EXISTING					
	AZIMUTH (° TN)	70° TN						200° TN						340° TN					
	EL C/L ANTENNA	23.1m						23.1m						23.1m					
	CO-ORDINATES (NOTE 2)	E 520 051			N 5 263 789			E 520 051			N 5 263 789			E 520 051			N 5 263 789		
	MECHANICAL TILT (°)	0°						0°						0°					
	MAKE & MODEL	HUAWEI ASI4517R1						HUAWEI ASI4517R1						HUAWEI ASI4517R1					
	DIMENSIONS (H x W x D)	2600 x 548 x 150						2600 x 548 x 150						2600 x 548 x 150					
	PORTS	1 & 2	3 & 4	5 & 6	7 & 8	9 & 10	11 & 12	1 & 2	3 & 4	5 & 6	7 & 8	9 & 10	11 & 12	1 & 2	3 & 4	5 & 6	7 & 8	9 & 10	11 & 12
	PORT USER	V	O	V	V	O	O	V	O	V	V	O	O	V	O	V	V	O	O
	FREQUENCY BANDS	850/900	700/900	1800/2100	1800/2100	18/21/26	18/21/26	850/900	700/900	1800/2100	1800/2100	18/21/26	18/21/26	850/900	700/900	1800/2100	1800/2100	18/21/26	18/21/26
	RET	2°	2°	2°	2°	2°	2°	2°	2°	2°	2°	2°	2°	2°	2°	2°	2°	2°	2°
ANCILLARIES	MHA	N/A						N/A						N/A					
	COMBINER / DIPLEXER	1 x COM2a (7/9)(O), 2 x COM3 (18/21/23/26)(O), 1 x COM2 (7/8.5/9)(V), 2 x COM4 (18/21)(V)						1 x COM2a (7/9)(O), 2 x COM3 (18/21/23/26)(O), 1 x COM2 (7/8.5/9)(V), 2 x COM4 (18/21)(V)						1 x COM2a (7/9)(O), 2 x COM3 (18/21/23/26)(O), 1 x COM2 (7/8.5/9)(V), 2 x COM4 (18/21)(V)					
	RRU / RF MODULES	1 x RRU3268 (L7)(O), 1 x RRU3936(U9)(O), 1 x RRU3971(L18)(O), 1 x RRU3971(L21)(O), 1 x RRU3281(L26)(O), 1x RRU3952(850)(V), 1x RRU3953(U9)(V), 2x RRU3971(18/21)(V)						1 x RRU3268 (L7)(O), 1 x RRU3936(U9)(O), 1 x RRU3971(L18)(O), 1 x RRU3971(L21)(O), 1 x RRU3281(L26)(O), 1x RRU3952(850)(V), 1x RRU3953(U9)(V), 2x RRU3971(18/21)(V)						1 x RRU3268 (L7)(O), 1 x RRU3936(U9)(O), 1 x RRU3971(L18)(O), 1 x RRU3971(L21)(O), 1 x RRU3281(L26)(O), 1x RRU3952(850)(V), 1x RRU3953(U9)(V), 2x RRU3971(18/21)(V)					
COAXIAL FEEDERS	STATUS	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	TECHNOLOGIES	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	QUANTITY	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	DESIGNATION (SIZE)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
	ESTIMATED LENGTH	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
TRUNK CABLES	STATUS	EXISTING																	
	TECHNOLOGIES	L7/U9/L18/L21/L26 (OPTUS), 8.5/9/18/21 (VHA)																	
	QUANTITY	3 SHARED ACROSS 3 SECTORS																	
	MAKE & MODEL (SIZE)	H&S / MLEH BP																	
	NO. OF DC / SMF PAIRS	3x 9/18 (1 OPTUS, 1 SHARED, 1 VHA), SHARED ACROSS 3 SECTORS																	
	ESTIMATED LENGTH	40m																	
	OTHER	-																	

ANCILLARY	EQUIPMENT CODE	MANUFACTURER PRODUCT CODE	TECHNOLOGY FREQUENCIES	DIMENSIONS (mm x mm x mm)	WEIGHT (kg)
RRU	HUAWEI RRU	3268	700	400 x 300 x 150	20
		3936	900	400 x 300 x 120	20
		3971	1800	400 x 300 x 120	15
		3971	2100	400 x 300 x 120	15
		3281	2600	400 x 300 x 150	21
	OTHER RRU	3952	850	TBA	TBA
		3953	900	TBA	TBA
		3971	1800/2100	TBA	TBA
COMBINER	COM2	TYT-C003D008 (F2V1)	700/850/900	330 x200 x 130	10
	COM2a	E11F13P25	700/900	165 x253 x 103	6
	COM3	E15V90P56	18/21/23/26	250 x 205 x115	7.6
	COM4	E11F05P82	1800/2100	149 x 145 x117	3.5

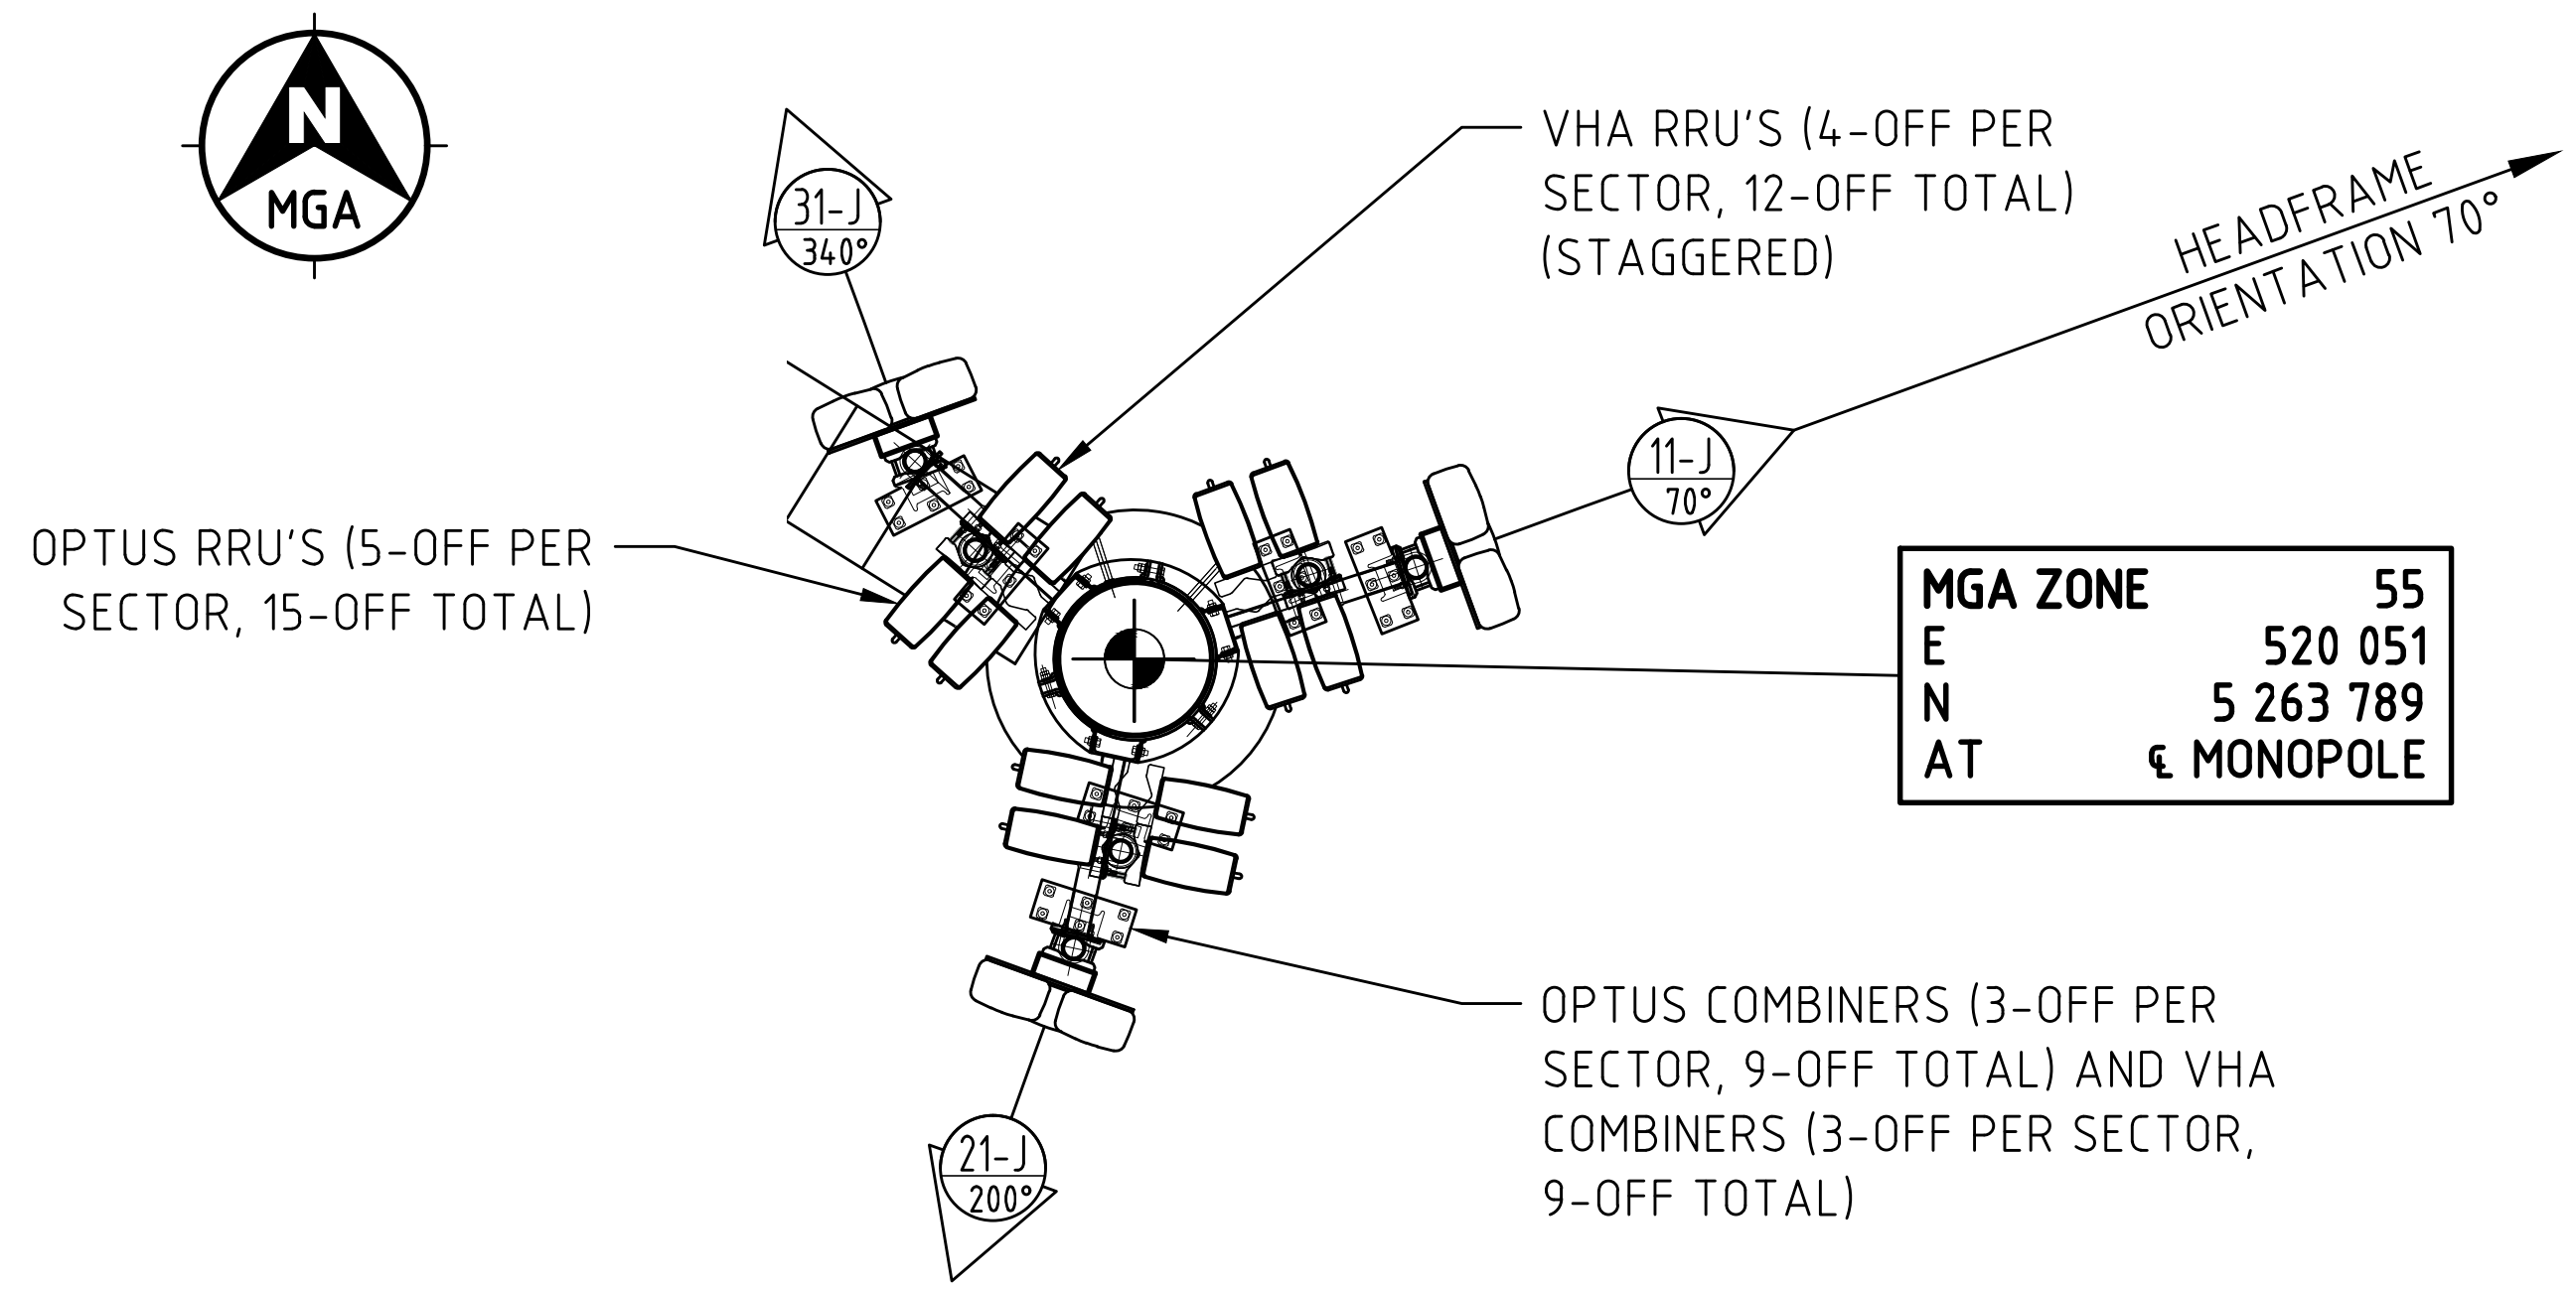

OPTUS ANTENNAS PLAN

SCALE 1:50

LEGEND:

ID AZI° EXISTING

NOTES:

1. THIS DRAWING IS READ IN CONJUNCTION WITH RF PLUMBING DIAGRAM DRAWING H8097-A2.
2. ANTENNA CO-ORDINATES ARE SPECIFIED FOR CENTRE OF THE MONOPOLE, TO THE NEAREST METRE.
3. INFORMATION IN THE TABLES SUPPLIED AND VERIFIED BY OPTUS.
4. ANCILLARIES REFER TO ITEMS AT OR NEAR THE ANTENNA.
5. TOTAL TAIL QUANTITY: 120.

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI
HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: PANEL ANTENNA SYSTEM CONFIGURATION

Drawing Status: AS BUILT

Drawing No. H8097-A1

Revision AB

20 10 0 10 20 30 40 50mm A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:42 AM

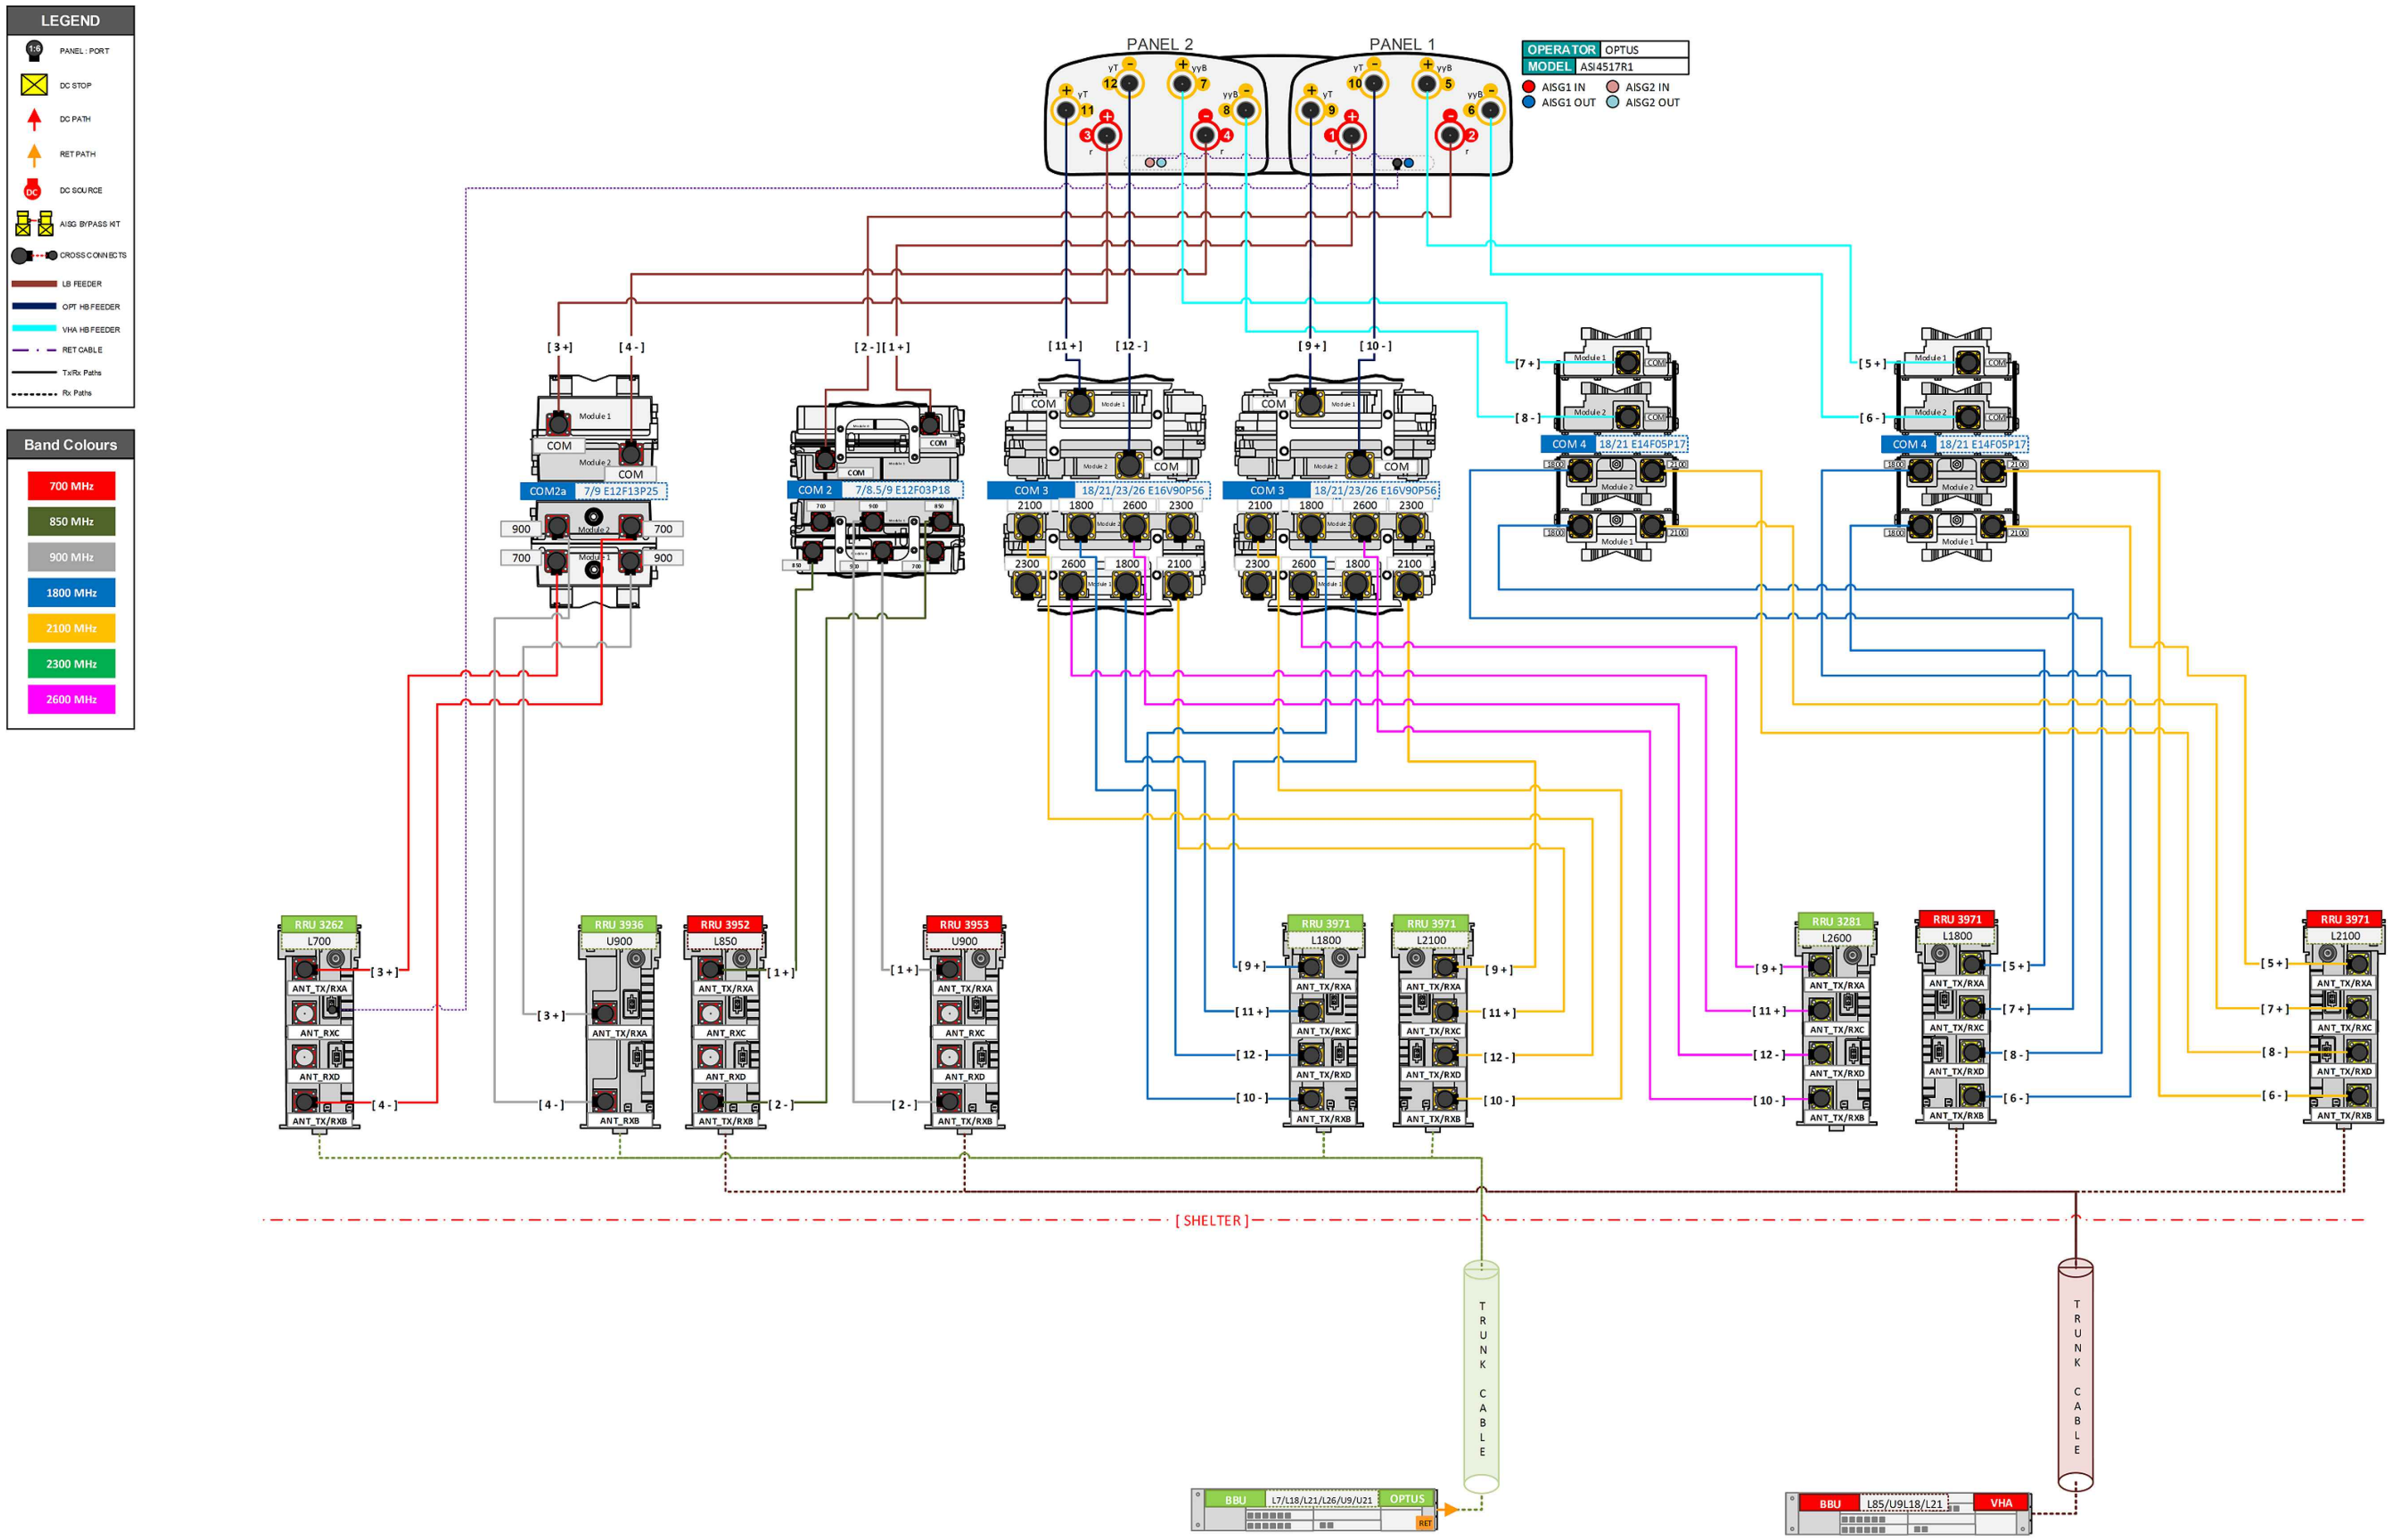

OPTUS RF PLUMBING DIAGRAM

PER SECTOR

NOTES:

1. THIS DRAWING IS READ IN CONJUNCTION WITH DRG. H8097-A1.
2. RF PLUMBING DIAGRAMS ARE PROVIDED BY OPTUS.

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: RF PLUMBING DIAGRAM

Drawing Status: AS BUILT

Drawing No. H8097-A2

Revision AB

20 10 0 10 20 30 40 50mm

A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:47 AM

NOTE:
THIS DRAWING IS DIAGRAMMATIC ONLY AND SHOULD NOT BE SCALED.

TRANSMISSION LINKS – PARABOLIC ANTENNA SCHEDULE

TAG	STATUS	LINK SITE NAME	SITE No.	AZIMUTH	ELEVATION	DIAMETER	MODEL
A	EXISTING	MT DIRECTION	H0002	120.89° TN	20.9m	ø600	A11D06HS

ODU's

TAG	STATUS	No.	MODEL	ELEVATION	FEEDER LENGTH	FEEDER DETAILS
A	EXISTING	1	XMC-2H REMOTE MOUNTED	20.9m	30m	1 x LDF4-50 (1/2")

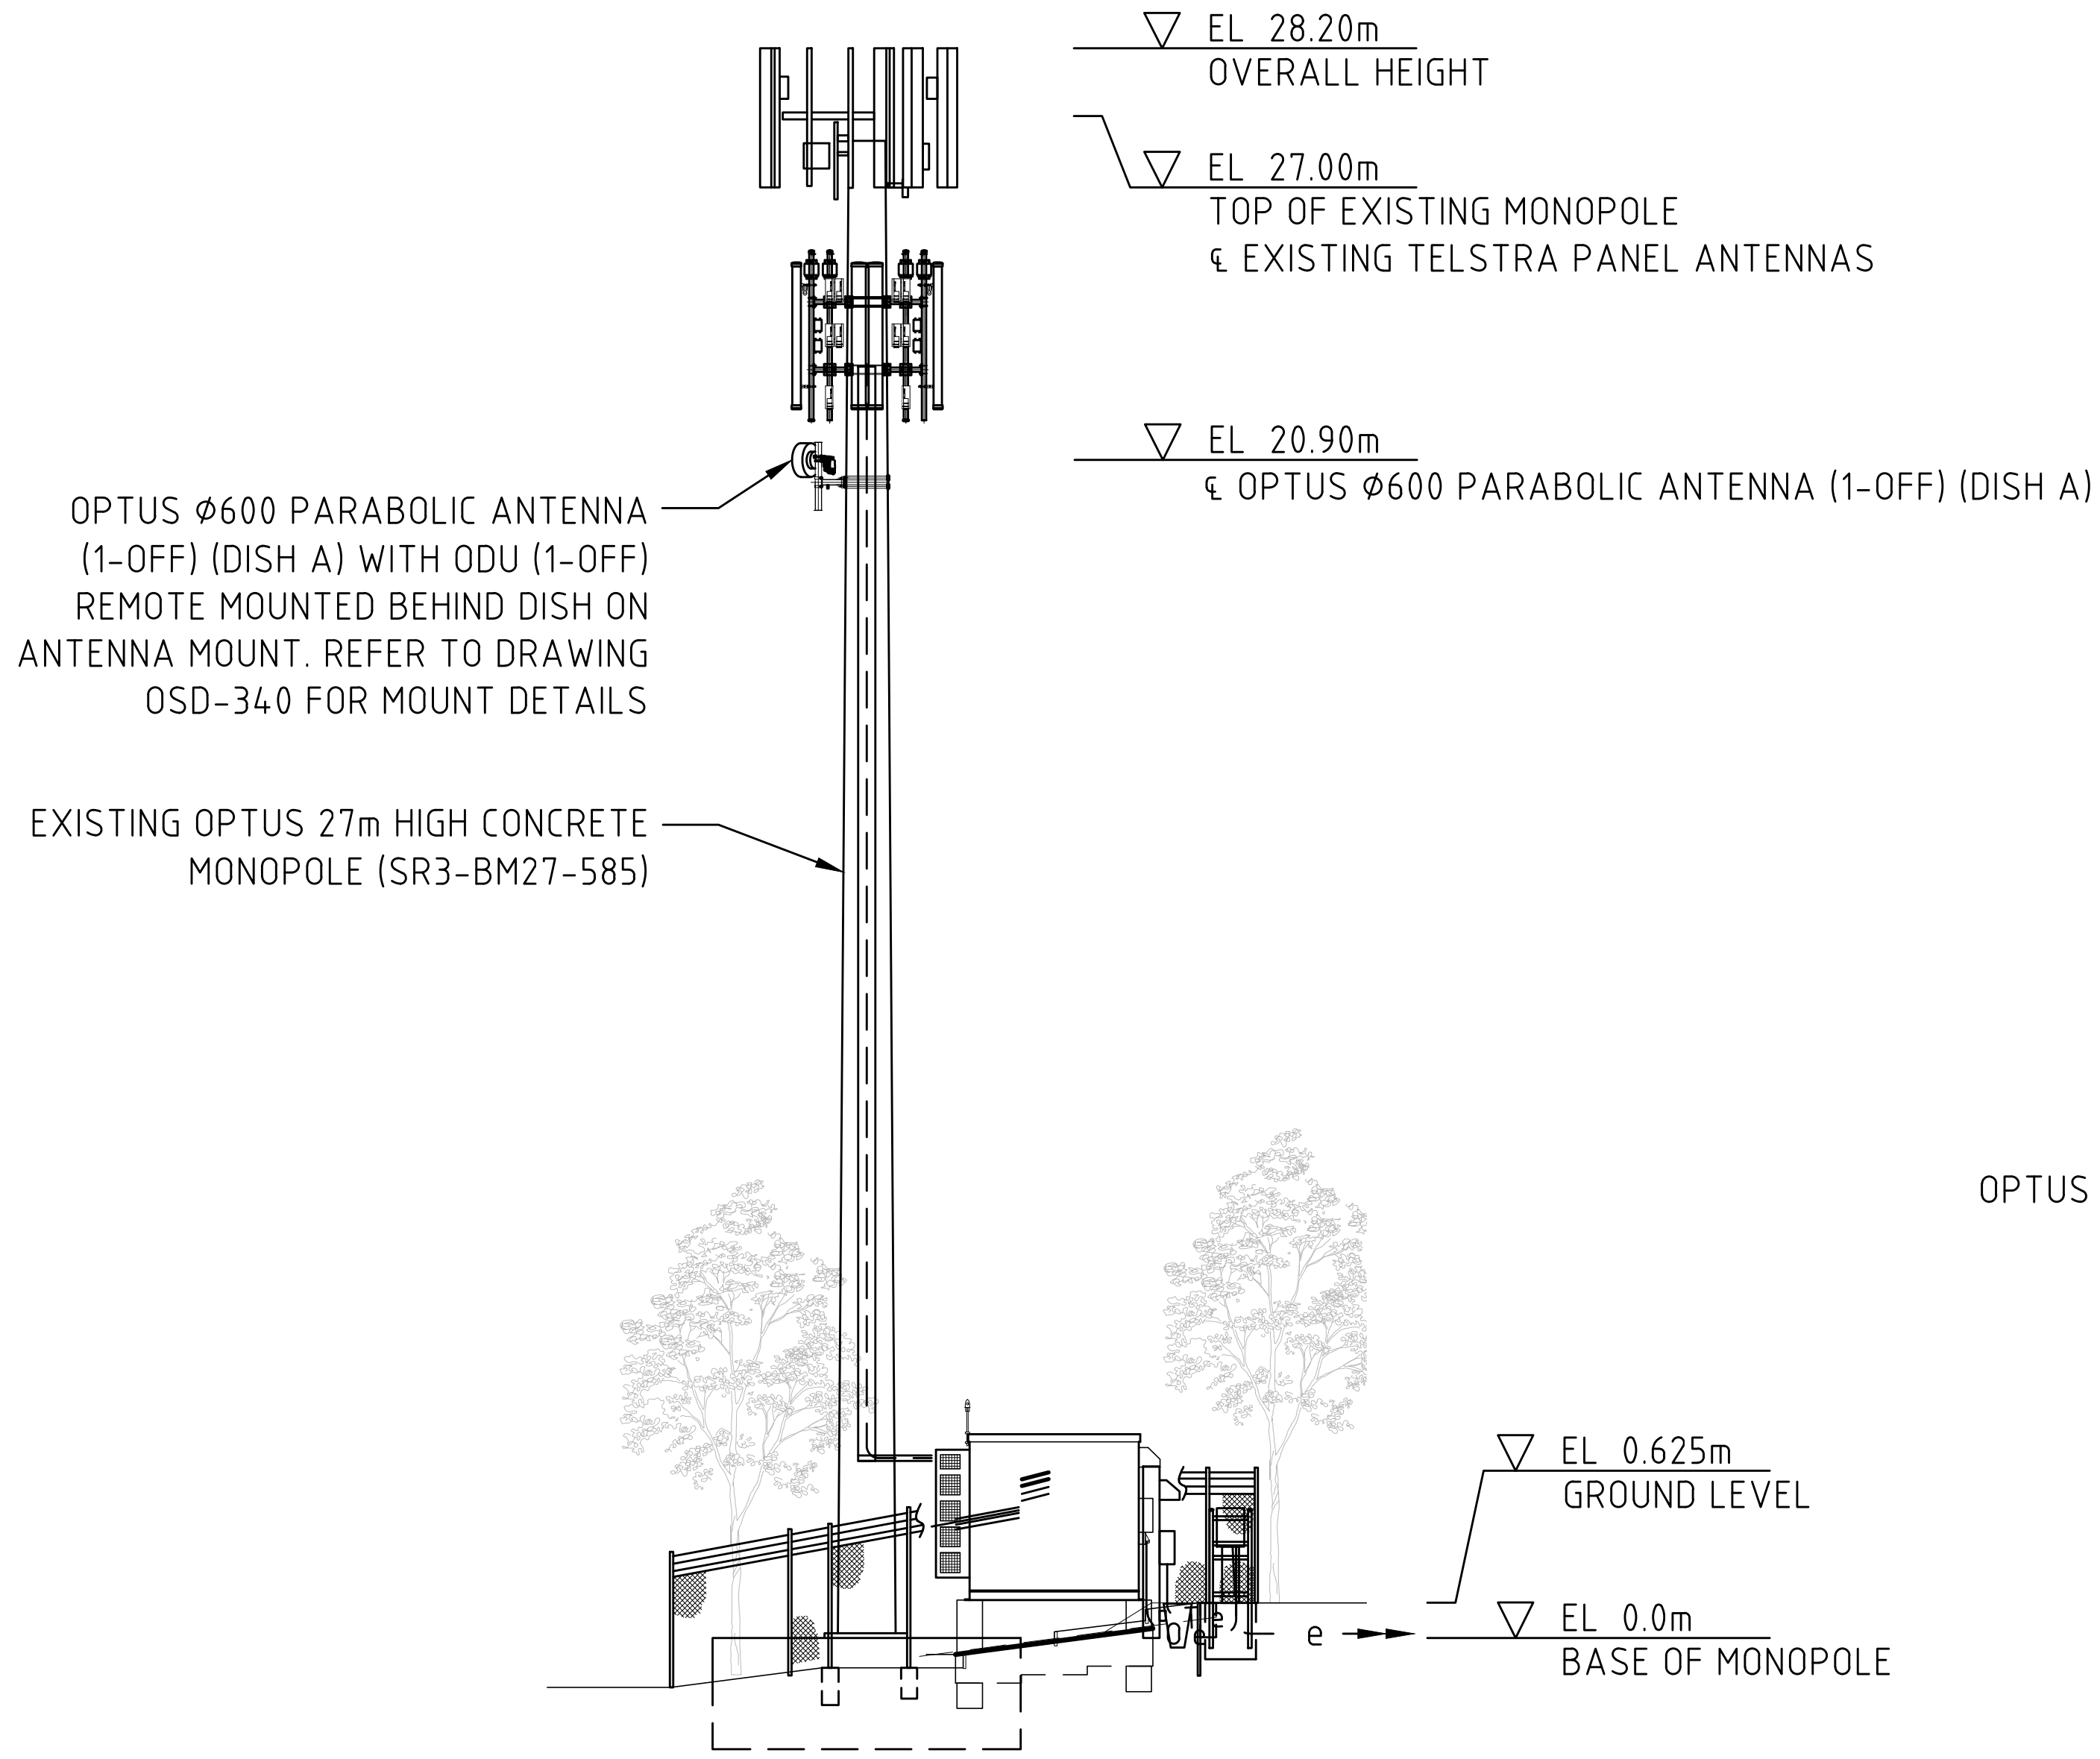

NORTH WEST ELEVATION
SCALE 1:200

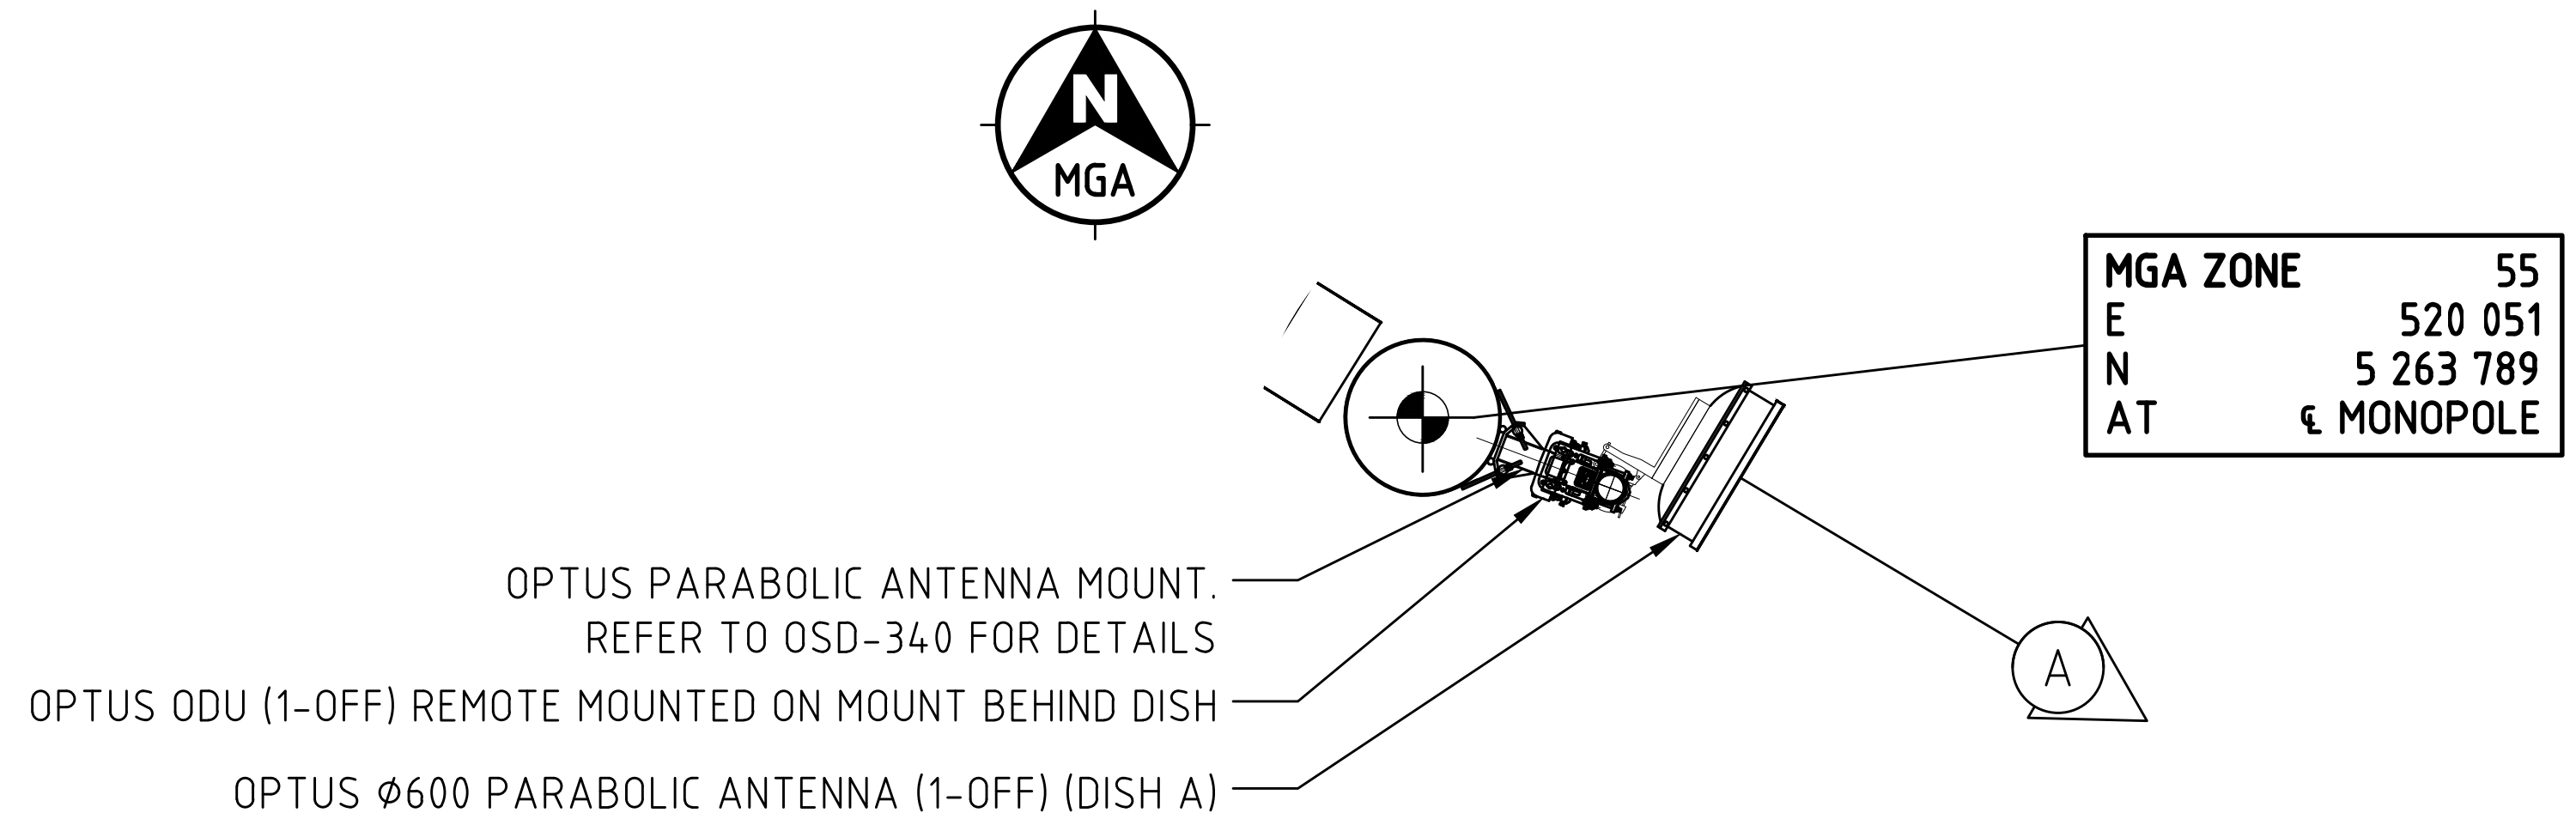

OPTUS PARABOLIC ANTENNA PLAN
SCALE 1:50

LEGEND:

A EXISTING

NOTES:
1. ALL ANTENNA AZIMUTHS ARE IN DEGREES RELATIVE TO TRUE NORTH.
2. EXISTING OTHER CARRIER ANTENNAS ARE OMITTED FROM THE ANTENNA PLAN FOR CLARITY.
3. THIS DRAWING IS DIAGRAMMATIC ONLY AND SHOULD NOT BE SCALED.
4. OPTUS ø600 PARABOLIC ANTENNA (1-OFF) AND ODU (1-OFF) REMOTE MOUNTED.

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project:
MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title:
SITE TRANSMISSION DETAILS

Drawing Status: AS BUILT

Drawing No.: H8097-T1

Revision: AB

20 10 0 10 20 30 40 50mm A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:43 AM

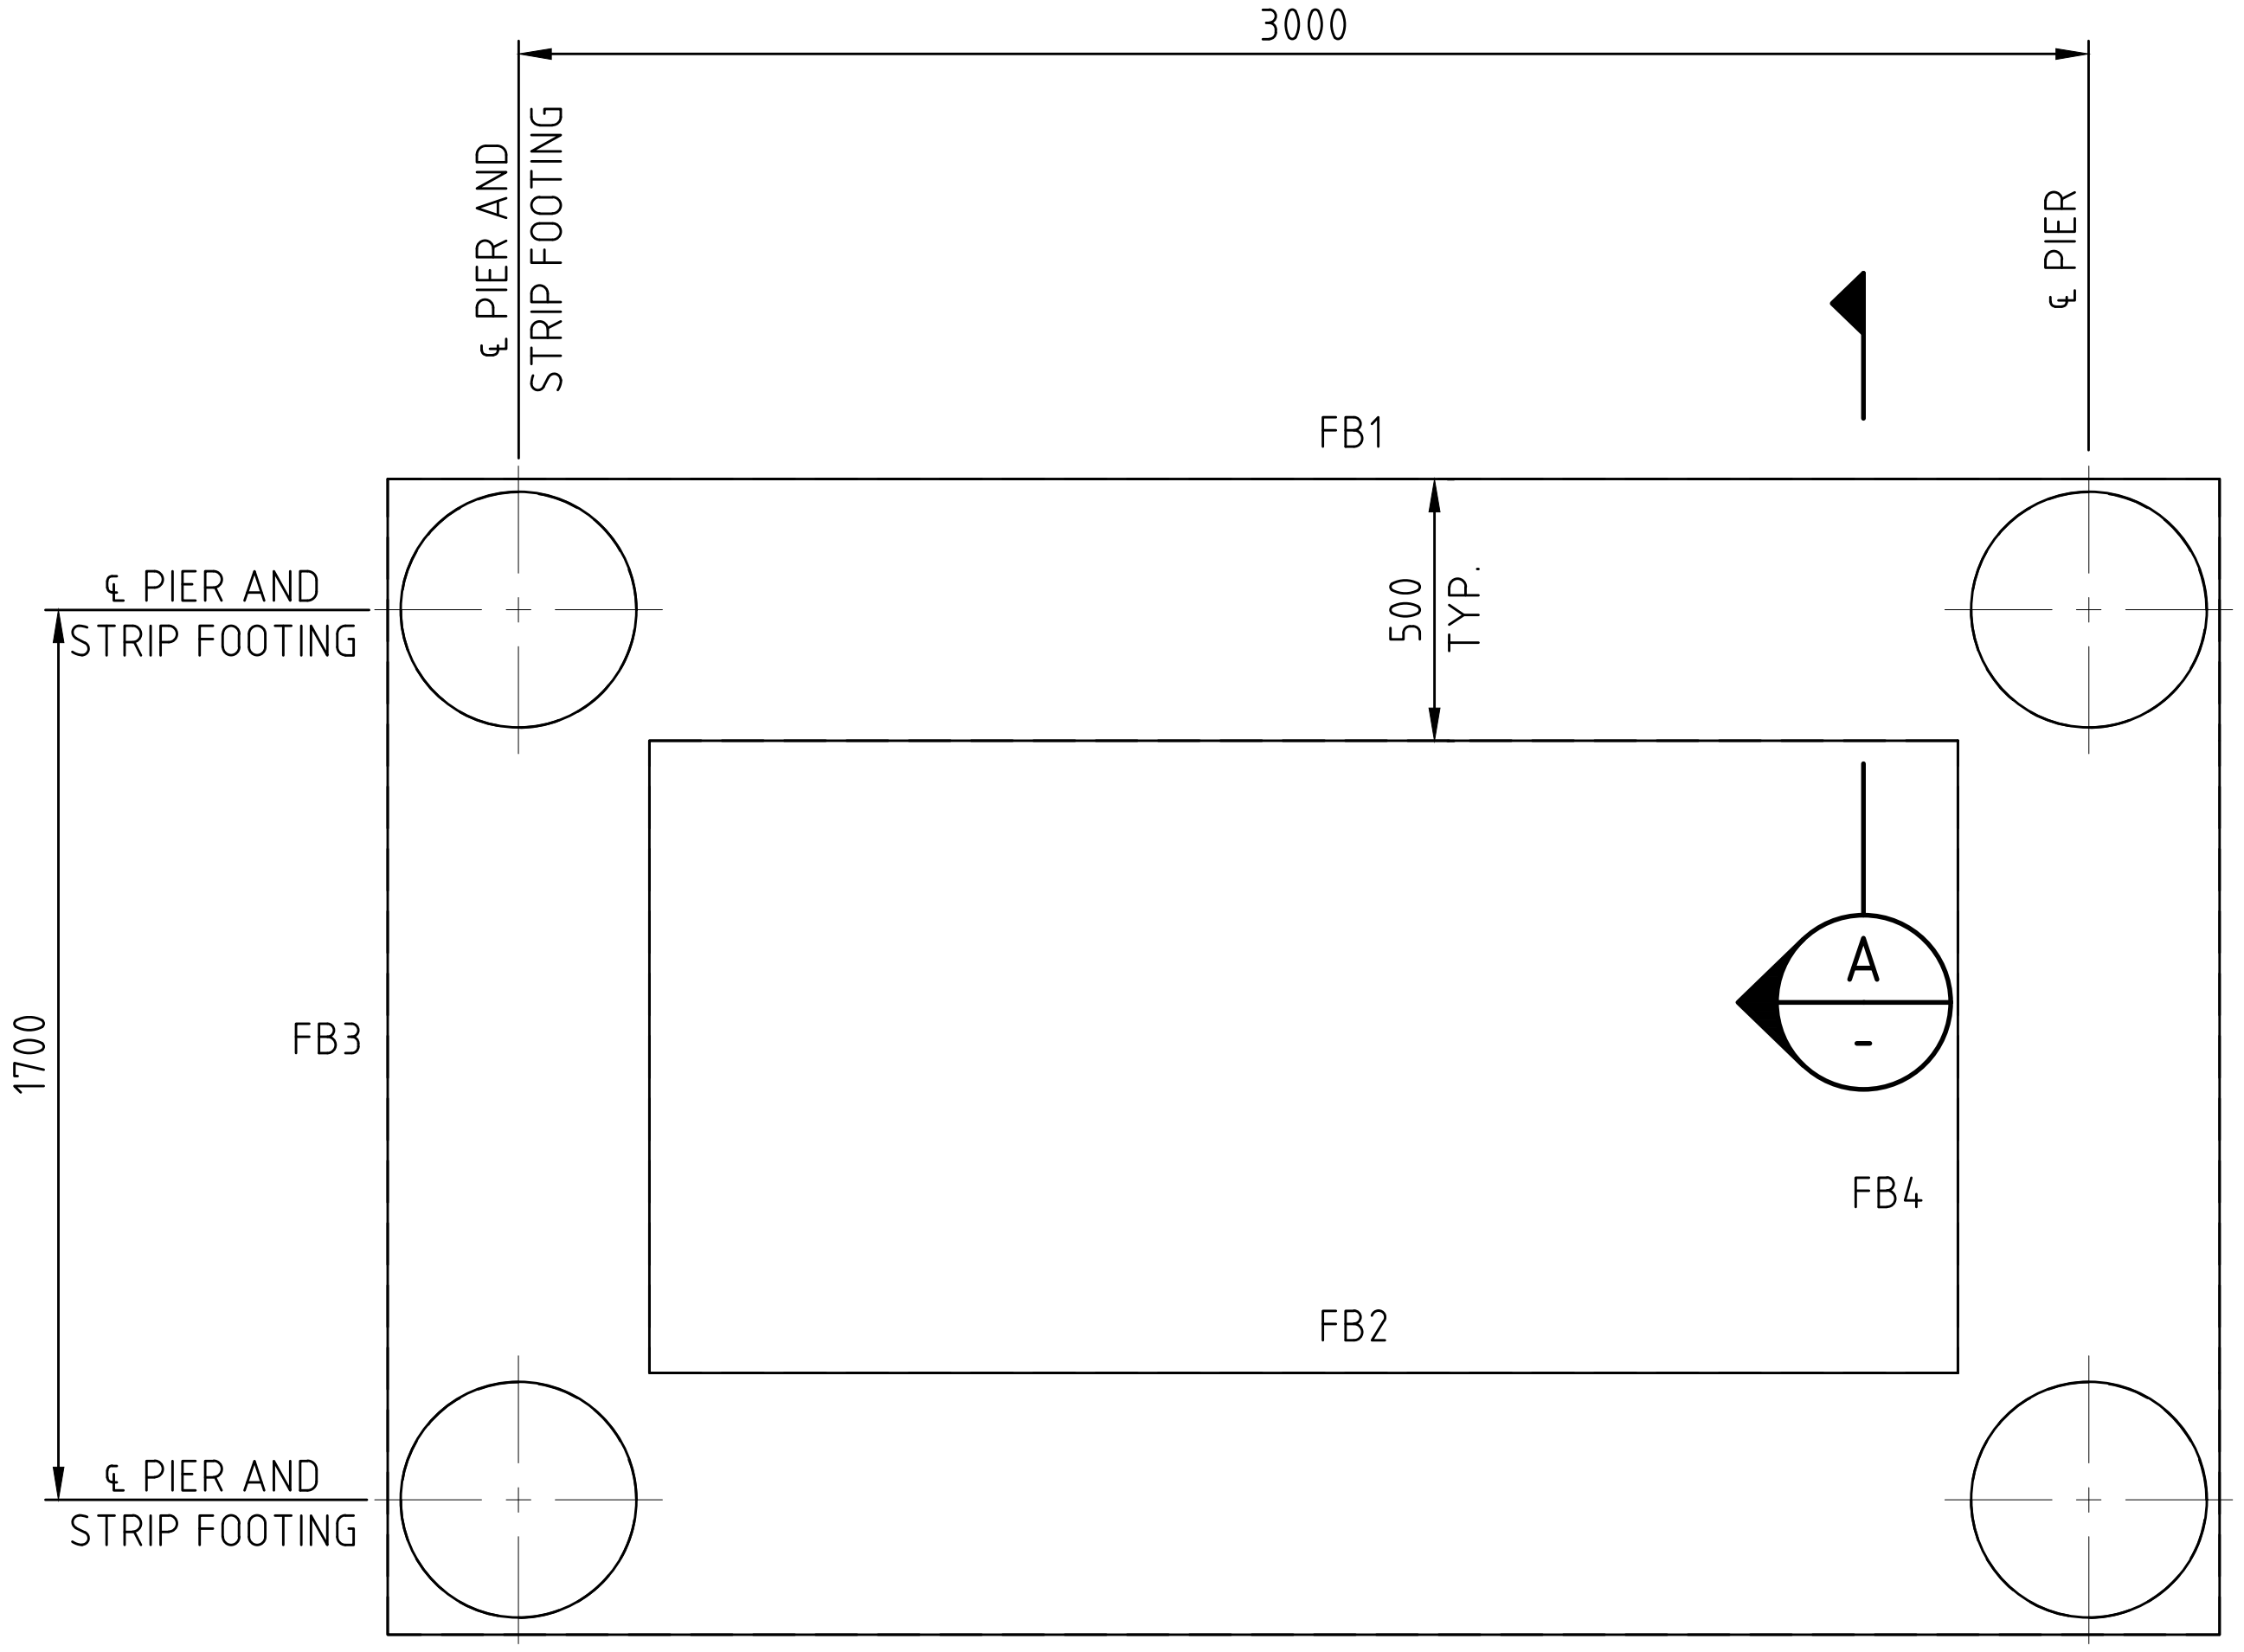

FOUNDATION PLAN
SCALE 1:25

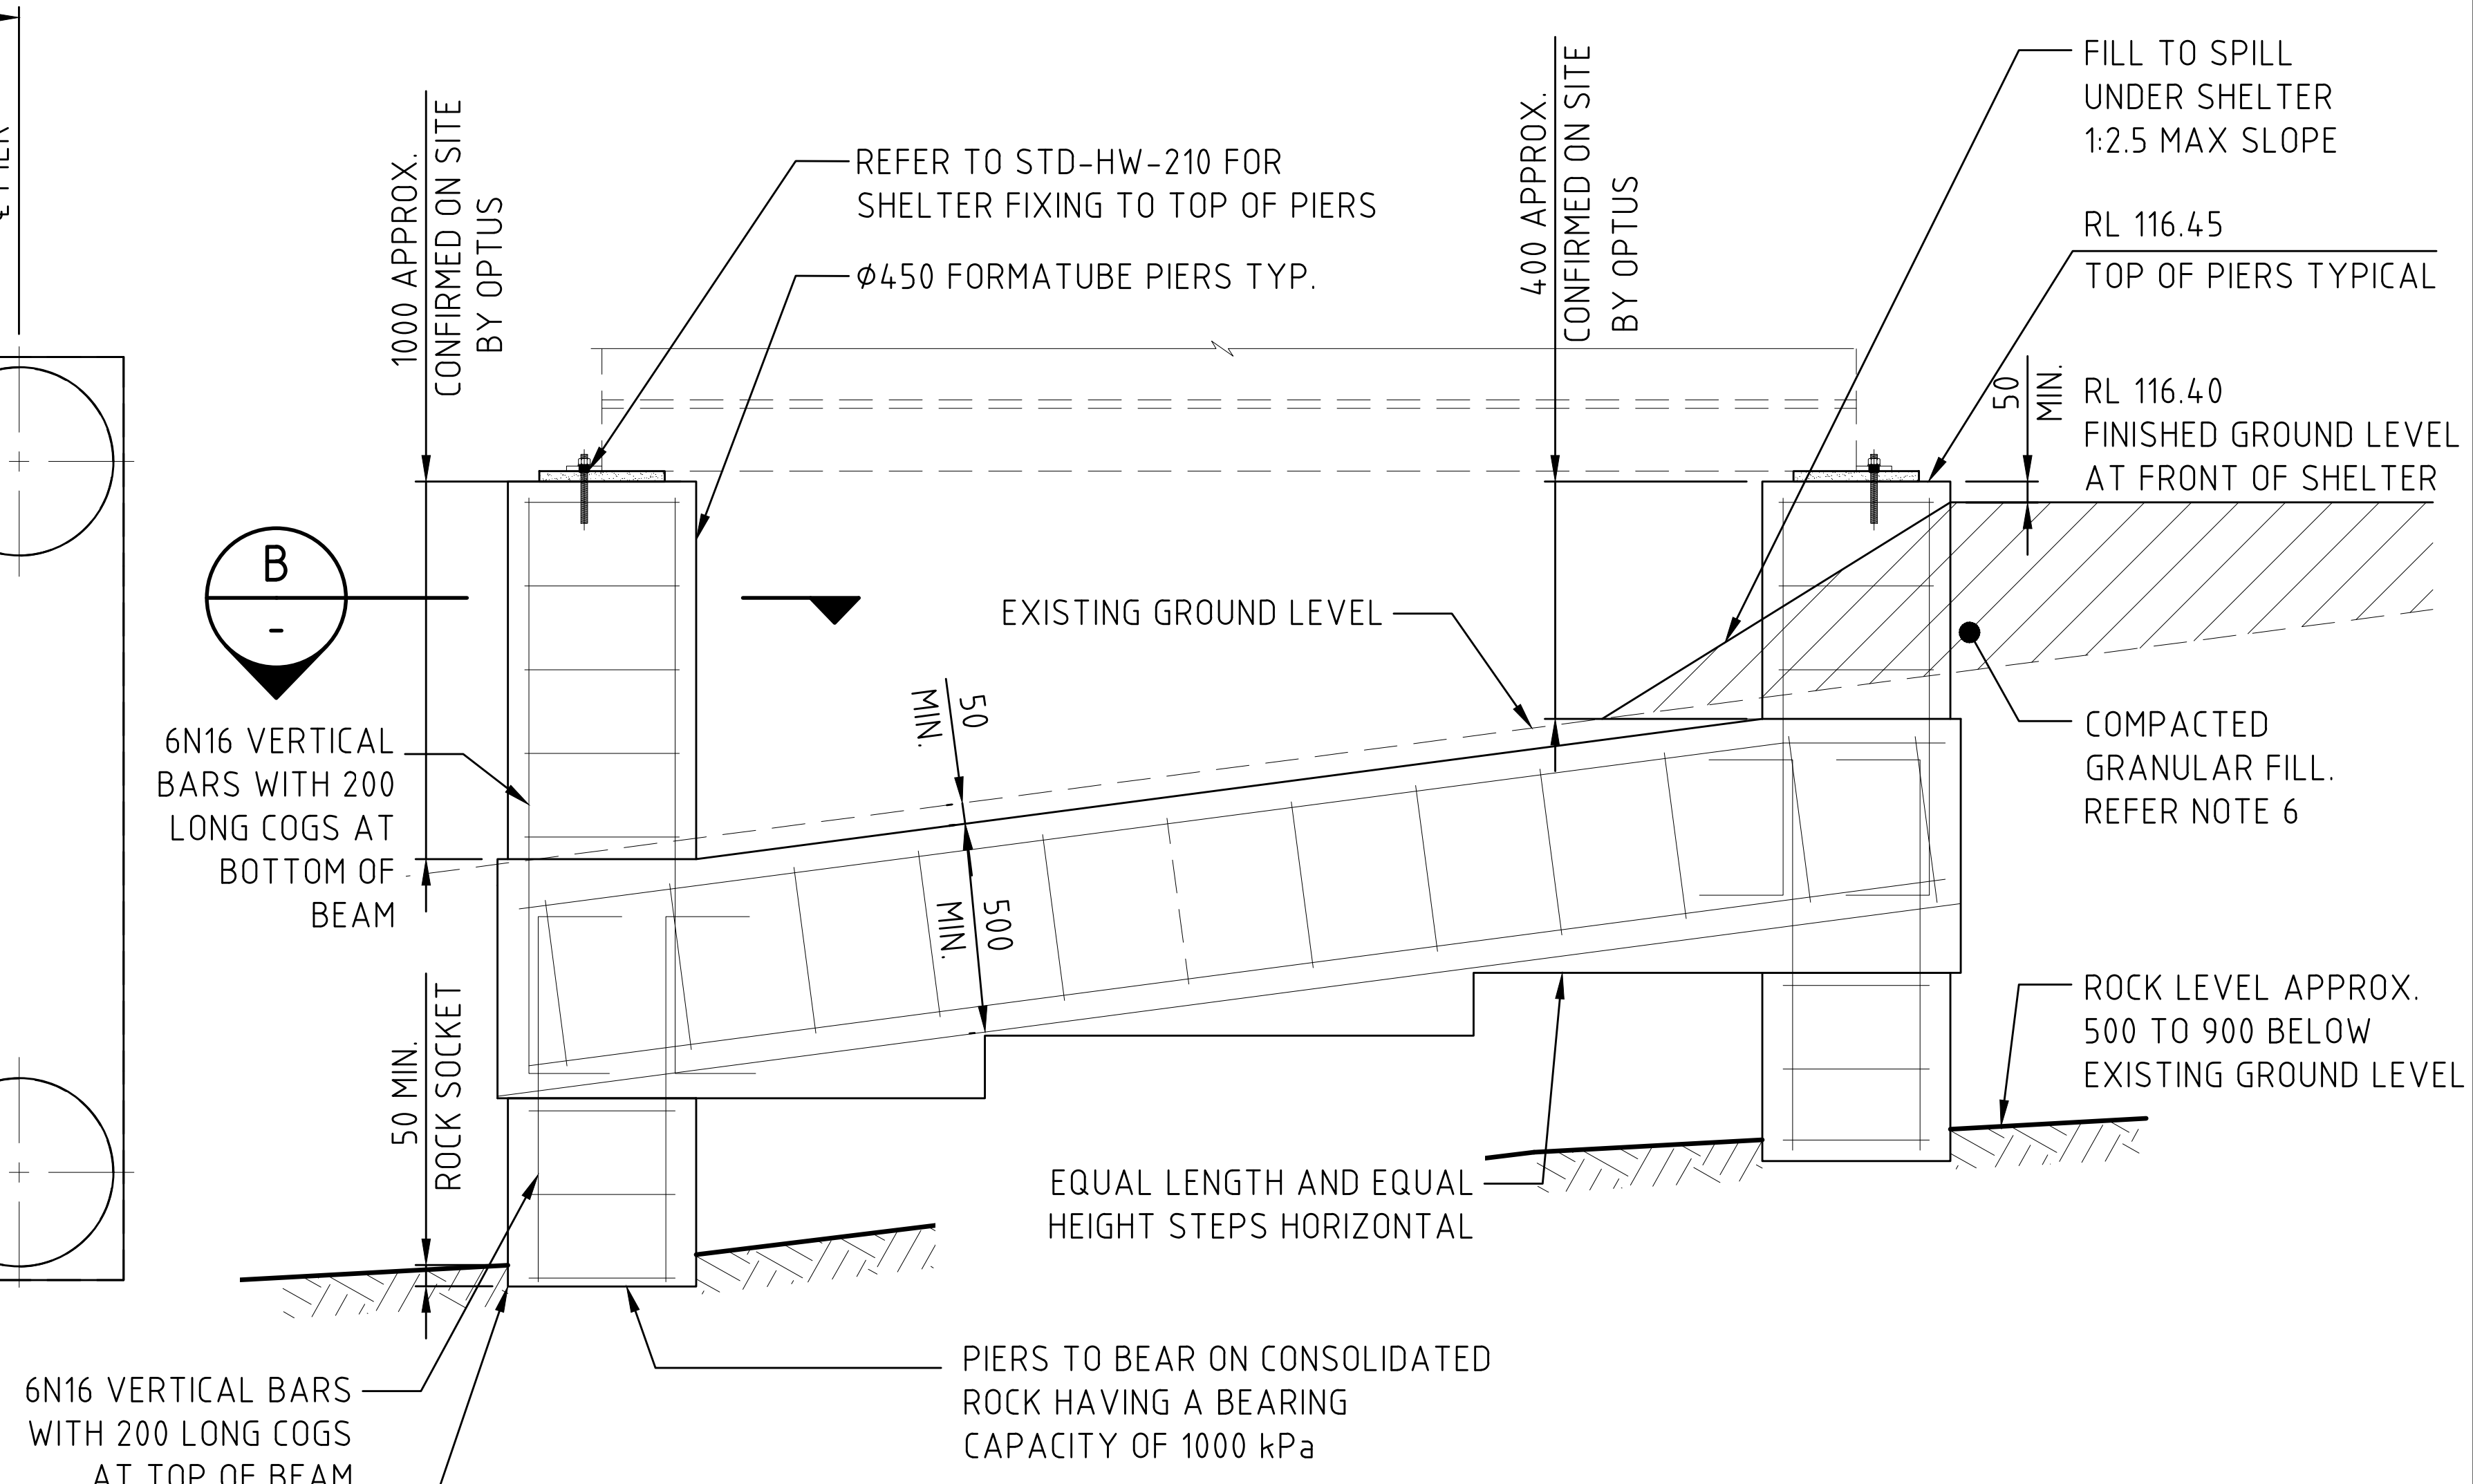

FOUNDATION ELEVATION FB1, FB2, FB3 AND FB4 SIMILAR
SCALE 1:25

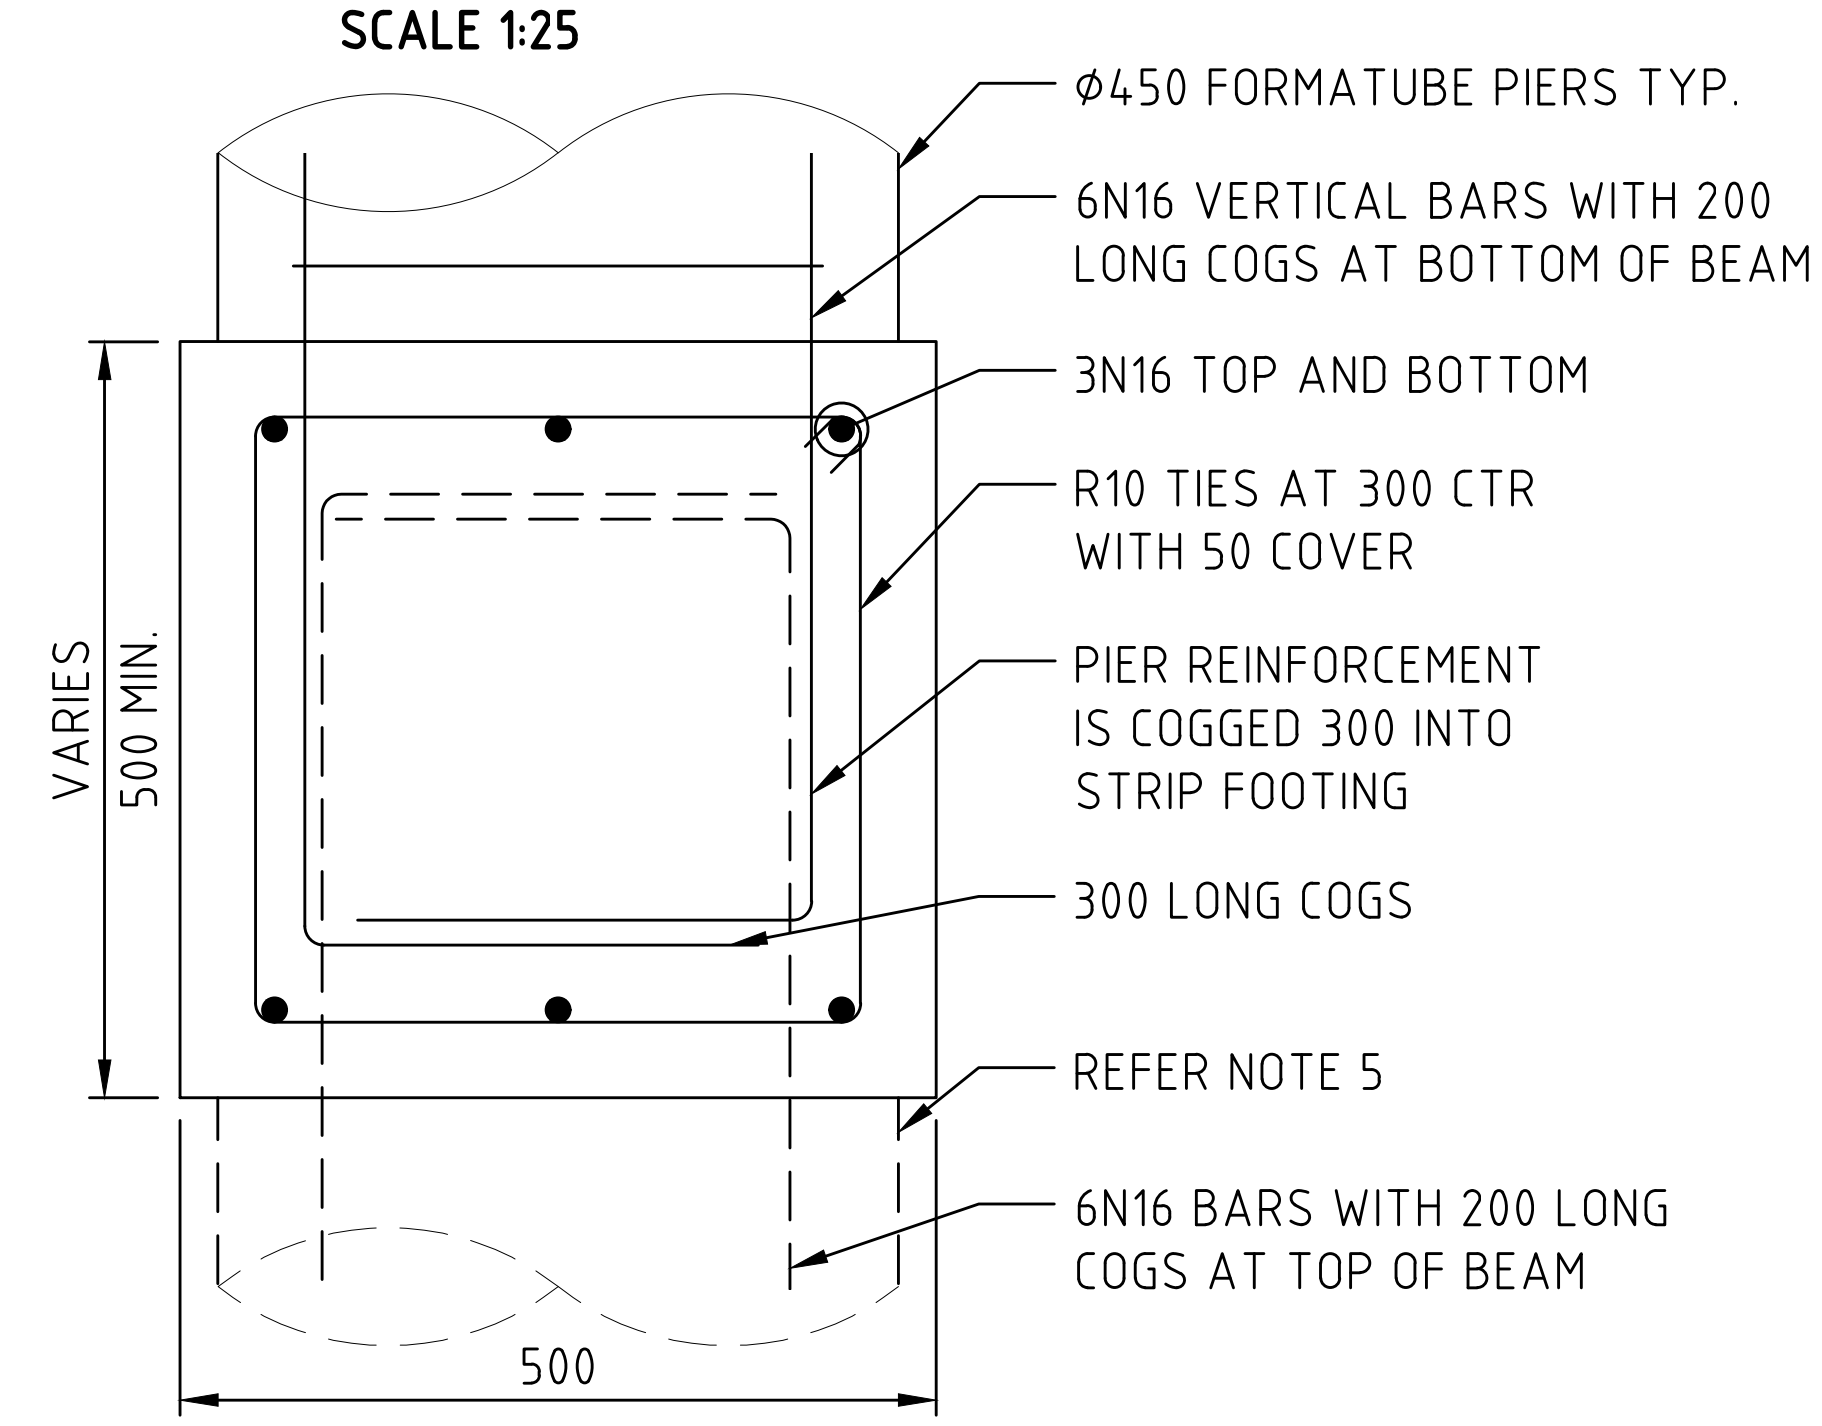

SECTION A -
SCALE 1:10

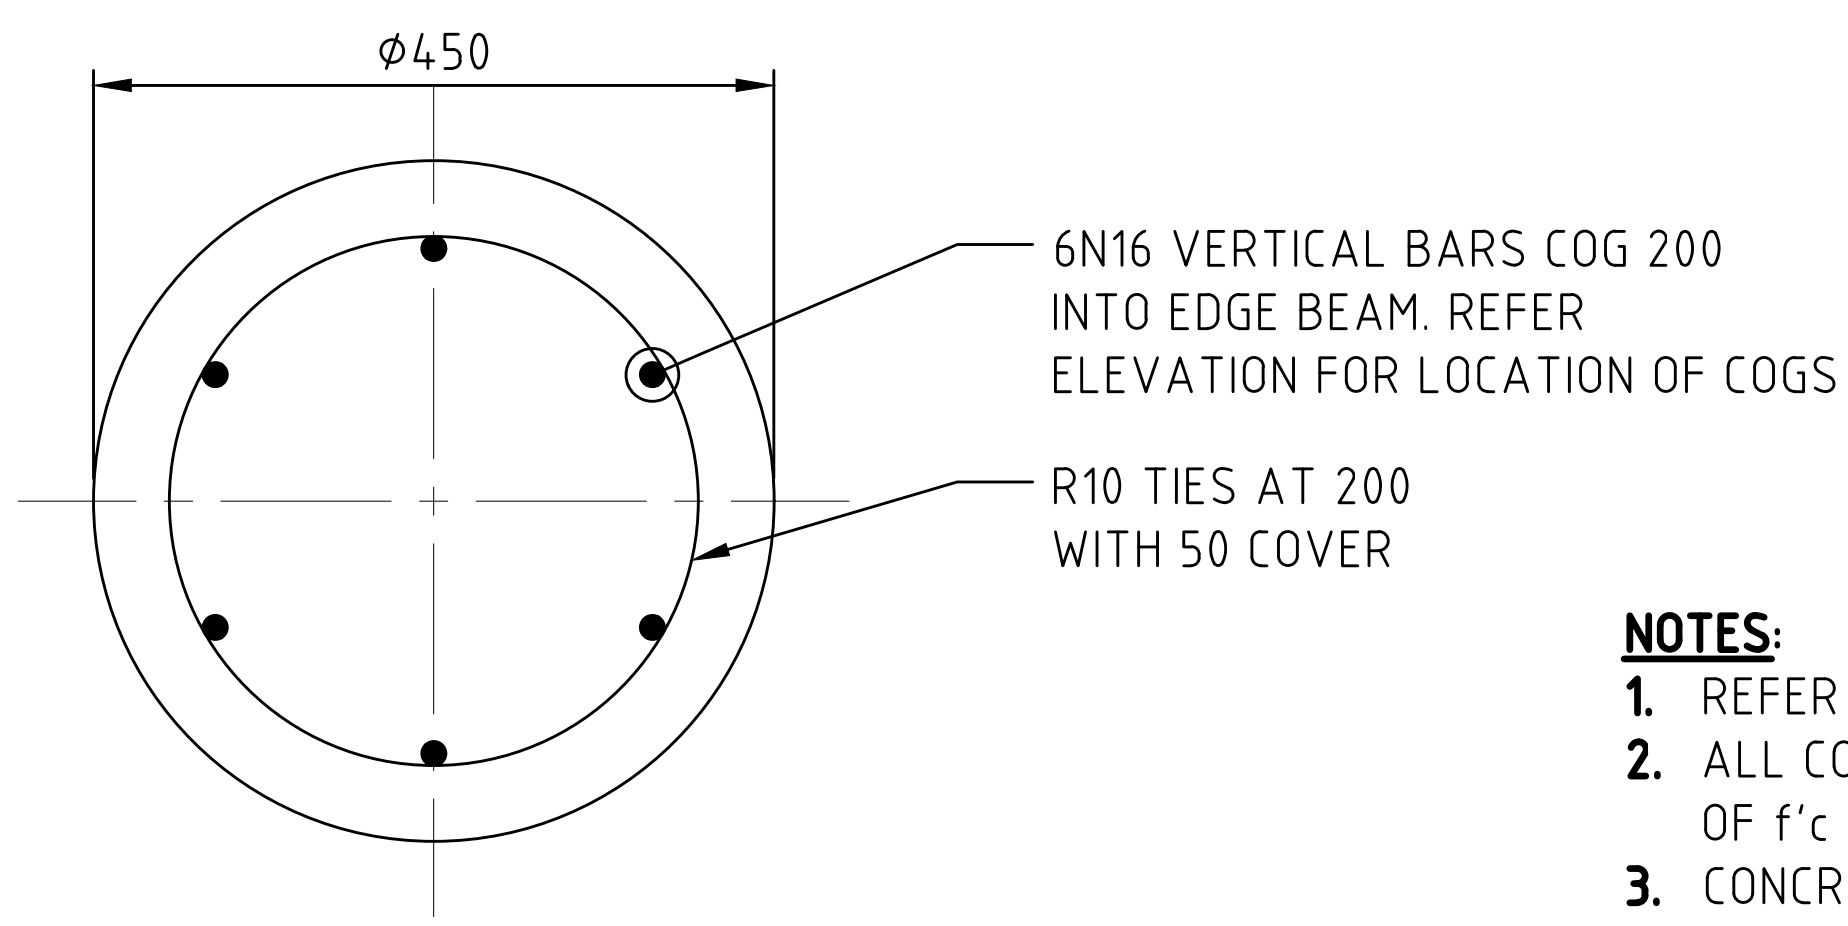

SECTION B -
SCALE 1:10

NOTES:
1. REFER TO DRG. H8097-G3 FOR SHELTER SET-OUT DETAILS.
2. ALL CONCRETE WORK IN ACCORDANCE WITH AS 3600 WITH CONCRETE STRENGTH OF f'c 32MPa AT 28 DAYS.
3. CONCRETE COVER TO REINFORCEMENT: 50mm TOP; 50mm BOTTOM AND SIDES.
4. FOUNDATION MATERIAL FOR STRIP FOOTINGS TO HAVE A MINIMUM BEARING CAPACITY OF 100 kPa.
5. EXTEND ALL PIERS AND REINFORCEMENT DOWN TO ROCK. PIERS TO SOCKETED 50mm INTO ROCK.
6. FILL GRANULAR MATERIAL COMPACTED TO 95% STANDARD DRY DENSITY.

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: SHELTER FOUNDATION DETAILS

Drawing Status: AS BUILT

Drawing No. H8097-S1

Revision AB

20 10 0 10 20 30 40 50mm A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:43 AM

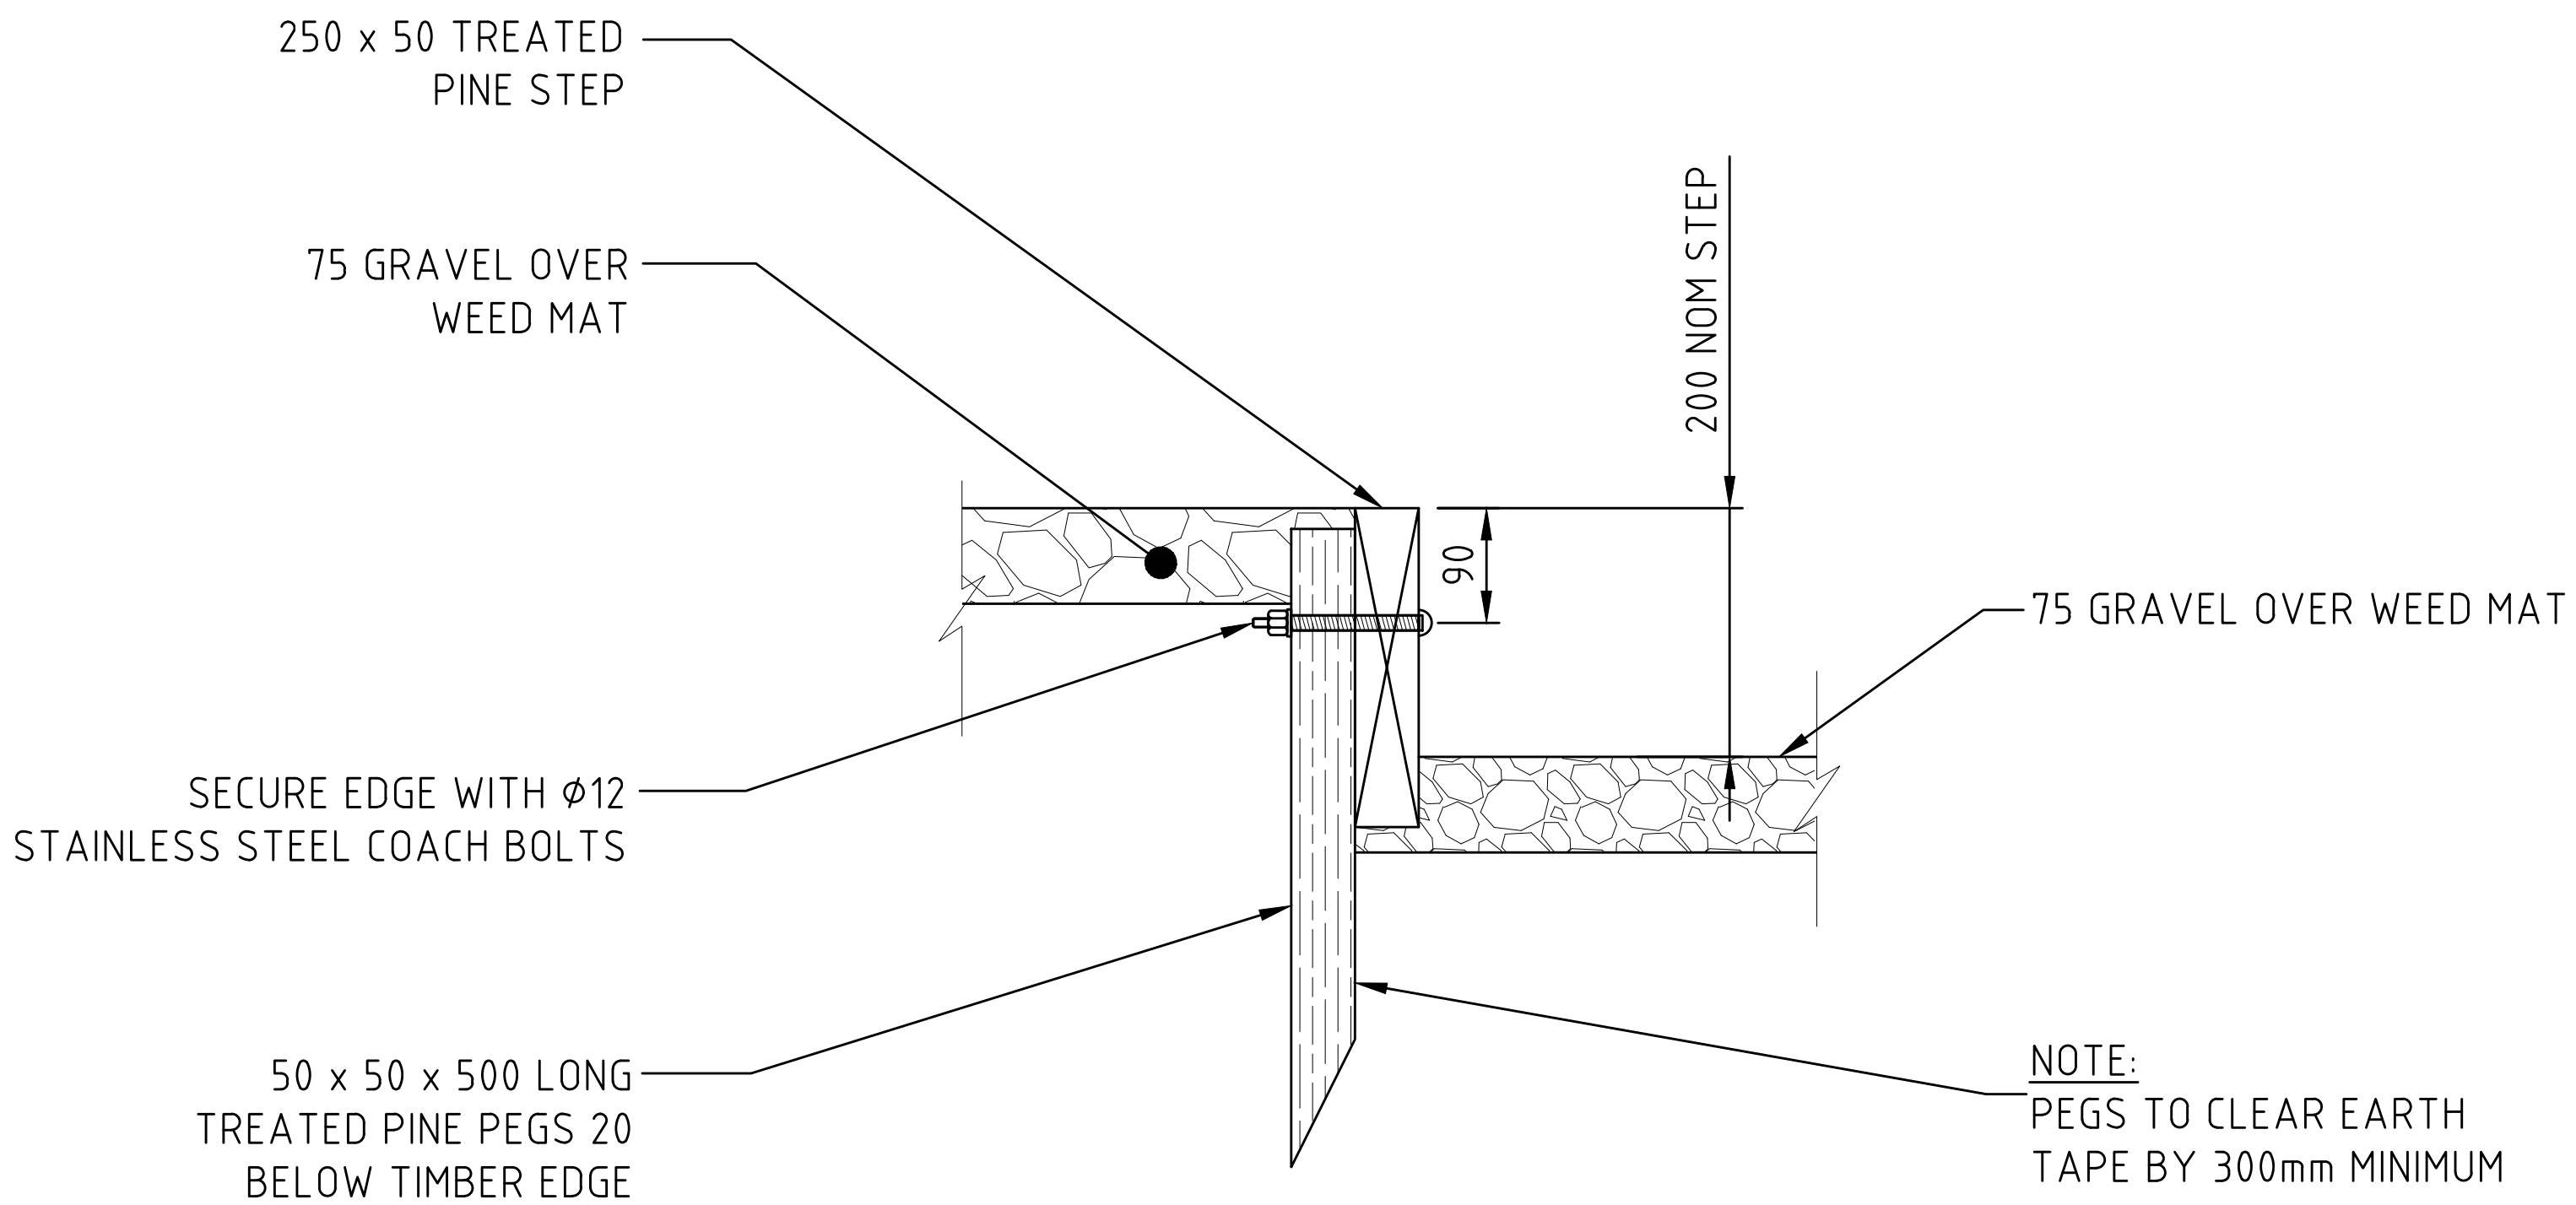

TIMBER STEP DETAIL

SCALE 1:10

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: TIMBER STEP DETAIL

Drawing Status: AS BUILT

Drawing No. H8097-S2

Revision AB

20 10 0 10 20 30 40 50mm

A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:43 AM

1. GENERAL

ELECTRICAL INSTALLATION IS IN ACCORDANCE WITH THIS SPECIFICATION, H8097-E2, OPTUS MOBILE NETWORK DESIGN AND CONSTRUCTION MANUAL SPECIFICATIONS, AS3000, AS3008, AS3015, AS1768 AND ALL OTHER RELEVANT AUSTRALIAN STANDARDS AND TAS NETWORKS SERVICE AND INSTALLATION RULES. LATEST EDITIONS AND AMENDMENTS AT TIME OF CONSTRUCTION APPLY.
THE CABLE ROUTE IS AS DIRECT AS POSSIBLE. WHERE CABLE TURNS ARE REQUIRED, THE RADIUS OF ANY BENDS NOT LESS THAN THE MINIMUM BENDING RADIUS OF THE CABLE.
UNDERGROUND CABLING IS IN HEAVY DUTY RIGID UPVC CONDUIT. ALL EXPOSED CABLES AND CONDUITS UV RESISTANT.
THE CABLES ROUTE GENERALLY AS SHOWN ON H8097-G2 AND G3.

2. SITE SUPPLY

SITE POINT OF SUPPLY IS DIRECTLY CONNECTED TO THE TASNETWORK POWER TRANSFORMER POLE VIA PROTECTION FUSES LOCATED ON THE POLE. REFER TO TASNETWORK FIRM OFFER CS18-1213, 50A 3 PHASE IS APPROVED TO OPTUS PROJECT. OPTUS IS CO-LOCATING WITH TELSTRA AND THEY SHARE THE SUPPLY VIA THE CONSUMER MAINS AFTER BE UPGRADED.
OPTUS POINT OF SUPPLY IS FROM THE UN-METERED POWER LINKS IN THE SITE GROUP METER ON FREE STANDING “H“ FRAME HOSTING OPTUS AND RELOCATED TELSTRA METER. EMERGENCY GENERATOR REQUIRED TO POWER UP TELSTRA SHELTER DURING THE ELECTRICAL WORK.

3. SITE CONSUMER MAINS

EXISTING TELSTRA CONSUMER MAINS IS OVERHEAD TO UNDERGROUND FOR 260m. THEY USE 4 x 1C 35mm² XLPE CABLES IN PVC CONDUIT. CONSUMER MAINS TO 4 x 1C Cu 70mm² XLPE/XLPE. EXISTING UNDERGROUND CONDUIT IS 50mm DIAMETER WITH 63mm PVC CONDUIT TO HOST THE SITE CONSUMER MAINS.
CONSUMER MAINS VOLTAGE DROP IS 3.32% AT 100A LOAD.

4. OPTUS METERING

SITE METERING IN FREE STANDING METER ENCLOSURE ATTACHED TO A “H” FRAME IN TELSTRA COMPOUND AS PER H8097-G3 DRAWING. REFER TO METASITE STANDARD DRAWING MSD-S430 FOR THE “H” FRAME DESIGN AND INSTALLATION. METERING ENCLOSURE IS WEATHER PROOF WITH IP55 RATING AND THE PANEL LAYOUT COMPLIANT WITH THE POWER DISTRIBUTOR REQUIREMENTS. ENCLOSURE IS ABLE TO HOST THE FOLLOWING ITEMS:
- 100A ACTIVE LINKS
- 100A SITE CURRENT CONTROL DEVICE SCCD
- FUSE ISOLATION FOR OPTUS METER
- 400V kWh POLY-PHASE METERING FOR OPTUS
- OPTUS METERED LOAD CONTROL 50A TYPE C MAIN SWITCH CIRCUIT BREAKER
- AC PROTECTIVE EARTH ELECTRODE WITH ASSOCIATED EARTH CABLES 16mm² FOR MEN LINK.

REMOVE OLD MEN LINK IN TELSTRA POWER ISOLATION BOX.

5. SUB MAINS LAYOUT

1 x 4C 16mm² CU PLUS EARTH XLPE/PVC CABLES AS OPTUS SUB-MAINS VIA UNDERGROUND SERVICES. OPTUS SUB-MAINS IS VIA P63 HEAVY DUTY RIGID UPVC CONDUIT AT MINIMUM COVER OF 500mm AS PER AS3000 CATEGORY “A” WIRING.
APPROXIMATE OPTUS SUB-MAINS LENGTH IS 10m.
TELSTRA SUPPLY TO THEIR SHELTER FROM THE SITE GROUP METER USING 1 x 4C 16mm² CU PLUS EARTH XLPE/PVC CABLES VIA UNDERGROUND IN P63 PVC CONDUITS APPROXIMATE CABLE LENGTH IS 5m.
ELECTRICAL DRAW PITS AT CABLE TURNS AS REQUIRED AS PER SECTION 3.5.5 OF OSD-010.

6. APPLICATION FOR SUPPLY OF ELECTRICITY

AN APPLICATION FOR CONNECTION OF ELECTRICITY MADE TO TASNETWORKS. 100A 3 PHASE SUPPLY IS APPROVED FOR THE SITE (OPTUS PLUS TELSTRA LOAD) CALCULATED SITE MAXIMUM DEMAND IS 70A. REFER TO TASNETWORKS FIRM OFFER CS18-1213 FOR DETAILS. TASNETWORKS CONTACT NAME IS JOHN ROBINSON, PHONE NUMBER IS 03 63247636.
AN NMI NUMBER CREATED FOR OPTUS ACCOUNT FOR THIS SITE UPON COMPLETION OF ELECTRICAL WORKS AND SUBMISSION OF EWR FORM.

7. LABELLING

STANDARD LABELS FIXED TO ALL FUSE, METER AND SWITCH POSITIONS. LABELS BLACK LETTERING ON WHITE BACKGROUND “TRAFFOLYTE”. LETTERING MINIMUM 10mm HIGH. TEXT TO READ “OPTUS”. A PERMANENT SKETCH PLAN IN THE OPTUS METERING ENCLOSURE INDICATING THE SIZE AND DIRECTION OF THE SERVICES.

8. GENERATOR SUPPLY

REFER TO OSD-620 FOR MANUAL CHANGEOVER SWITCH DETAILS.

9. EARTHING

SITE EARTHING SYSTEM US IN ACCORDANCE WITH OSD-020, OSD-750, OSD-760, OSD-830 AND OSD-831.

OPTUS EARTH GRID RESISTANCE IS MEASURED ON ITS OWN BEFORE CONNECTED TO TELSTRA EARTH SYSTEM OR TO MEN EARTH SYSTEM. REPORT THE RESULTS TO METASITE FOR FURTHER ASSISTANCE IF 5 OHMS CANNOT BE ACHIEVED WHEN BOTH TELSTRA AND OPTUS EARTH GRIDS ARE BONDED TOGETHER. EARTH RESISTANCE MEASUREMENT REPORT IS PROVIDED AS PART OF AS BUILT DOCUMENT.

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI
HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: SITE POWER DETAILS

Drawing Status: AS BUILT

Drawing No.: H8097-E1

Revision: AB

20 10 0 10 20 30 40 50mm A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:43 AM

CABLE SCHEDULE								
CABLE	CABLE TYPE	CORES	ACTIVE	NEUTRAL	EARTH	CABLE LENGTH	INSTALLATION METHOD	COMMENTS
A	XLPE/PVC Cu	4 x 1C	$70mm^2$	$70mm^2$	-	260m	U/G IN Ø63mm CONDUIT	BY OPTUS
B	XLPE/Cu/SDI	1 x 4C + E	$16mm^2$	$16mm^2$	$6mm^2$	10m	U/G IN P63 PVC CONDUIT	BY OPTUS
C	XLPE/Cu	1 x 4C + E	$16mm^2$	$16mm^2$	$6mm^2$	5m	U/G IN Ø63mm CONDUIT	BY OPTUS

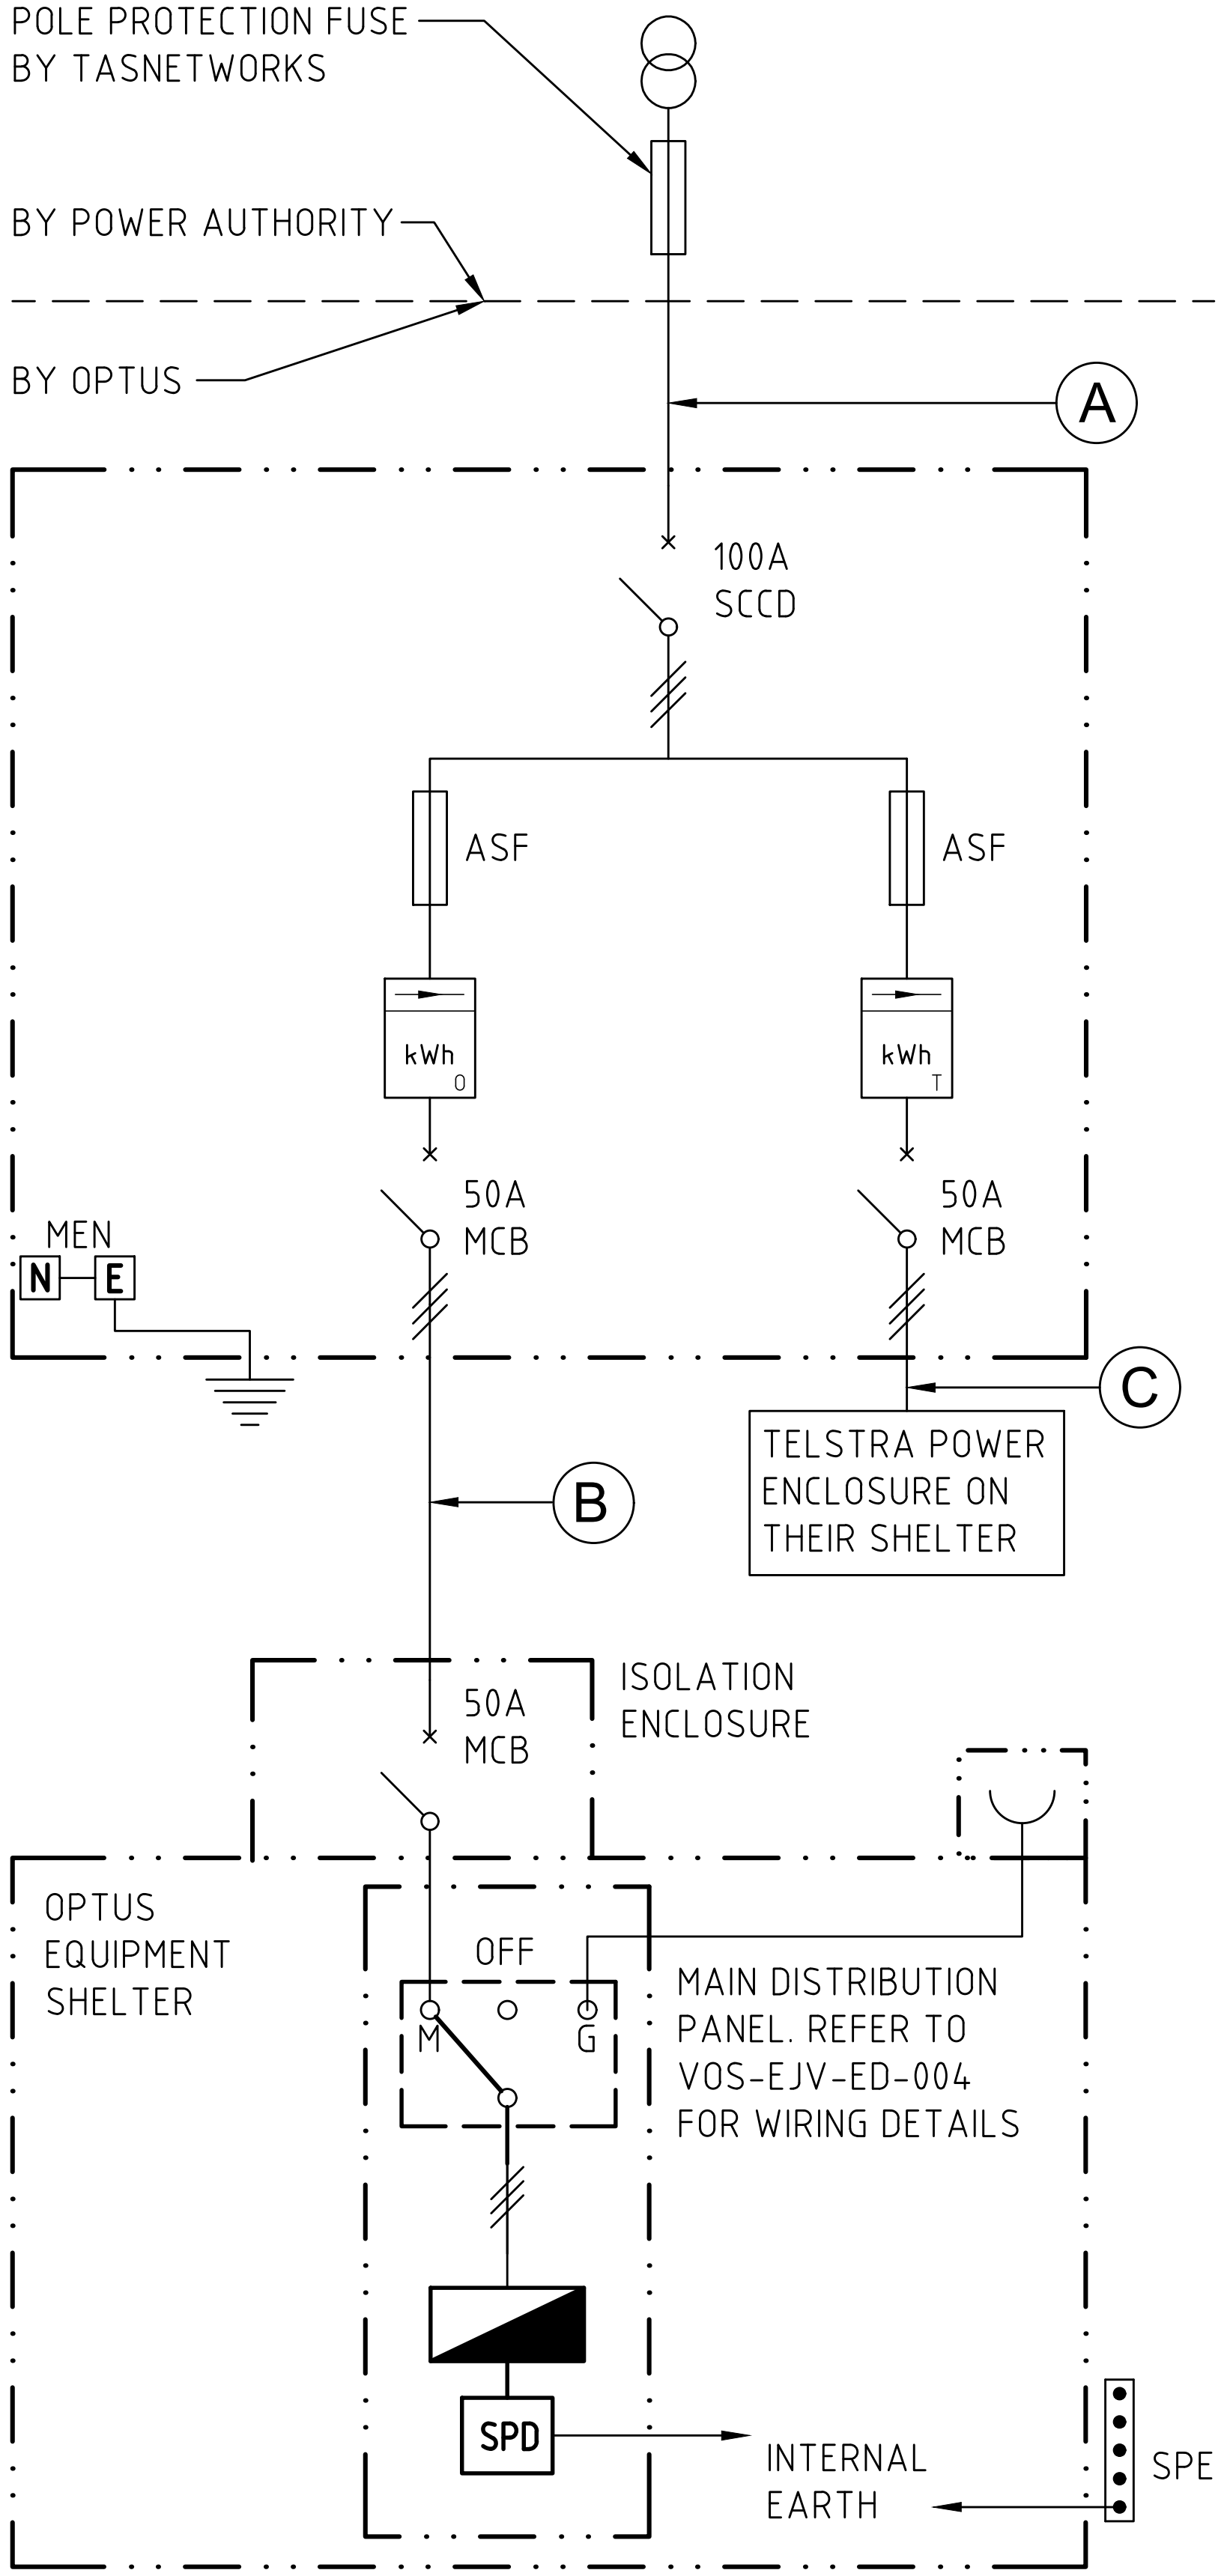

SINGLE LINE DIAGRAM

NTS

LEGEND

N NEUTRAL
E EARTH
MEN MULTIPLE EARTHED NEUTRAL
SPD SURGE PROTECTION DEVICE
SCCD SITE CURRENT CONTROL DEVICE

CIRCUIT BREAKER
3 PHASES
2 PHASES
SINGLE PHASE
ISOLATOR
AUTHORITY SERVICE FUSE
EARTH CONNECTION
RESIDUAL CURRENT DEVICE
TRANSFORMER
kWh O METER
O FOR OPTUS
T FOR TELSTRA
OFF M G MANUAL CHANGEOVER SWITCH

NOTES:

1. THIS DRAWING READ IN CONJUNCTION WITH H8097-E1.
2. CABLE LENGTHS GIVEN ARE INDICATIVE ONLY. EXACT CABLE ROUTES AND LENGTHS CONFIRMED ON SITE PRIOR TO CONSTRUCTION.

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575
HUAWEI

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: SINGLE LINE DIAGRAM

Drawing Status: AS BUILT

Drawing No. H8097-E2

Revision AB

20 10 0 10 20 30 40 50mm A3

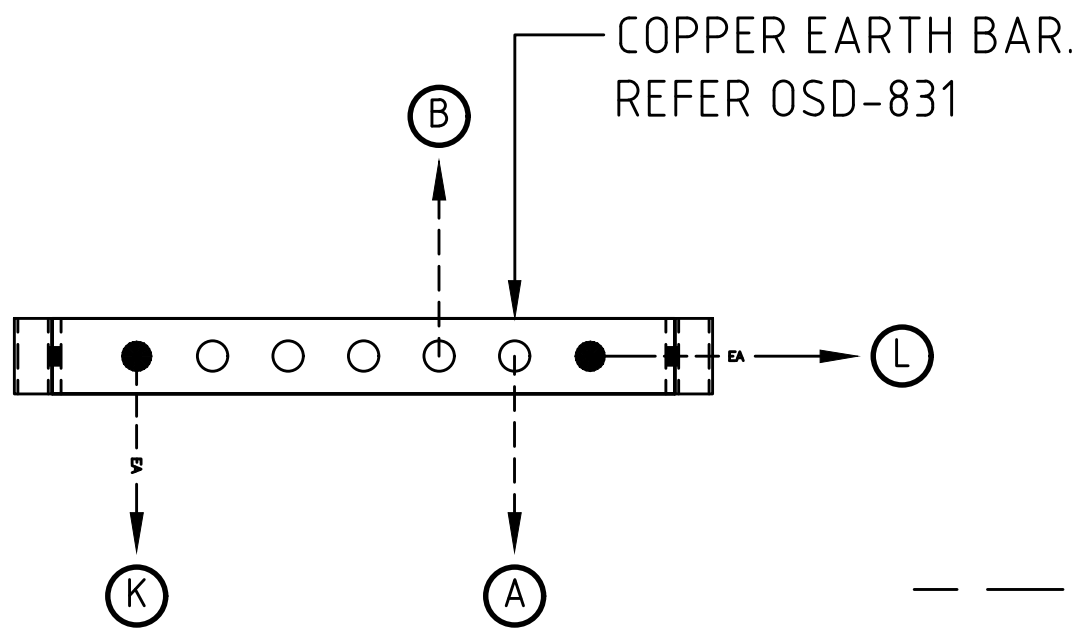

SERVICE EARTH BAR

NTS

LEGEND:

	EARTHING ELECTRODE IN INSPECTION SLEEVE. ELECTRODE LENGTH (SITE SPECIFIC)
	TRAFFICABLE INSPECTION SLEEVE (WHERE REQUIRED)
— — —	35mm² STRANDED COPPER GREEN/YELLOW PVC
— — — EA —	50 x 3mm GALVANISED STRAP (TELSTRA)
	SERVICE EARTH BAR

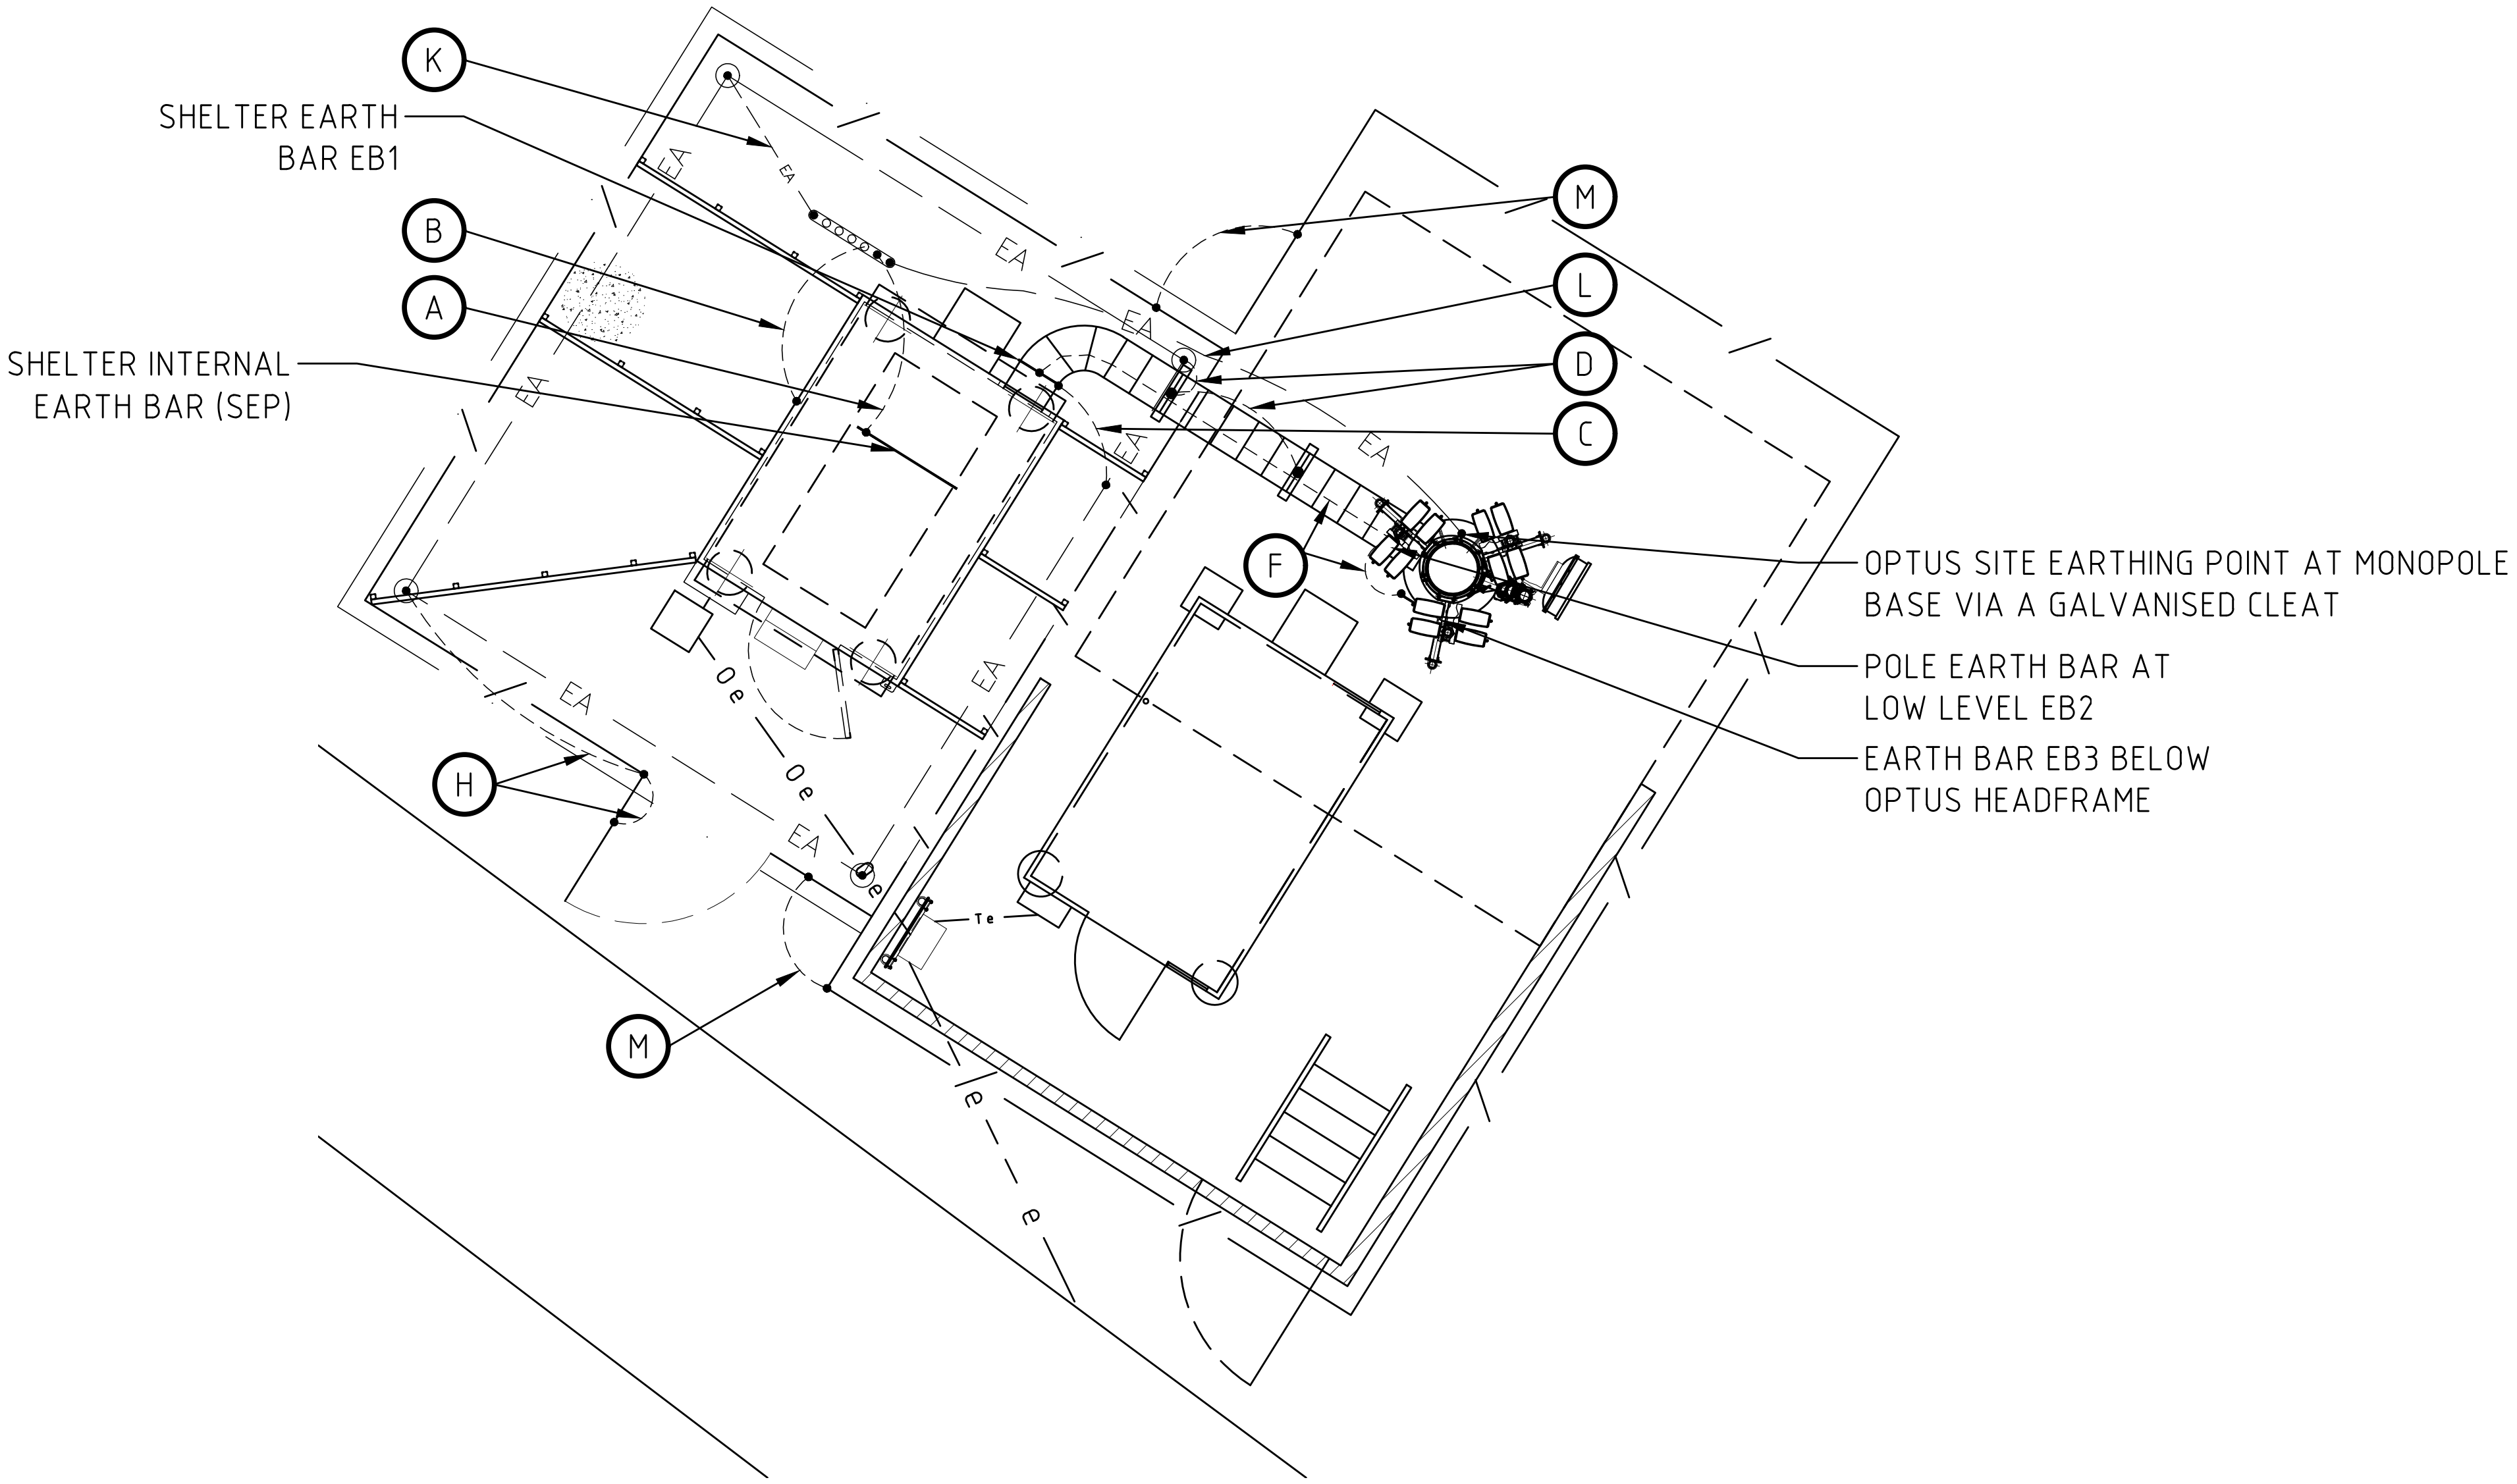

EARTHING PLAN

SCALE 1:100

EARTHING INSTALLATION

ALL ITEMS EARTHED GENERALLY AS SHOWN ON THIS DRAWING. FOR CONNECTION REFERENCE NUMBER, CABLE SIZE AND CONNECTION DETAILS, REFER TO TABLE 1 OF THE OPTUS EARTHING SPECIFICATION (OSD-020).

ITEM	DESCRIPTION	CONNECTION REF No.
A	INTERIOR EARTH TAPE TO SPE	EC4
B	SHELTER BASE FRAME TO SPE	EC2
C	EARTH BAR	EC5
D	CABLE LADDER SUPPORT POST	EC6
F	CABLE TRAY EQUIPOTENTIAL EARTH CABLES BETWEEN EARTH BARS	EC2
H	FENCING AND GATES	EC6/EC9
K	SPE TO ELECTRODE	EC7
L	SPE TO TOWER LEG	-
M	EARTH CONTINUING BETWEEN FENCES FRAMES	EC2

NOTES:

OPTUS EARTH SYSTEM IS OF THE SAME MATERIAL AS HOST STRUCTURE EARTHING SYSTEM. 3 x 50mm HOT DIPPED GALVANISED EARTH STRAPS.

1. A MINIMUM OF 4-OFF 13mm DIAMETER SOLID STAINLESS STEEL EARTHING ELECTRODES DRIVEN 3m DEPTH UNLESS SPECIFIED OTHERWISE.
2. ELECTRODES IN 75mm MINIMUM DIAMETER HOLES AND BACKFILL AS PER OSD-020.
3. A MINIMUM OF 3-OFF EARTH BARS AT TOP OF MONOPOLE, ON MONOPOLE ABOVE ELEVATED CABLE LADDER AND THE SHELTER.
4. SINGLE POINT EARTH BAR FACE FIXED TO SHELTER BASE FRAME IN ACCORDANCE WITH OSD-831.
5. SHELTER INTERIOR EARTHING TAPE IS SHELTER SUPPLIER.
6. MECHANICAL EXTERNAL CONNECTIONS ARE TREATED WITH DENSO PASTE AND TAPE.
7. ANY ALTERED SURFACE IN PARENT GRID COMPOUND AS A RESULT OF THIS INSTALLATION REINSTATED TO ITS ORIGINAL CONDITION.
8. MEN LOCATED AT THE METERING POINT.
9. MONOPOLE BOLT ALLOWING FOR OPTUS EARTHING SYSTEM ISOLATION FOR TESTING PURPOSES. REFER TO STD-HW-E001.
10. OPTUS CONNECTION CLEARLY LABELLED AS "OPTUS SITE EARTHING POINT".
11. OPTUS FEEDER EARTH BAR AT THE BASE OF MONOPOLE MOUNTED ON THE CABLE LADDER AS CLOSE POSSIBLE TO FEEDER ENTRY.

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380

SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533

MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: SITE EARTHING PLAN

Drawing Status: AS BUILT

Drawing No. H8097-E3

Revision AB

20 10 0 10 20 30 40 50mm

A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:43 AM

SHELTER DETAILS:

1. INTERNATIONAL COMMUNICATIONS SHELTERS (ICS) ZONECOOL TYPE C3 SANDWICH PANEL SHELTER, COLOURED COLORBOND "PALE EUCALYPT".
2. SHELTER SELECTION IS BASED ON OSD-010 V13.0 SECTION 3.1.2.
3. SHELTER LAYOUT BASED ON ICS DRAWING PACK ISSUE DATE 14-10-2016.
4. REFER TO REFER TO DRG H8097-G3 FOR METER BOX LOCATION.
5. THIS DRAWING IS DIAGRAMMATIC ONLY AND SHOULD NOT BE SCALED.

DC POWER SUPPLY:

OPTUS AND VHA HUAWEI DC POWER SYSTEM, EACH EQUIPPED WITH 6 x OFF 3kW RECTIFIERS AND 5 x 100AH BATTERY STRINGS.

U	VODAFONE DC POWER RACK Modular Zone Cool Rack-Type 1	OPTUS DC POWER RACK Modular Zone Cool Rack-Type 1	TX RACK Modular Zone Cool Rack-Type 2	MISC/SPARE RACK Modular Zone Cool Rack-Type 2
44	POWER SYSTEM UNIT	POWER SYSTEM UNIT		
43			DC FAN INLET CHANNEL	DC FAN INLET CHANNEL
42				
41	MODEL: HUAWEI	MODEL: HUAWEI		
40				
39	6 x 3KW RECTIFIERS	6 x 3KW RECTIFIERS	RESERVED FOR AIR GUIDE SHELF	RESERVED FOR AIR GUIDE SHELF
38			Optus Eltek APDP	SPARE
37				SPARE
36	Battery String 5	Battery String 5	SPARE	SPARE
35			SPARE	SPARE
34			SPARE	SPARE
33			SPARE	SPARE
32			SPARE	SPARE
31			SPARE	SPARE
30			Fibre Management - OPTUS	SPARE
29			SPARE	SPARE
28	Battery String 4	Battery String 4	Optus - Huawei ATN 910	SPARE
27			SPARE	SPARE
26			Fibre Management - OPTUS	SPARE
25			SPARE	SPARE
24			Optus - Huawei RTN 905	SPARE
23			SPARE	SPARE
22			SPARE	SPARE
21	Battery String 3	Battery String 3	SPARE	SPARE
20			SPARE	SPARE
19			SPARE	SPARE
18			SPARE	SPARE
17			SPARE	SPARE
16			SPARE	SPARE
15			KRONE 1 - 15 Way ENV ALARMS BTS, 1642 or MSR	SPARE
14	Battery String 2	Battery String 2		SPARE
13				SPARE
12			SPARE	SPARE
11			SPARE	SPARE
10			SPARE	SPARE
9			SPARE	SPARE
8			SPARE	SPARE
7	Battery String 1	Battery String 1	SPARE	SPARE
6			SPARE	SPARE
5			AIR INLET VENT	AIR INLET VENT
4				
3				
2				
1				

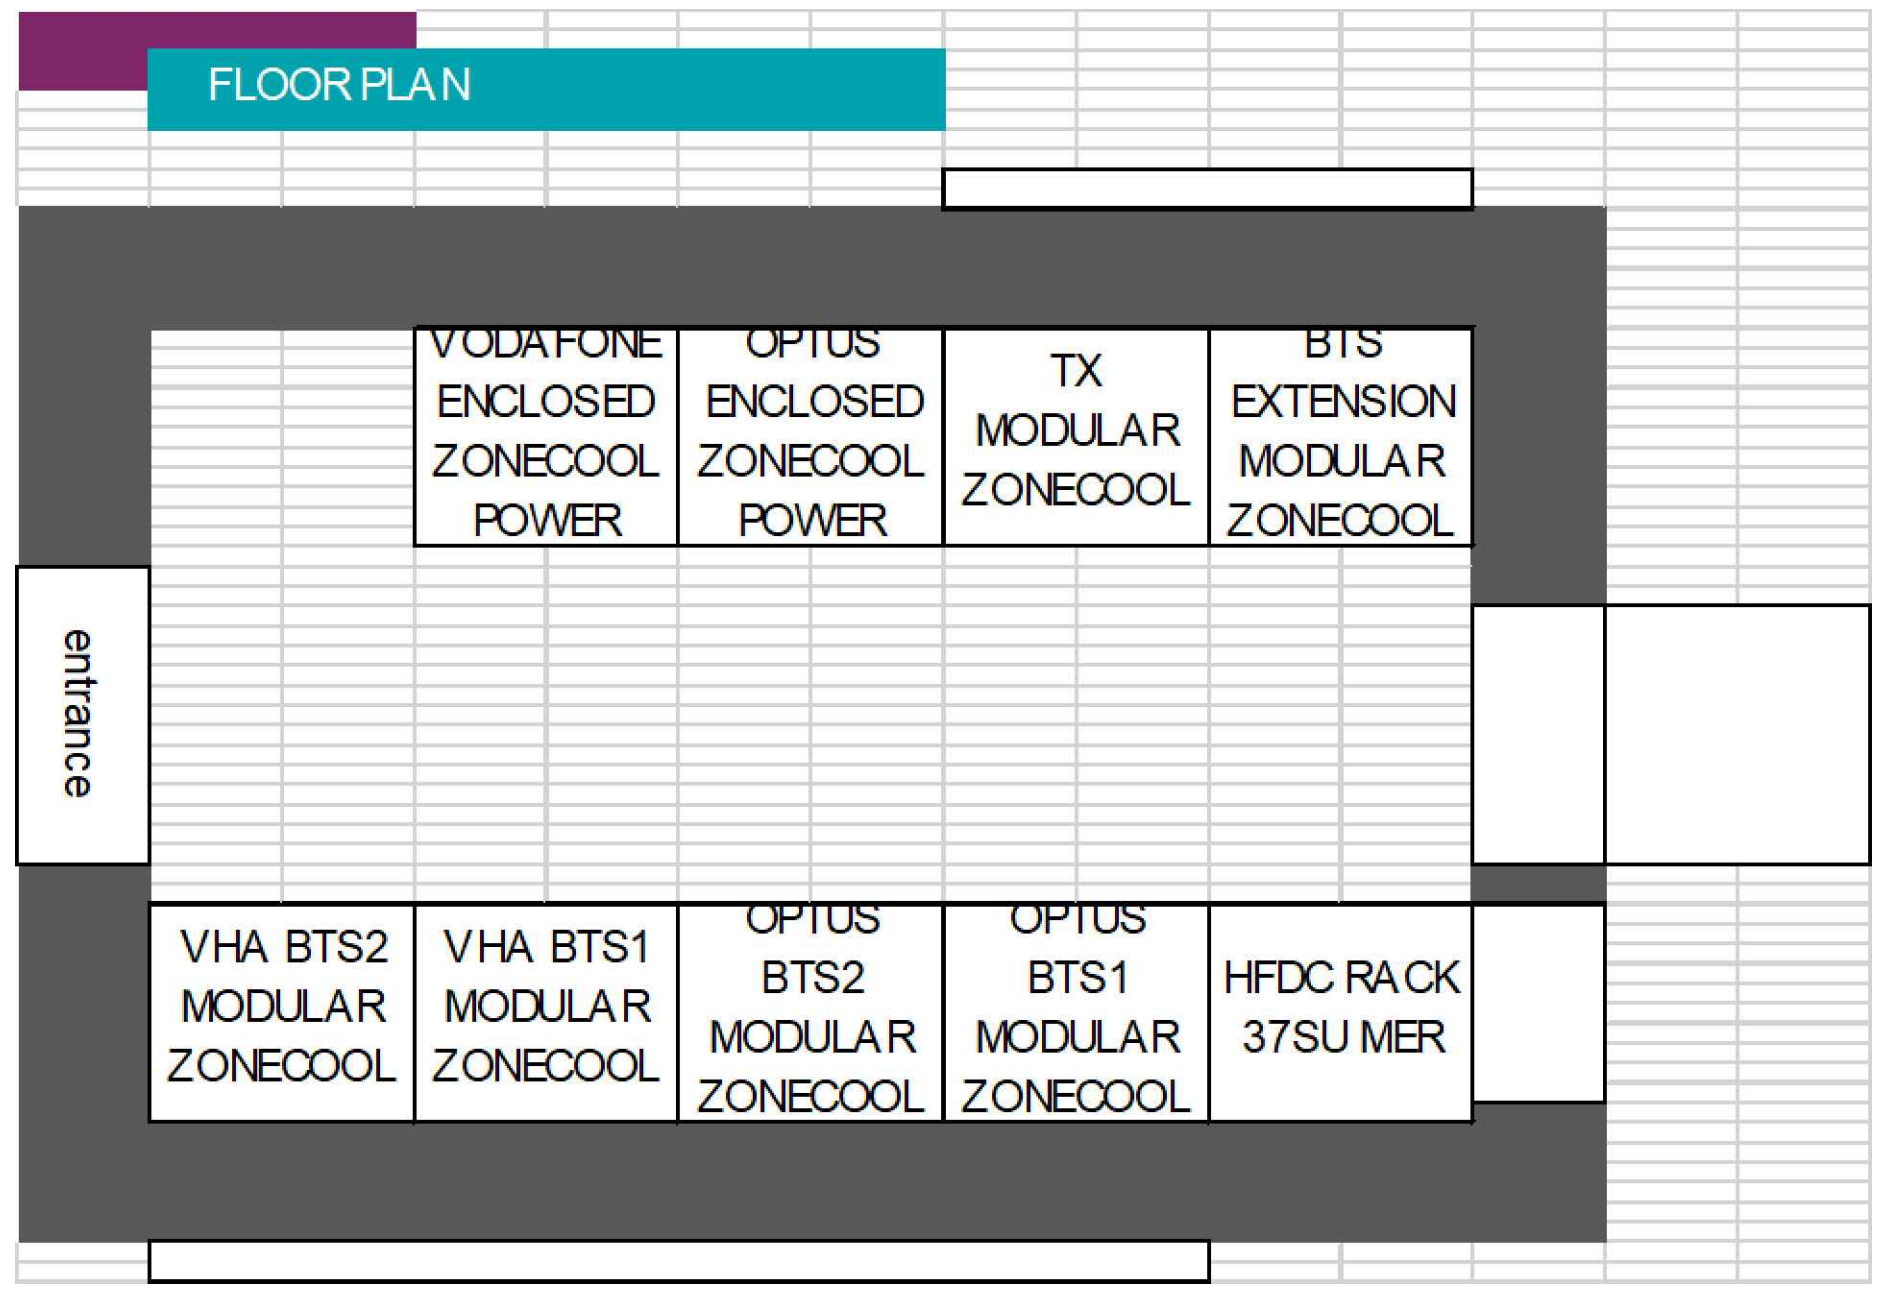

OPTUS SHELTER
RACK CONFIGURATION (MZC-001)

NTS

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: EQUIPMENT SHELTER LAYOUT PLAN - SHEET 1 OF 2

Drawing Status: AS BUILT

Drawing No. H8097-F1

Revision AB

20 10 0 10 20 30 40 50mm

A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:43 AM

	HFDC RACK 37 SU Rack			OPTUS BTS RACK 1 Modular Zone Cool Rack-Type 2			OPTUS BTS RACK 2 Modular Zone Cool Rack-Type 2			VODAFONE BTS RACK 1 Modular Zone Cool Rack-Type 2			VODAFONE BTS RACK 2 Modular Zone Cool Rack-Type 2	
			43	DC FAN INLET CHANNEL	43	43	DC FAN INLET CHANNEL	43	43	DC FAN INLET CHANNEL	43	43	DC FAN INLET CHANNEL	43
			42		42	42		42	42		42	42		42
			41		41	41		41	41		41	41		41
			40		40	40		40	40		40	40		40
			39	SPARE	39	39	SPARE	39	39	SPARE	39	39	SPARE	39
			38	SPARE	38	38	SPARE	38	38	SPARE	38	38	SPARE	38
37	SPARE	37	37	SPARE	37	37	SPARE	37	37	SPARE	37	37	SPARE	37
36	SPARE	36	36	SPARE	36	36	SPARE	36	36	SPARE	36	36	SPARE	36
35	SPARE	35	35	SPARE	35	35	SPARE	35	35	SPARE	35	35	SPARE	35
34	22 way iDCDP OPTUS	34	34	SPARE	34	34	SPARE	34	34	SPARE	34	34	SPARE	34
33		33	33	SPARE	33	33	SPARE	33	33	SPARE	33	33	SPARE	33
32		32	32	SPARE	32	32	SPARE	32	32	SPARE	32	32	SPARE	32
31	SPARE	31	31	SPARE	31	31	SPARE	31	31	SPARE	31	31	SPARE	31
30	Optus Hybrid Fibre Termination (H+S)	30	30	SPARE	30	30	SPARE	30	30	SPARE	30	30	SPARE	30
29	Optus Hybrid Fibre Management Tray (H+S)	29	29	SPARE	29	29	SPARE	29	29	SPARE	29	29	SPARE	29
28	Optus Hybrid Fibre Termination (H+S)	28	28	SPARE	28	28	SPARE	28	28	SPARE	28	28	SPARE	28
27	Optus Hybrid Fibre Management Tray (H+S)	27	27	SPARE	27	27	SPARE	27	27	SPARE	27	27	SPARE	27
26	Optus Hybrid Fibre Management Tray (H+S)	26	26	SPARE	26	26	SPARE	26	26	V-DCDU	26	26	SPARE	26
25	SPARE	25	25	SPARE	25	25	SPARE	25	25	VADAFONE BBU	25	25	SPARE	25
24	SPARE	24	24	SPARE	24	24	SPARE	24	24		24	24	SPARE	24
23	SPARE	23	23	SPARE	23	23	SPARE	23	23	SPARE	23	23	SPARE	23
22	22 way iDCDP VODA	22	22	SPARE	22	22	SPARE	22	22	SPARE	22	22	SPARE	22
21		21	21	SPARE	21	21	SPARE	21	21	SPARE	21	21	SPARE	21
20		20	20	SPARE	20	20	SPARE	20	20	SPARE	20	20	SPARE	20
19	SPARE	19	19	SPARE	19	19	SPARE	19	19	SPARE	19	19	SPARE	19
18	Vodafone Hybrid Fibre Termination (H+S)	18	18	SPARE	18	18	SPARE	18	18	SPARE	18	18	SPARE	18
17	SPARE	17	17	SPARE	17	17	SPARE	17	17	SPARE	17	17	SPARE	17
16	SPARE	16	16	SPARE	16	16	SPARE	16	16	SPARE	16	16	SPARE	16
15	SPARE	15	15	SPARE	15	15	SPARE	15	15	SPARE	15	15	SPARE	15
14	SPARE	14	14	SPARE	14	14	SPARE	14	14	SPARE	14	14	SPARE	14
13	SPARE	13	13	SPARE	13	13	SPARE	13	13	SPARE	13	13	SPARE	13
12	SPARE	12	12	FAN / OPTUS BBU / UPEU	12	12	SPARE	12	12	SPARE	12	12	SPARE	12
11	SPARE	11	11	U9 / L7 / L18 / L21 / L26 / UPEU	11	11	SPARE	11	11	SPARE	11	11	SPARE	11
10	SPARE	10	10	O-DCDU(11B)-0-SM/BBU-BLVD	10	10	SPARE	10	10	SPARE	10	10	SPARE	10
9	SPARE	9	9	EMUA	9	9	SPARE	9	9	SPARE	9	9	SPARE	9
8	SPARE	8	8	SPARE	8	8	SPARE	8	8	SPARE	8	8	SPARE	8
7	SPARE	7	7	SPARE	7	7	SPARE	7	7	SPARE	7	7	SPARE	7
6	SPARE	6	6	SPARE	6	6	SPARE	6	6	SPARE	6	6	SPARE	6
5	SPARE	5	5	AIR INLET VENT	5	5	AIR INLET VENT	5	5	AIR INLET VENT	5	5	AIR INLET VENT	5
4	SPARE	4	4		4	4		4	4		4	4		4
3	SPARE	3	3		3	3		3	3		3	3		3
2	SPARE	2	2		2	2		2	2		2	2		2
1	SPARE	1	1		1	1		1	1		1	1		1

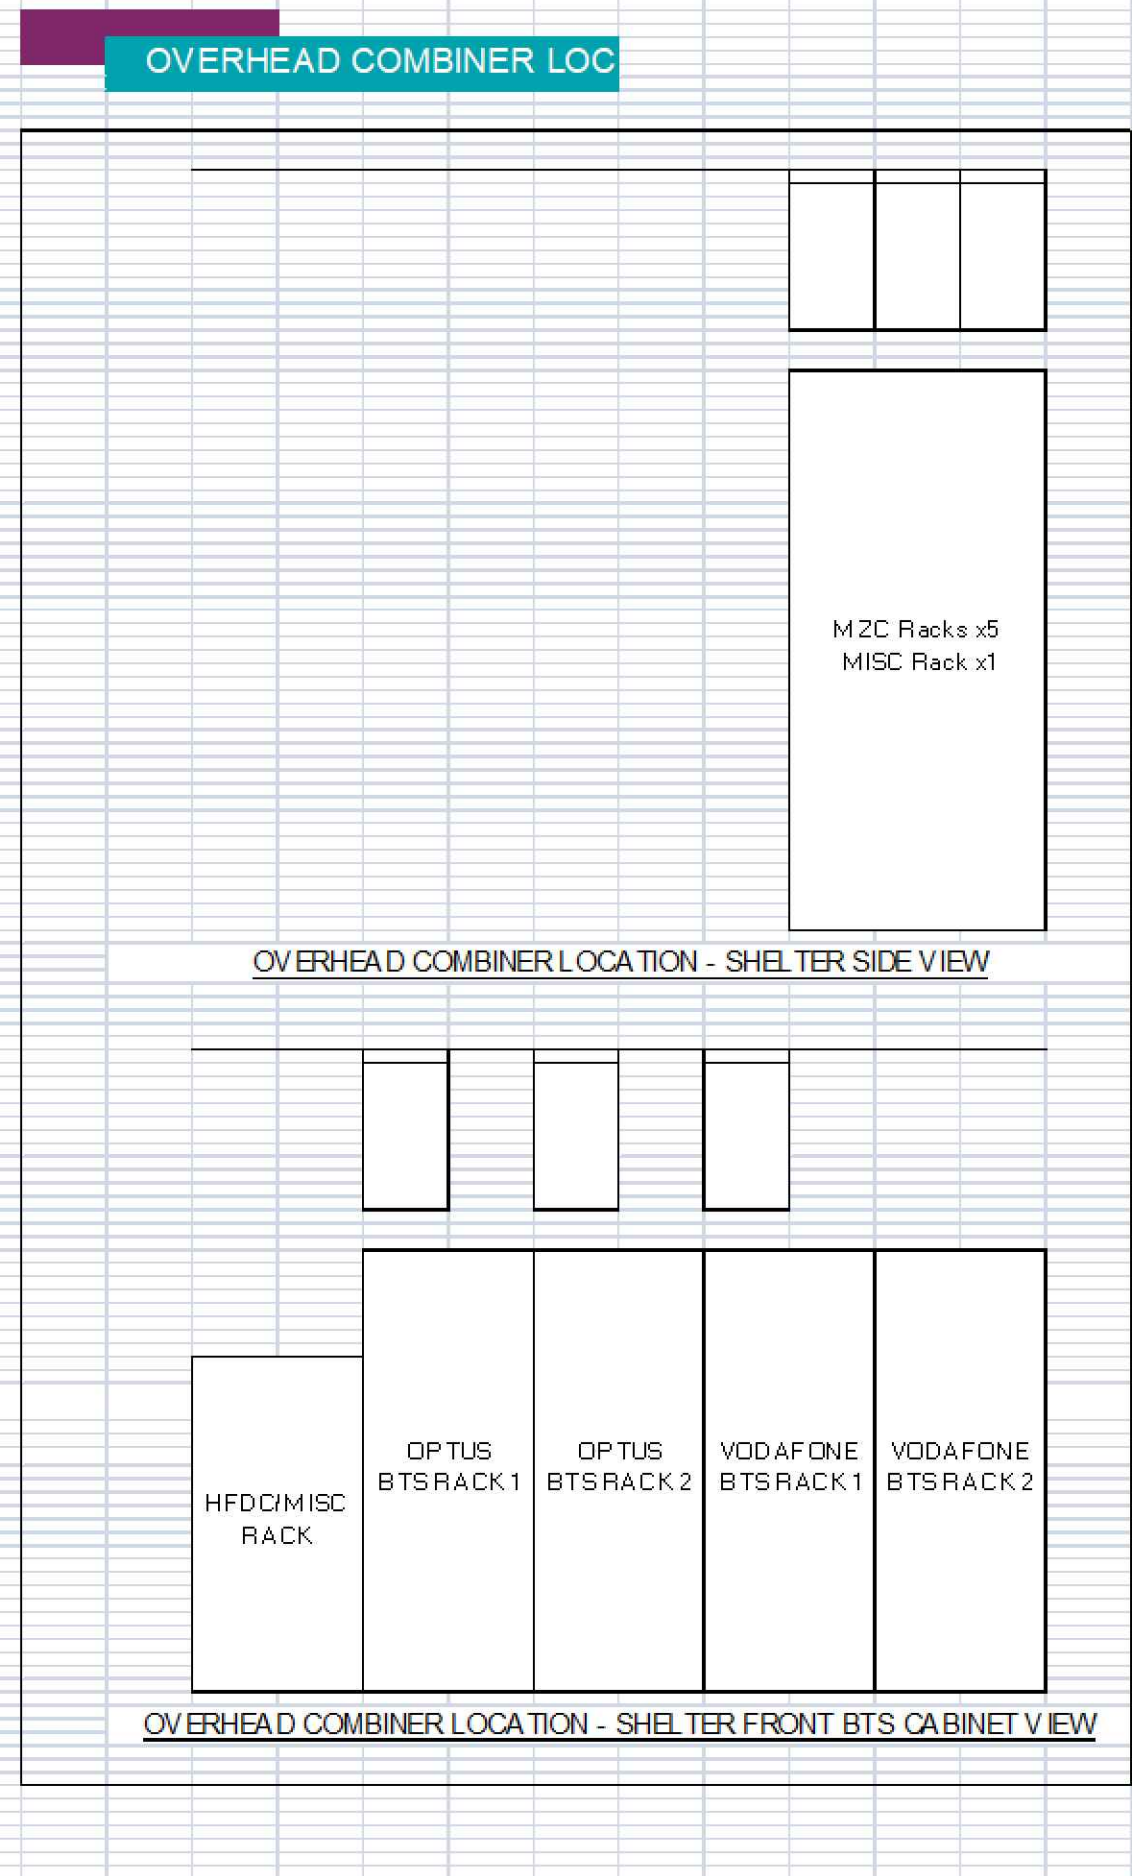

OPTUS SHELTER RACK CONFIGURATION (MZC-001)

NTS

Rev	Date	Revision Details	Consultant	CAD	Designer	Verifier	Approver
AB	09.04.21	AS BUILT	METASITE	AU	JB	GC	PJ
A	28.06.18	ISSUED FOR CONSTRUCTION (EJV GREENFIELD PROJECT)	METASITE	JM	JB	GC	PJ

HUAWEI TECHNOLOGIES (AU) PTY LTD
ABN 49 103 793 380
SYDNEY
LEVEL 6 TOWER B 799 PACIFIC HIGHWAY
CHATSWOOD NSW 2067
TEL: +61 2 9928 3888 FAX: +61 2 9411 8533
MELBOURNE
LEVEL 24 459 COLLINS STREET
MELBOURNE VIC 3000
TEL: +61 3 8610 0600 FAX: +61 3 9621 1575

Client: OPTUS

Project: MOBILE NETWORK AUSTRALIA
SITE No:- H8097
AUSTINS FERRY
2 PLAN 158154 WAKEHURST ROAD

Drawing Title: EQUIPMENT SHELTER LAYOUT PLAN - SHEET 2 OF 2

Drawing Status: AS BUILT

Drawing No. H8097-F1-1

Revision AB

A3

CAD File: C:\Users\SelvaMurugan\OneDrive - All Telecos Pty Ltd\CPS WORKING\New Batch 2025\H8097 Austins Ferry\3 Ph2\1 PH2 INS\H8097-160126-CHILD1.dwg Date: 28.07.2016 9:43 AM