


TRUNCATED SQUARE-PYRAMID UNDERLAKE DATA CENTER STRUCTURE


3 x 2U servers | Backup battery | Vibration isolation | Upper lifting points | Proposed dimensions in mm

(a) Front elevation

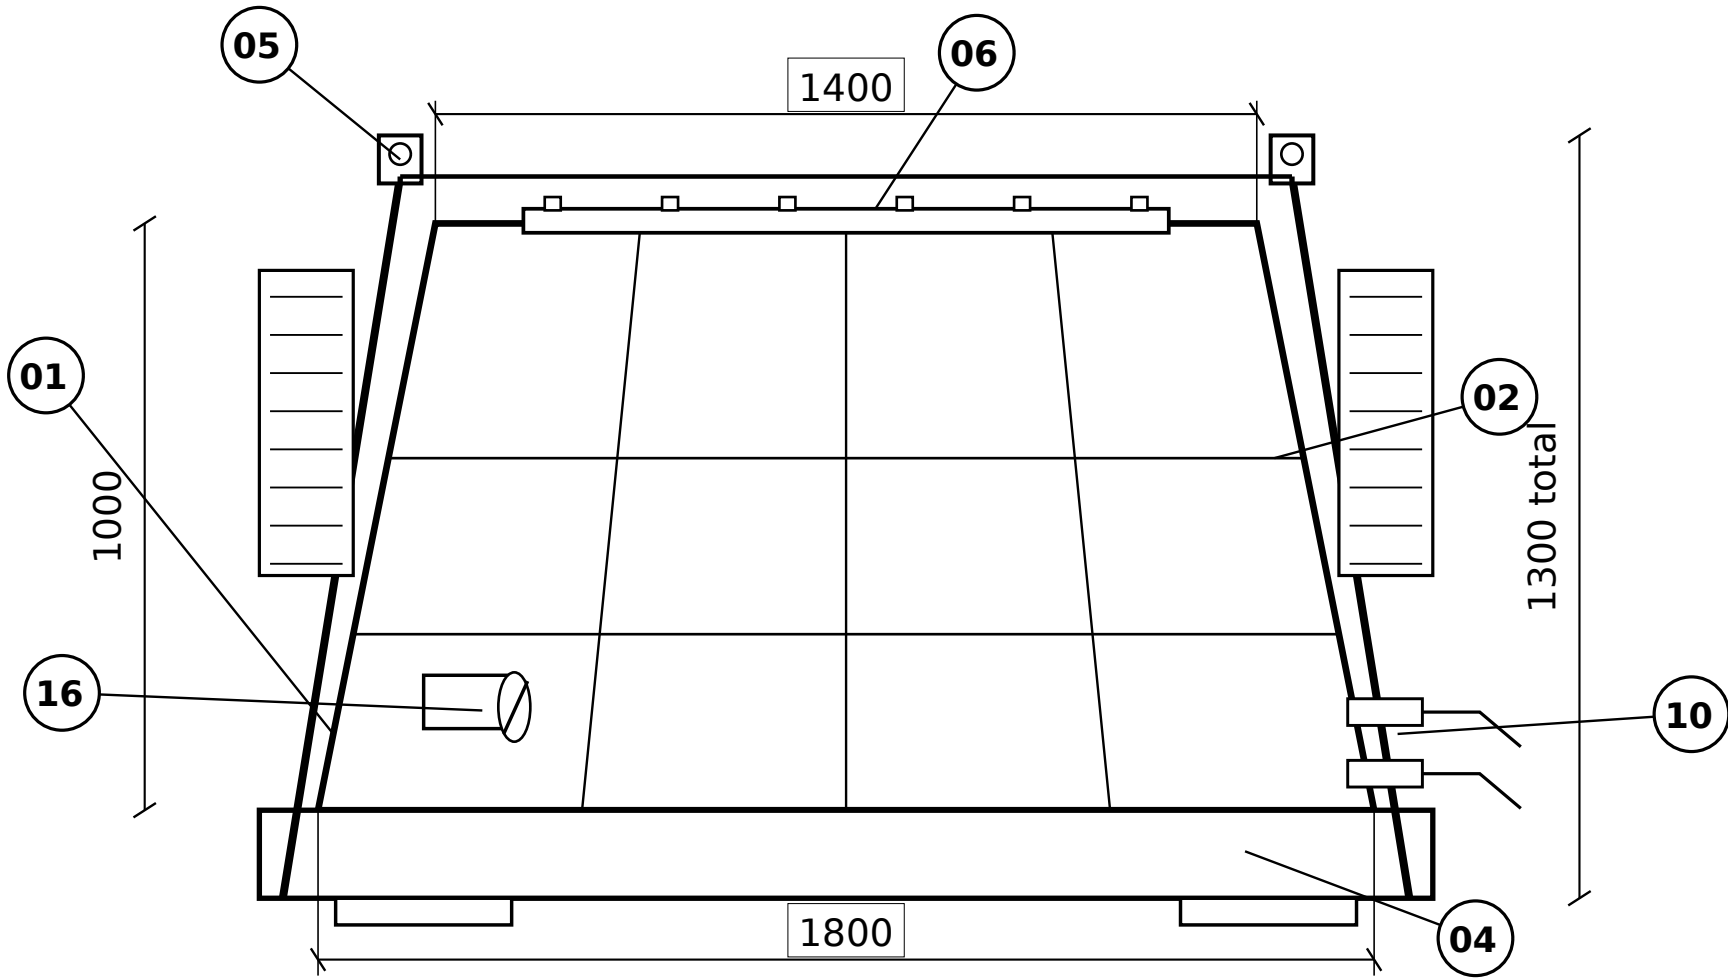


Skid 2000 x 2000; height 150; rigging excluded.

(b) Section A-A

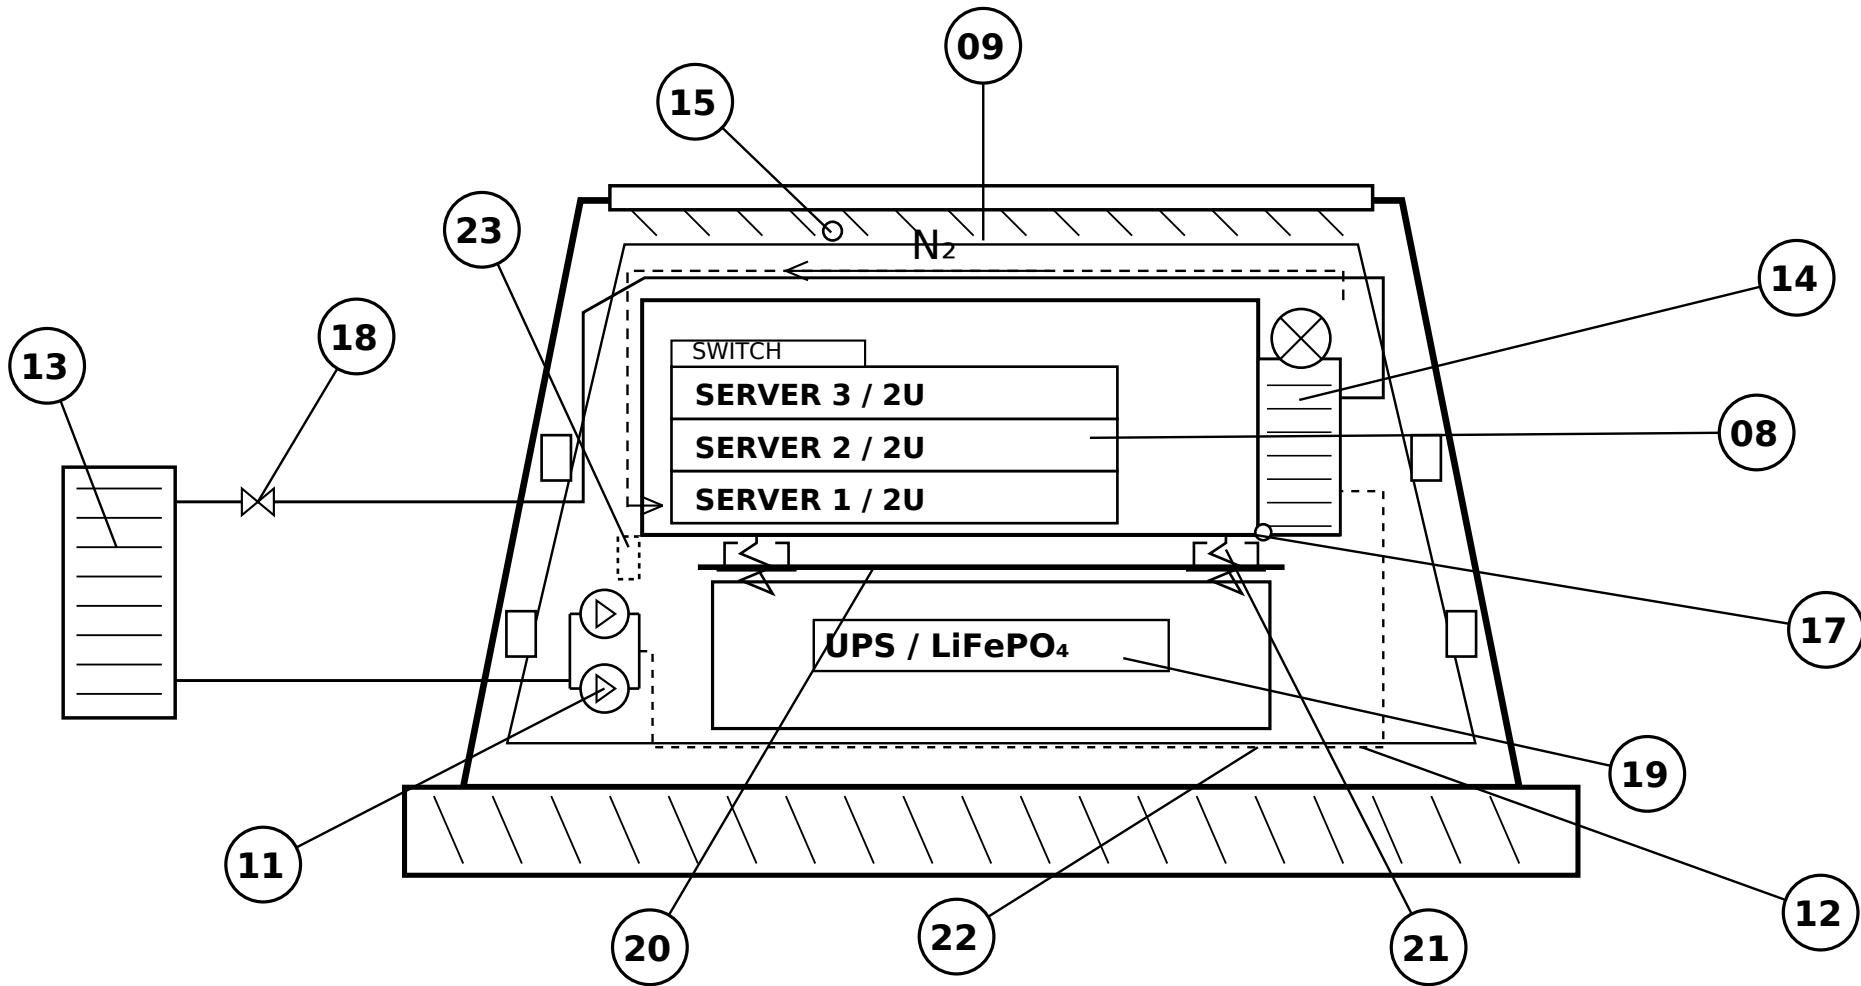


Pumps inside enclosure; projection offset for clarity.

(c) Plan / roof framing

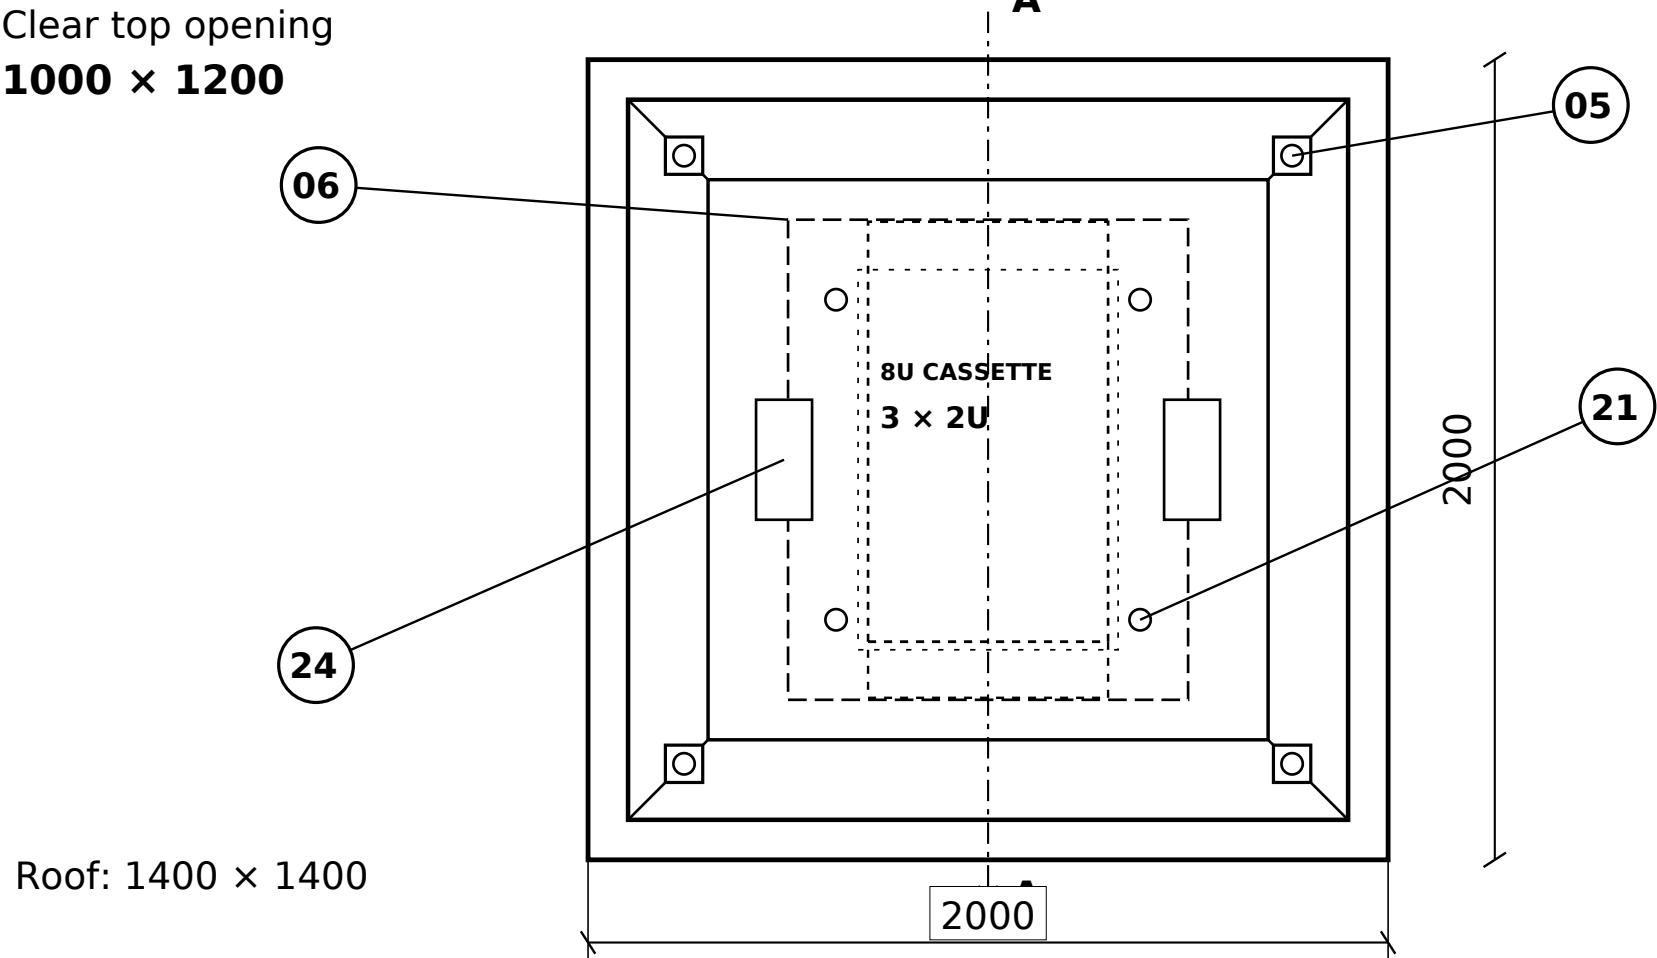

(d) Lid seal and shell detail

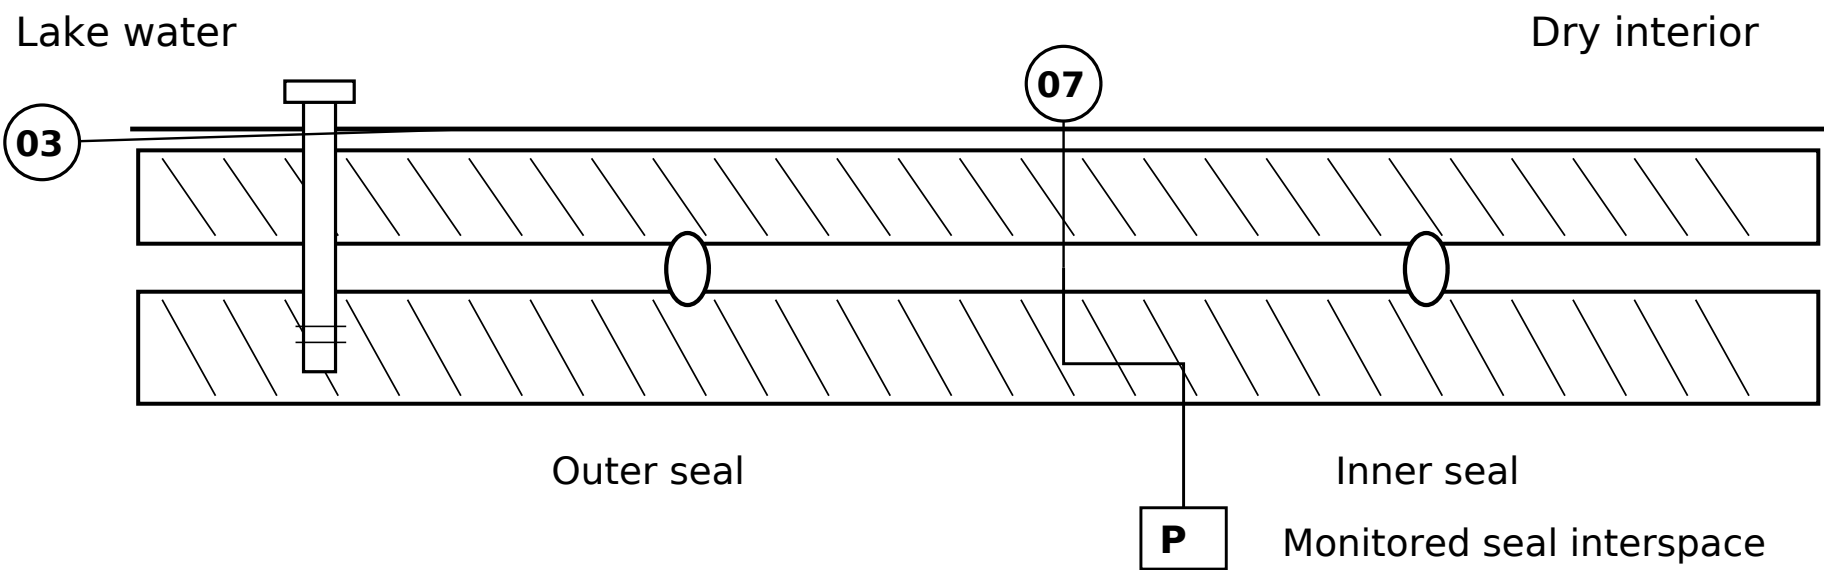

Service only after recovery to the surface. The top lid provides access for rack and battery removal.

Isolators reduce vibration; they do not keep the rack level. Travel, safe tilt and seismic performance require testing.

- 01 Stainless-steel shell; grade TBD
- 02 Structural frame / stiffeners
- 03 Corrosion-protection coating
- 04 Ballast skid and foundation
- 05 4 upper padeyes on load-bearing frame
- 06 Watertight top service lid
- 07 Dual seals + monitored interspace
- 08 3 x 2U servers + SSD/NVMe / 8U cassette

- 09 N₂ atmosphere (OEM approval required)
- 10 A/B power / fibre-optic feedthroughs
- 11 Coolant pumps A/B
- 12 Closed coolant circuit
- 13 External heat exchangers A/B
- 14 Gas-to-liquid coil + fans
- 15 T/RH/O₂/pressure sensors + IMU
- 16 Camera + window + wiper

- 17 Leak collection tray / detectors
- 18 Coolant isolation valves
- 19 UPS + LiFePO₄ battery (optional)
- 20 Battery barrier / cooling bay
- 21 4 captive isolators + snubbers
- 22 Flexible connections + bonding
- 23 Transport / service locks
- 24 PDU / safety controls