



UNDERLAKE DATA CENTER / SITE SECTION AND POWER PROTECTION

Not to scale | Routes, depth, flood level and ratings remain unassigned

01 / LAND - LAKE SECTION

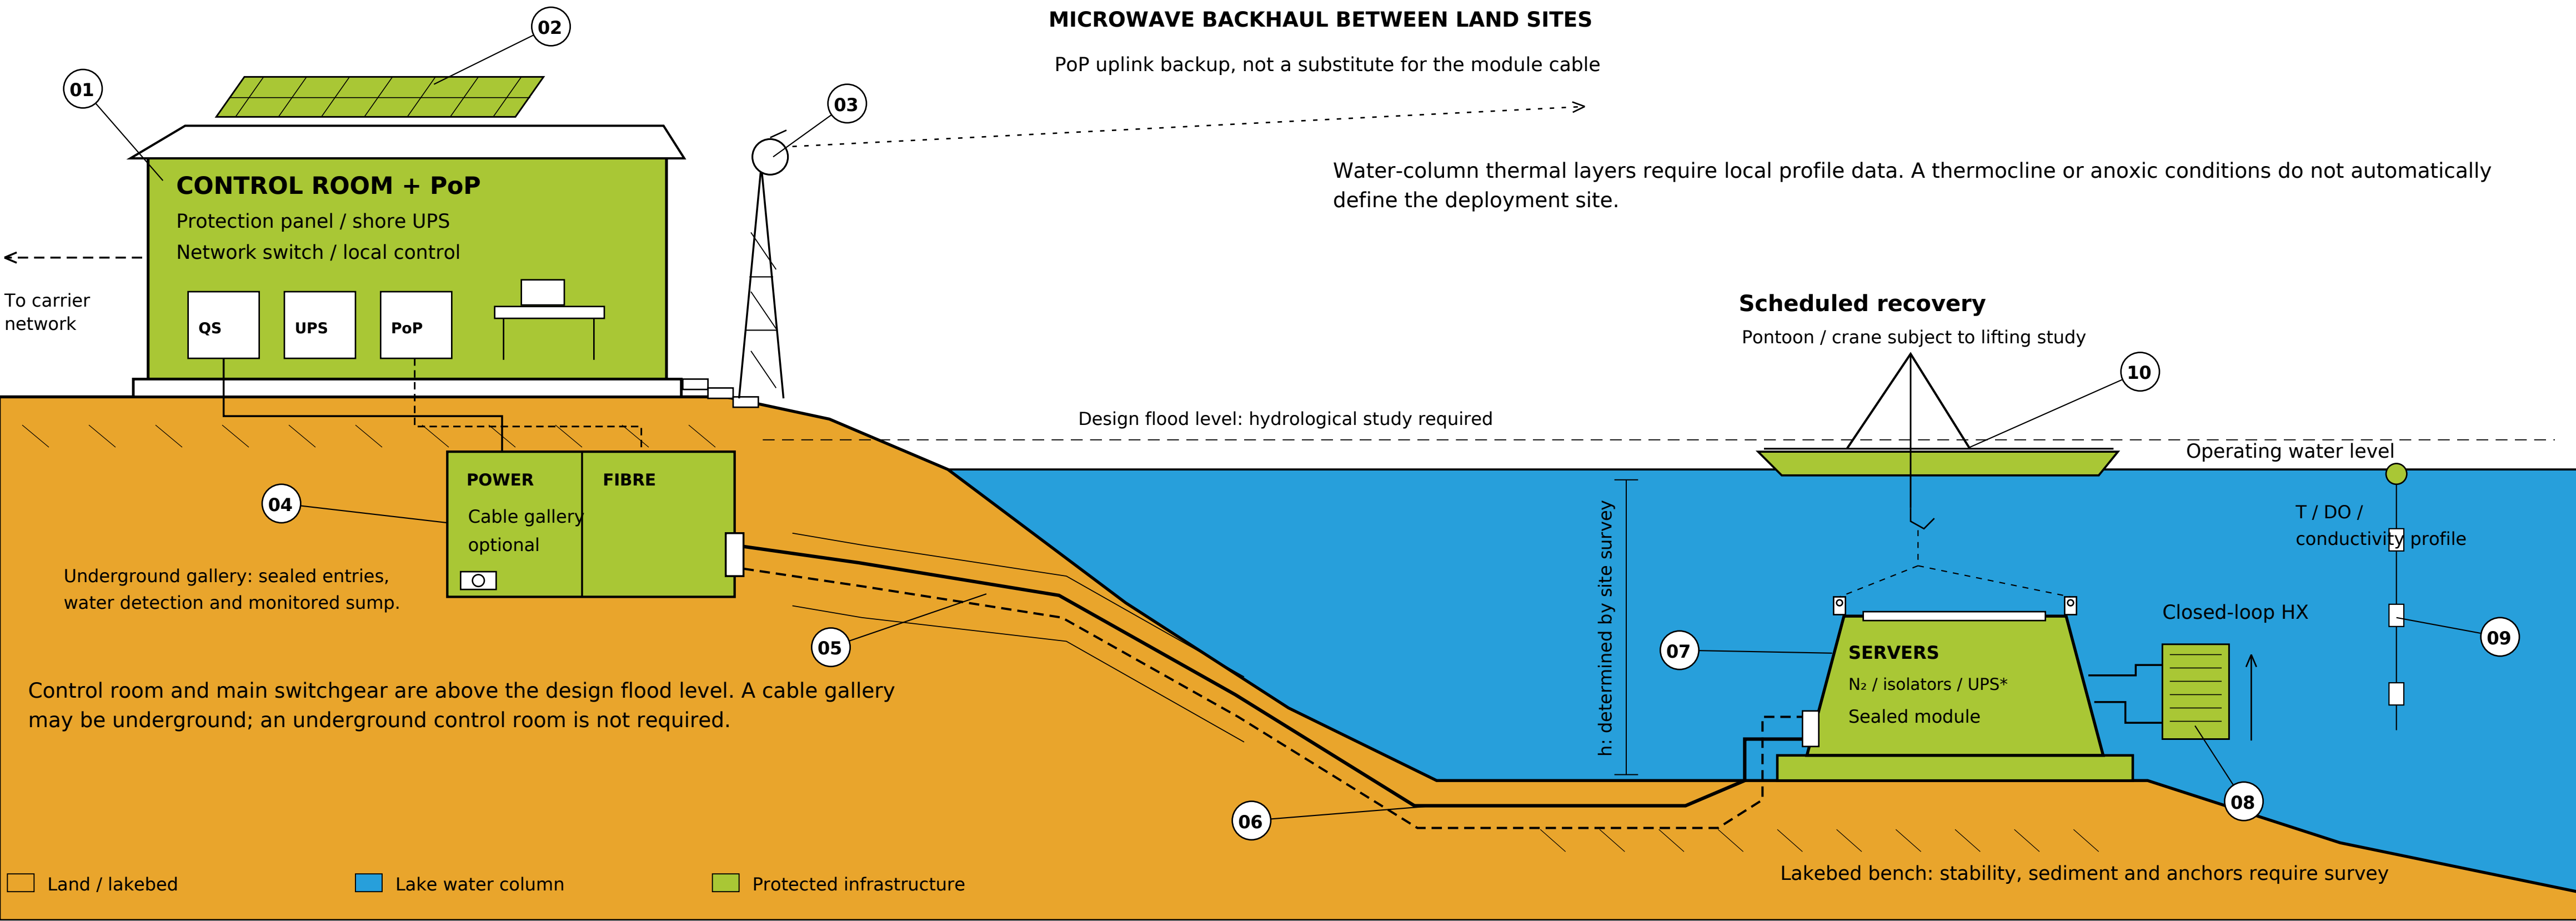

02 / POWER-CABLE PROTECTION PRINCIPLE

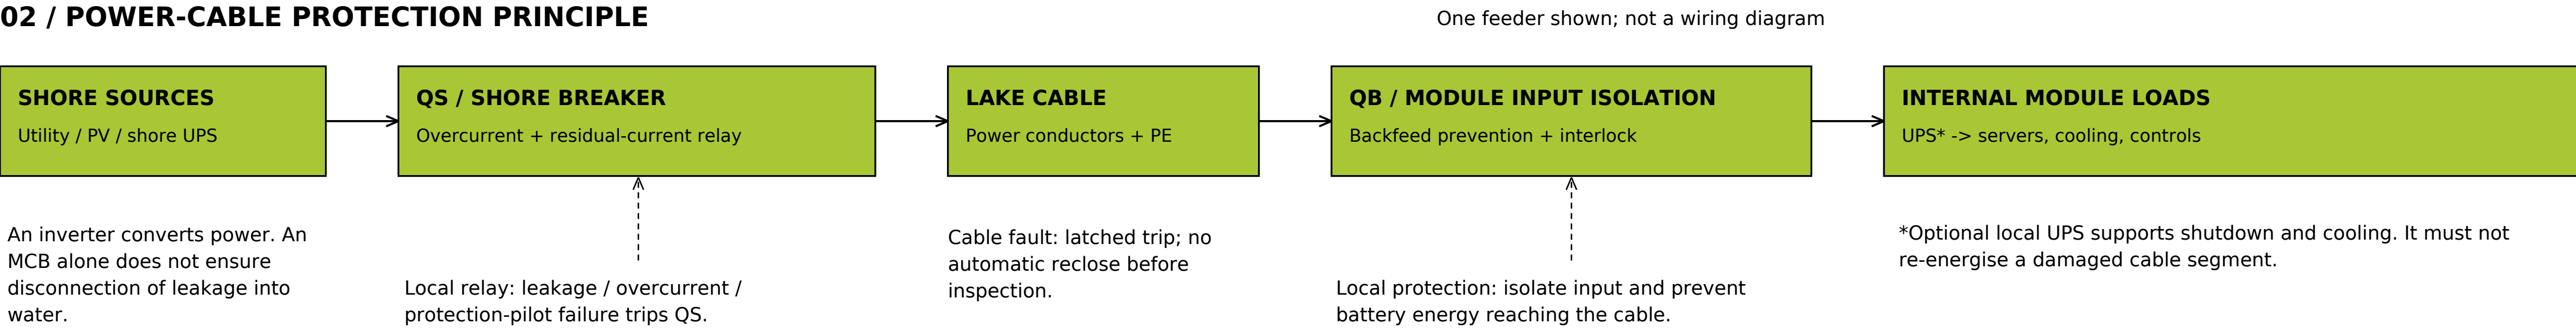

- | | | | | |
|---|--|---|-------------------------------------|---------------------------------------|
| 01 Control room / switchgear / PoP | 02 Rooftop PV, supplementary source | 03 Land-based radio backhaul | 04 Underground cable gallery | 05 Protected landfall and duct |
| 06 Power / fibre on surveyed route | 07 Truncated square-pyramid module | 08 HX, no normal coolant discharge | 09 Lake-condition monitoring | 10 Lifting / recovery access |

Solid route: power. Long-dashed route: fibre. Short-dashed rigging: recovery operation. Diagram routes do not establish geographical A/B diversity.

Concept, not a construction design. Earthing, RCD/relay type, breaker rating, trip time and habitat protection require site-specific calculation and testing.