


Seven-Model Ablation Study — Held-Out Test Set

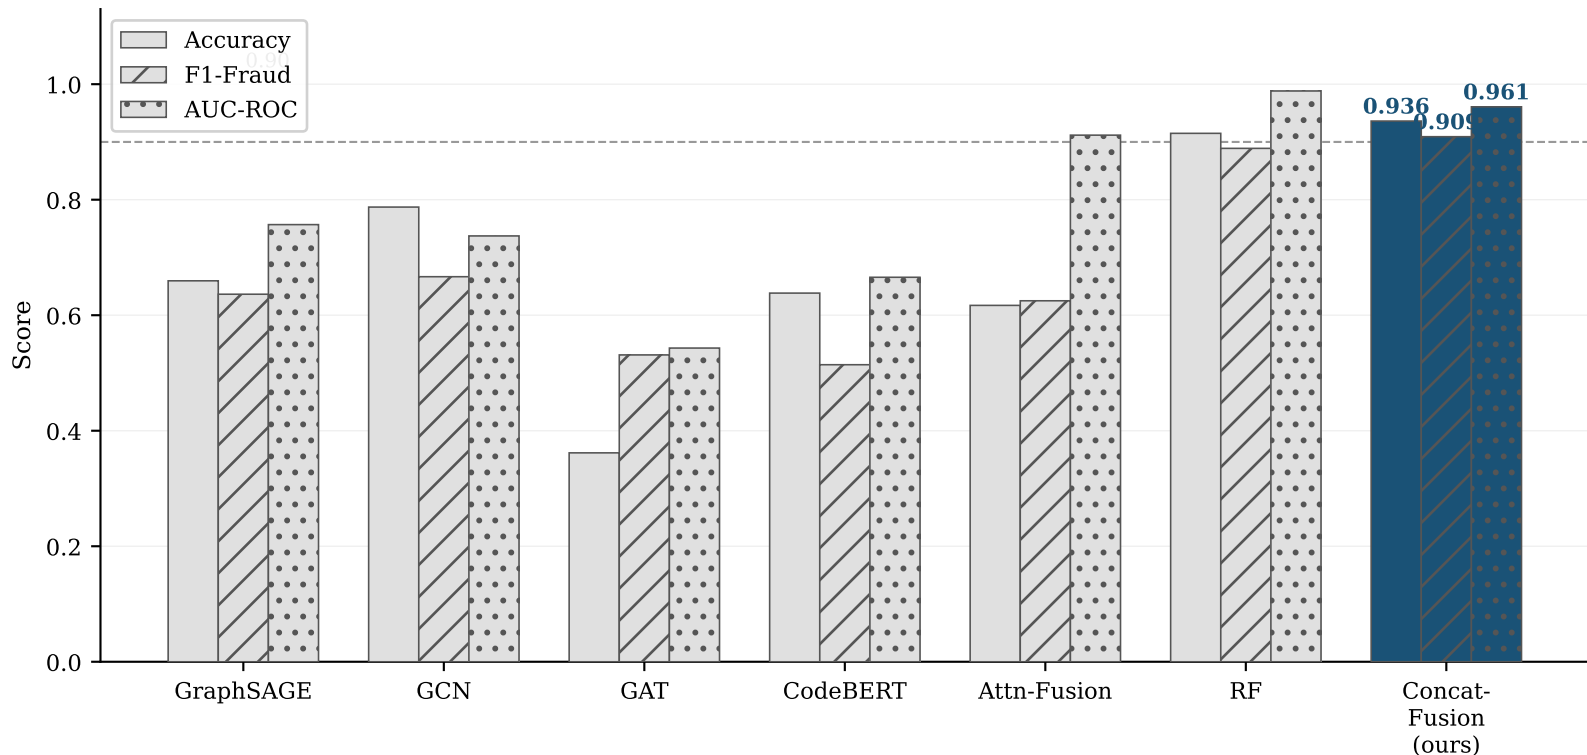

GAT: degenerate prediction (MCC = 0, accuracy = 36.2%)