


Seven-Model Ablation Study — Held-Out Test Set

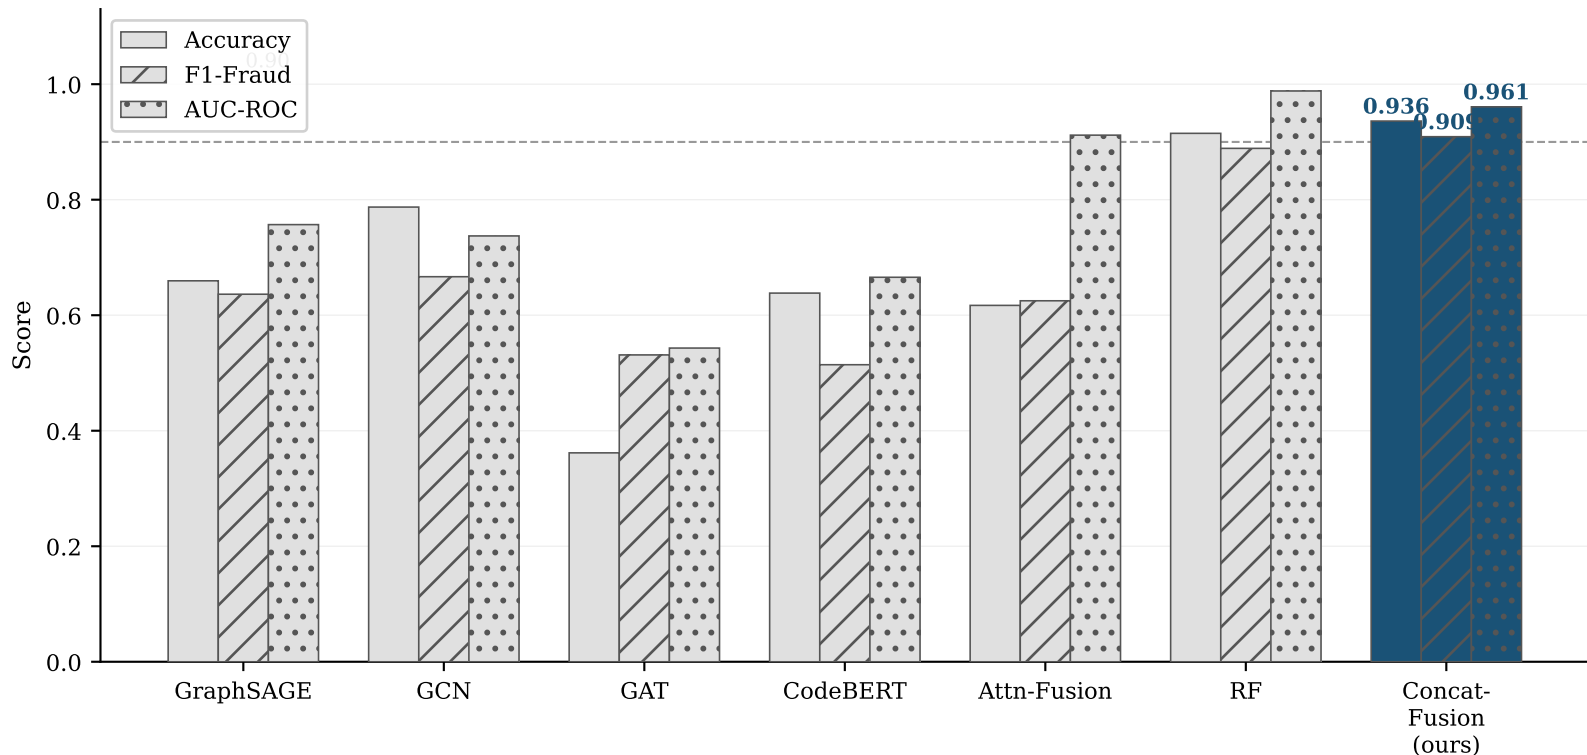

GAT: degenerate prediction ($MCC = 0$, accuracy = 36.2%)