



Softmax Temperature Ablation

Median relative error

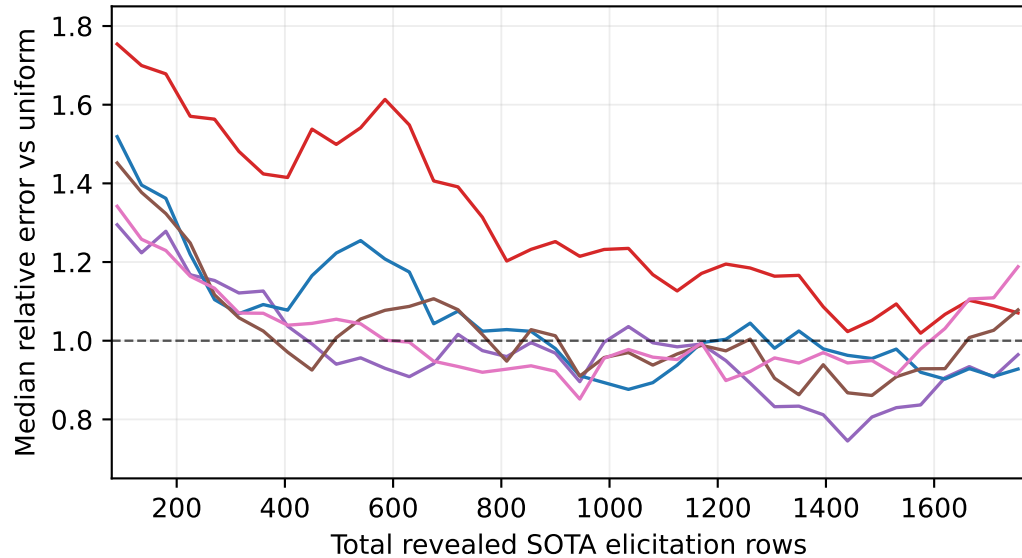

Win rate

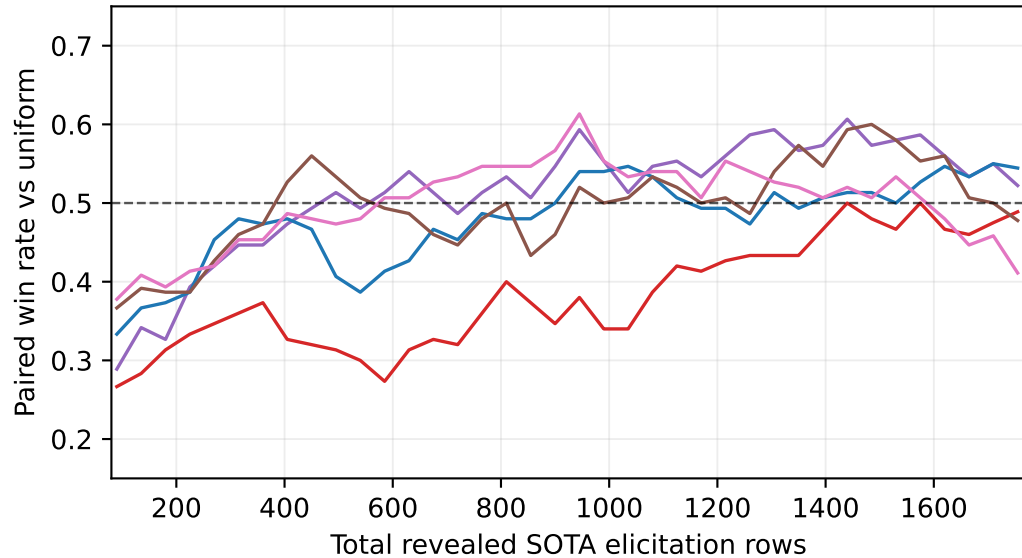

Uniform positive Proportional fragility Softmax T=0.25 Softmax T=2.0 Softmax T=4.0