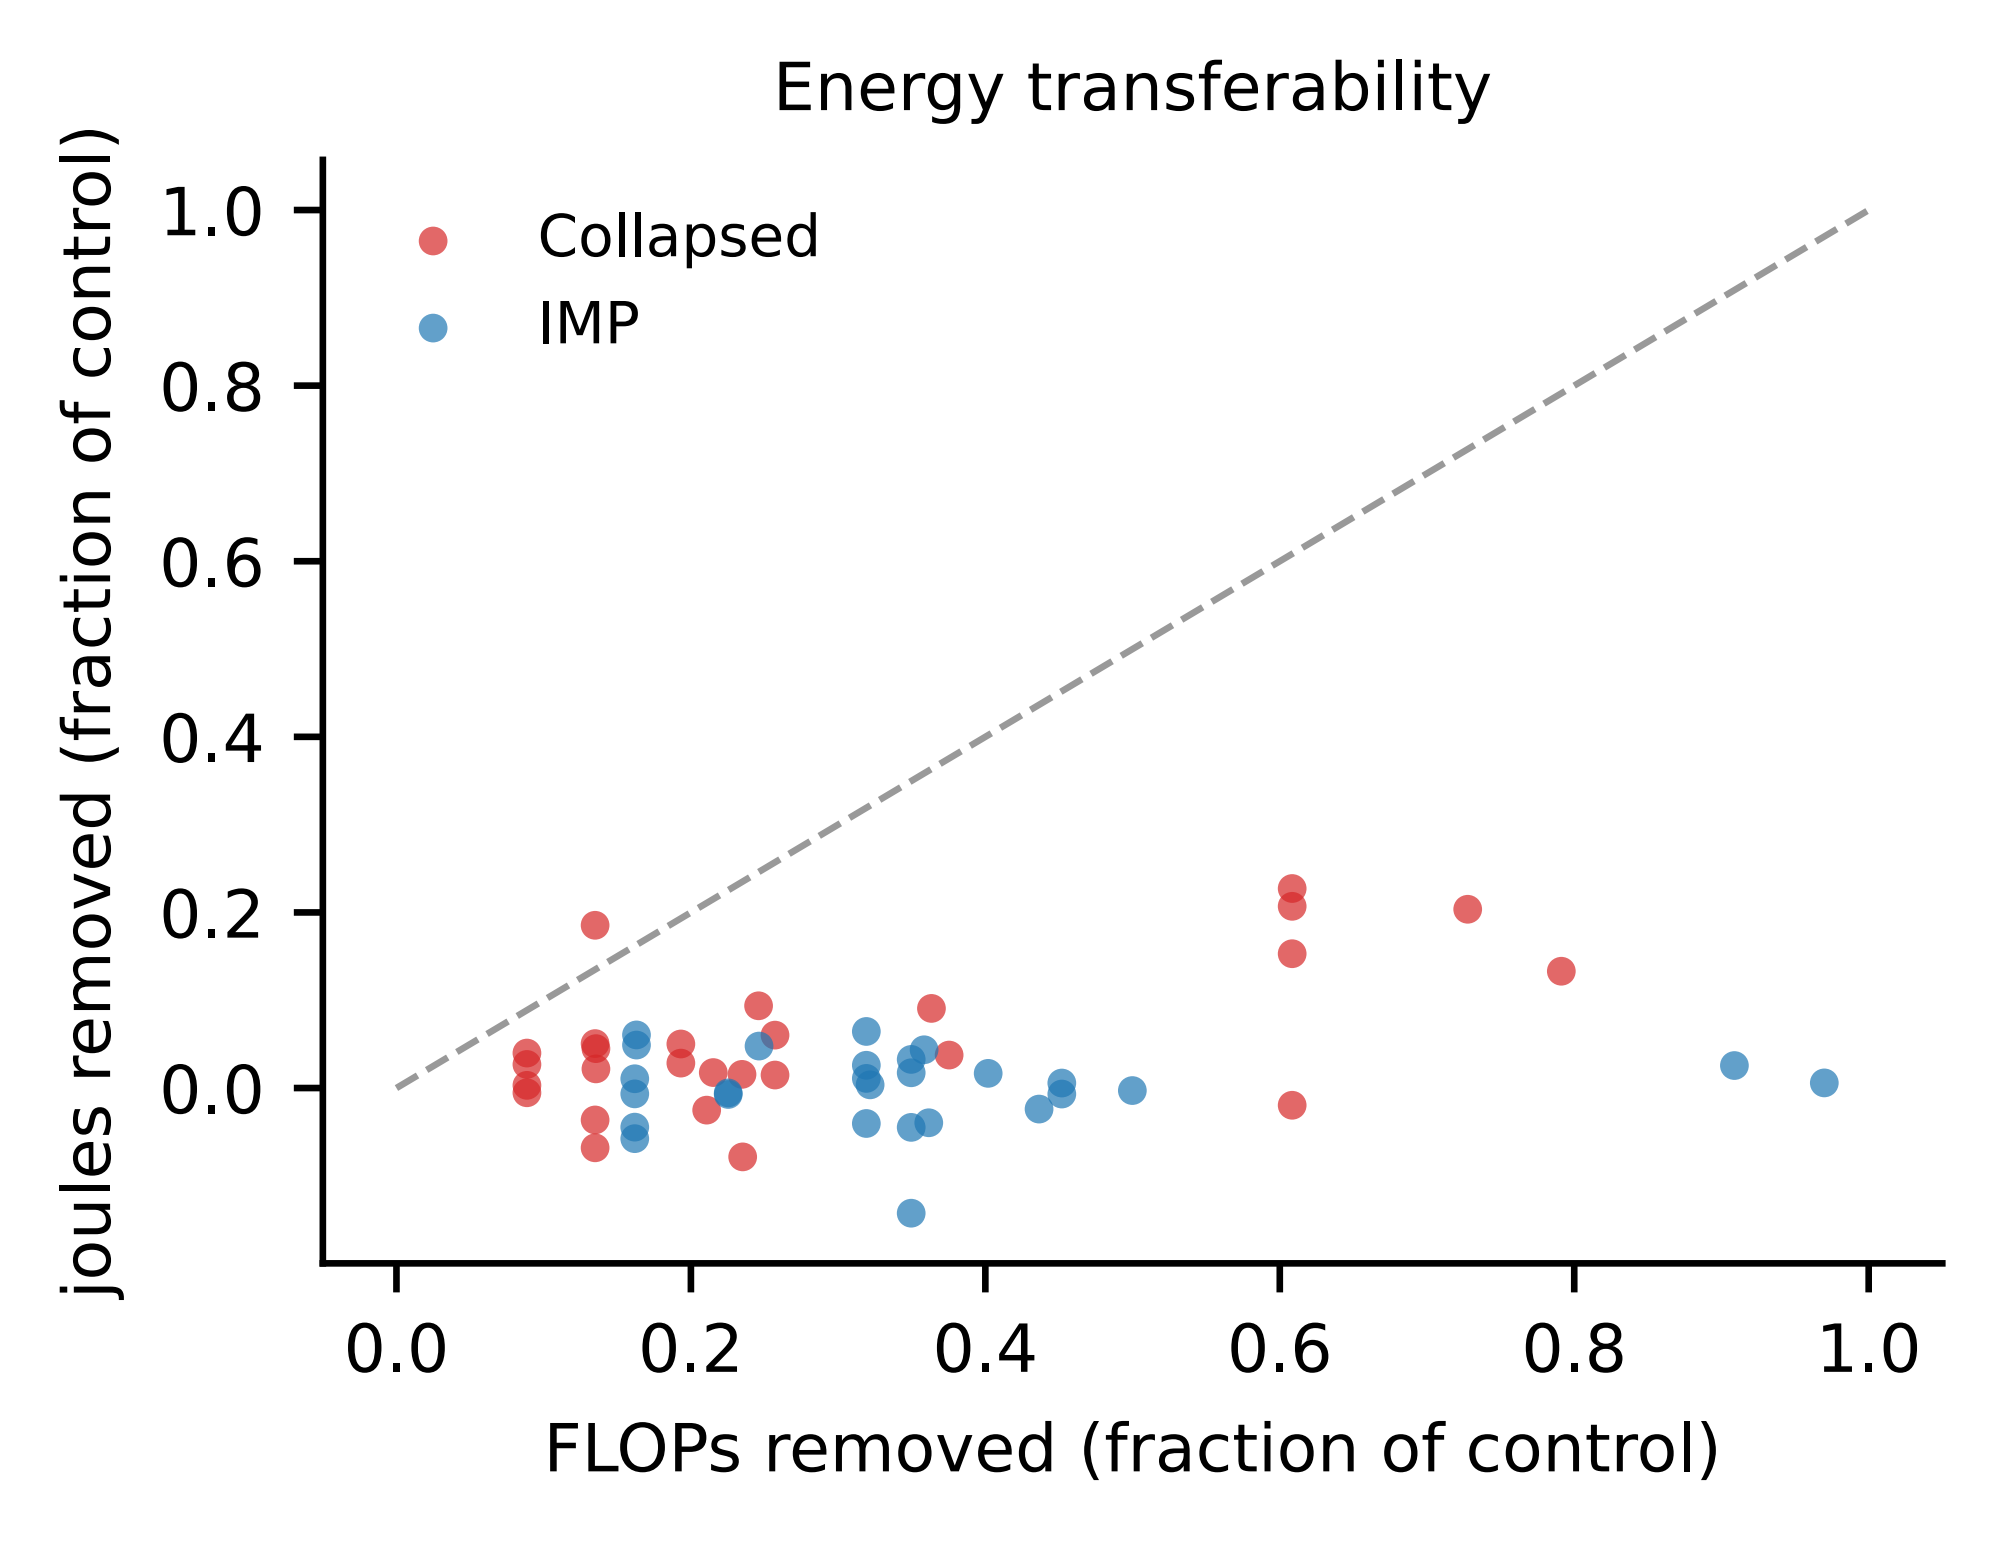
Energy transferability
Collapsed
IMP
joules removed (fraction of control)
FLOPs removed (fraction of control)
1.0
0.8
0.6
0.4
0.2
0.0
0.0
0.2
0.4
0.6
0.8
1.0