
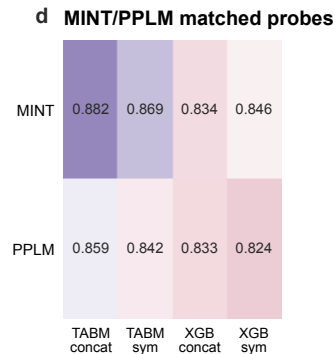
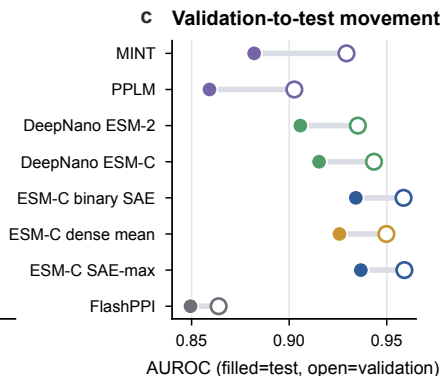
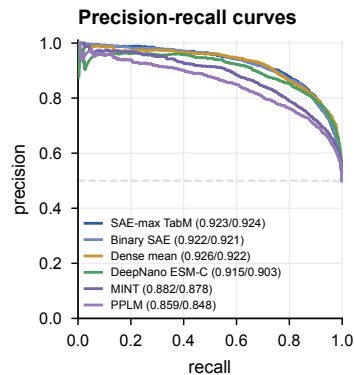
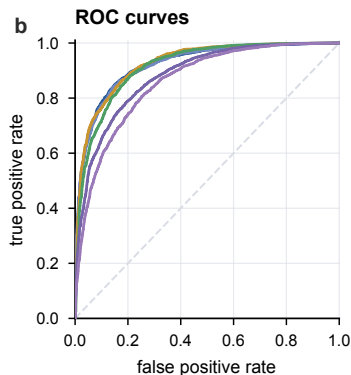


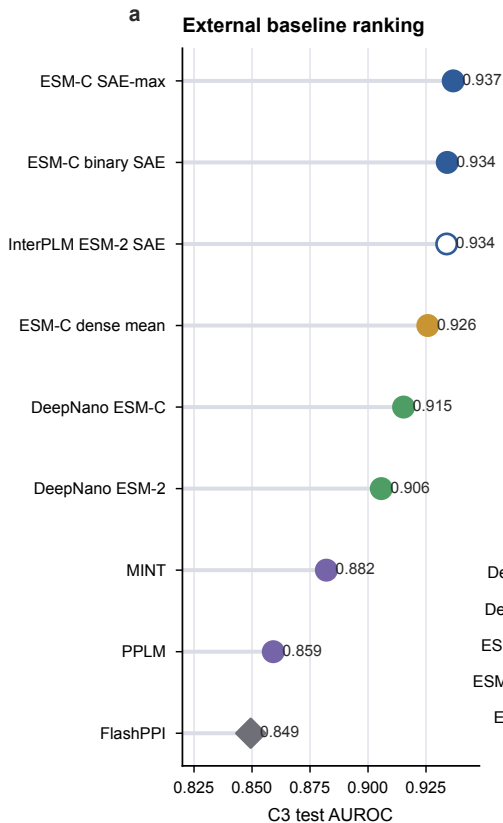

Panel b uses regenerated C3 test scores from saved TabM/DeepNano checkpoints; scalar-only InterPLM-SAE and FlashPPI remain in panel a.