


ablation variant

PA-DSE full (SCF+DFRL)

evidence-hierarchy violation

(a) Bambu (B=30, 24 runs/config)

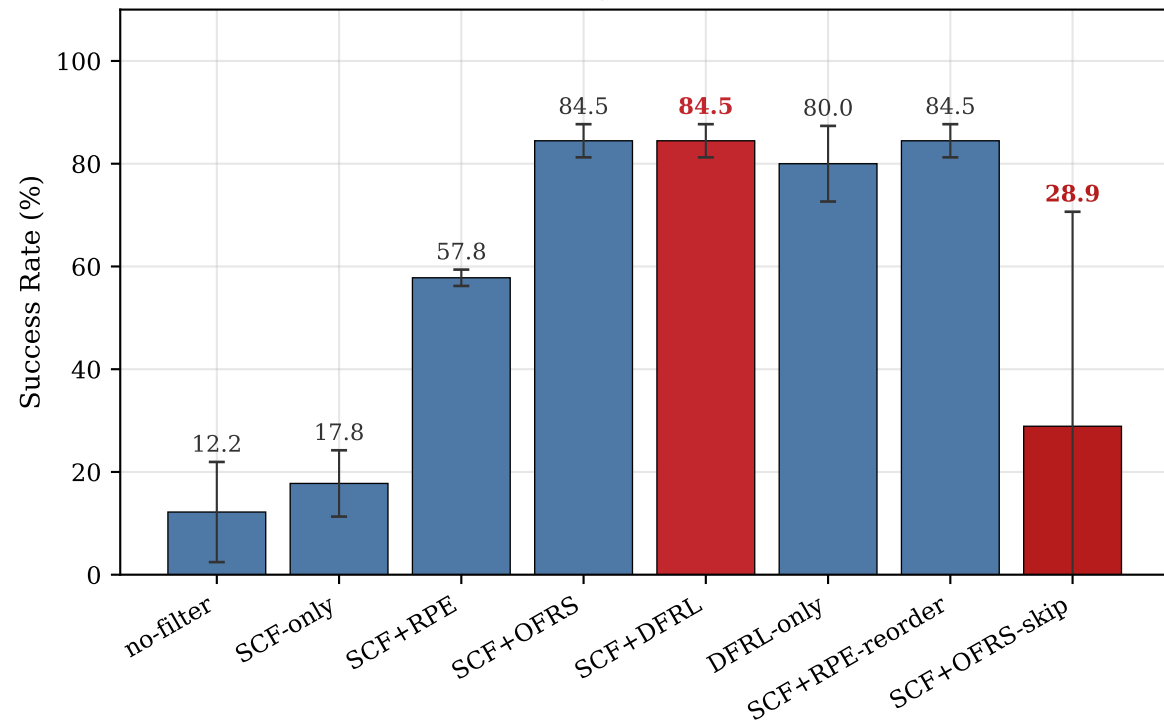

(b) Dynamatic (B=30, 12 runs/config)

