


ablation variant   PA-DSE full (SCF+DFRL)   evidence-hierarchy violation

(a) Bambu (B=30, 24 runs/config)



(b) Dynamic (B=30, 25 runs/config)

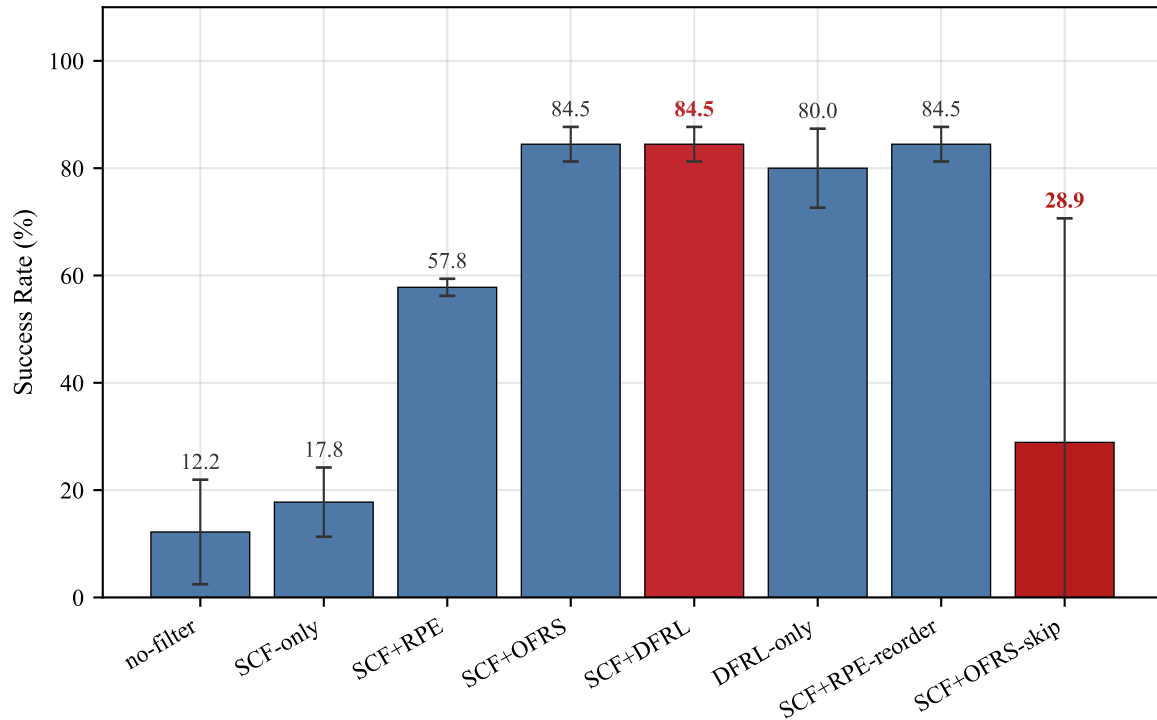