















- Compliance to BS EN/EN50155 and BS EN/EN45545-2 railway standard
- Ultra compact and 1U low profile(25mm)
- 4:1 wide input range
- No minimum load required
- Protections: Short circuit / Overload / Over voltage / Input reverse polarity
- 4000VDC I/O isolation (reinforced isolation)
- · Half encapsulated, cooling by free air convection
- -40~+70°C wide working temperature
- · Built-in constant current limiting circuit
- · LED indicator for power on
- 3 years warranty







Applications

- · Bus,tram,metro or railway system
- Wireless network
- Telecom or datacom system
- Highly vibrating, highly dusty, extremely low or high temperature harsh environment

GTIN CODE


MW Search: https://www.meanwell.com/serviceGTIN.aspx

Description

RSD-30 is a 30W enclosed type DC-DC reliable railway converter. This series is compliant with BS EN/EN50155/ IEC60571 railway standard, constituting three types of models with 4:1 wide but different input ranges 9~36V/18~72V/40~160V, suitable for railway and all kinds of transportation systems exploiting the frequently used standard input voltages such as 12V, 24V, 36V, 48V, 72V, 96V and 110V. Various output voltages, 3.3V, 5V, 12V and 24V are available for selection.

This series has the capability of working under -40~+70°C, low ripple and noise, supreme EMC characteristics, 4KVDC I/P-OP, low enclosure profile 25mm and an interior with semi-potted silicone. It does not only well fits the in-car systems or the facilities by rails for railway, trams and buses but also can be used in the harsh environment with high vibration, high dust, extremely low or high temperature, etc.

Model Encoding





SPECIFICATION

9 ~ 36VDC 84% 1.1A/24V 20A/24VDC		12V 2.5A 0 ~ 2.5A 30W 60mVp-p ±2.0% ±0.3% ±0.3%	24V 1.25A 0 ~ 1.25A 30W 50mVp-p ±2.0% ±0.2% ±0.2%	3.3V 6A 0~6A 19.8W 70mVp-p ±2.0% ±0.5% ±0.5%	5V 6A 0 ~ 6A 30W 70mVp-p ±2.0% ±0.5% ±0.5%	12V 2.5A 0~2.5A 30W 60mVp-p ±2.0% ±0.3%	24V 1.25A 0 ~ 1.25A 30W 50mVp-p ±2.0% ±0.2%						
6A 0 ~ 6A 19.8W ote.2 70mVp-p ote.3 ±2.0% ±0.5% ±0.5% 120ms, 85ms a Please refer to OUS 9 ~ 36VDC 84% 1.1A/24V 20A/24VDC EN50155:2007- EN50155:2017	6A 0 ~ 6A 30W 70mVp-p ±2.0% ±0.5% ±0.5% t full load page 5 Hold up	2.5A 0 ~ 2.5A 30W 60mVp-p ±2.0% ±0.3% ±0.3%	1.25A 0~1.25A 30W 50mVp-p ±2.0% ±0.2%	6A 0~6A 19.8W 70mVp-p ±2.0% ±0.5%	6A 0 ~ 6A 30W 70mVp-p ±2.0% ±0.5%	2.5A 0~2.5A 30W 60mVp-p ±2.0% ±0.3%	1.25A 0~1.25A 30W 50mVp-p ±2.0% ±0.2%						
19.8W lote.2 70mVp-p ote.3 ±2.0% ±0.5% ±0.5% 120ms, 85ms a Please refer to OUS 9 ~ 36VDC 84% 1.1A/24V 20A/24VDC EN50155:2007- EN50155:2017	30W 70mVp-p ±2.0% ±0.5% ±0.5% tfull load page 5 Hold up	30W 60mVp-p ±2.0% ±0.3% ±0.3%	30W 50mVp-p ±2.0% ±0.2% ±0.2%	19.8W 70mVp-p ±2.0% ±0.5%	30W 70mVp-p ±2.0% ±0.5%	30W 60mVp-p ±2.0% ±0.3%	30W 50mVp-p ±2.0% ±0.2%						
tote.2 70mVp-p ote.3 ±2.0% ±0.5% ±0.5% 120ms, 85ms a Please refer to OUS 9 ~ 36VDC 84% 1.1A/24V 20A/24VDC EN50155:2007- EN50155:2017	70mVp-p ±2.0% ±0.5% ±0.5% t full load page 5 Hold up	30W 60mVp-p ±2.0% ±0.3% ±0.3%	50mVp-p ±2.0% ±0.2% ±0.2%	70mVp-p ±2.0% ±0.5%	70mVp-p ±2.0% ±0.5%	60mVp-p ±2.0% ±0.3%	50mVp-p ±2.0% ±0.2%						
tote.2 70mVp-p ote.3 ±2.0% ±0.5% ±0.5% 120ms, 85ms a Please refer to OUS 9 ~ 36VDC 84% 1.1A/24V 20A/24VDC EN50155:2007- EN50155:2017	70mVp-p ±2.0% ±0.5% ±0.5% t full load page 5 Hold up	60mVp-p $\pm 2.0 \%$ $\pm 0.3 \%$ $\pm 0.3 \%$ $\pm 0.3 \%$	50mVp-p ±2.0% ±0.2% ±0.2%	70mVp-p ±2.0% ±0.5%	70mVp-p ±2.0% ±0.5%	60mVp-p ±2.0% ±0.3%	50mVp-p ±2.0% ±0.2%						
bote.3 ±2.0% ±0.5% ±0.5% 120ms, 85ms a Please refer to 0US 9 ~ 36VDC 84% 1.1A/24V 20A/24VDC EN50155:2007- EN50155:2017	±2.0% ±0.5% ±0.5% t full load page 5 Hold up	$\pm 2.0\%$ $\pm 0.3\%$ $\pm 0.3\%$ Time(Load de-	±2.0% ±0.2% ±0.2%	±2.0% ±0.5%	±2.0% ±0.5%	±2.0% ±0.3%	±2.0% ±0.2%						
±0.5% ±0.5% 120ms, 85ms a Please refer to OUS 9 ~ 36VDC 84% 1.1A/24V 20A/24VDC EN50155:2007- EN50155:2017	±0.5% ±0.5% t full load page 5 Hold up	$\pm 0.3\%$ $\pm 0.3\%$ Description Time(Load de-	±0.2% ±0.2%	±0.5%	±0.5%	±0.3%	±0.2%						
±0.5% 120ms, 85ms a Please refer to OUS 9 ~ 36VDC 84% 1.1A/24V 20A/24VDC EN50155:2007- EN50155:2017	±0.5% t full load page 5 Hold up	$\pm 0.3\%$	±0.2%	1 111									
120ms, 85ms a Please refer to 9 ~ 36VDC 84% 1.1A/24V 20A/24VDC EN50155:2007- EN50155:2017	t full load page 5 Hold up	Time(Load de-		20.070	20.070	= 0.070							
Please refer to OUS 9 ~ 36VDC 84% 1.1A/24V 20A/24VDC EN50155:2007- EN50155:2017	page 5 Hold up	,	rating curve)										
0US 9 ~ 36VDC 84% 1.1A/24V 20A/24VDC PPLY EN50155:2007- EN50155:2017	84%	,	rating curve)	Please refer to page 5 Hold up Time(Load de-rating curve)									
84% 1.1A/24V 20A/24VDC EN50155:2007- EN50155:2017		86.5%											
1.1A/24V 20A/24VDC PPLY EN50155:2007-0 EN50155:2017			89%	84%	86%	90%	91%						
20A/24VDC EN50155:2007 EN50155:2017	1.5A/24 V	00.070	0370	0.52A/48V	0.8A/48V	30 /0	3170						
PPLY EN50155:2007-					0.0A/40V								
EN50155:2017	20A/24VDC 20A/48VDC EN50155:2007-G type comply with S1 level(3ms) @full load,S2 level(10ms) @80% load; L type comply with S2 level(10ms) @80% load; L type c						10ms) @full lo						
	*		With load, 32 le	vei(10iiis) @00 //	ioau, L type con	ipiy witti 32 level(roms) with the						
			iora automaticali	ly often fault cand	ition in romavas	<u> </u>							
				ly after fault cond			07.0 00.41						
3.8 ~ 4.5V	5.75 ~ 7V	13.8 ~ 16.2V	1	3.8 ~ 4.5V	5.75 ~ 7V	13.8 ~ 16.2V	27.6 ~ 32.4\						
				1: 170°C /	d C 20	4							
,	, , , , , , , , , , , , , , , , , , , ,												
	-40 ~ +85°C												
	±0.03%/°C (0~50°C)												
	3 10min./1cycle,	60min. each alo	ng X, Y, Z axes ;	Mounting : compl	iance to IEC613	373							
	IEC 62368-1, UL 62368-1, AS/NZS 62368-1, EAC TP TC 004 approved, Design refer to BS EN/EN62368-1												
I/P-O/P:4KVD0	I/P-O/P:4KVDC I/P-FG:2.5KVDC O/P-FG:2.5KVDC												
,	I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25°C/ 70% RH												
Parameter					Test Lev	vel / Note							
Conducted				Class A									
Radiated				Class B	В								
Harmonic Cur	Harmonic Current BS EN/EN61000-3-		2										
Voltage Flicker	Voltage Flicker BS EN/EN61000-3-												
BS EN/EN5503	BS EN/EN55035												
Parameter	Parameter Standard			Test Level / Note		vel / Note							
ESD	ESD		BS EN/EN61000-4-2		Level 3, \pm 8KV air ; Level 3, \pm 6KV cor		3, ±6KV conta						
Radiated Field	Radiated Field BS EN/EN61		EN/EN61000-4-3	I/EN61000-4-3		Level X, 20V/m							
EET / Donnet		DC.I	PS EN/EN61000 4 4		Level 3,	Level 3, 2KV at power							
EF1/Burst	EFT / Burst BS EN/EN61000-4-		ł	Level 4,	Level 4, 2KV at signal								
Surge		BSI	BS EN/EN61000-4-5		Level 3,1KV Line-Line, Level 3, 2KV Line-E		3, 2KV Line-Ea						
Conducted	Conducted BS EN/EN61000-4-		6 Level 3										
Compliance to BS							V50121-3-2 for EN						
-						,							
			,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,,										
	,	Γ											
	-40 ~ +55°C (nd 5 ~ 95% RH no -40 ~ +85°C ±0.03%/°C (0 10 ~ 500Hz, 56 5000 meters IEC 62368-1, U I/P-O/P:4KVDO EI/P-O/P, I/P-FG Parameter Conducted Radiated Harmonic Curry Voltage Flicker BS EN/EN5503 Parameter ESD Radiated Field EFT / Burst Surge Conducted Compliance to BS 3093.5K hrs mi 113*60*25mm 0.25Kg; 56pcs/ecially mentioned are	-40 ~ +55°C (no derating); +70 5 ~ 95% RH non-condensing -40 ~ +85°C ±0.03%/°C (0 ~ 50°C) 10 ~ 500Hz, 5G 10min./1cycle, 5000 meters IEC 62368-1, UL 62368-1, AS/I I/P-O/P:4KVDC I/P-FG:2.5K I/P-O/P, I/P-FG, O/P-FG:100M Parameter Conducted Radiated Harmonic Current Voltage Flicker BS EN/EN55035 Parameter ESD Radiated Field EFT / Burst Surge Conducted Compliance to BS EN/EN45545-2 fc 3093.5K hrs min. Telcordia 113*60*25mm (L*W*H) 0.25Kg; 56pcs/15Kg/0.81CUF* ecially mentioned are measured at 2	-40 ~ +55°C (no derating) ; +70°C @ 60% load load load load load load load load	5 ~ 95% RH non-condensing -40 ~ +85°C ±0.03%/°C (0 ~ 50°C) 10 ~ 500Hz, 5G 10min./1cycle, 60min. each along X, Y, Z axes; 5000 meters IEC 62368-1, UL 62368-1, AS/NZS 62368-1, EAC TP TC 004 approximately 1/P-O/P:4KVDC I/P-FG:2.5KVDC O/P-FG:2.5KVDC I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25°C / 70% RH Parameter Standard Conducted BS EN/EN55032 Radiated BS EN/EN55032 Radiated BS EN/EN55032 Radiated BS EN/EN55035 Parameter Standard ESD BS EN/EN61000-3-3 BS EN/EN61000-4-3 Radiated Field BS EN/EN61000-4-5 BS EN/EN61000-4-5 Conducted BS EN/EN61000-4-5 Surge BS EN/EN61000-4-5 Surge BS EN/EN61000-4-5 Surge Conducted Compliance to BS EN/EN45545-2 for fire protection; BS EN/EN50155 / IEC 3093.5K hrs min. Telcordia SR-332 (Bellcore); 396.9K hrs min 113*60*25mm (L*W*H) 0.25Kg; 56pcs/15Kg/0.81CUFT ecially mentioned are measured at 24,48VDC input, rated load and	-40 ~ +55°C (no derating); +70°C @ 60% load by free air convection; +70°C (no 5 ~ 95% RH non-condensing -40 ~ +85°C ±0.03%/°C (0 ~ 50°C) 10 ~ 500Hz, 5G 10min./1cycle, 60min. each along X, Y, Z axes; Mounting: compl 5000 meters IEC 62368-1, UL 62368-1, AS/NZS 62368-1, EAC TP TC 004 approved, Design refer I/P-O/P:4KVDC I/P-FG:2.5KVDC O/P-FG:2.5KVDC I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25°C / 70% RH Parameter Standard Conducted BS EN/EN55032 Radiated BS EN/EN55032 Harmonic Current BS EN/EN61000-3-2 Voltage Flicker BS EN/EN61000-3-3 BS EN/EN55035 Parameter Standard ESD BS EN/EN61000-4-2 Radiated Field BS EN/EN61000-4-2 Radiated Field BS EN/EN61000-4-3 EFT / Burst BS EN/EN61000-4-5 Conducted BS EN/EN61000-4-6 Compliance to BS EN/EN454545-2 for fire protection; BS EN/EN50155 / IEC60571 including IEC 3093.5K hrs min. Telcordia SR-332 (Bellcore); 396.9K hrs min. MIL-HDBK-113*60*25m (L*W*H) 0.25Kg; 56pcs/15Kg/0.81CUFT ecially mentioned are measured at 24,48VDC input, rated load and 25°C of ambient	-40 ~ +55°C (no derating); +70°C @ 60% load by free air convection; +70°C (no derating with existed by the exis	-40 ~ +55°C (no derating); +70°C @ 60% load by free air convection; +70°C (no derating with external base plate 5 ~ 95% RH non-condensing -40 ~ +85°C ± 0.03%/°C (0 ~ 50°C) 10 ~ 500Hz, 5G 10min./1cycle, 60min. each along X, Y, Z axes; Mounting: compliance to IEC61373 5000 meters IEC 62368-1, UL 62368-1, AS/NZS 62368-1, EAC TP TC 004 approved, Design refer to BS EN/EN62368-1 I/P-O/P;4KVDC //P-FG:2.5KVDC 0/P-FG:2.5KVDC I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25°C 70% RH Parameter Standard Test Level / Note Conducted BS EN/EN55032 Class A Radiated BS EN/EN55032 Class B Harmonic Current BS EN/EN55032 Class B Harmonic Current BS EN/EN61000-3-2 Voltage Flicker BS EN/EN61000-3-3 BS EN/EN55035 Parameter Standard Test Level / Note ESD BS EN/EN61000-4-2 Level 3, ±8KV air; Level Radiated Field BS EN/EN61000-4-3 Level 3, ±8KV air; Level EFT / Burst BS EN/EN61000-4-4 EFT / Burst BS EN/EN61000-4-5 Level 3, 1KV Line-Line, Level Conducted BS EN/EN61000-4-6 Level 3 Compliance to BS EN/EN45545-2 for fire protection; BS EN/EN50155 / IEC60571 including IEC61373 for shock & vibration, BS EN/EN 13*60*25mm (L*W*H) 0.25Kg; 56pcs/15Kg/0.81CUFT ecially mentioned are measured at 24,48VDC input, rated load and 25°C of ambient temperature.						




SPECIFICATION

MODEL		RSD-30H-3.3	RSD-30H	-5	RSD-30H-12		RSD-30H-24		
	DC VOLTAGE	3.3V	5V		12V		24V		
OUTPUT	RATED CURRENT	6A	6A		2.5A		1.25A		
	CURRENT RANGE	0 ~ 6A	0 ~ 6A		0 ~ 2.5A		0 ~ 1.25A		
	RATED POWER	19.8W	30W		30W		30W		
	RIPPLE & NOISE (max.) Note.2	70mVp-p	70mVp-p		60mVp-p		50mVp-p		
	VOLTAGE TOLERANCE Note.3		±2.0%		±2.0%		±2.0%		
	LINE REGULATION	±0.5%	±0.5%		±0.3%		±0.2%		
	LOAD REGULATION	±0.5%	±0.5%		±0.3%		±0.2%		
	SETUP, RISE TIME	120ms, 85ms at full load							
	HOLD UP TIME (Typ.)	Please refer to page 5 Hold u	ıp Time(Load						
	VOLTAGE RANGE CONTINUOUS								
	EFFICIENCY (Typ.)	87%	87%		89%		89%		
	DC CURRENT (Typ.)	0.23A/110V	0.35A/110)V	I		1		
INPUT	INRUSH CURRENT (Typ.)	20A/110VDC							
	INTERDURTION OF VOLTAGE CURRLY	EN50155:2007-H-type comp	ply with S2 le	evel(10ms) @ full loa	d				
	INTERRUPTION OF VOLTAGE SUPPLY	EN50155:2017-Comply with	S1 level						
		105 ~ 135% rated output power							
	OVERLOAD	Protection type : Constant cur	rent limiting,	recovers automatically	after fault condition is	removed			
PROTECTION		3.8 ~ 4.5V	5.75 ~ 7V	,	13.8 ~ 16.2V		27.6 ~ 32.4V		
	OVER VOLTAGE	Protection type : Shut down o/	/p voltage, re-	power on to recover					
	WORKING TEMP.				tion ; +70°C (no derati	ng with exte	ernal base plate)		
	WORKING HUMIDITY	-40 ~ +55°C (no derating); +70°C @ 60% load by free air convection; +70°C (no derating with external base plate) 5 ~ 95% RH non-condensing							
	STORAGE TEMP.	-40 ~ +85°C							
ENVIRONMENT	TEMP. COEFFICIENT	±0.03%/°C (0~50°C)							
	VIBRATION	10 ~ 500Hz, 5G 10min./1cycle, 60min. each along X, Y, Z axes; Mounting: compliance to IEC61373							
	OPERATING ALTITUDE	5000 meters							
	SAFETY STANDARDS	IEC 62368-1, UL 62368-1, AS/NZS 62368-1, EAC TP TC 004 approved, Design refer to BS EN/EN62368-1							
	WITHSTAND VOLTAGE	I/P-O/P:4KVDC I/P-FG:2.5KVDC O/P-FG:2.5KVDC							
	ISOLATION RESISTANCE	I/P-O/P, I/P-FG, O/P-FG:100M Ohms / 500VDC / 25°C / 70% RH							
				Standard		Test Leve	I / Note		
	EMC EMISSION	Conducted BS EN/EN55032		BS EN/EN55032		Class A			
		Radiated BS EN/EN55032			Class B				
		Harmonic Current		BS EN/EN61000-3-2					
		Voltage Flicker		BS EN/EN61000-3-3					
SAFETY &		BS EN/EN55035							
EMC (Note 4)	EMC IMMUNITY	Parameter	Standard Test Level / No		I / Note				
(NOTE 4)		ESD	BS EN/EN61000-4-2		Level 3, \pm 8KV air ; Level 3, \pm 6KV cont				
		Radiated Field	ated Field BS EN/EN61000-4-3		Level X, 20V/m				
		EFT / Burst BS EN/EN610		DC EN/ENG1000 4 4	Leve		vel 3, 2KV at power		
				35 EN/EN61000-4-4		Level 4, 2KV at signal			
		Surge	BS EN/EN61000-4-5			Level 3,1KV Line-Line, Level 3, 2KV Line-E			
		Conducted		BS EN/EN61000-4-6 L		Level 3			
	RAILWAY STANDARD	Compliance to BS EN/EN45545-2 for fire protection; BS EN/EN50155 /IEC60571 including IEC61373 for shock & vibration, BS EN/EN50121-3-2 for					vibration,BS EN/EN50121-3-2 for EM		
	MTBF	3093.5K hrs min. Telcordia SR-332 (Bellcore) ; 396.9K hrs min. MIL-HDBK-217F (25°C)							
OTHERS	DIMENSION	113*60*25mm (L*W*H)							
	PACKING	0.25Kg; 56pcs/15Kg/0.81CUF	-T						
NOTE	Ripple & noise are measure Tolerance: includes set up The power supply is conside a 360mm*360mm metal plat perform these EMC tests, pi Strongly recommended that The ambient temperature despired.	ally mentioned are measured at 110VDC input, rated load and 25°C of ambient temperature. red at 20MHz of bandwidth by using a 12" twisted pair-wire terminated with a 0.1uf & 47uf parallel capacitor. to tolerance, line regulation and load regulation. dered a component which will be installed into a final equipment. All the EMC tests are been executed by mounting the unit on late with 1mm of thickness. The final equipment must be re-confirmed that it still meets EMC directives. For guidance on how to please refer to "EMI testing of component power supplies." (as available on http://www.meanwell.com) at external output capacitance should not exceed 5000uF. derating of 3.5°C/1000m with fanless models and of 5°C/1000m with fan models for operating altitude higher than 2000m(6500ft). or: For detailed information, please refer to https://www.meanwell.com/serviceDisclaimer.aspx							



■ Block Diagram

fosc: 110KHz

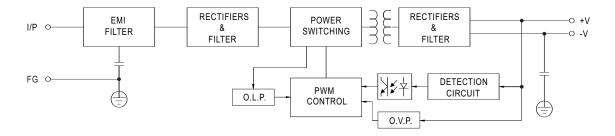

■ Input Fuse

There is one fuse connected in series to the positive input line, which is used to protect against abnormal surge. Fuse specifications of each model are shown as below.

Type	Fuse Type	Reference and Rating
G	Time-Lag	CONQUE MST, 6.3A, 250V
L	Time-Lag	CONQUE MST, 3.15A, 250V
Н	Time-Lag	CONQUE MST, 2A, 250V

■ Input Reverse Polarity Protection


There is a MOSFET connected in series to the negative input line. If the input polarity is connected reversely, the MOSFET opens and there will be no output to protect the unit.


■ Input Range and Transient Ability


The series has a wide range input capability. With $\pm 40\%$ of rated input voltage, it can withstand that for 1 second.

■ Input Under-Voltage Protection

If input voltage drops below Vimin, the internal control IC shuts down and there is no output voltage. It recovers automatically when input voltage reaches above Vimin, please refer to the cruve below.







■ Inrush Current

Inrush current is suppressed by a resistor during the initial start-up, and then the resistor is bypassed by a MOSFET to reduce power consumption after accomplishing the start-up.



■ Hold-up Time

0ms

10ms

20ms

• EN50155: 2007 version - H type is in compliance with S2 level (10ms), while G and L types are in compliance with S1 level (3ms) at full load output condition. To fulfil the requirements of S2 level (10ms), G types require de-rating their output load to 80%, please refer to the curve diagrams below.




40ms


30ms


50ms

60ms

70ms

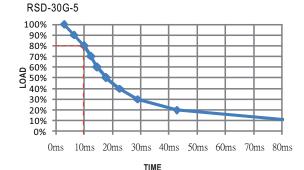





• EN50155: 2017 version - Comply with S1 level (3ms)


■ Output Voltage Adjustment

This function is optional, which the standard product does not have it. If you do need the function, please contact MW for details.

MEAN WELL

Efficiency vs Load & Vin Curve

The efficiency vs load & Vin curves of each model are shown as below.

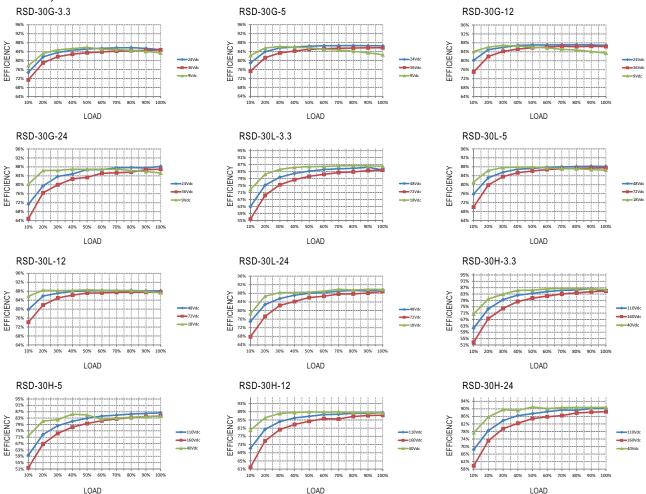


■ Parallel and Series Connection

A.Operation in Parallel

Since RSD-30 series don't have built-in parallel circuit, it can only use external circuits to achieve the redundant operation but not increase the current rating.

1.Add a diode at the positive-output of each power supply (as shown as below), the current rating of the diode should be larger than the maximum output current rating and attached to a suitable heat sink. This is only for redundant use (increase the reliability of the system) and users have to check suitability of the circuit by themselves.




2. When using S.P.S. in parallel connection, the leakage current will increase at the same time. This could pose as a shock hazard for the user. So please contact the supplier if you have this kind of application.

B.Operation in Series


RSD-30 can be operated in series. Here are the methods of doing it:

1. Positive and negative terminals are connected as shown as below. According to the connection, you can get the positive and negative output voltages for your loads.






2. Increase the output voltage (current does not change). Because RSD-30 series have no reverse blocking diode in the unit, you should add an external blocking diode to prevent the damage of every unit while starting up. The voltage rating of the external diode should be larger than V1+V2 (as shown as below).



■ Overload Protection

If the output draw up to 105~135% of its output power rating, the converter will go into overload protection which is constant current mode. After the faulty condition is removed, it will recover automatically. Please refer to the diagram below for the detail operation characteristic. Please note that it's not suitable to operate within the overload region continuously, or it may cause to over temperature and reduce the life of the power supply unit or even damage it.



■ Over Voltage Protection

The converter shuts off to protect itself when the output voltage drawn exceeds 115~140% of its output rating. It must be repowered on to recover.


■ LED Indicator

Equipped with a built-in LED indicator, the converter provides an easy way for users to check its condition through the LED indicator. Green: normal operation; No signal: no power or failure.

■ Derating Curve

a.Single unit operation


If the unit has no iron plate mounted on its bottom, the maximum ambient temperature for the unit will be 55°C as operating under full load condition. It requires de-rating output current when ambient temperature is between 55~70°C, please refer to the de-rating curve as below.

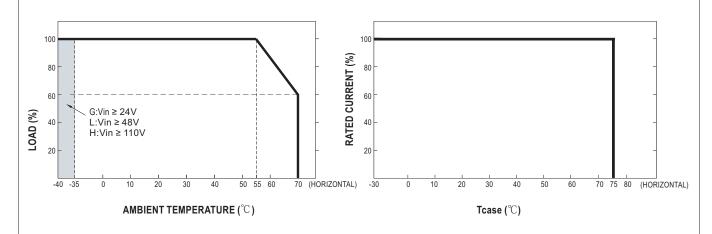






Suitable installation methods are shown as below. Since RSD-30 is a semi-potted model, its thermal performances for the following installation methods are similar and share the same derating curve.













b. Operate with additional iron plate

If it is necessary to fulfil the requirements of EN50155 TX level that operate the unit fully-loaded at 70° C, RSD-30 series must be installed onto an iron plate on the bottom. The size of the suggested iron plate is shown as below. In order for optimal thermal performance, the iron plate must have an even & smooth surface and RSD-30 series must be firmly mounted at the center of the iron plate.

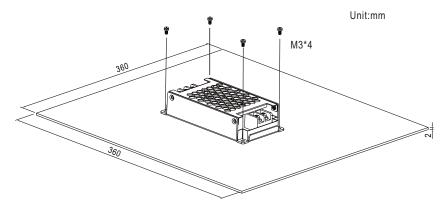



The load vs ambient temperature curve is shown as below.

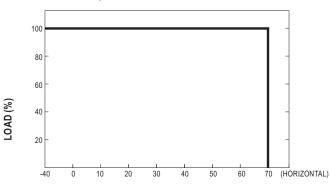



AMBIENT TEMPERATURE (°C)


Suitable installation methods are shown as below. Since RSD-30 is a semi-potted model, its thermal performances for the following installation methods are similar and share the same derating curve.













■ Immunity to Environmental Conditions

Test method	Standard	Test conditions	Status
Cooling Test	EN 50155 section 12.2.3 (Column 2, Class TX) EN 60068-2-1	Temperature: -40°C Dwell Time: 2 hrs/cycle	No damage
Dry Heat Test	EN 50155 section 12.2.4 (Column 2, Class TX) EN 50155 section 12.2.4 (Column 3, Class TX & Column 4, Class TX) EN 60068-2-2	Temperature: 70°C / 85°C Duration: 6 hrs / 10min	PASS
Damp Heat Test, Cyclic	EN 50155 section 12.2.5 EN 60068-2-30	Temperature: 25°C~55°C Humidity: 90%~100% RH Duration: 48 hrs	PASS
Vibration Test	EN 50155 section 12.2.11 EN 61373	Temperature: 19°C Humidity: 65% Duration: 10 mins	PASS
Increased Vibration Test	EN 50155 section 12.2.11 EN 61373	Temperature: 19°C Humidity: 65% Duration: 5 hrs	PASS
Shock Test	EN 50155 section 12.2.11 EN 61373	Temperature: $21\pm3^{\circ}\text{C}$ Humidity: $65\pm5\%$ Duration: $30\text{ms*}18$	PASS
Low Temperature Storage Test EN 50155 section 12.2.3 (Column 2, Class TX) EN 60068-2-1		Temperature: -40°C Dwell Time: 16 hrs	PASS
Salt Mist Test	EN 50155 section 12.2.10 (Class ST4)	Temperature: 35°C ±2°C Duration: 96 hrs	PASS


■ EN45545-2 Fire Test Conditions


Test Items Hazard Level					
Items Standard		Standard	HL1	HL2	HL3
R24	Oxygen index test	EN 45545-2:2013+A1:2015 EN ISO 4589-2:1996	PASS	PASS	PASS
R25	Glow-wire test	EN 45545-2:2013+A1:2015 EN 60695-2-11:2000	PASS	PASS	PASS
R26	Vertical flame test	EN 45545-2:2013+A1:2015 EN 60695-11:2003	PASS	PASS	PASS



■ Mechanical Specification

Case No.253A Unit:mm

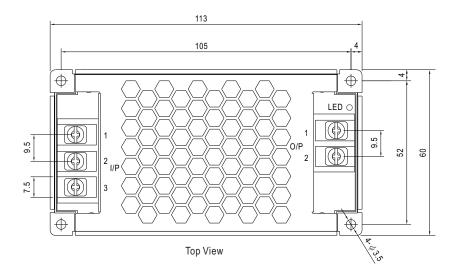



• (tc): Max. Case Temperature

Side View

Input Terminal Pin No. Assignment:

Output Terminal Pin No. Assignment:

Pin No.	Assignment
1	DC INPUT V+
2	DC INPUT V-
3	FG ±

Pin No.	Assignment
1	DC OUTPUT -V
2	DC OUTPUT +V

■ Installation Manual

Please refer to : http://www.meanwell.com/manual.html