

The Direct Current Control Method of STATCOM and It's Simulation

Li Shengqing, Li Weizhou, Xu Wenxiang, Zeng Huanyue

Hunan University of Technology, Zhuzhou Hunan 412008, China
lsq1961@sohu.com

Abstract-This paper introduced the working principle of STATCOM, uses the method of direct current control of triangle carrier wave to detect both the harmonic and the basic reactive power. Used the Matlab to build the model of STATCOM, The simulation and experimental results verified the feasibility and effectiveness of this method, and good tracking performance, and accurately, fast and steady compensation effect.

Keywords-STATCOM; direct current control; instantaneous reactive power; MATLAB

I. INTRODUCTION

With the rapid development of industry, the requirements of electric power quality are becoming stricter, how to improve the reliability, controllability and rapidity of modern power system has become a urgent problem to be solved^[1]. Static Synchronous Compensator (STATCOM) is the central device of modern Flexible AC Transmission Systems, compared with the traditional reactive power compensation device, STATCOM has the advantage of fast response, absorb reactive continuous, harmonic current, low loss, small size, etc. Therefore, STATCOM has become an important development direction of reactive power and harmonic compensation device's research^[2,3].

There are many researches on the control design of STATCOM. The literature [4] analysis the direct current control method of voltage outer, the current inner structure static Var generator and simulate the control method. The literature [5] give the reason and the solution of high voltage across the capacitor when device emits pure capacitive reactive power, Simulation gives the simulation waveform of the system emits inductive and capacitive reactive current and the voltage across the capacitor under the control of direct current method. The literature [6] which application of instantaneous power detection theory to collect real-time power decoupled into active and reactive component, using the relation of the power and switch quantity to control active and reactive power through the simulation verified the effectiveness of control. The simulation results can be further improved.

This paper studies the working principle of STATCOM, According to the triangular carrier direct current control method to build Matlab simulation model validation and study, verify its effect of control and compensation.

II. THE WORKING PRINCIPLE OF STATCOM

In short, The basic principle of STATCOM is self

commutated bridge circuit through the reactor or directly parallel to the grid, a properly adjusted bridge circuit in AC side output voltage amplitude and phase, or directly control the AC current, can make the circuit to absorb or emit to meet the requirements of the reactive current, achieve the purpose of dynamic reactive power compensation. According to the structure of STATCOM, it can be divided two types: voltage bridge type circuit and the current bridge type circuit. In fact, due to the reasons of operational efficiency, practical uses is mostly voltage bridge type circuit, so STATCOM specifically refers to Using self commutation voltage bridge circuit as a dynamic reactive power compensation device. Device main circuit structure as shown in Figure 1, Power switch devices use the switch device IGBT which have the capacity of self-switching-off.


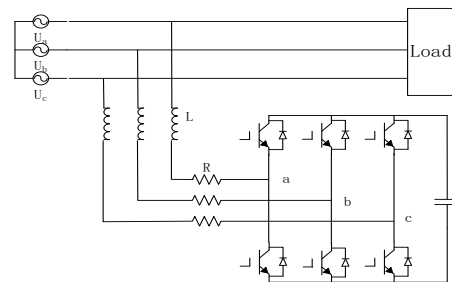


Figure 1. The main circuit structure of STATCOM

By the STATCOM working, it transforms DC side voltage into the output voltage of AC side with the electrical network frequency, which is equivalent to a voltage type inverter. It is equivalent to an amplitude and phase controlled AC voltage source here^[7]. The actual phase equivalent circuit and phase diagram as shown in Figure 2, taking into account loss of the circuit, It can be considered the loss as resistance which connect reactor. The grid voltage and the output AC voltage of STATCOM is V_s and V_{STA} , the voltage of reactance is V_L , the reactor equivalent impedance is R , inductive reactance is X , electric current is I .

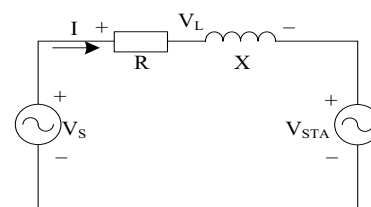

(a) The actual phase equivalent circuit

This work was supported by the National Natural Science Foundation of China (51077046) and the construct program of the key discipline in hunan province(201176).

of harmonic current; another part is the reactive load, the reactive power change of the load simulation in the network which set in 0.1s.

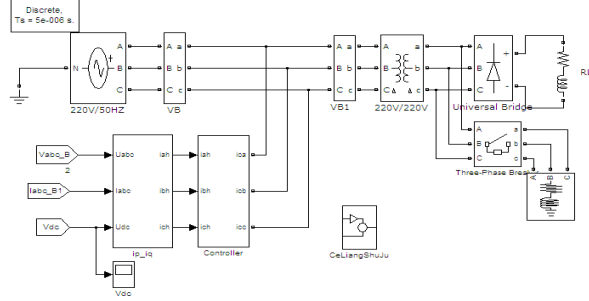


Fig 5. Direct current control MATLAB simulation model

Figure 6 is the voltage and current waveform before and after compensation of phase A. From the Figure (a) can be seen, before the compensation rectifier load harmonics are relatively obvious, reactive load input also caused the current changes in 0.1s. Figure(a) is the voltage and current waveforms of after compensation, compensation system tends to be stable in 0.02s. When the system access a reactive load caused fluctuations in 0.1s, the compensation device respond quickly and achieve good compensation effect. Figure (b) the former 0.02s fluctuations are caused by the impact. when the device just input.

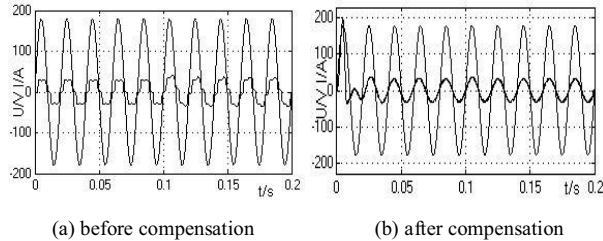


Figure 6. The A phase voltage and current waveform

Figure 7 analysis A phase harmonic current spectrum before and after compensation, The figure shows that current distortion rate was 21.80% before the compensation, It is more serious. While the current distortion rate can reduce to 2.45% after the compensation, current quality improved obviously.

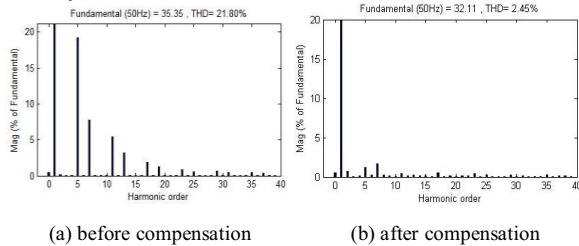


Figure 7. The A phase harmonic current FFT analysis

Figure 8 is the power factor changes of A phase circuit before and after compensation, Figure (a) compare with Figure (b), the power factor of A phase circuit is basic for 1

after compensate stably. So STATCOM has good compensation performance on reactive power.

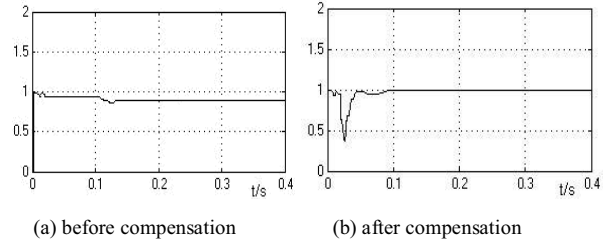


Figure 8. The A phase power factor

Figure 9 is the current tracking effect of the compensation process, compared the reactive current with the detected instruction signal. From the figure can be seen, the reactive current of the device emits and the command signal basically are coincident in 0.01s, It achieve to a precise and fast tracking performance.

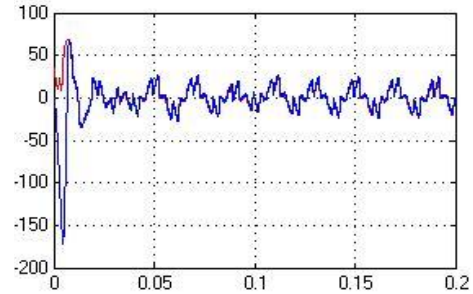


Figure 9. Current tracking effect of the compensation process

Figure 10 is the DC side capacitor voltage waveform, after compensation stably, the DC capacitor voltage can be stabilized to a set value, It still can stable to the set value rapidly when the load is suddenly thrown.

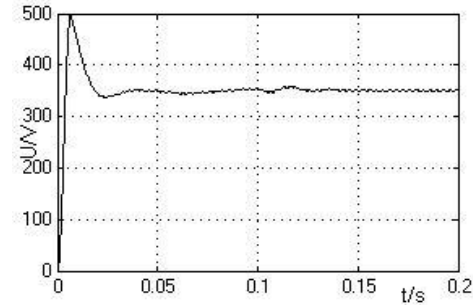


Figure 10. The DC side capacitor voltage waveform

V. CONCLUSIONS

This paper analysis the basic working principle of STATCOM as well as the triangle wave modulation direct current control method, using the MATALB simulation software to build simulation model, a detailed analysis of the STATCOM rectifier load circuit of reactive and harmonic compensation characteristics. The simulation results show that, STATCOM adopts direct current control strategy of

reactive power and harmonic current fast tracking effect, the system reactive power and harmonic has good compensation characteristics.

REFERENCES

- [1] Luo yinghong, Zhang peng, Zhou biying, et al The STATCOM system simulation study based on the current indirect control[J]. Modern electronic technology, 2011, 21(12): 154~156. (in Chinese)
- [2] Tu chunwu, Li Hui, Tang Jie, et al. Based on direct current control D-STATCOM equipment [J]. High voltage engineering, 2008, 34 (6): 1173~1178. (in Chinese)
- [3] Al Hadidi H K, Menzies R W. Investigation of a cascade multilevel inverter as an STATCOM [C].Power Engineering Society General Meeting, 2003, IEEE, Volume: 1: 193
- [4] Huang Hua, Liu Zhaotian, Zhang Lei, et al. The research of static var generator based on direct current control [J]. Electric, 2012, 1: 27~30. (in Chinese)
- [5] Sheng Zhanshi, Jiang Suyan, Yu Ligui. The static var generator research of Direct current control [J]. Electrical measurement & instrumentation, 2009, 46 (9): 53~56. (in Chinese)
- [6] Liu Gang, Li Zaiyou. The direct power control strategy of new static synchronous compensator [J]. Electrical switch, 2011, 1: 34~36. (in Chinese)
- [7] Wang Zhaoan, Yang Jun, Liu Jinjun, et al. Harmonic suppression and reactive power compensation[M]. Beijing: Mechanical Industry Press, 2006. (in Chinese)
- [8] Ma Guoxi. The modeling and control study of Advanced STATCOM [D]. Hunan: Central South University, 2004. (in Chinese)
- [9] Su Shiping, Liu Guiying. Static reactive power compensation technology [M]. Beijing: China Electric Power Press, 2007. (in Chinese)
- [10] Ou Jianbo, Luo an, Tang Jie, et al. The software and hardware design of the static synchronous compensator Based on DSP [J]. Power electronics, 2008, 42 (2): 6~8. (in Chinese)
- [11] Li Shengqing, Zhu Yinghao, Zhou Youqing, et al. The overview on the detecting methods for harmonic in power system[J]. High voltage engineering, 2004, 30 (3): 39~42. (in Chinese)