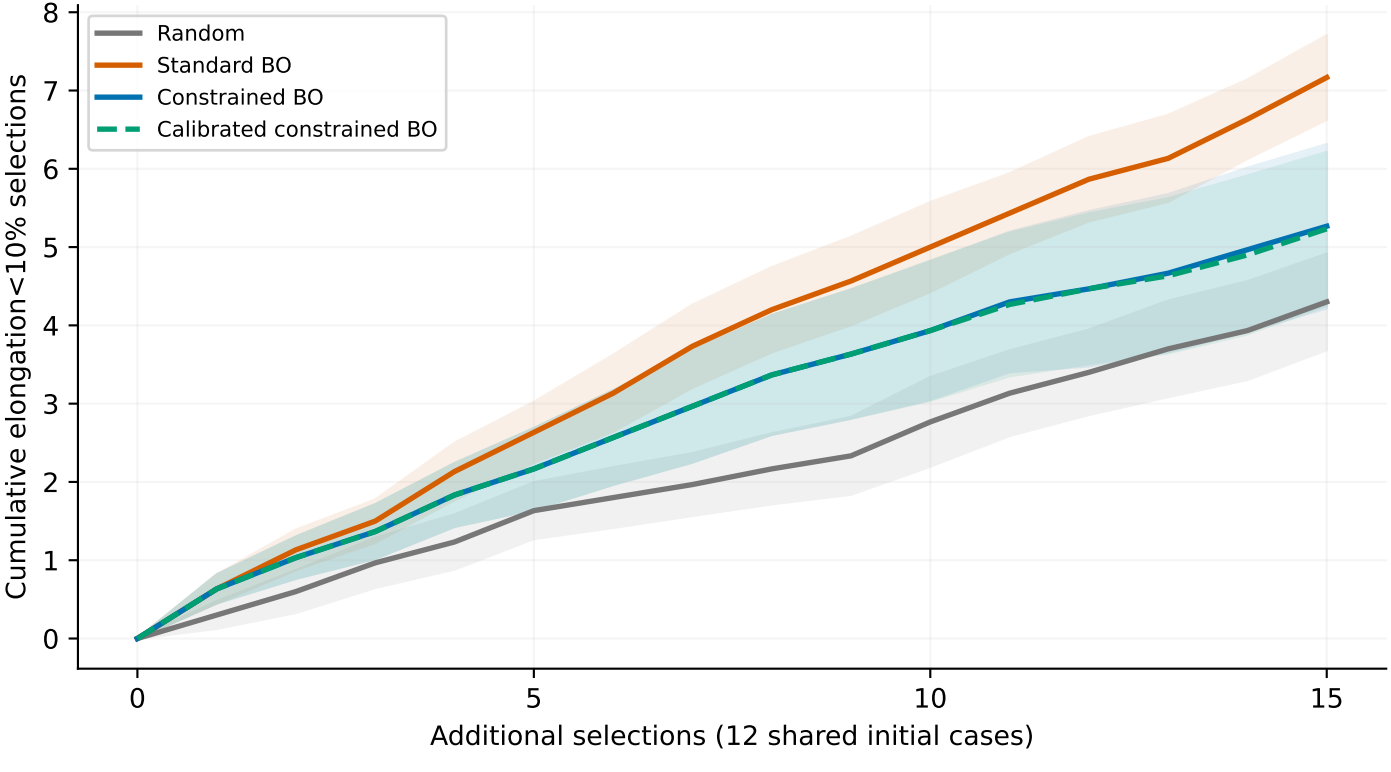
Exploratory published-data replay: explicit tensile tests at25°C
Random
Standard BO
Constrained BO
Calibrated constrained BO
Cumulative elongation<10% selections
0
1
2
3
4
5
6
7
8
0
5
10
15
Additional selections (12 shared initial cases)