



Staged benchmarking selected diffusion after WGAN and harmonization screens


A ARCHS4 tissue reverse validation

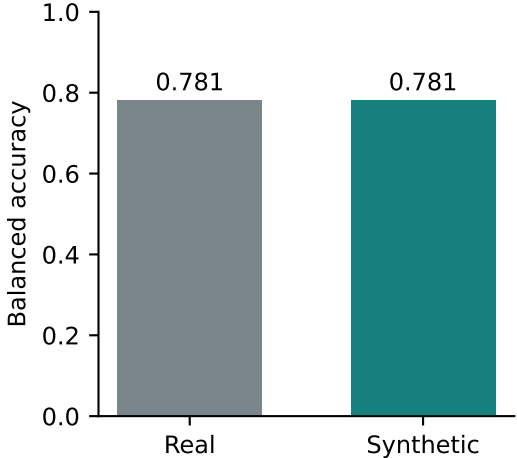


B Generator candidates

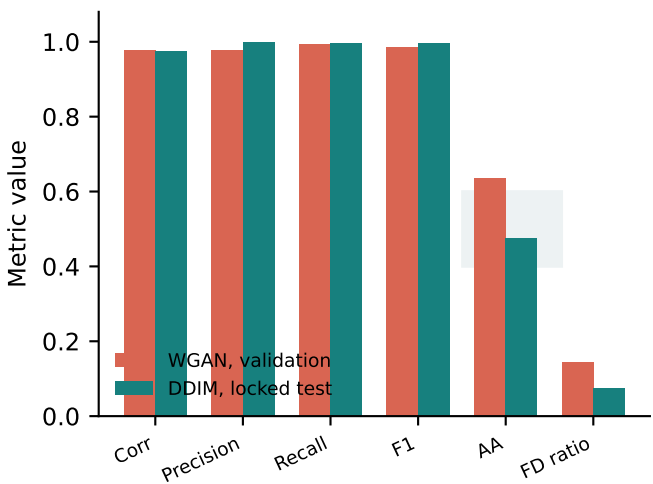

C Selected DDIM locked gates

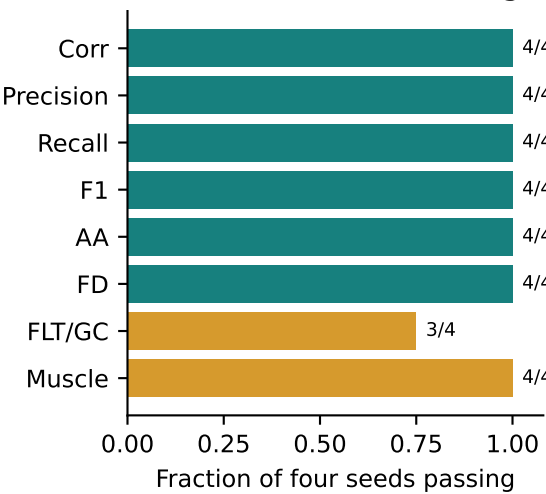

D Matched liver harmonization

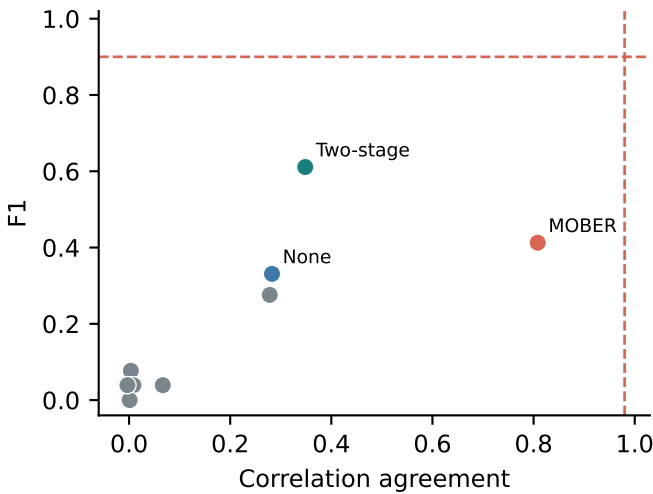

WGAN values are validation results; DDIM values are locked-test results after staged selection, not a paired test-set comparison.