

Site Assessment Report

City Life — 477 Anton Lembede Street, Durban CBD

Prepared by: Jason van Wyk, Precept Systems (Pty) Ltd

Prepared for: Precision Meters — Bradley Cassani, Garth Le Roux

Client: Mosaic Group — Tanya Dowley

1. Executive Summary

Precept Systems conducted a site visit at City Life, 477 Anton Lembede Street, Durban CBD on 29 January 2026. The building is a 27-storey residential high-rise owned by Mosaic Group (2,500+ residential units, 7,000+ tenants across multiple brands). The scope covers the first 12 floors (576 units at 48/floor). The upper floors accommodate a different tenant type and are excluded from this phase.

The building has no individual water metering. Tenants pay a flat R400/month; Mosaic Group absorbs the full municipal water bill (~R1.2M/month). The client requires **576 unit meters** (15mm), **12 bulk floor meters** (50mm), automated telemetry, and ERP integration.

Recommendation: Precision Meters Ultrasonic 15mm (576x) and Ultrasonic 50mm (12x) with integrated LoRaWAN radio, connected via a private LoRaWAN network (868 MHz, EU863-870, ChirpStack) using the building's existing UniFi ethernet for gateway backhaul. Total: 588 meters, phased rollout.

2. Building Profile

Building	City Life
Address	477 Anton Lembede Street, Durban CBD
Owner	Mosaic Group
Total floors	27
Floors in scope	12 (first 12)
Units per floor	48
Total units	576
Building age	~60 years
Construction	Reinforced concrete, brick, steel
Floor slab	Est. 200–300mm RC (1960s-era)

3. Water Infrastructure

Municipal supply	110mm, ground level
Supply path	Rooftop tanks → gravity-fed riser
Main riser	75mm (single, full building)
Floor branch	50mm (at each floor)
Unit feed	16mm (to each apartment)
Feed type	Single riser (not ring)
Isolation	Per unit valve + per riser/floor
Meter location	Passage ceiling, above front door

Mosaic Group's portfolio includes City Life (2,500+ units), Ole (student housing), Luna (furnished apartments). Success here may extend to other properties.

4. Current Water Operations

Municipal bill	R1.2M/month (all 27 floors)
Tariff	R65.91/kL
Consumption	~10,500 kL/month (entire building)
Tenant charge	Flat R400/month (no usage basis)
Leak detection	Visual/reported only
Estimated loss	Unknown — no measurement

5. Problems Identified

- 1 No usage visibility per unit
- 2 No tenant incentive to conserve
- 3 No leak detection (hidden leaks)
- 4 Manual reading of 576 meters impractical
- 5 Building bears full cost — no recovery
- 6 Water restrictions unenforceable
- 7 System silos — no ERP integration

6. Meter Requirements

Type	Application	Pipe	Qty	Purpose
Unit meter	Apartment feed	15mm	576	Per-unit consumption & billing
Bulk floor meter	Floor branch	50mm	12	Leak detection & water balance

Total	588
-------	-----

Site-Specific Constraints

Constraint	Implication
Durban water quality (sediment/grit)	Ultrasonic (no moving parts) strongly preferred over mechanical
Passage ceiling, mixed orientation	Position-independent (UOD0) meters essential
No straight pipe sections available	Eliminates meters requiring upstream/downstream runs
576 meters at scale	Battery >10 years, maintenance-free, no moving parts
Manual reading impractical	Integrated LoRaWAN radio required (avoids 576 separate nodes)
Leak detection is primary driver	Low-flow sensitivity critical for bulk meters

7. Recommended Meter Selection

7.1 Unit Meters — Precision Meters Ultrasonic 15mm

Specification	Value	Site Relevance
Technology	Ultrasonic (no moving parts)	Resistant to Durban sediment/grit
Body length	110mm	Fits passage ceiling space
Qmin (Class C)	7.5 L/h	Detects very low flows
Sensitive to	1 L/h	Dripping tap detection
Installation	Any position (UOD0)	Mixed orientation in ceiling
IP rating	IP68	Fully submersible
Battery	>16 years	Exceeds 10-year horizon
Data logger	Hourly, daily, monthly	Resilience if comms fail
Standards	SANS 1529-1:2019 Class C/D	SA legal metrology compliant
AMR/AMI	LoRaWAN (EU863-870), wM-Bus, NB-IoT, NFC	Integrated radio — no separate node needed

Key advantage: Integrated LoRaWAN radio means each meter transmits directly to a gateway. For 576 meters, this eliminates separate telemetry hardware, reducing cost, installation complexity, and maintenance. Built-in leak, burst, backflow, tamper, and temperature alarms are all transmitted over the radio.

7.2 Bulk Floor Meters — Precision Meters Ultrasonic 50mm

Same ultrasonic range recommended for 12 bulk meters. **Note:** The 32–50mm spec sheet shows a third column labelled "40mm" with doubled flow rates (Qs 24 m³/h) and shorter body (255mm). We believe this is the 50mm variant — confirmation requested.

7.3 Why Not Woltmann for Bulk? Why Not ASM Polymer for Unit?

Bulk meter factor	Ultrasonic 50mm	Woltmann 50mm	Unit meter factor	Ultrasonic 15mm	ASM Polymer 15mm
Qmin	72 L/h	240 L/h	Moving parts	None	Rotary piston
Leak sensitivity	3.3x better	Misses small leaks	Qmin	7.5 L/h	15 L/h
LoRaWAN	Integrated	No (pulse only)	LoRaWAN	Integrated	No (pulse only)
Moving parts	None	Turbine bearings	Enclosure needed	No (IP68)	Yes (legal req.)
			Sediment resilience	Excellent	At risk

A running toilet at ~100 L/h: detected by ultrasonic, missed by Woltmann.

8. Communications Architecture — Why LoRaWAN

8.1 The Challenge

Reliably collect data from 588 meters across 12 reinforced concrete floors, with 10+ year battery life, no new cabling (rejected by client), no interference with tenant WiFi, and support for future valve control.

8.2 868 MHz LoRaWAN Signal Analysis for This Building

Material (868 MHz)	Attenuation	Link Budget	Value
RC floor slab (150–250mm)	18–25 dB	TX power	+14 dBm (ICASA limit)
RC slab (1960s-era, denser)	22–28 dB	RX sensitivity (SF12)	-137 dBm
Brick/masonry wall (110mm)	3–5 dB	Max link budget	~157 dB
Steel fire door	15–18 dB	Atten. per slab (conservative)	23 dB
Plumbing riser (metal)	5–10 dB	Floors per gateway	5–7

Sources: ITU-R P.2040, field studies in 1960s-era buildings.

Gateway	Location	Primary
GW-1	Floor 3	Floors 1–6
GW-2	Floor 8	Floors 5–12
GW-3	Floor 12/Roof	Floors 9–12

Three gateways with deliberate overlap zones. ChirpStack handles deduplication. Meters are in passage ceilings (open corridors), not inside sealed apartments — vertical penetration through floor slabs only.

8.3 LoRaWAN vs WiFi vs Ethernet

Factor	LoRaWAN (868 MHz)	WiFi (2.4 GHz)	Wired Ethernet
Building penetration	Excellent (sub-GHz)	Poor in concrete	N/A (wired)
Battery life (5-min)	10–16 years	12–18 months	No battery (PoE)
Spectrum congestion	None (dedicated band)	Severe (13–15 APs/floor)	None
10-year battery cost (576)	R0	~R864,000	R0
Infrastructure cost (12 floors)	R0 per meter	R0 per meter	R240K–R480K
Reliability	High (CSS, below noise floor)	Low (contention, interference)	Very high
Client acceptance	Accepted	Possible	Rejected (cost)


Critical factor: With integrated LoRaWAN in the ultrasonic meter, the meter's own battery (>16 years) powers both metering and radio. No external node, no external battery, no replacement schedule. WiFi would require battery replacement every 12–18 months at ~R86,400/year for 576 meters.

8.4 Private LoRaWAN (ChirpStack) vs Public Networks

Factor	ChirpStack (Private)	Public (TTN, Loriot, etc.)
Monthly subscription	R0	R0 (TTN, limited) or R15–45/device
10-year cost (588 devices)	~R50,000 (hosting)	R0 (TTN) or R1M–R3M
Data sovereignty	Full (SA-hosted, POPIA)	EU/US cloud
Downlink (future valves)	Full (Class A/B/C)	Limited (TTN: 10/day)
Device limits	Unlimited	Fair Use or per-device

Precept Systems already operates ChirpStack in production for the Fairfield Water monitoring project — proven and portable.

8.5 Architecture Summary

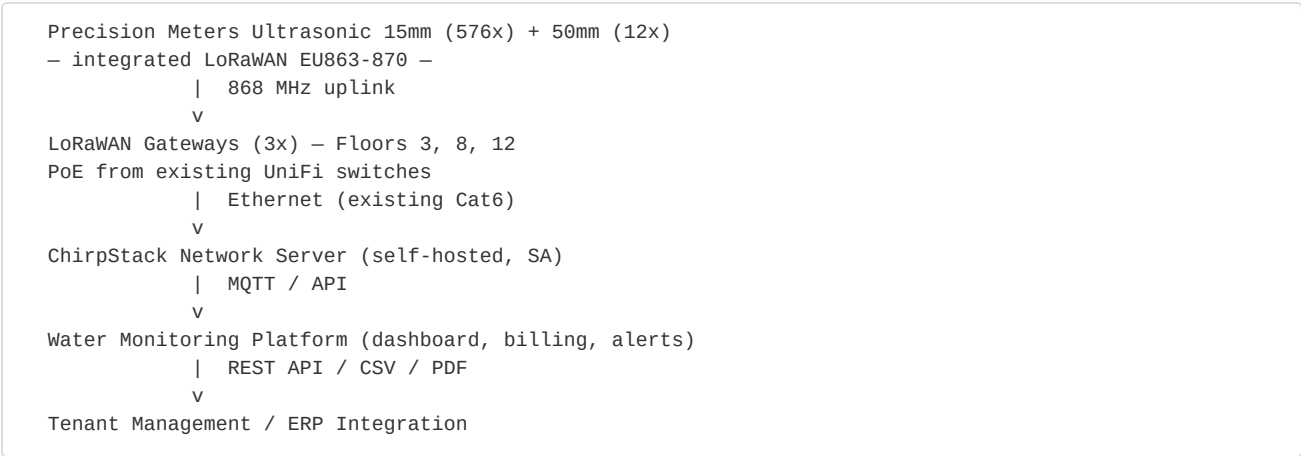

9. IT Infrastructure & Installation

Existing IT (no changes needed)

Network	Ubiquiti / UniFi managed
APs per floor	13–15
Internet	1 Gb fibre (Vox)
Cabling	Cat6 solid copper throughout
Switches	UniFi managed per floor (PoE)
VLANs	Available (Sumir can allocate)

10. Installation Considerations

Mounting	Passage ceiling, above front door
Isolation valve	Existing per unit
Orientation	Mixed — U0D0 meters required
Shutoff method	Per riser on each floor
Install time	~1 hour per unit
Window	10:00–14:00 preferred

UPS	Comms room + all switches
Rooftop	Power, ethernet, secure access

Each gateway needs one Cat6 to nearest switch. PoE provides power + data. No additional infrastructure.

Plumbing	Ryan (Mosaic, in-house)
IT support	Sumir (Mosaic, in-house)

With integrated LoRaWAN meters, installation is purely plumbing. No node wiring or per-unit configuration.

11. Phased Rollout Plan

Phase	Scope	15mm	50mm
Pilot	1 floor + 5 units	5	1
Phase 1	Complete pilot floor	+43	—
Phase 2	Floors 1–4	+192	+4
Phase 3	Floors 5–8	+192	+4
Phase 4	Floors 9–12	+192	+3
Total	12 floors	576	12

Gateway Rollout

Gateway	Phase	Location	Covers
GW-1	Pilot	Floor 3	Floors 1–6
GW-2	Phase 3	Floor 8	Floors 5–12
GW-3	Phase 4	Floor 12/Roof	Floors 9–12

Pilot Design Principles

- Same meter model as full deployment
- Pilot gateway becomes permanent GW-1
- Production-grade platform from day one
- Recommended floor: **3 or 4**

12. Next Steps

#	Action	Owner
1	Confirm 15mm ultrasonic LoRaWAN availability (standard or optional module)	Precision Meters
2	Confirm 50mm ultrasonic variant (3rd column in spec sheet)	Precision Meters
3	Provide volume pricing for 15mm and 50mm (pilot and full quantities)	Precision Meters
4	Provide ChirpStack device profile / payload codec for ultrasonic 15mm	Precision Meters
5	Confirm LoRaWAN uplink interval and NFC configuration capability	Precision Meters
6	Clarify supply chain arrangement (direct to client or via Precept)	Precision Meters / Precept
7	Develop technical proposal and business case for Mosaic Group	Precept Systems
8	Submit proposal to client	Precept Systems