

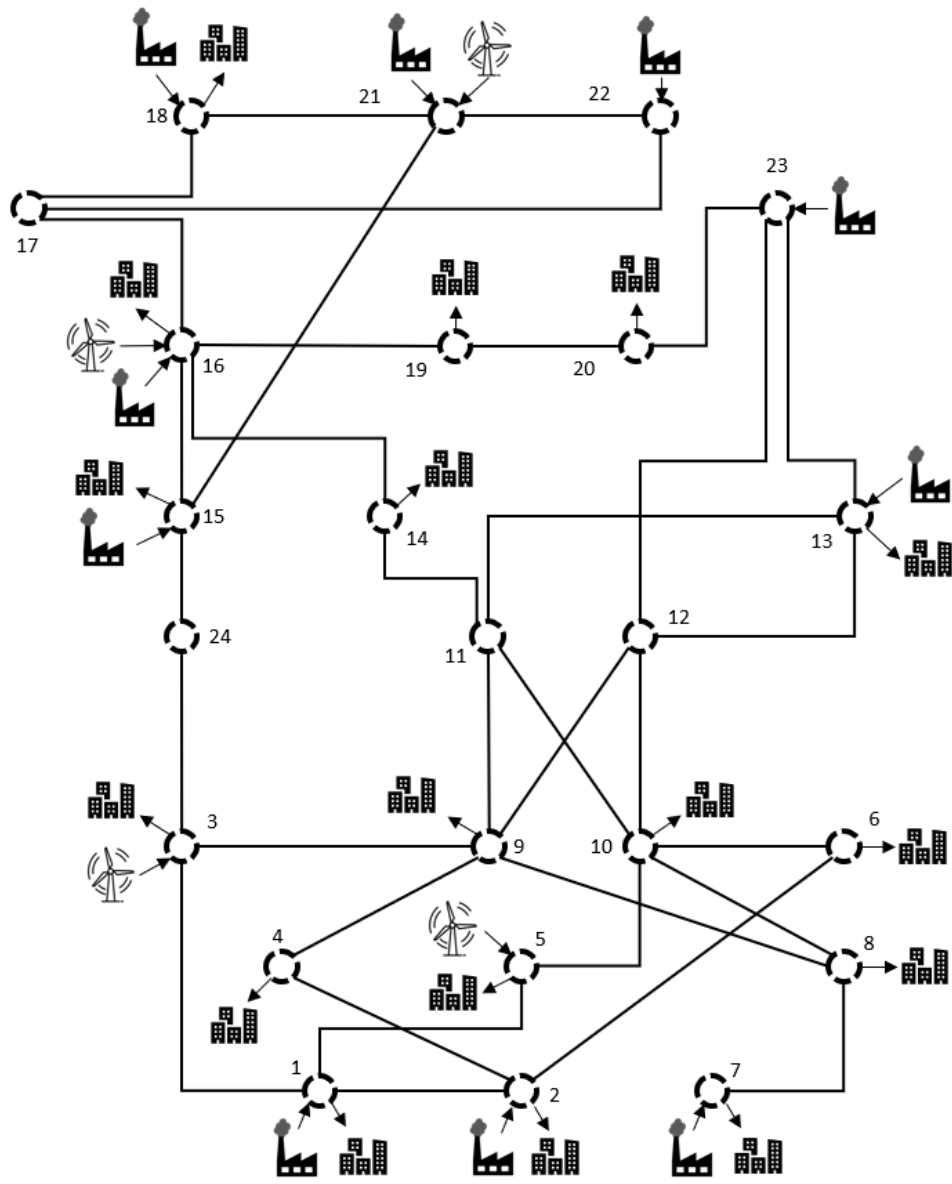


Table F.4: Technical data for conventional generators, wind farms, demands and transmission lines

Conventional generators														1	2	3	4	5	6	7	8	9	10	11	12	
Location [node]														1	2	7	13	15	15	16	18	21	22	23	23	
Production cost [\$/MWh]														13.32	13.32	20.7	20.93	26.11	10.52	10.52	6.02	5.47	7	10.52	10.89	
Upward reserve cost [\$/MW]														1.68	1.68	3.30	4.07	1.89	5.48	5.48	4.98	5.53	8.00	3.45	5.11	
Downward reserve cost [\$/MW]														2.32	2.32	4.67	3.93	3.11	3.52	3.52	5.02	4.97	6.00	2.52	2.89	
Capacity [MW]														106.4	106.4	245	413.7	42	108.5	108.5	280	280	210	217	245	
Maximum upward reserve provision capability [MW]														48	48	84	216	42	36	36	60	60	48	72	48	
Maximum downward reserve provision capability [MW]														48	48	84	216	42	36	36	60	60	48	72	48	
Wind farms																						1	2	3	4	
Location [node]																							3	5	16	21
Installed capacity [MW]																							500	500	300	300
Day-ahead forecast [MW]																							120.54	115.52	53.34	38.16
Demands	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17									
Location [node]	1	2	3	4	5	6	7	8	9	10	13	14	15	16	18	19	20									
Consumption [MW]	84	75	139	58	55	106	97	132	135	150	205	150	245	77	258	141	100									
Curtailement cost [\$/MWh]	500	500	500	500	500	500	500	500	500	500	500	500	500	500	500	500	500									
Transmission lines: From node		1	1	1	2	2	3	3	4	5	6	7	8	8	9	9	10	10								
To node		2	3	5	4	6	9	24	9	10	10	8	9	10	11	12	11	12								
Susceptance [per-unit]		0.0146	0.2253	0.0907	0.1356	0.205	0.1271	0.084	0.111	0.094	0.0642	0.0652	0.1762	0.1762	0.084	0.084	0.084	0.084								
Capacity [MW]		175	175	350	175	175	175	400	175	350	175	350	175	175	400	400	400	400								
Transmission lines: From node		11	11	12	12	13	14	15	15	15	16	16	17	17	18	19	20	21								
To node		13	14	13	23	23	16	16	21	24	17	19	18	22	21	20	23	22								
Susceptance [per-unit]		0.0488	0.0426	0.0488	0.0985	0.0884	0.0594	0.0172	0.0249	0.0529	0.0263	0.0234	0.0143	0.1069	0.0132	0.0203	0.0112	0.0692								
Capacity [MW]		500	500	500	500	250	250	500	400	500	500	500	500	500	1000	1000	1000	500								