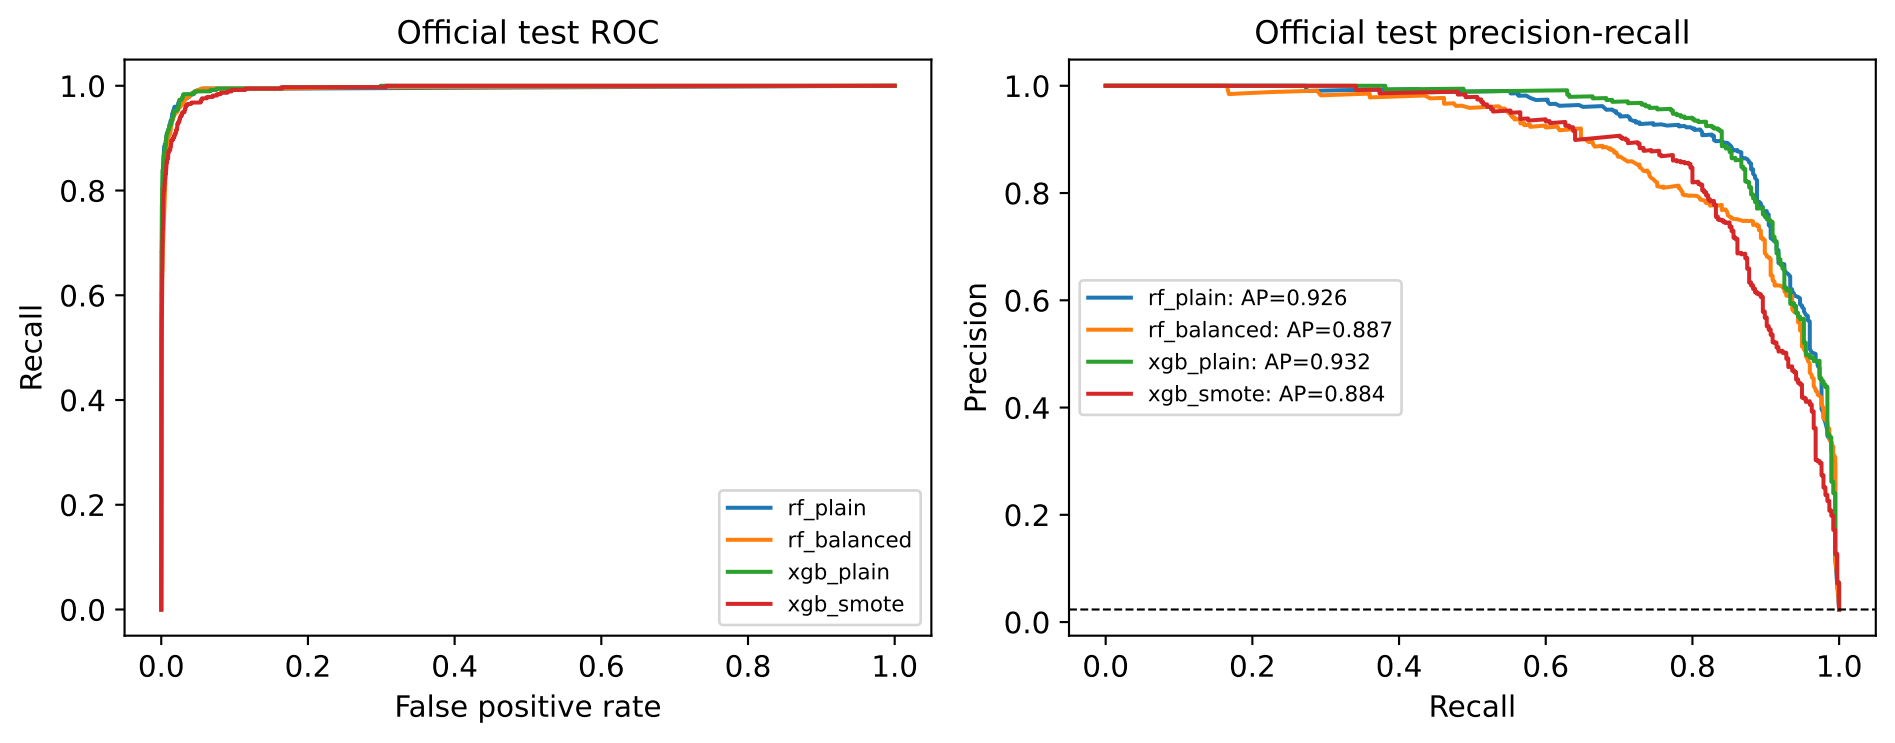
Official test ROC
Recall
False positive rate
rf_plain
rf_balanced
xgb_plain
xgb_smote
Official test precision-recall
Precision
Recall
rf_plain: AP=0.926
rf_balanced: AP=0.887
xgb_plain: AP=0.932
xgb_smote: AP=0.884