A. Setup Item Min Max

A. Setup Item Min Max

1. Go to Product Setup

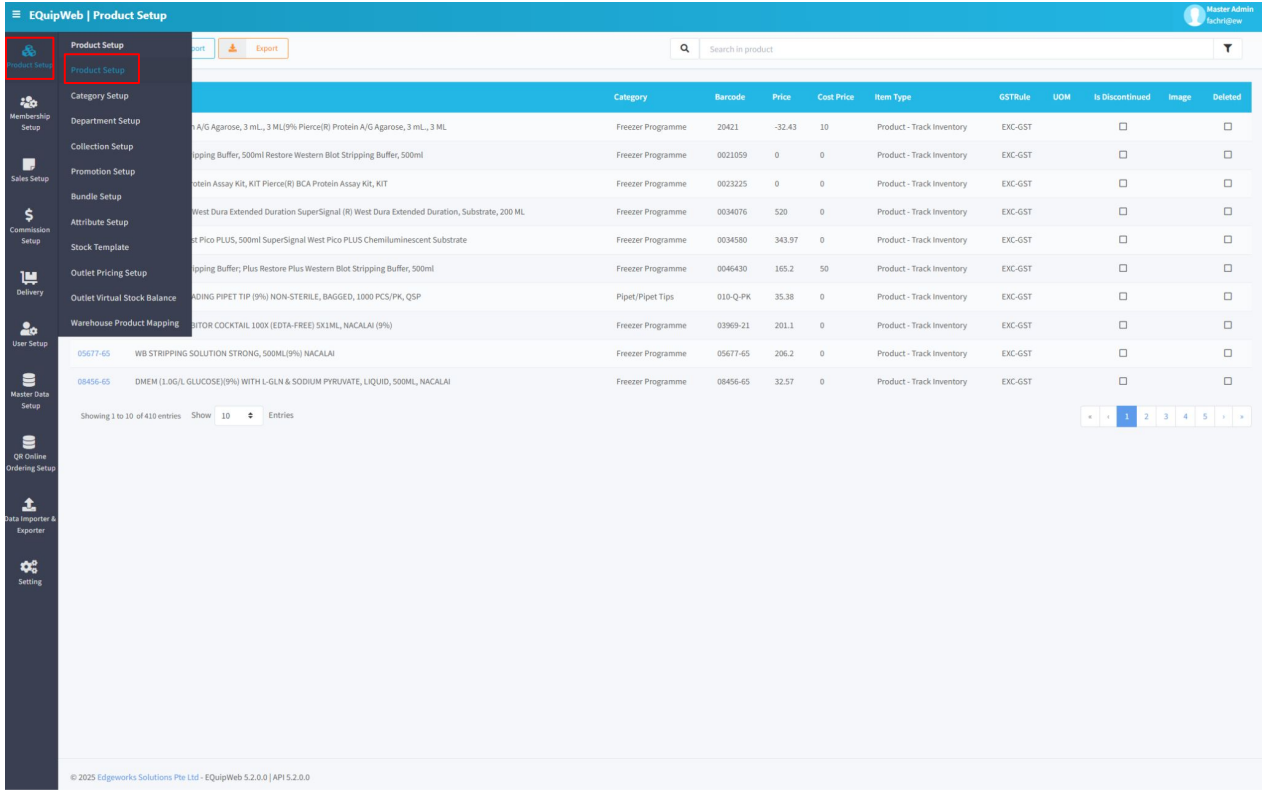

A. Setup Item Min Max

2. Search for the item you want to set up and click it

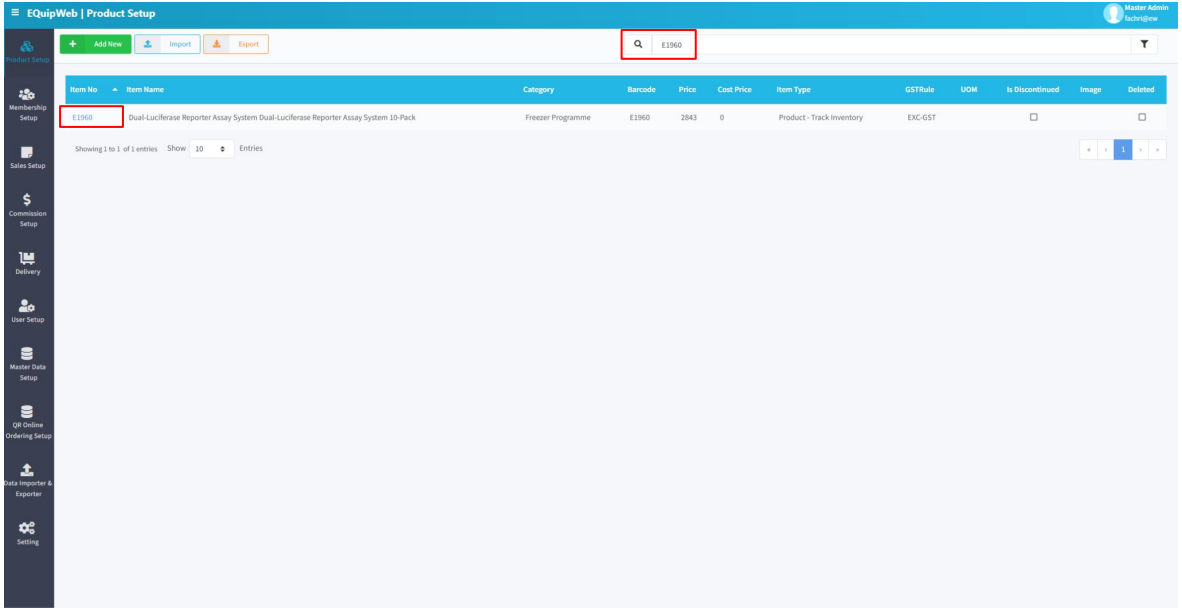

A. Setup Item Min Max

3. Go to the ""Min/Max" tab

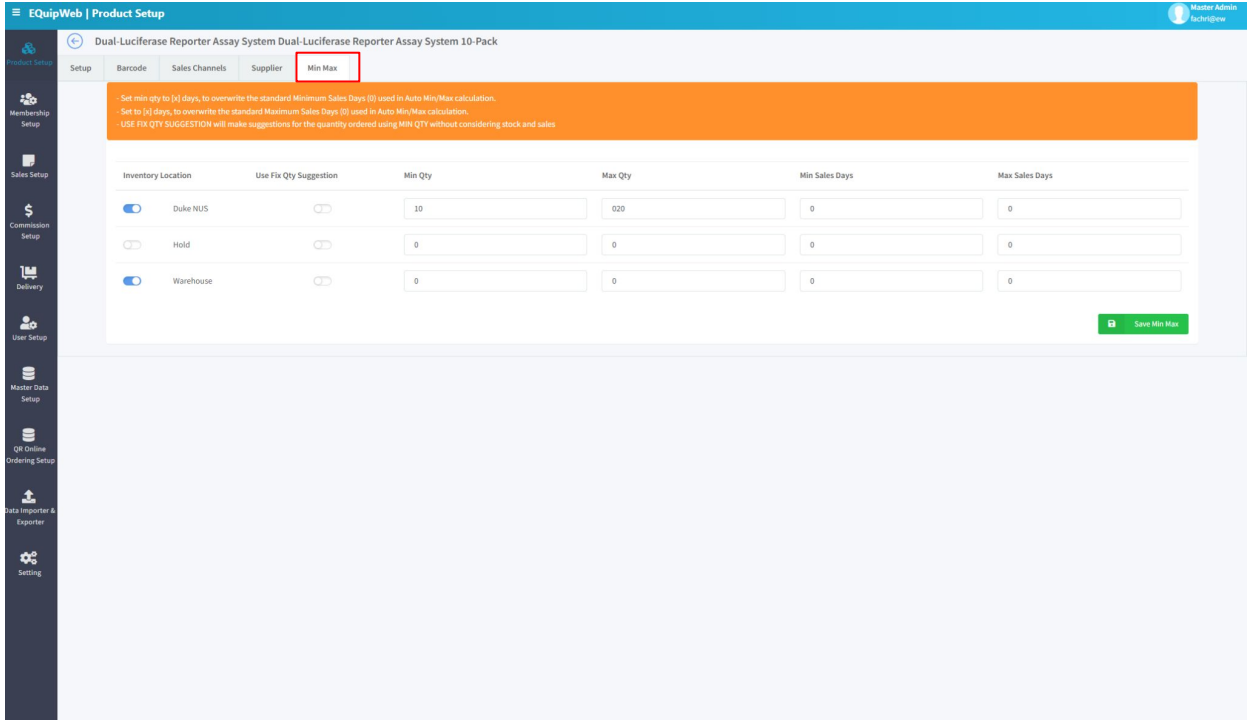

A. Setup Item Min Max

4. Set the values in the "Min Qty" and "Max Qty" columns for the desired location then press “Save Min/Max”.

(In this case we will use Item E1960 with 10 as Min Qty and 20 as Max qty, with “PROMEGA PTE LTD” as supplier)

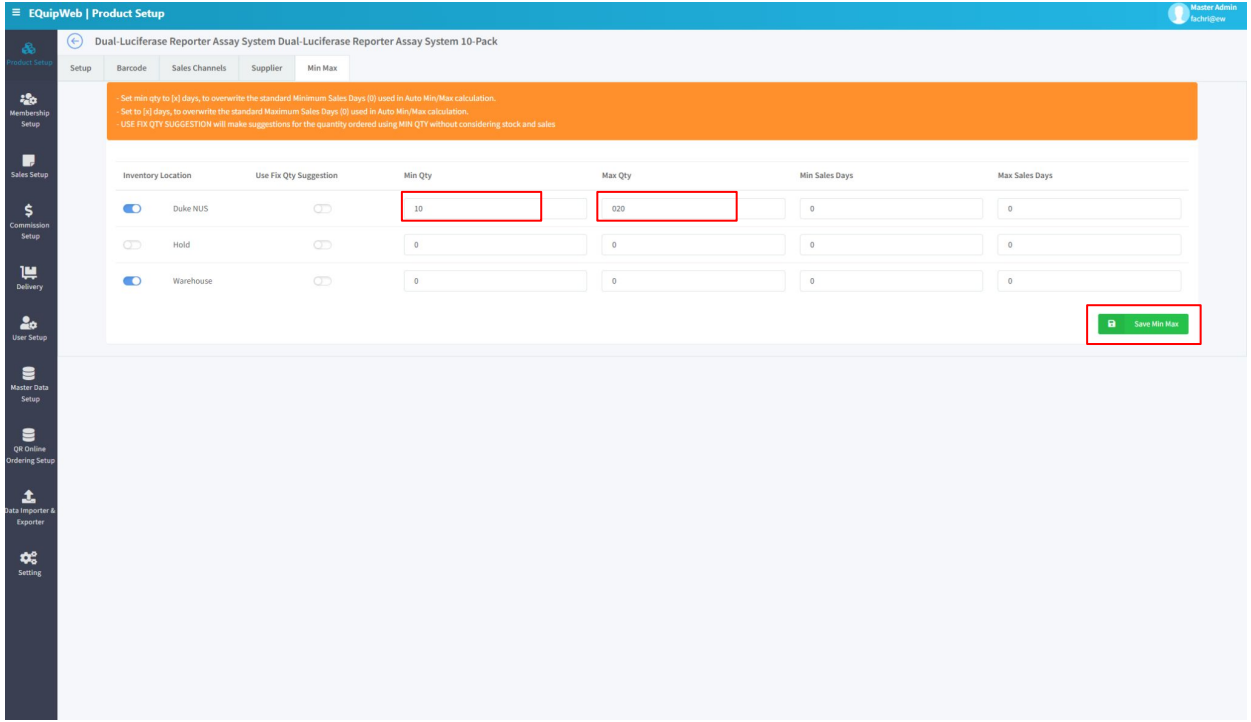

A. Setup Item Min Max

Min Qty is the minimum quantity threshold for the selected item.

Max Qty is the maximum quantity that will be ordered when this function is used.

Once the inventory drops below the Min Qty, you can use the "Add Low Qty" feature in Stock-In to automatically add the item up to the Max Qty.

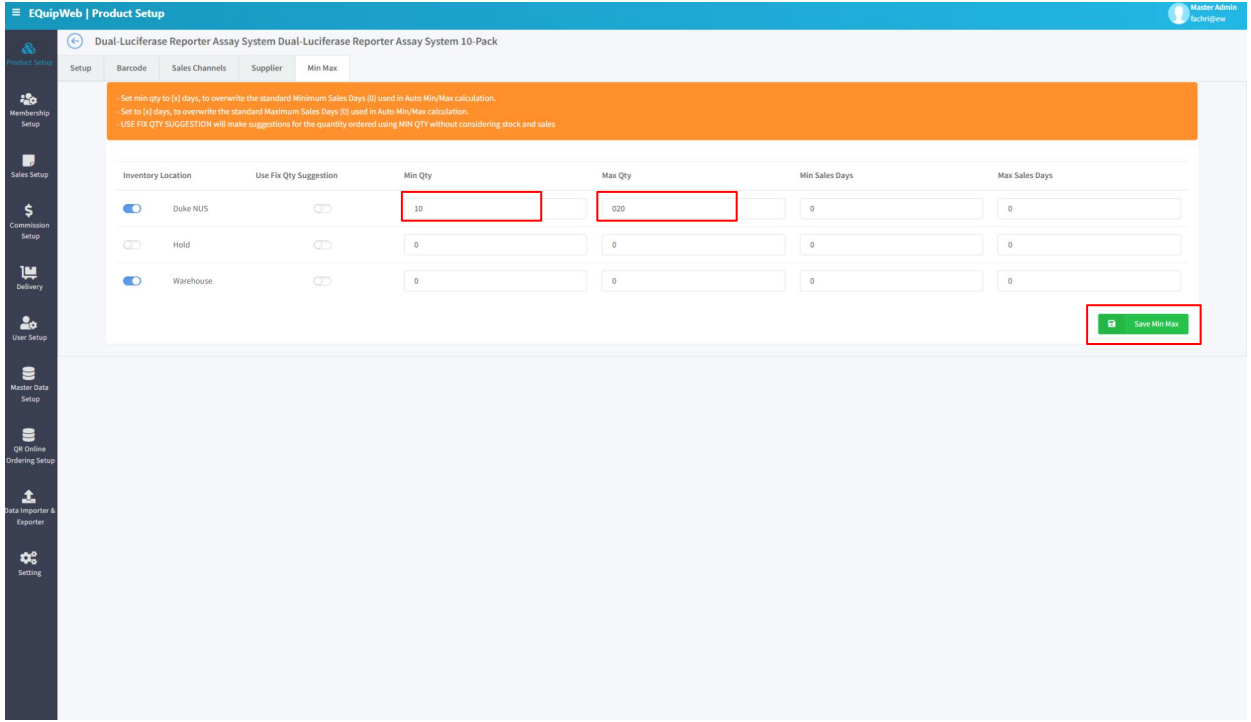

B. Using “Add Low Qty” for Stock In

B. Using “Add Low Qty” for Stock In

1. Go to Stock In

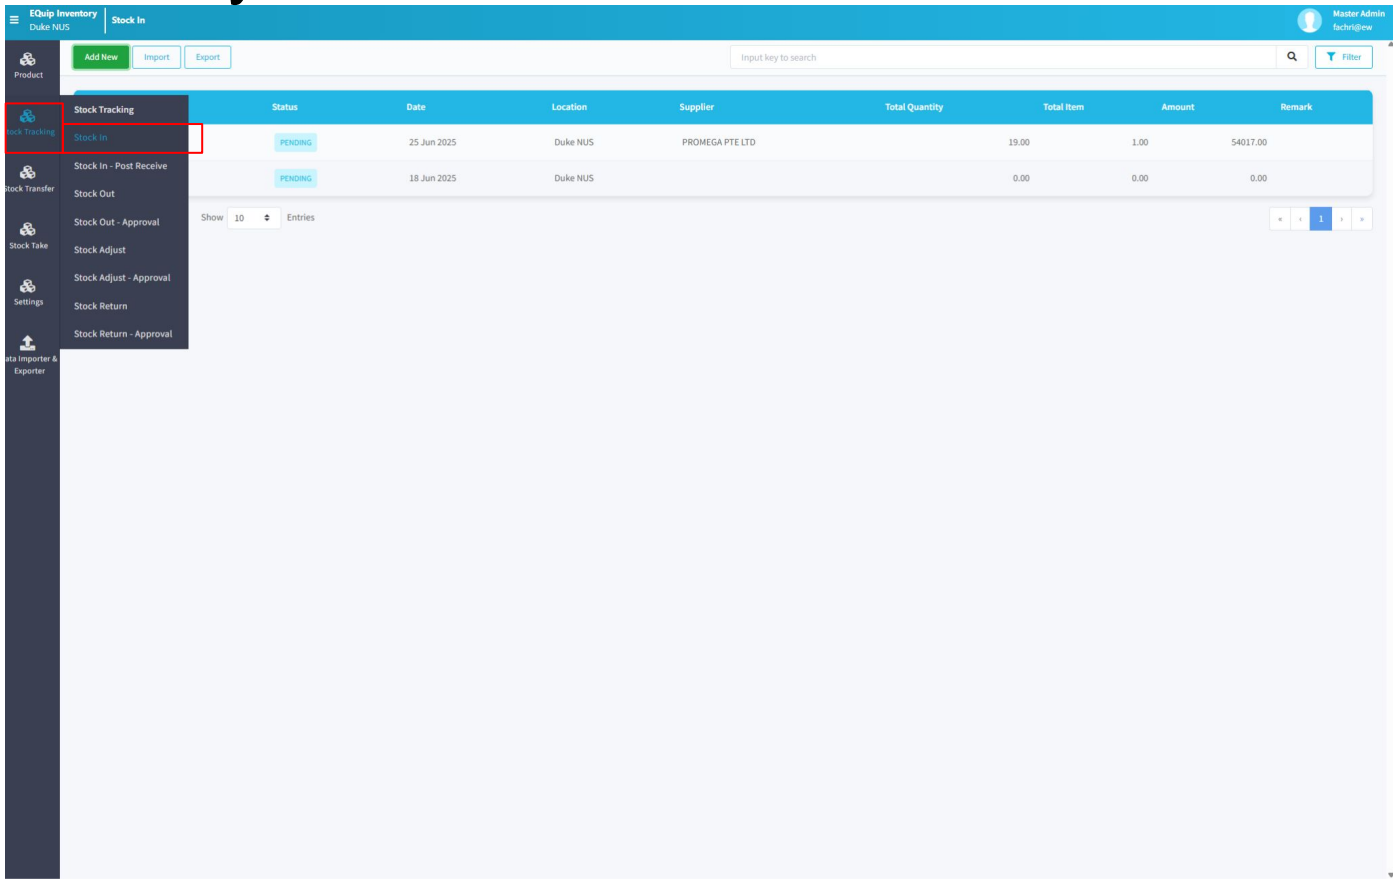

B. Using “Add Low Qty” for Stock In

2. Click add new

3. Select Location and Supplier

(In this case we will use Item E1960 with “PROMEGA PTE LTD” as supplier)

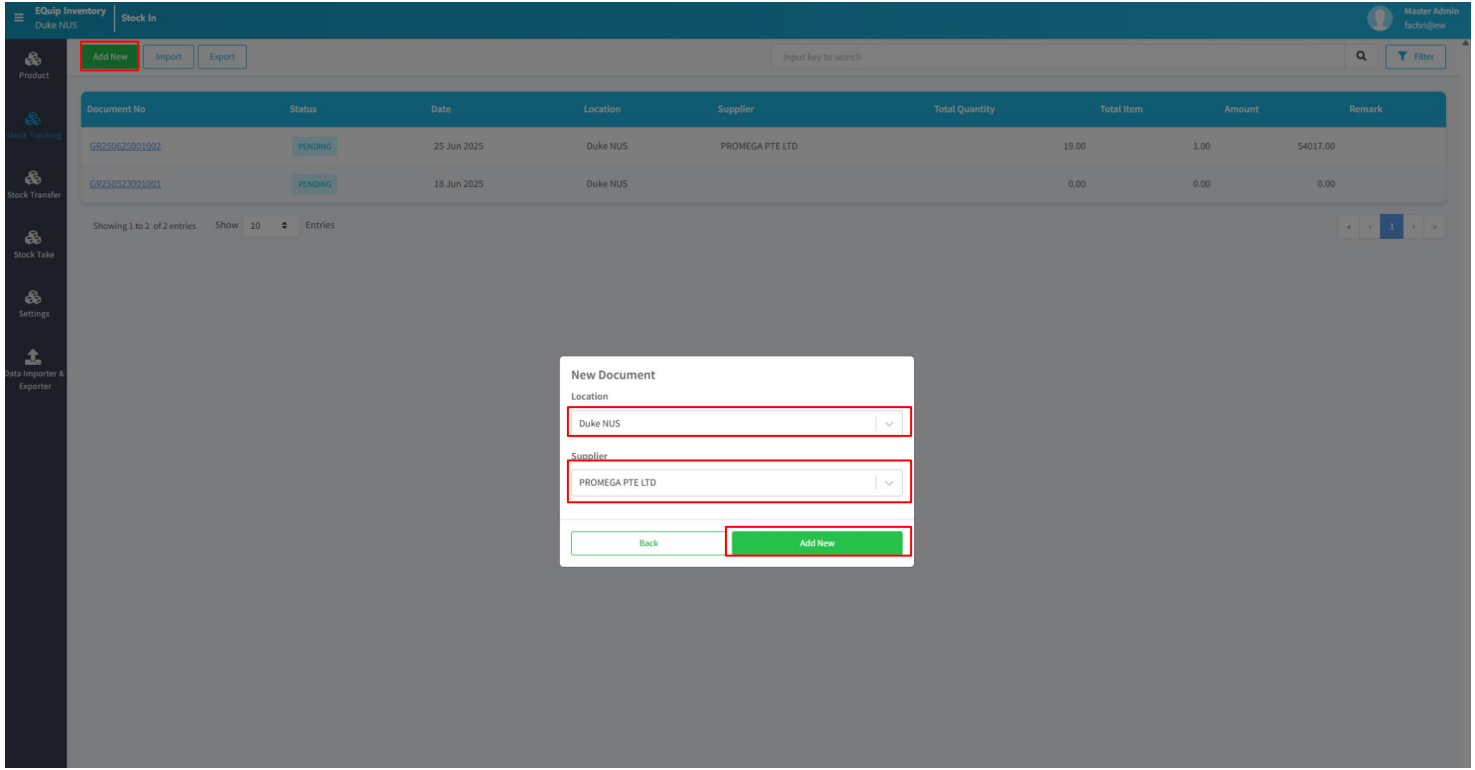

B. Using “Add Low Qty” for Stock In

4. Once stock in is created, click this arrow on the right

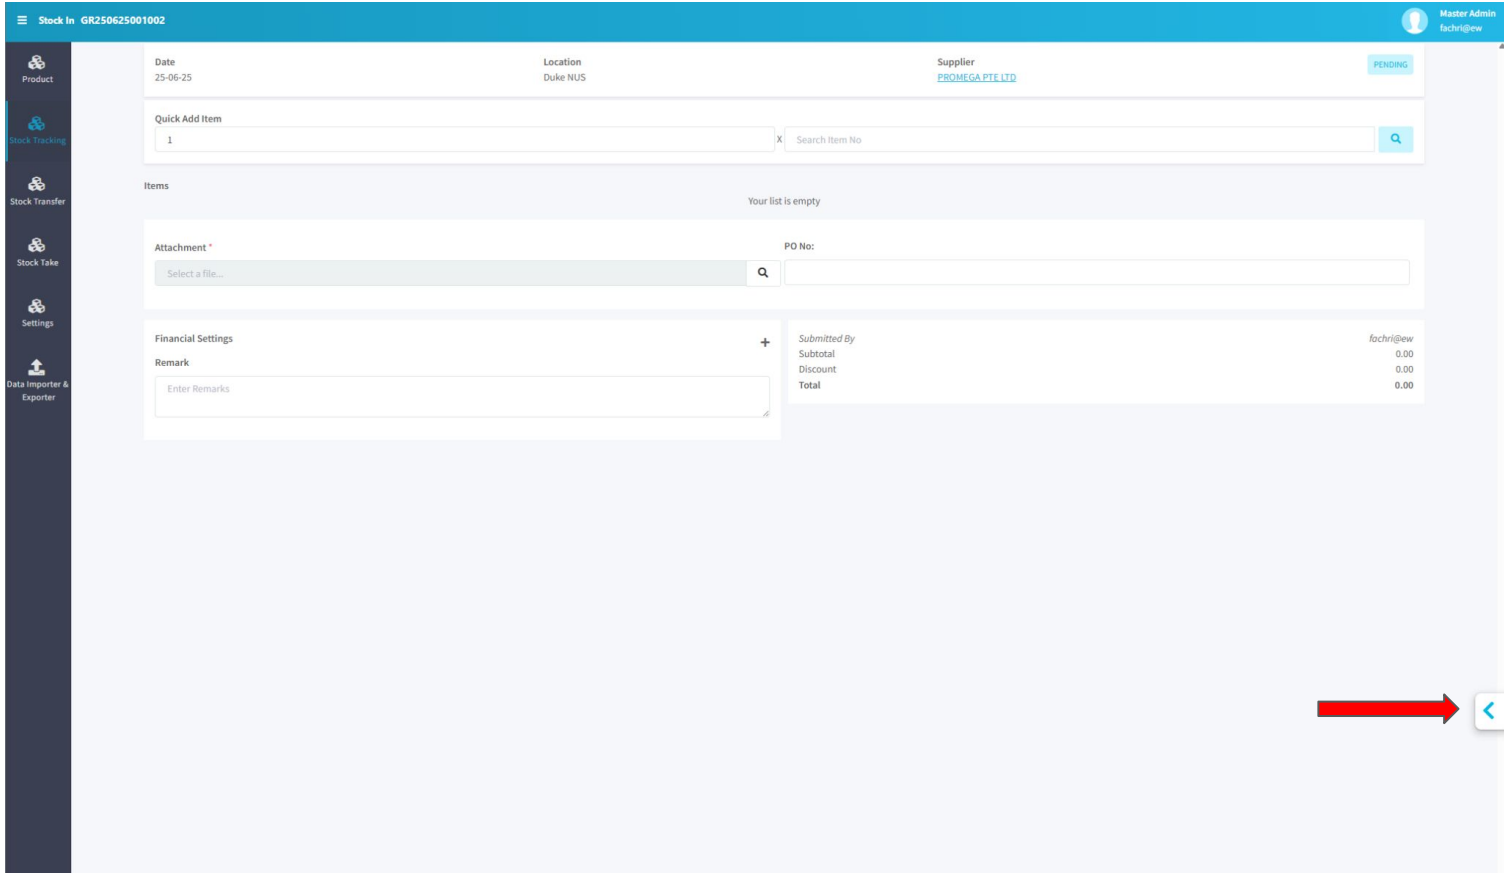

B. Using “Add Low Qty” for Stock In

5. Click Add Low Qty

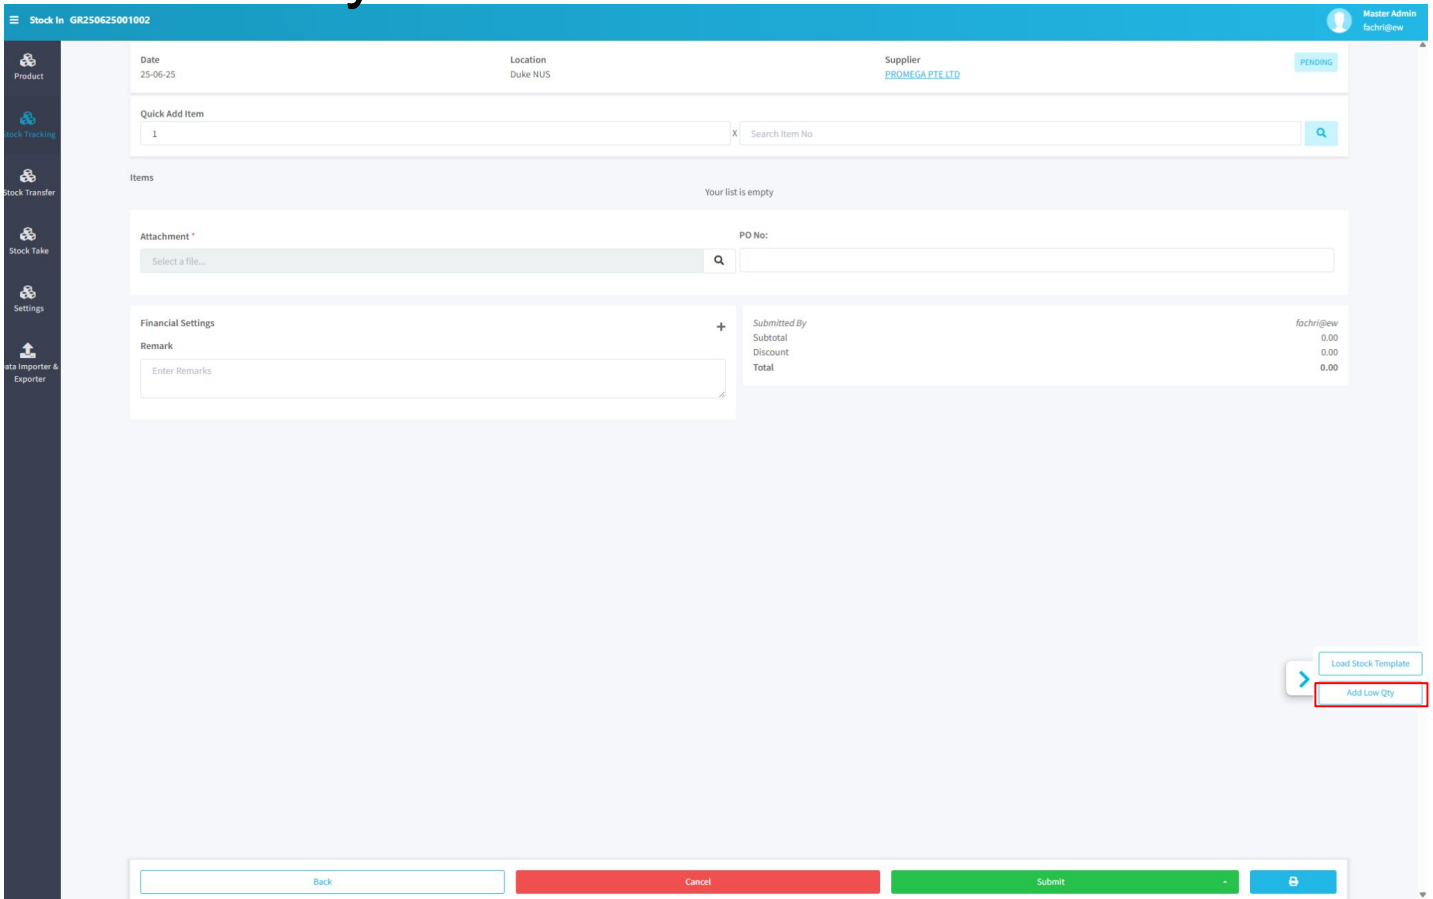

B. Using “Add Low Qty” for Stock In

6. Click ‘Continue’ On the Pop-up

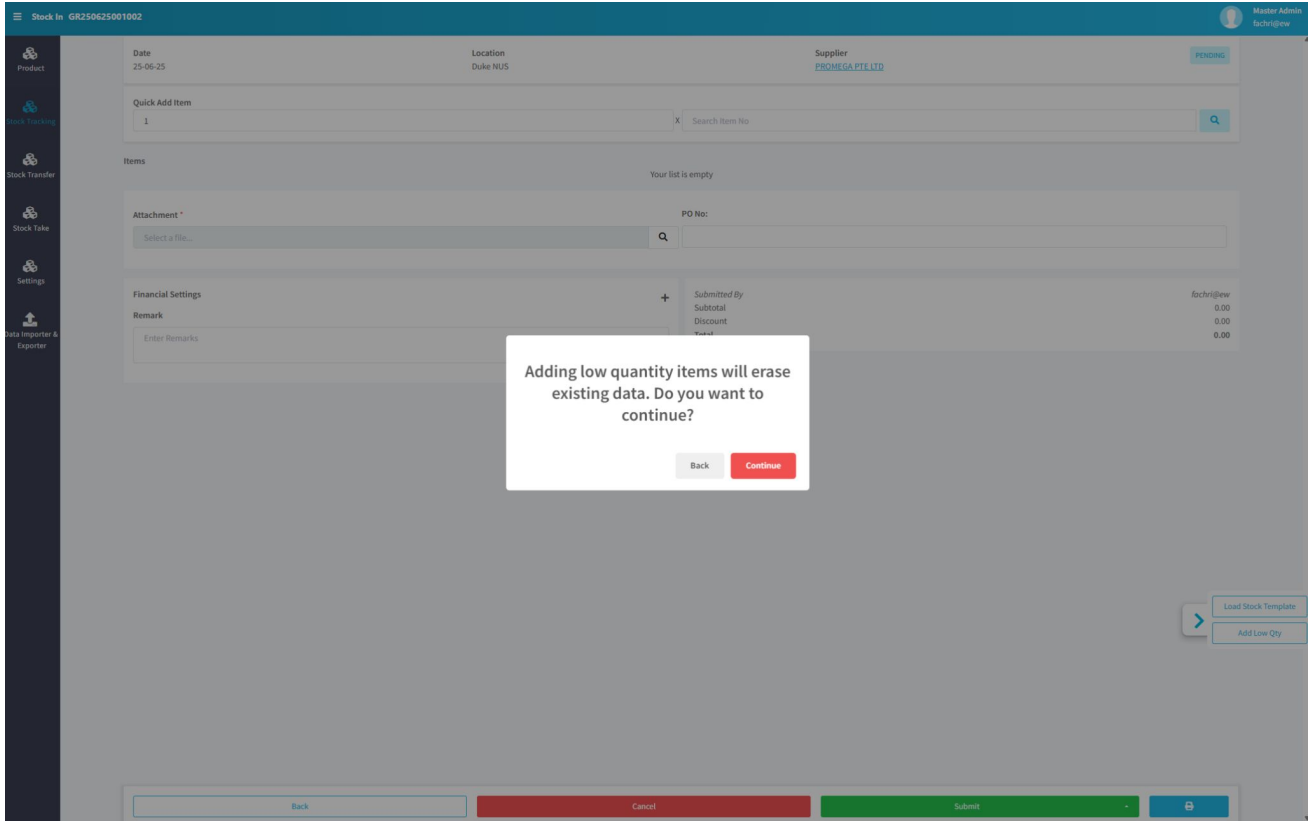

B. Using “Add Low Qty” for Stock In

7.1. It will then automatically add the required quantity to bring the stock level up to the Max Qty value set in Product Setup.

(In this case it’s Item E1960 with Min Qty 10 and Max Qty 20)

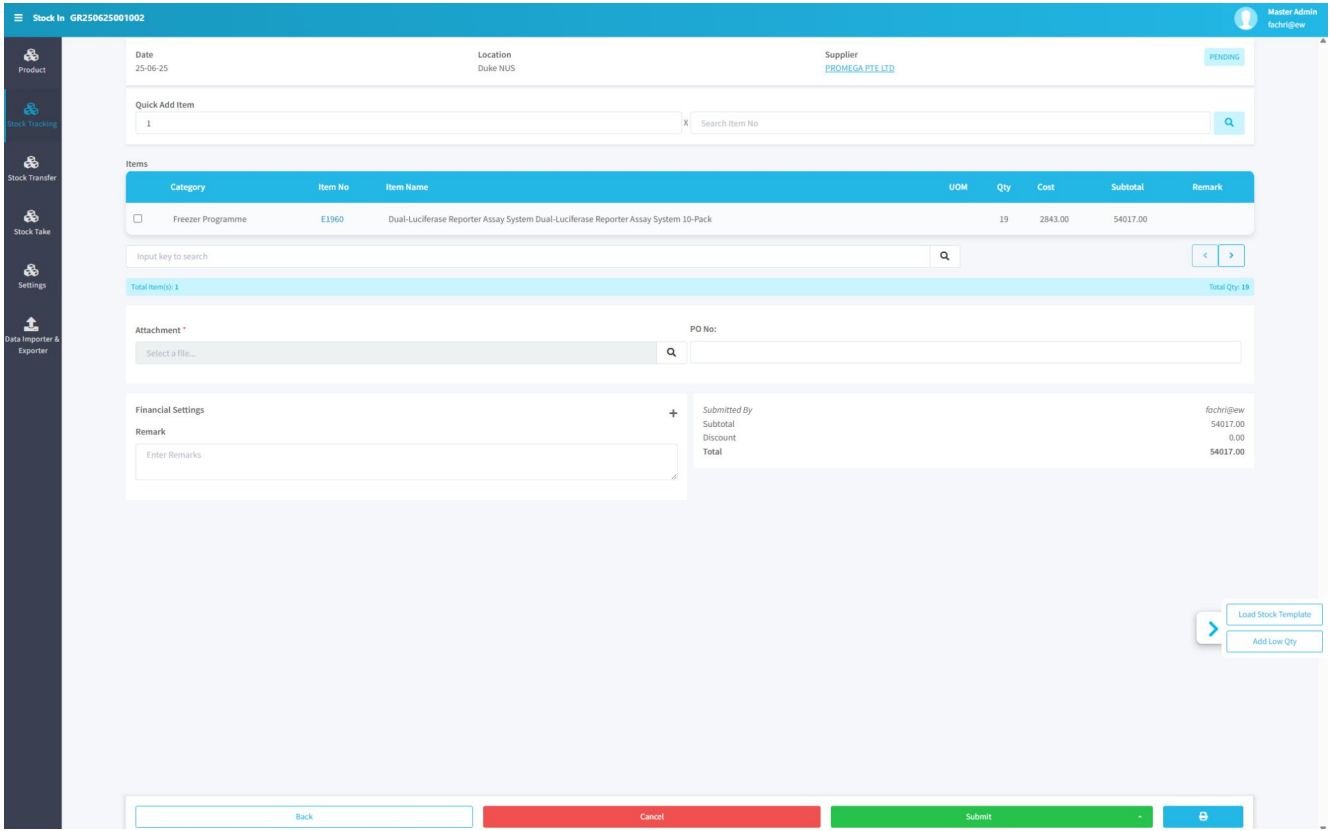

B. Using “Add Low Qty” for Stock In

7.2. For more details, Item E1960 currently has a quantity of 1. Since we Max Qty is set to 20, the system will automatically stock in 19 units to bring the total quantity up to 20.

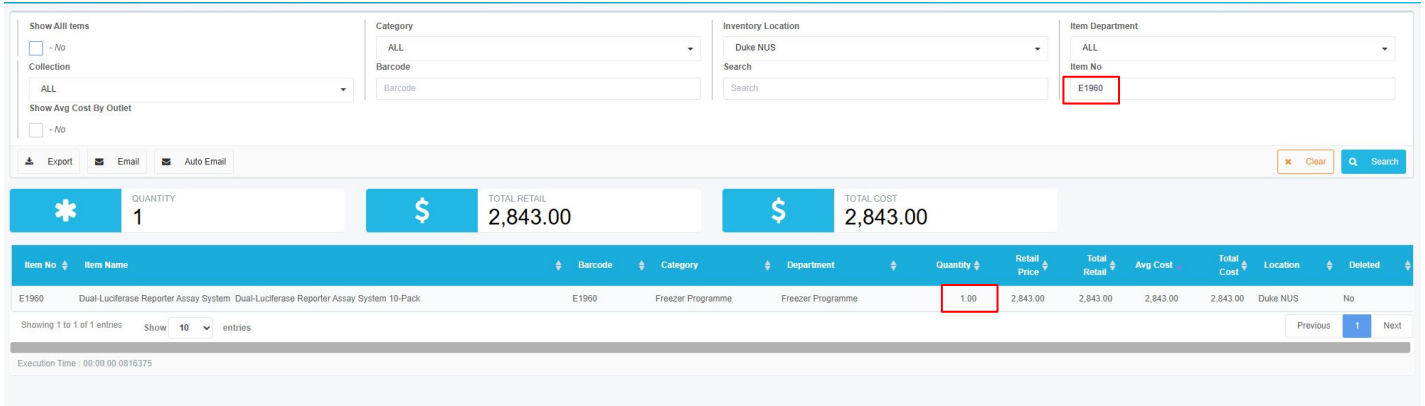

B. Using “Add Low Qty” for Stock In

8. Once the stock-in is ready, click Submit, then proceed to approve the stock-in.

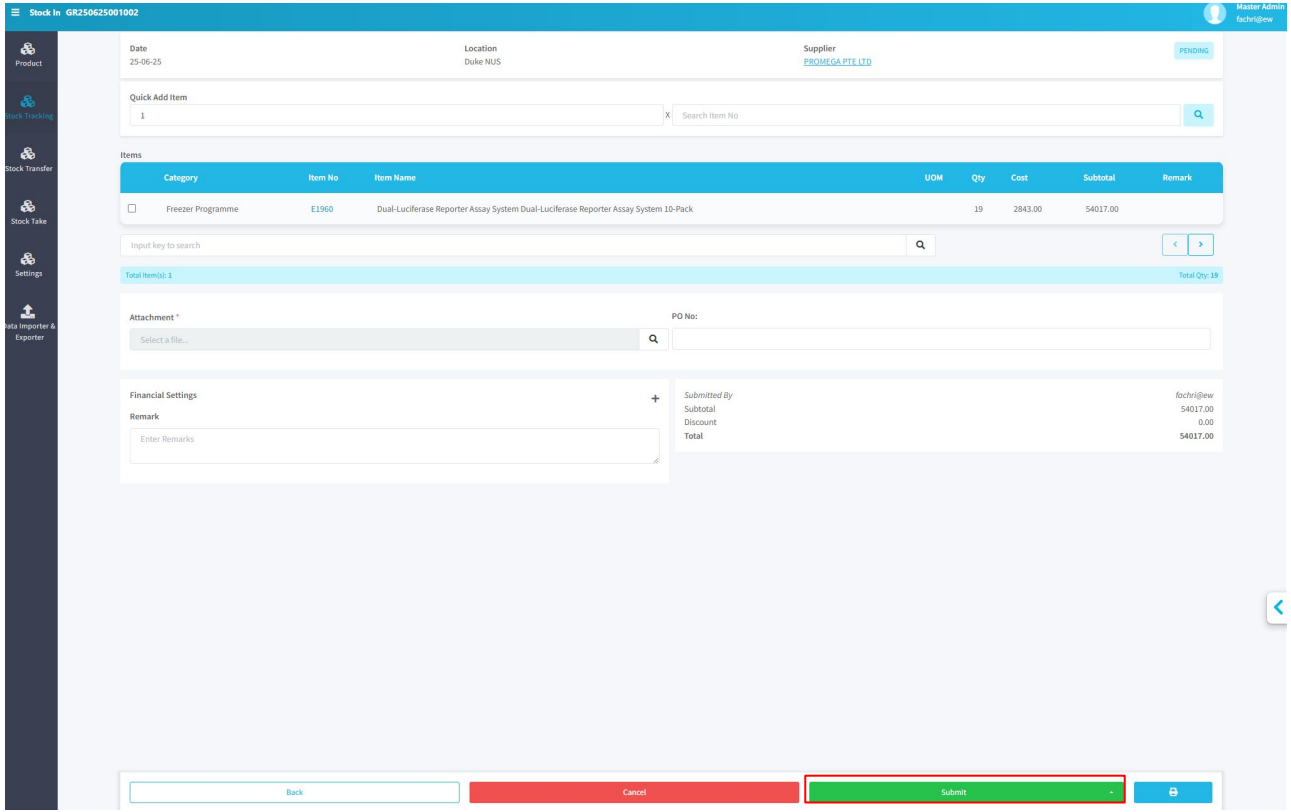

C. Min Sales Days and Max Sales Days

C. Min Sales Days and Max Sales Days

1. **Min Sales Days** and **Max Sales Days** are used to help calculate the minimum and maximum stock quantities needed to support demand and maintain proper inventory levels. When these functions are used, the **Min Qty** and **Max Qty** values will be updated automatically based on the **Min Sales Days** and **Max Sales Days** values.
2. It will Use 3 weeks average sales data to calculate product demand for each store

C. Min Sales Days and Max Sales Days

3. For example, if you set up the values as follows:

- **Min Sales Days** = 4
- **Max Sales Days** = 10
- **Average Daily Sales** = 10 units

Then the calculation will be:

- **Min Qty** = 4 × 10 = 40 units
- **Max Qty** = 10 × 10 = 100 units

4. As a result, the **Min Qty** will automatically be updated to 40, and the **Max Qty** will automatically be updated to 100.

C. Min Sales Days and Max Sales Days

5. To set up Min/Max Sales Days, go to the same tab as Min/Max Qty in the Product Setup.

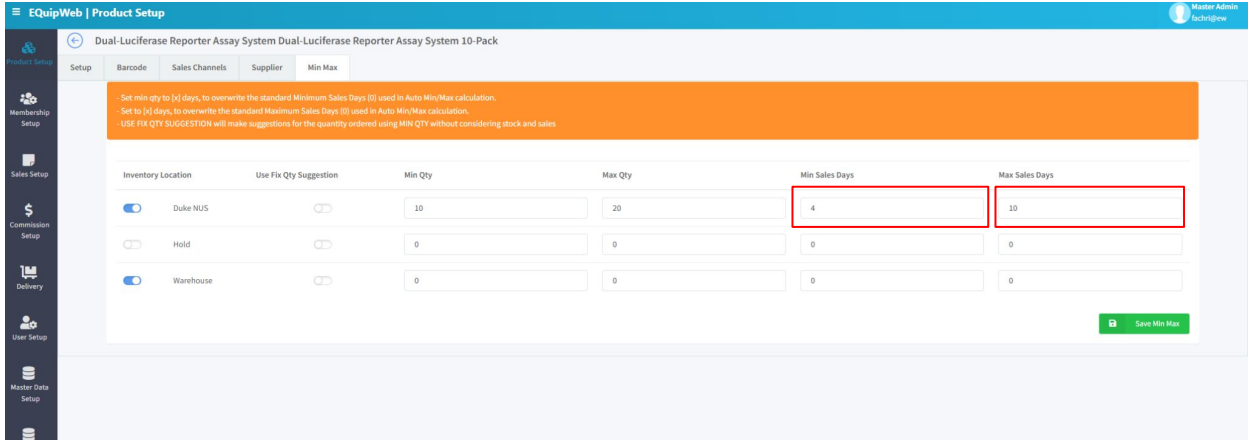

D. Low Qty Importer

D. Low Qty Importer

You can use this importer to update Min/Max quantities for items in batches, instead of updating them one by one through the Product Setup.

D. Low Qty Importer

1. Go to Low Qty Importer

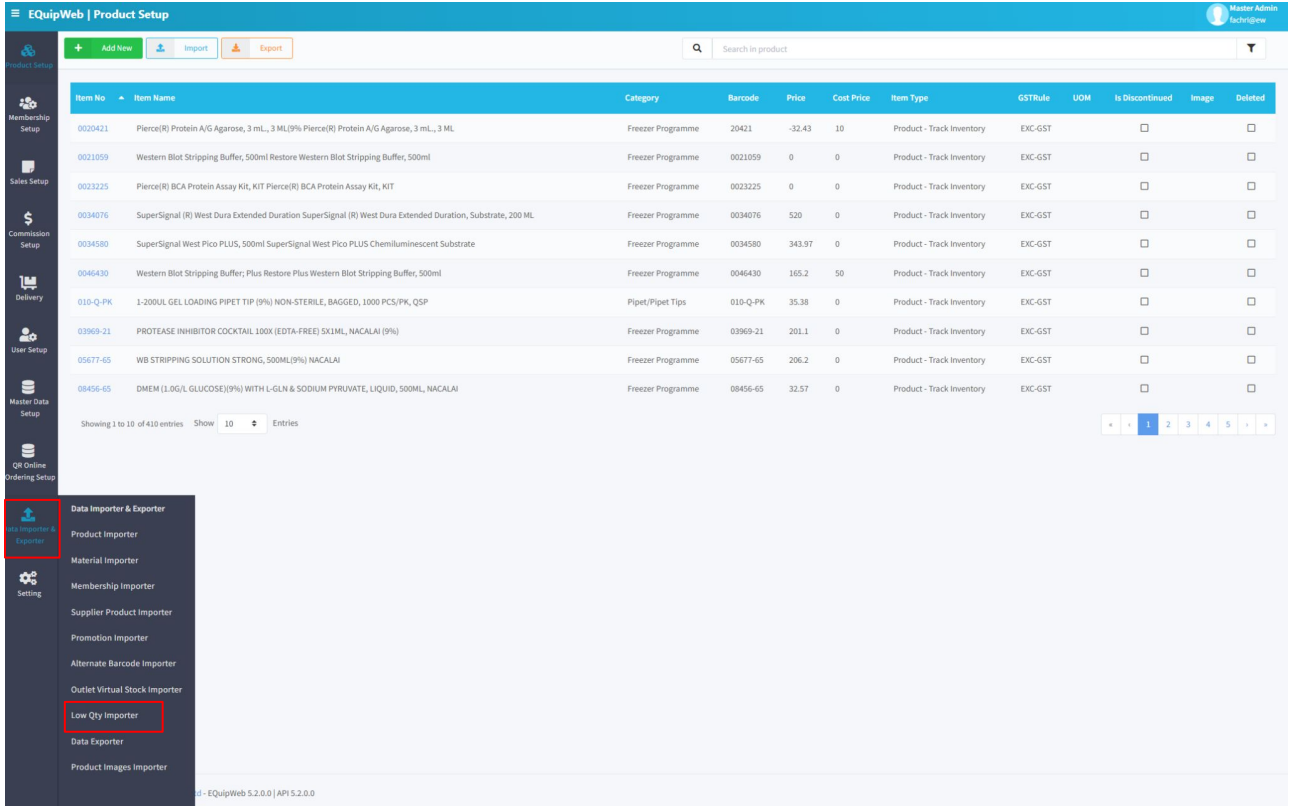

D. Low Qty Importer

2. Change Export to “Export Template for items”

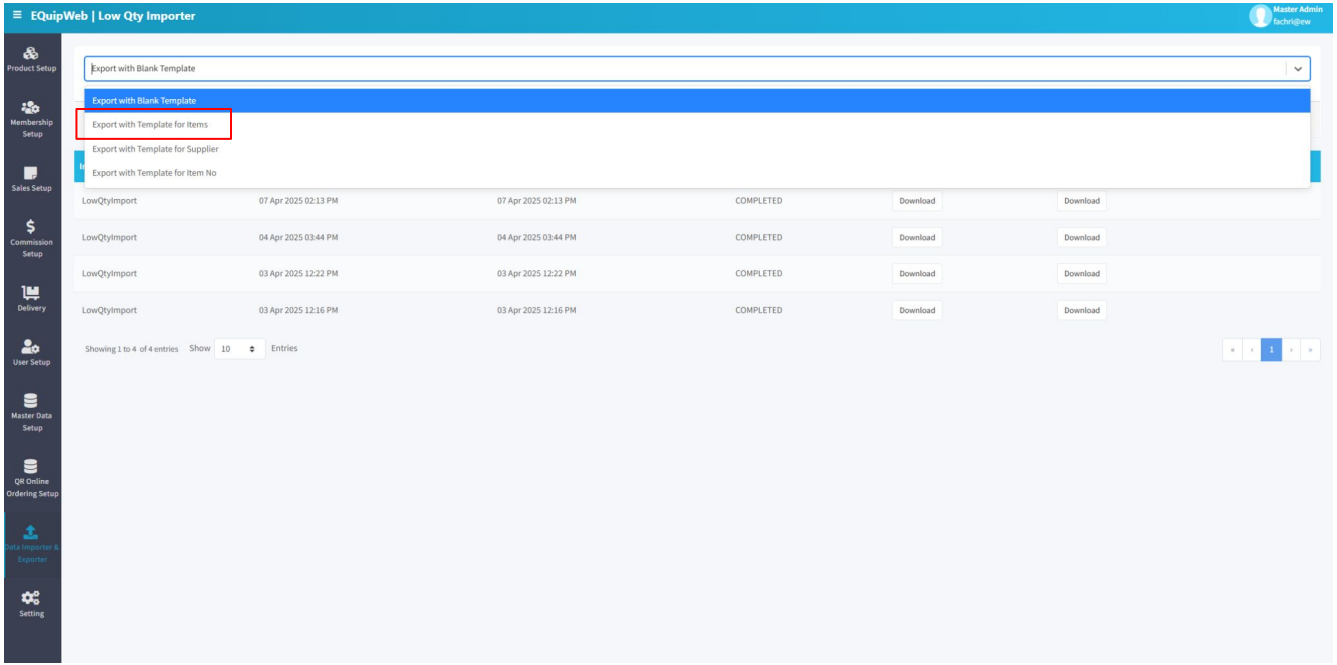

D. Low Qty Importer

3. Click Export

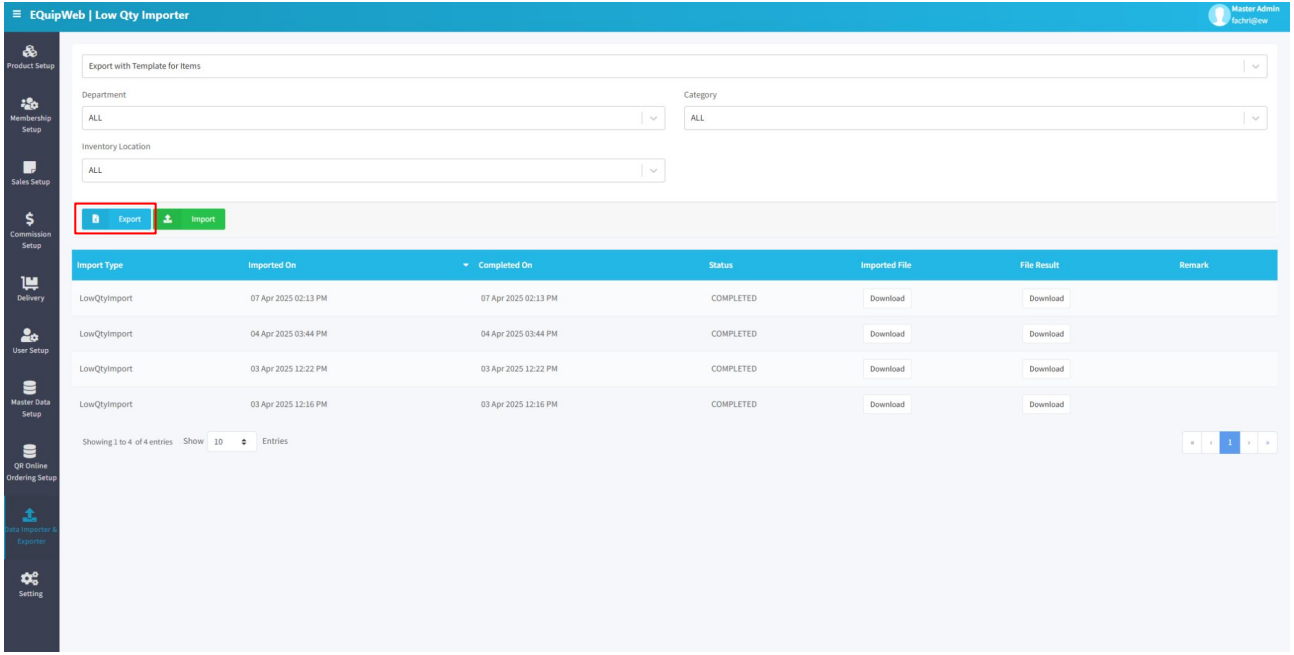

D. Low Qty Importer

4. It will download an Excel file containing all items, along with Min/Max columns, which you can use to update their values.

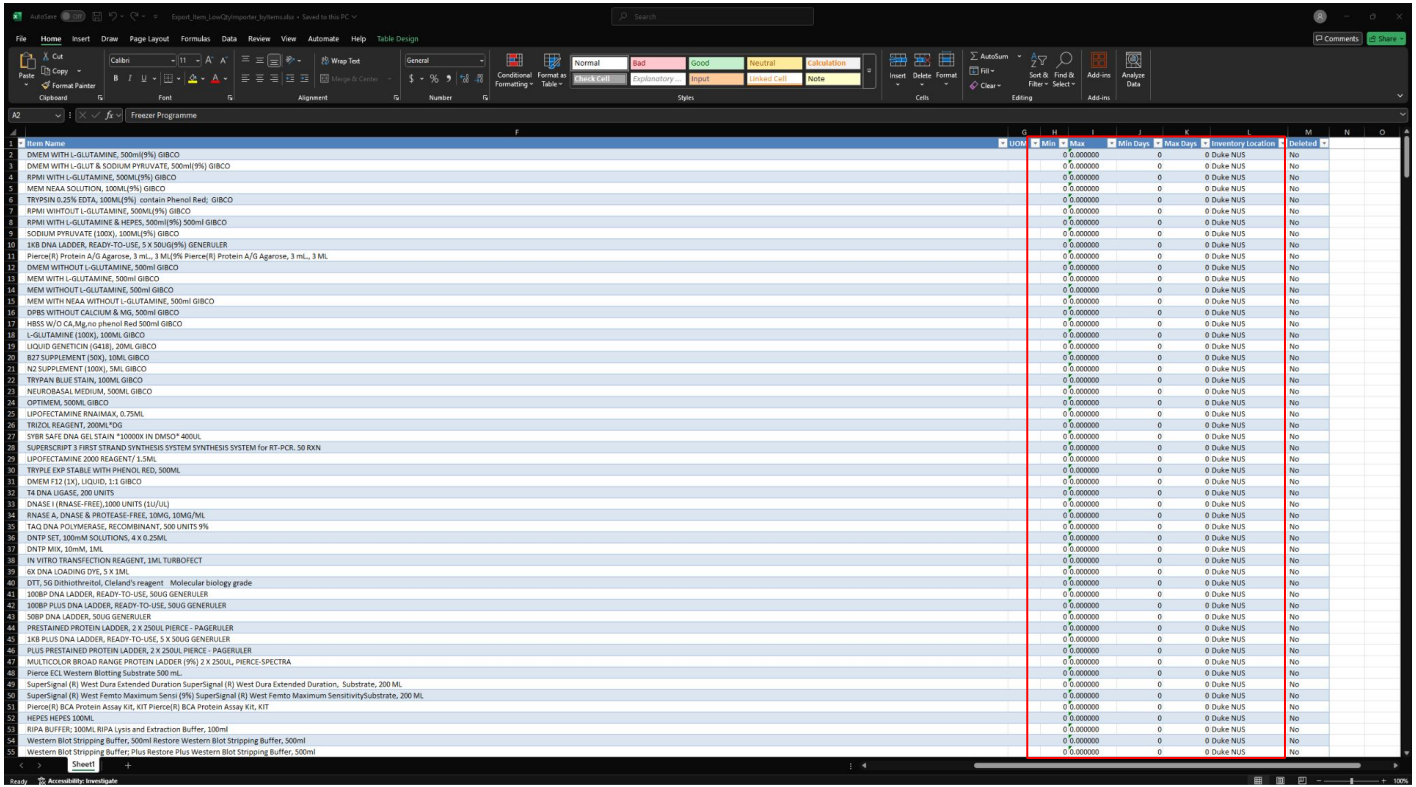

Item Name	UOM	Min	Max	Min Days	Max Days	Inventory Location	Deleted
DMEM WITH L-GLUTAMINE, 500ml(9%) GIBCO		0	0.000000	0	0	Duke NUS	No
DMEM WITH L-GLUT & SODIUM PYRUVATE, 500ml(9%) GIBCO		0	0.000000	0	0	Duke NUS	No
RPMI WITH L-GLUTAMINE, 500ML(9%) GIBCO		0	0.000000	0	0	Duke NUS	No
MEM NEAA SOLUTION, 100ML(9%) GIBCO		0	0.000000	0	0	Duke NUS	No
TRYPSIN 0.25% EDTA, 100ML(9%) contain Phenol Red; GIBCO		0	0.000000	0	0	Duke NUS	No
RPMI WIHTOUT L-GLUTAMINE, 500ML(9%) GIBCO		0	0.000000	0	0	Duke NUS	No
RPMI WITH L-GLUTAMINE & HEPES, 500ml(9%) 500ml GIBCO		0	0.000000	0	0	Duke NUS	No
SODIUM PYRUVATE (100X), 100ML(9%) GIBCO		0	0.000000	0	0	Duke NUS	No
1KB DNA LADDER, READY-TO-USE, 5 X 50UG(9%) GENERULER		0	0.000000	0	0	Duke NUS	No
Pierce(R) Protein A/G Agarose, 3 mL., 3 ML(9% Pierce(R) Protein A/G Agarose, 3 mL., 3 ML		0	0.000000	0	0	Duke NUS	No
DMEM WITHOUT L-GLUTAMINE, 500ml GIBCO		0	0.000000	0	0	Duke NUS	No
MEM WITH L-GLUTAMINE, 500ml GIBCO		0	0.000000	0	0	Duke NUS	No
MEM WITHOUT L-GLUTAMINE, 500ml GIBCO		0	0.000000	0	0	Duke NUS	No
MEM WITH NEAA WITHOUT L-GLUTAMINE, 500ml GIBCO		0	0.000000	0	0	Duke NUS	No
DPBS WITHOUT CALCIUM & MG, 500ml GIBCO		0	0.000000	0	0	Duke NUS	No
HBSS W/O CA,Mg,no phenol Red 500ml GIBCO		0	0.000000	0	0	Duke NUS	No
L-GLUTAMINE (100X), 100ML GIBCO		0	0.000000	0	0	Duke NUS	No
LIQUID GENETICIN (G418), 20ML GIBCO		0	0.000000	0	0	Duke NUS	No
B27 SUPPLEMENT (50X), 10ML GIBCO		0	0.000000	0	0	Duke NUS	No
N2 SUPPLEMENT (100X), 5ML GIBCO		0	0.000000	0	0	Duke NUS	No
TRYPAN BLUE STAIN, 100ML GIBCO		0	0.000000	0	0	Duke NUS	No
NEUROBASAL MEDIUM, 500ML GIBCO		0	0.000000	0	0	Duke NUS	No
OPTIMEM, 500ML GIBCO		0	0.000000	0	0	Duke NUS	No
LIPOFECTAMINE RNAIMAX, 0.75ML		0	0.000000	0	0	Duke NUS	No
TRIZOL REAGENT, 200ML*DG		0	0.000000	0	0	Duke NUS	No
SYBR SAFE DNA GEL STAIN *10000X IN DMSO* 400UL		0	0.000000	0	0	Duke NUS	No
SUPERSCRIPT 3 FIRST STRAND SYNTHESIS SYSTEM SYNTHESIS SYSTEM for RT-PCR, 50 RXN		0	0.000000	0	0	Duke NUS	No
LIPOFECTAMINE 2000 REAGENT/ 1.5ML		0	0.000000	0	0	Duke NUS	No
TRYPLE EXP STABLE WITH PHENOL RED, 500ML		0	0.000000	0	0	Duke NUS	No
DMEM F12 (1X), LIQUID, 1:1 GIBCO		0	0.000000	0	0	Duke NUS	No
T4 DNA LIGASE, 200 UNITS		0	0.000000	0	0	Duke NUS	No
DNASE I (RNASE-FREE),1000 UNITS (1U/UL)		0	0.000000	0	0	Duke NUS	No
RNASE A, DNASE & PROTEASE-FREE, 10MG, 10MG/ML		0	0.000000	0	0	Duke NUS	No
TAQ DNA POLYMERASE, RECOMBINANT, 500 UNITS 9%		0	0.000000	0	0	Duke NUS	No
DNTP SET, 100mM SOLUTIONS, 4 X 0.25ML		0	0.000000	0	0	Duke NUS	No
DNTP MIX, 10mM, 1ML		0	0.000000	0	0	Duke NUS	No
IN VITRO TRANSFECTION REAGENT, 1ML TURBOFECT		0	0.000000	0	0	Duke NUS	No
6X DNA LOADING DYE, 5 X 1ML		0	0.000000	0	0	Duke NUS	No
DTT, 5G Dithiothreitol, Cleland's reagent Molecular biology grade		0	0.000000	0	0	Duke NUS	No
100BP DNA LADDER, READY-TO-USE, 50UG GENERULER		0	0.000000	0	0	Duke NUS	No
100BP PLUS DNA LADDER, READY-TO-USE, 50UG GENERULER		0	0.000000	0	0	Duke NUS	No
50BP DNA LADDER, 50UG GENERULER		0	0.000000	0	0	Duke NUS	No
PRESTAINED PROTEIN LADDER, 2 X 250UL PIERCE - PAGERULER		0	0.000000	0	0	Duke NUS	No
1KB PLUS DNA LADDER, READY-TO-USE, 5 X 50UG GENERULER		0	0.000000	0	0	Duke NUS	No
PLUS PRESTAINED PROTEIN LADDER, 2 X 250UL PIERCE - PAGERULER		0	0.000000	0	0	Duke NUS	No
MULTICOLOR BROAD RANGE PROTEIN LADDER (9%) 2 X 250UL, PIERCE-SPECTRA		0	0.000000	0	0	Duke NUS	No
Pierce ECL Western Blotting Substrate 500 mL.		0	0.000000	0	0	Duke NUS	No
SuperSignal (R) West Dura Extended Duration SuperSignal (R) West Dura Extended Duration, Substrate, 200 ML		0	0.000000	0	0	Duke NUS	No
SuperSignal (R) West Femto Maximum Sensi (9%) SuperSignal (R) West Femto Maximum SensitivitySubstrate, 200 ML		0	0.000000	0	0	Duke NUS	No
Pierce(R) BCA Protein Assay Kit, KIT Pierce(R) BCA Protein Assay Kit, KIT		0	0.000000	0	0	Duke NUS	No
HEPES HEPES 100ML		0	0.000000	0	0	Duke NUS	No
RIPA BUFFER; 100ML RIPA Lysis and Extraction Buffer, 100ml		0	0.000000	0	0	Duke NUS	No
Western Blot Stripping Buffer, 500ml Restore Western Blot Stripping Buffer, 500ml		0	0.000000	0	0	Duke NUS	No
Western Blot Stripping Buffer; Plus Restore Plus Western Blot Stripping Buffer, 500ml		0	0.000000	0	0	Duke NUS	No

D. Low Qty Importer

5. Once you have finished updating the Min/Max columns.
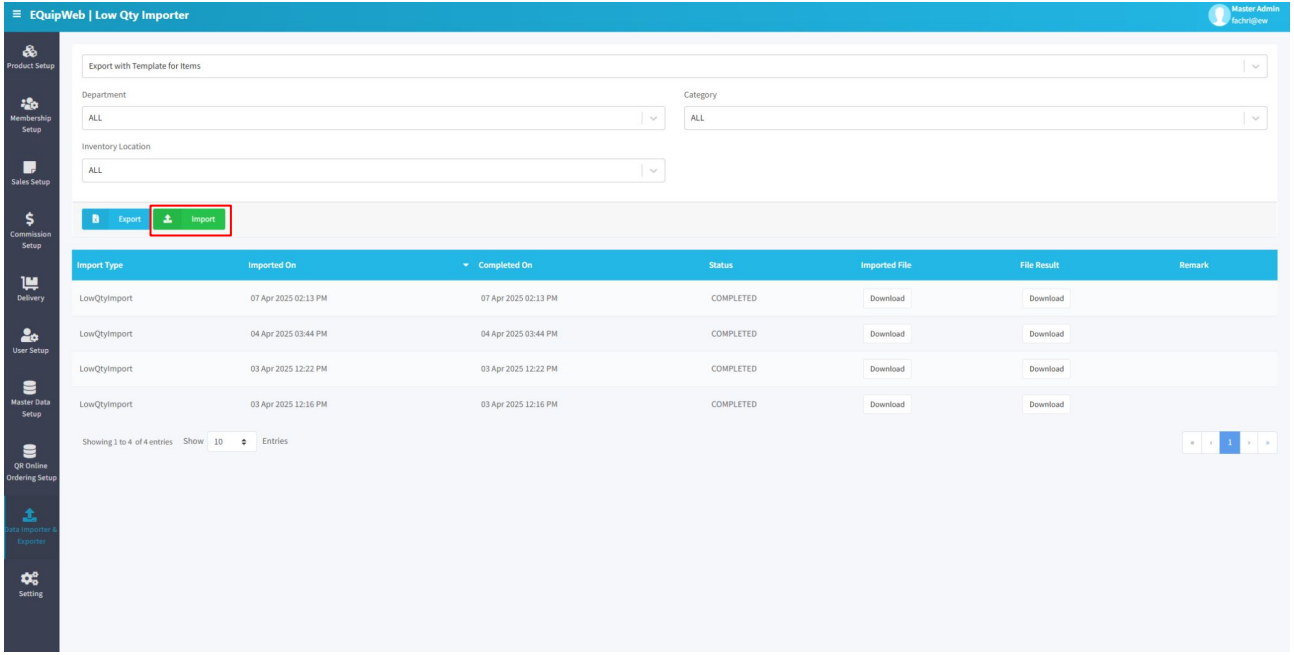
6. save the Excel file and import it on the Low Qty Importer.