Energy & Occupancy 2025

Month

01 January 2026	02 February 2026	03 March 2026
04 April 2026	05 May 2026	06 June 2026
07 July 2026	08 August 2026	09 September 2026


Building


Central Plaza	Harbour Tower	Northfield Campus
Tech Park A	Tech Park B	Westgate Retail


Building Type

Campus	Office	Retail
Tech		

Sum of Total kWh 8.85M	Sum of Energy Cost 1.28M
kWh per sqm 72.56	Weekend Load % 44.46%

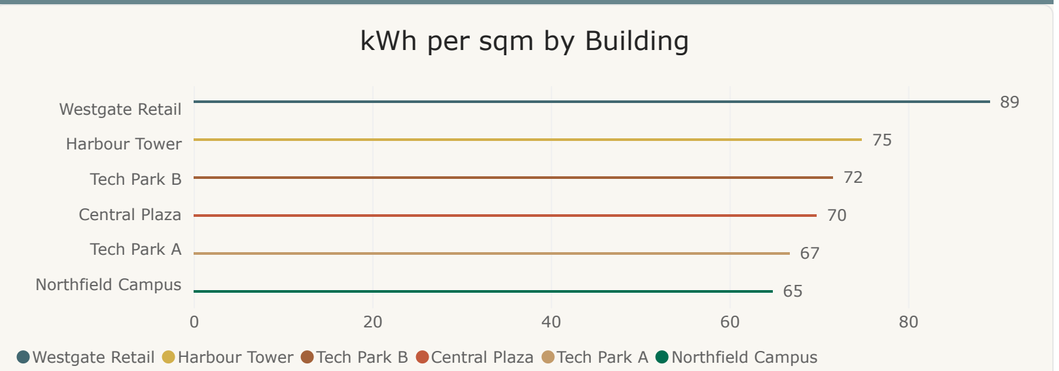

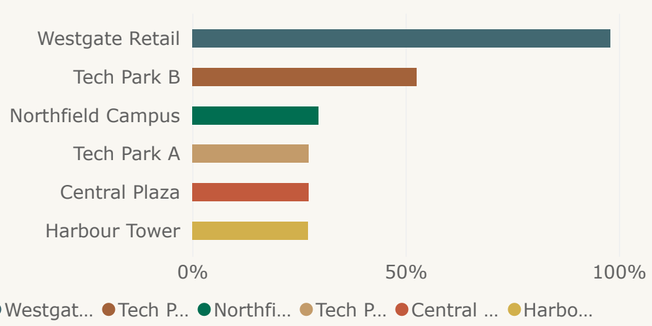

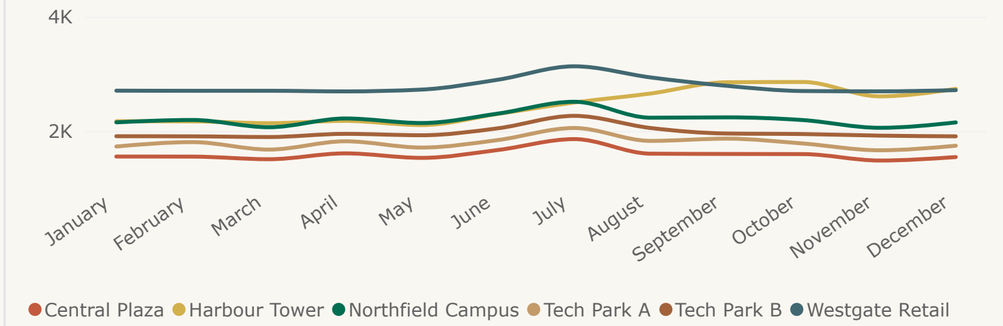

Building Heatmap Matrix

Building	1 Mon	2 Tue	3 Wed	4 Thu	5 Fri	6 Sat	7 Sun	Total
Central Plaza	60.16	77.63	79.31	72.99	43.93	7.41	5.98	**49.71**
Harbour Tower	60.83	78.03	78.56	72.61	43.69	7.01	6.55	**49.69**
Northfield Campus	53.65	70.66	70.87	64.76	39.66	9.13	10.28	**45.64**
Tech Park A	60.21	77.57	77.92	73.00	43.68	6.32	5.99	**49.32**
Tech Park B	59.70	78.62	77.78	73.82	45.09	5.83	5.55	**49.56**
Westgate Retail	53.06	55.31	53.65	53.84	54.53	70.28	69.89	**58.64**
Total	**57.93**	**72.97**	**73.01**	**68.51**	**45.10**	**17.66**	**17.37**	**50.43**

What the data shows:

- Tech Park B uses 52% of its weekday electricity at weekends with almost no one in. Similar buildings use 27%.
- Harbour Tower's electricity rose 25% from mid August with no change in occupancy.
- Westgate Retail is highest per square metre, but it trades at weekends.
- Other buildings energy follows how many people are in.

Recommendations:

- Fix the weekend building management schedule at Tech Park B. Low cost risk of upsetting weekend users.
- Inspect Harbour Tower's chiller and controls. Engineer cost now stops a continuing 25% overspend.
- Check the weekend and out of hours schedules at the other sites against occupancy. Needs reliable occupancy data small savings per site.