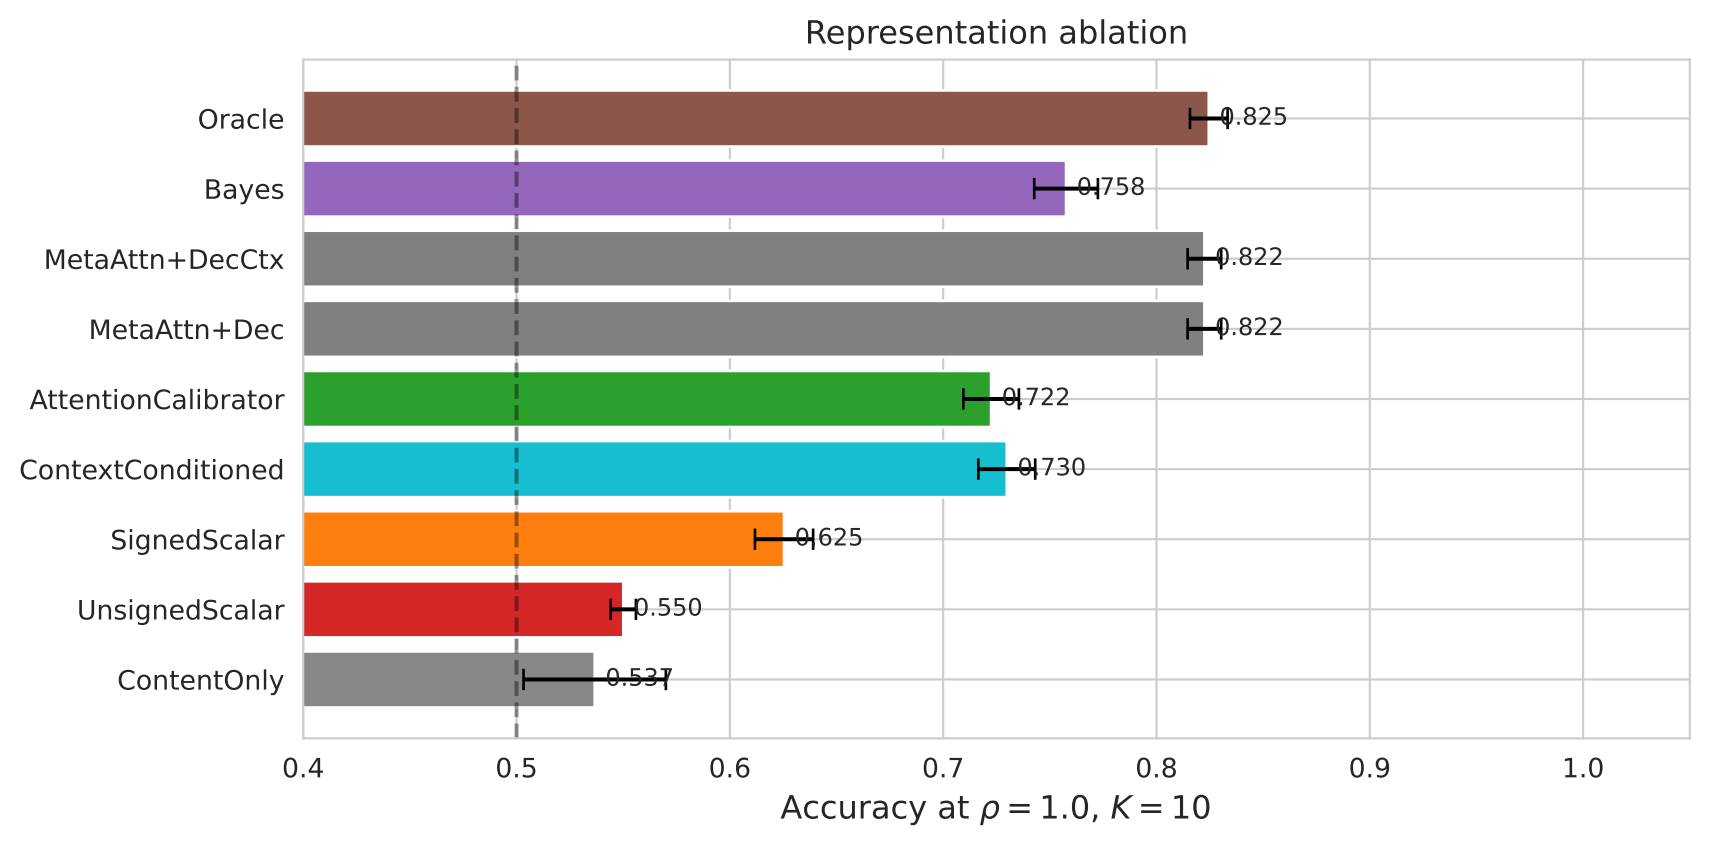
Representation ablation
Oracle
Bayes
MetaAttn+DecCtx
MetaAttn+Dec
AttentionCalibrator
ContextConditioned
SignedScalar
UnsignedScalar
ContentOnly
0.825
0.758
0.822
0.822
0.722
0.730
0.625
0.550
0.537
0.4
0.5
0.6
0.7
0.8
0.9
1.0
Accuracy at $\rho = 1.0$, $K = 10$