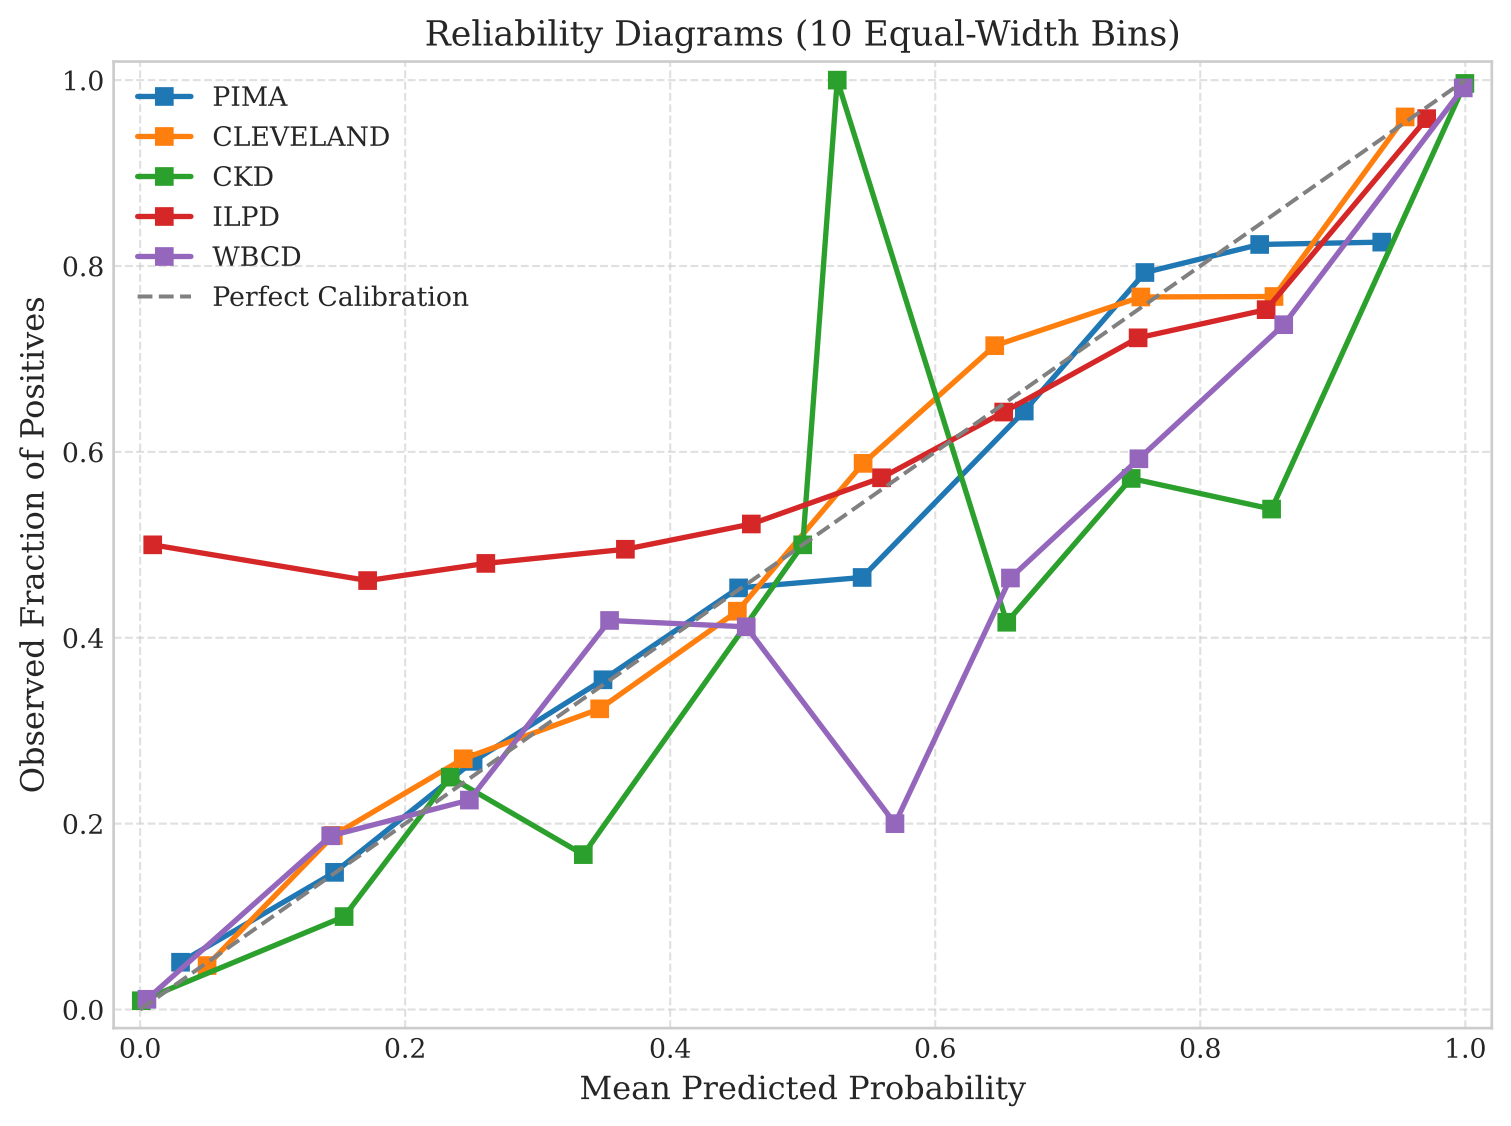
Reliability Diagrams (10 Equal-Width Bins)
PIMA
CLEVELAND
CKD
ILPD
WBCD
Perfect Calibration
Observed Fraction of Positives
Mean Predicted Probability
0.0
0.2
0.4
0.6
0.8
1.0