


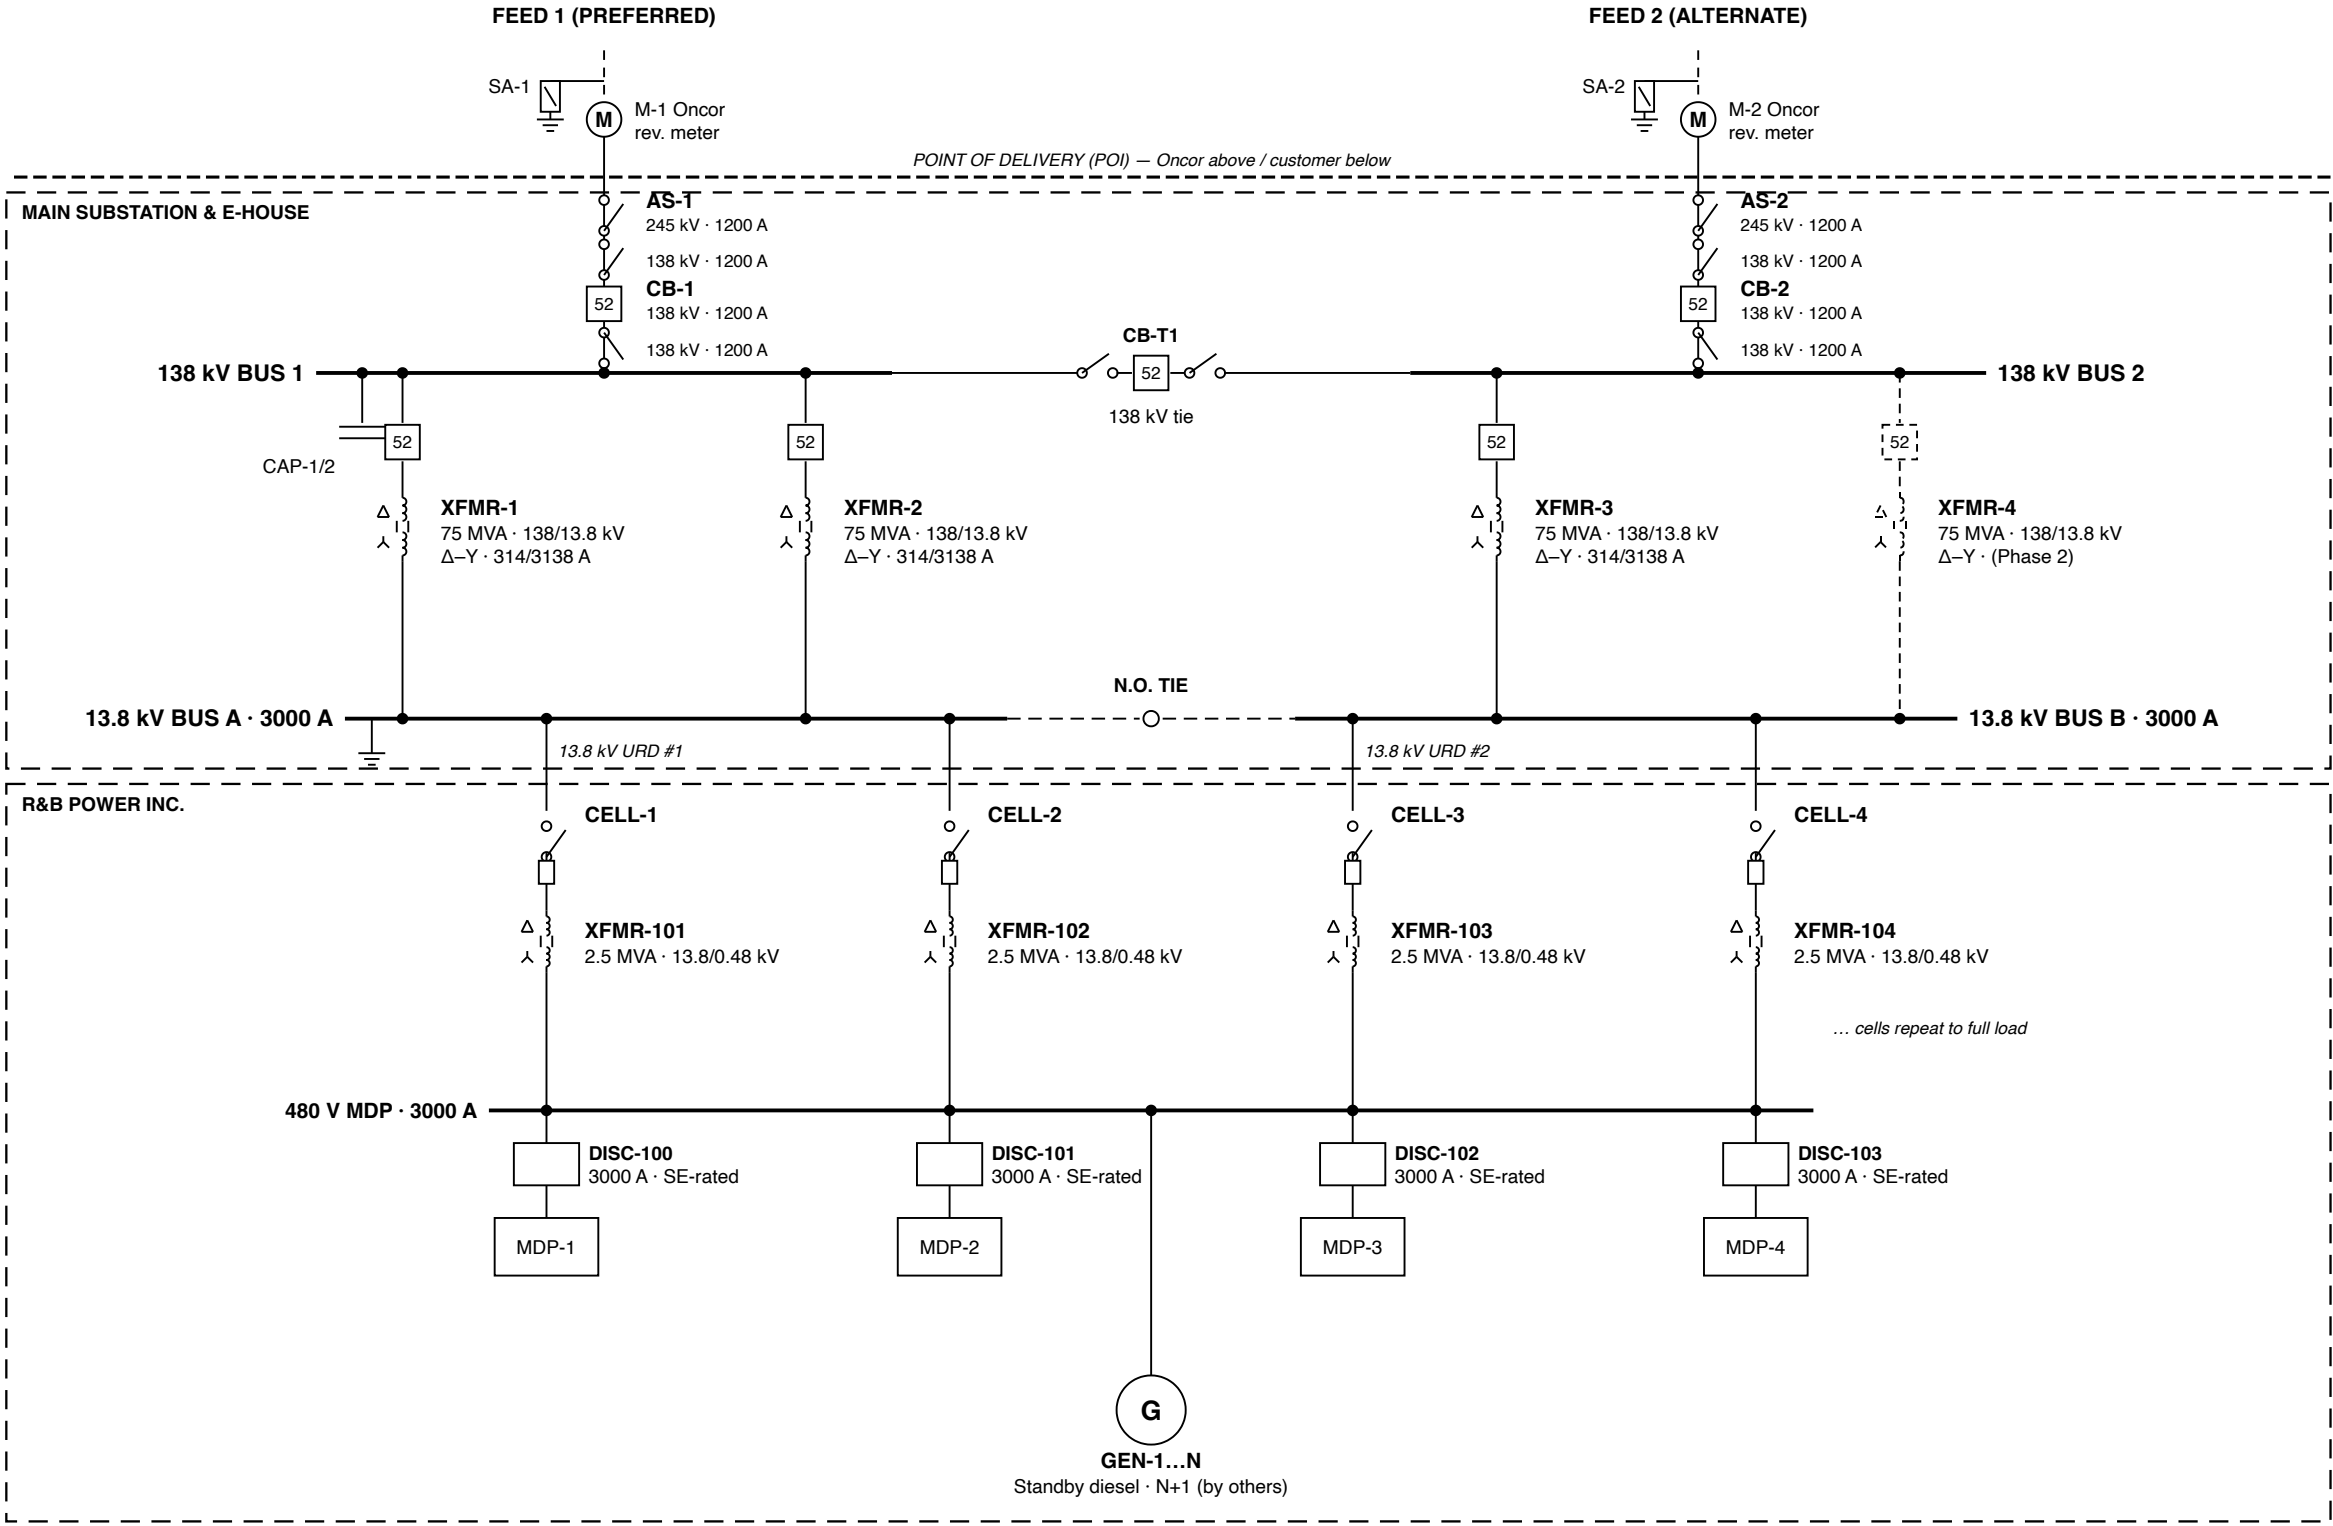

GENERAL NOTES

1. Service: dual (two-way) 138 kV feed; Oncor revenue metering (xfmr-rated) & arresters above POI.
2. Ultimate 175 MW (~180 MVA @ 0.97 pf), data center. Phased: 100 MW (2027) → 175 MW (2028).
3. 4 × 75 MVA (N-1 firm 225 MVA); dashed transformers = future phase.
4. 138 kV main-tie-main + 13.8 kV N.O. tie; no parallel of feeds without Oncor approval.
5. %Z, tap range, kA, CT/PT & relays — by final design.

LEGEND

- Disconnect switch
- 52 Circuit breaker
- Power transformer (Δ-Y)
- Fuse
- Capacitor bank
- Generator
- Surge arrester
- Revenue meter
- Connection (junction)

REV 1 · Issued for Interconnection Study · RBP · 2026-06-08

ELECTRICAL ONE-LINE DIAGRAM

NTSM Airport Quarry — McKinney, TX

McKinney, TX 75070

Oncor WO 32484946 · Sub 309443

Customer: NTNSM, LLC

R&B Power Inc.

Dwg RB-AQ-E-001 · Rev 1

Scale: AS SHOWN · Sheet 1 of 1

Study-stage · not for construction

TOTAL CONNECTED LOAD: 175 MW (~180 MVA @ 0.97 pf) · data center

Service: dual 138 kV feed · 1192.5 kcmil ACSR · 4 × 75 MVA (N-1 firm 225) · per-feed 755 A