



(a) Voltage restoration on the worst confirmed day

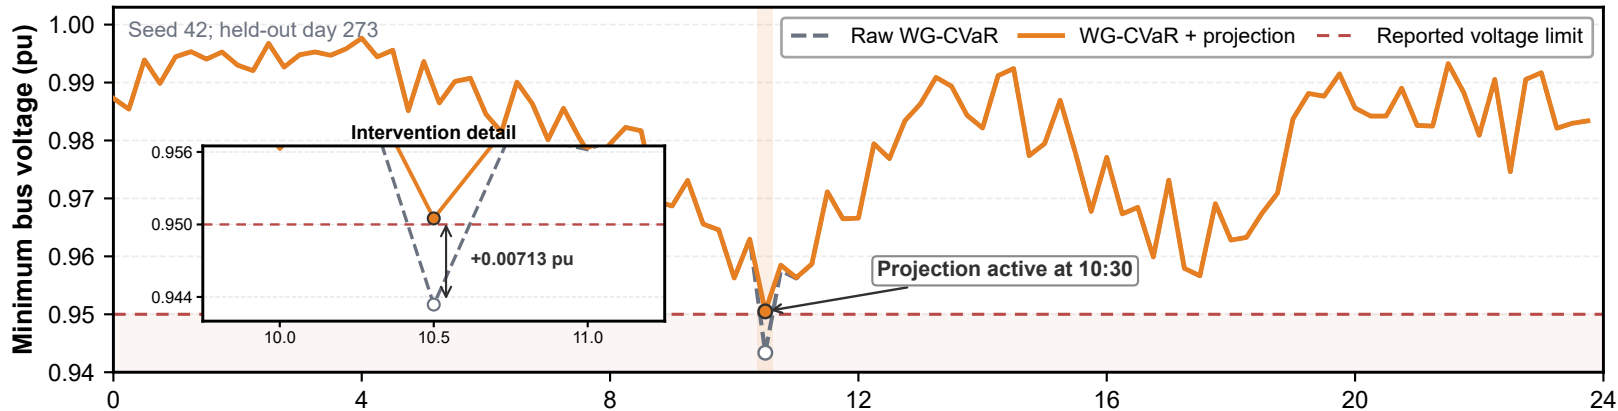

(b) Device allocation at 10:30

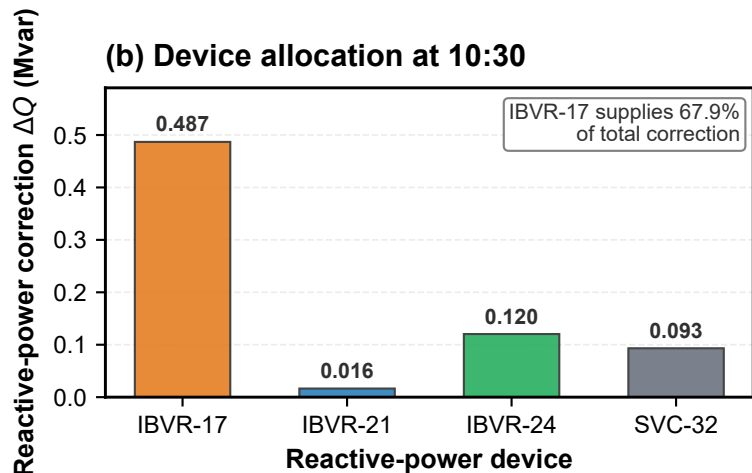

(c) Incremental line-loss effect

