


# Z-score distribution : Standard SISPA for oral swab samples

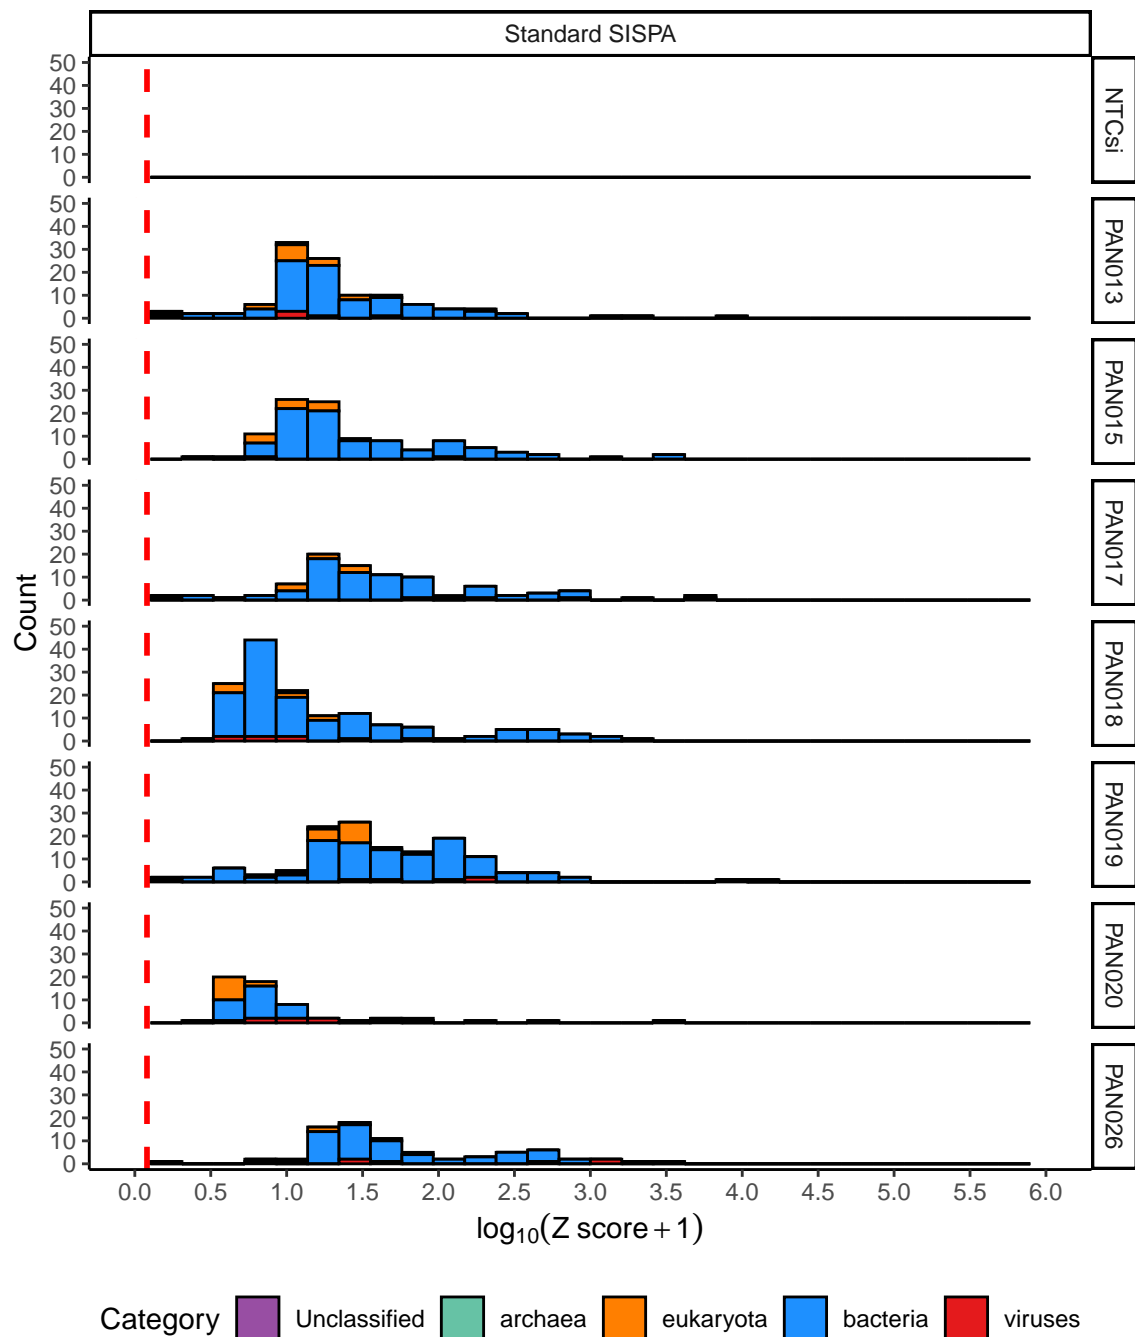

Red dashed line = z-score threshold from NTCs: 0.08