


THIS SPOOL MARKUP DRAWING IS GENERATED FROM ENGINEERING PDF & REFERRING APPROVED ENGG ISOMETRICS. ENGINEERING ISOMETRICS TO BE REFERRED FOR REVISION APPROVAL INFORMATION & IN CASE OF ANY DISCREPANCY DATA GIVEN IN ENGINEERING ISOMETRIC SHALL GOVERN

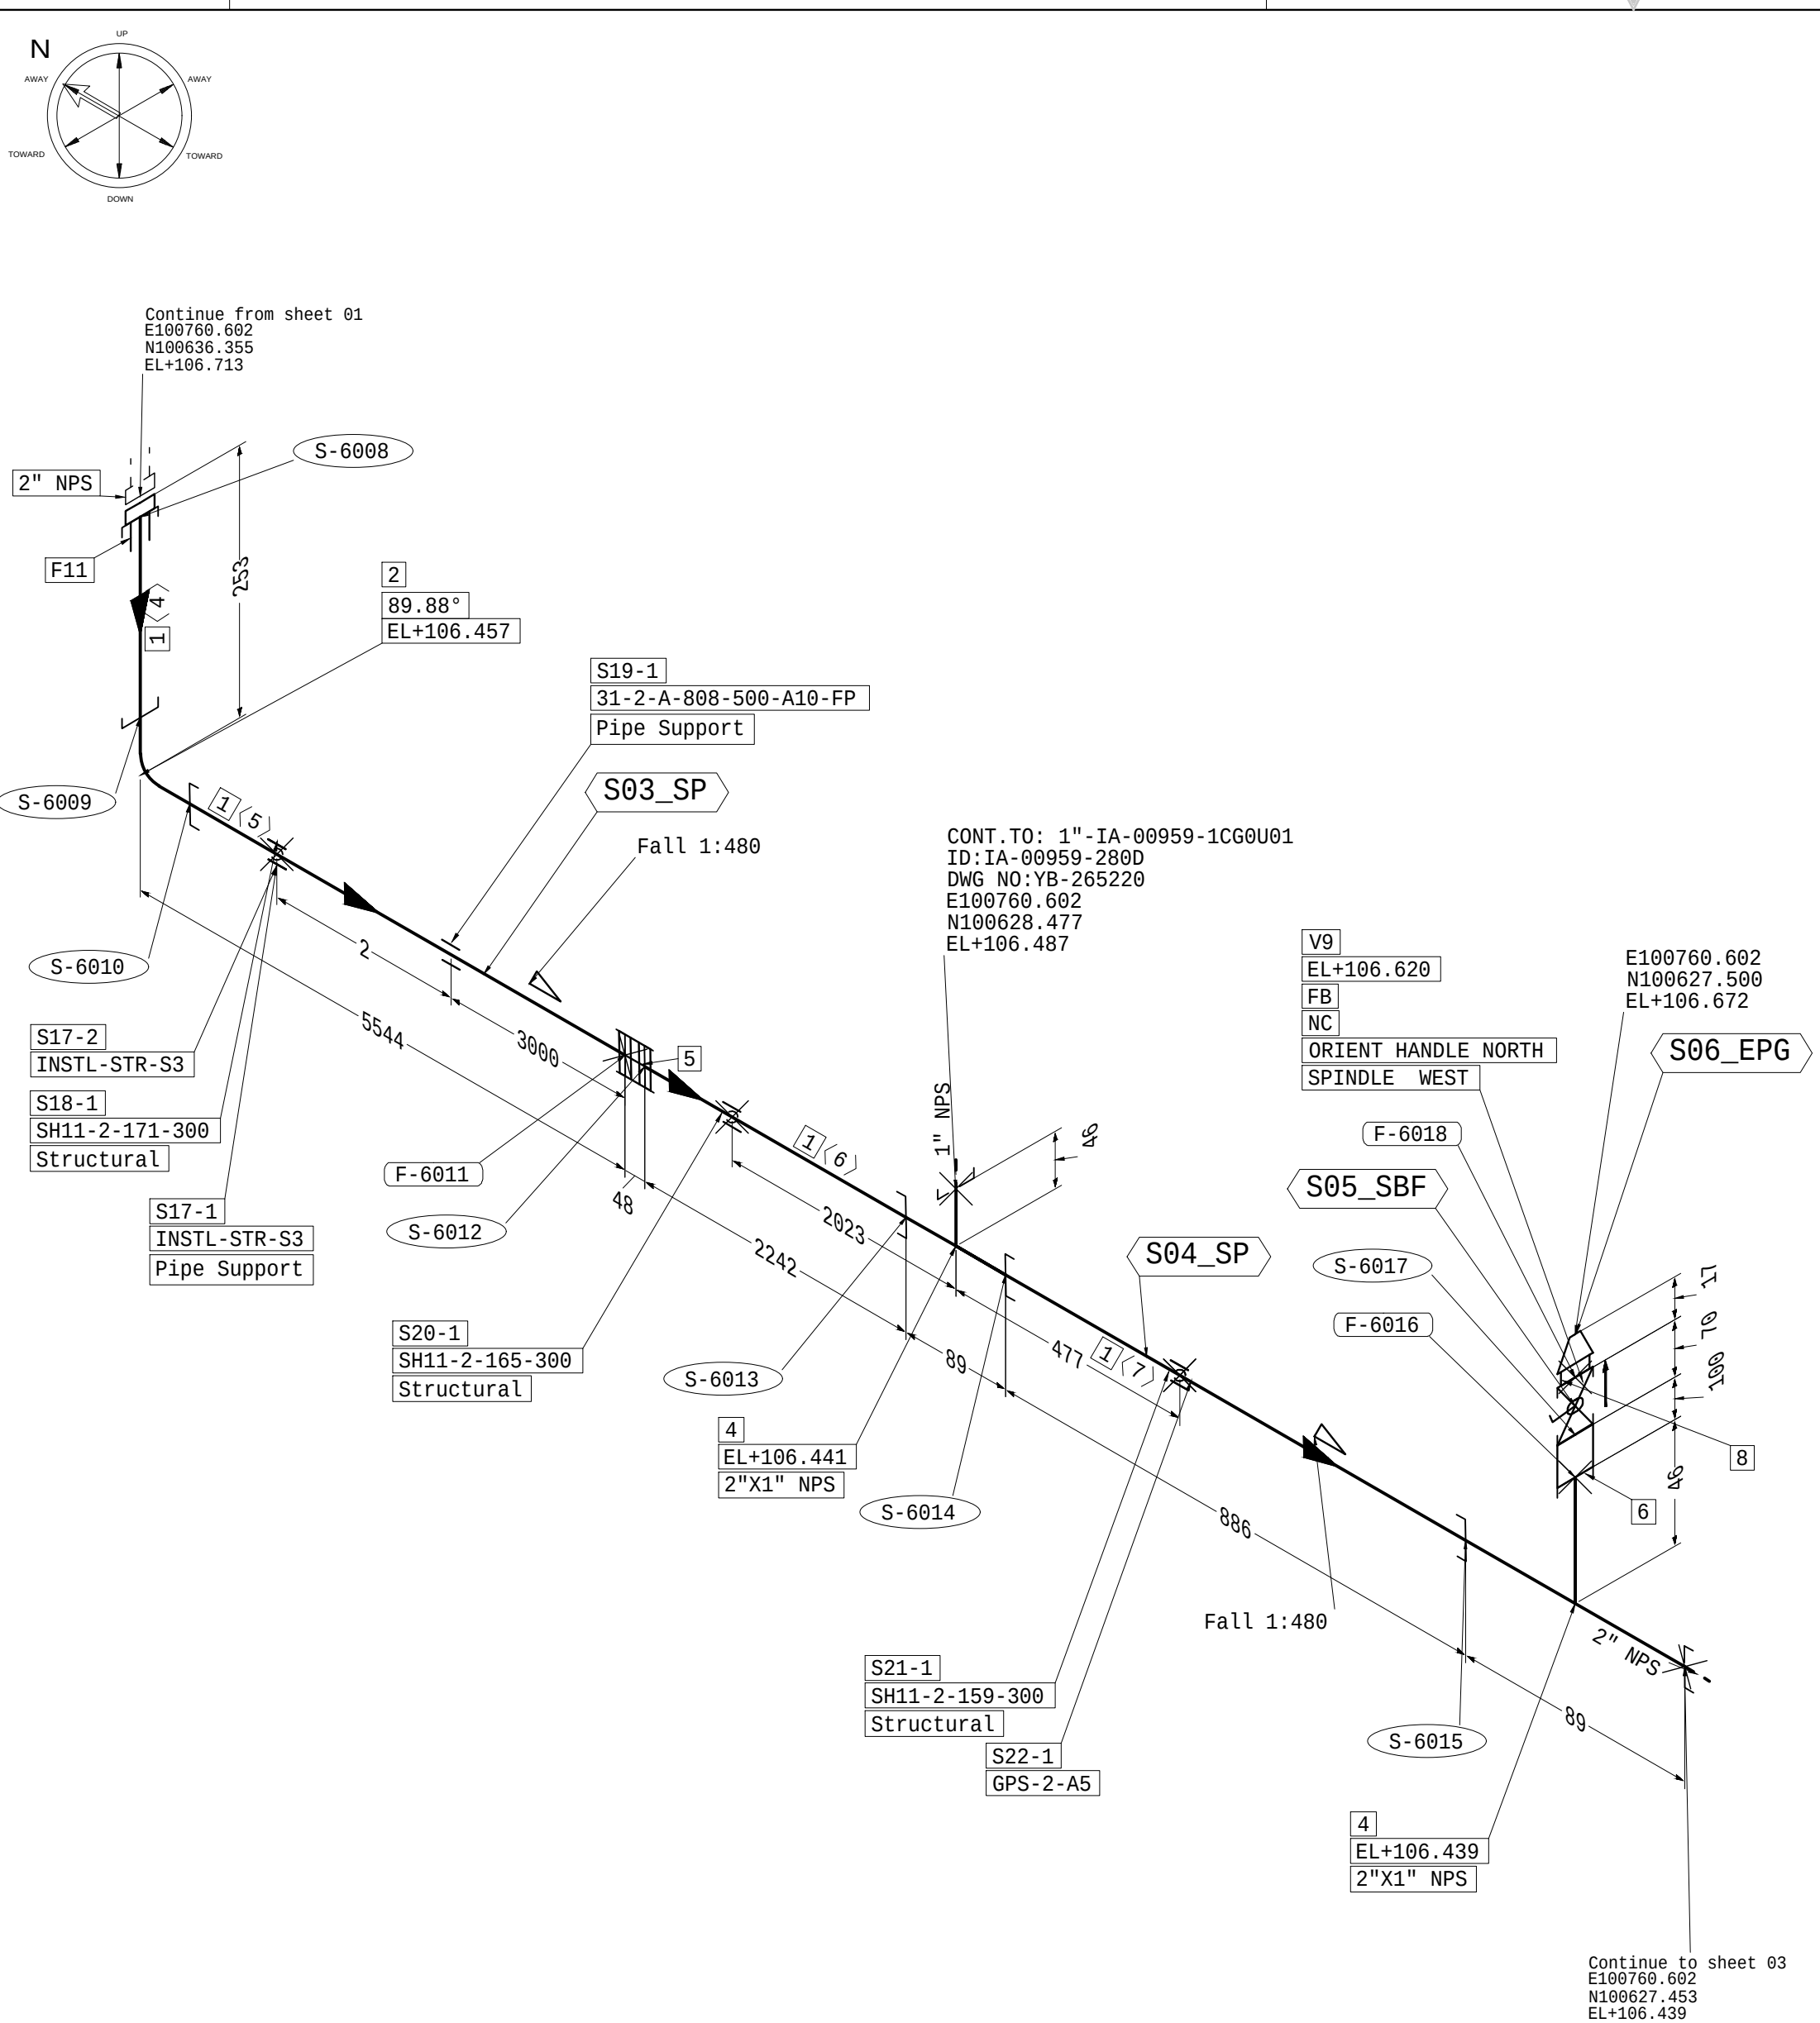

All Pipe attached supports shall be welded before galvanising.

PT No.

DESCRIPTION

NPD(IN)

ITEM CODE

QTY

PIPES

1 PIPE SMLS 2" A106-B GALV STD NPT (M) B36.10M

2 PPS2AEAE02ZZABUAUA

8.836

FITTINGS

2 ELB 90° FRG LR 2" A105N GALV 3000# NPT (F) B16.11

2 PE72ADAE02ZZAA0ATA

1

4 TEE RED. FRG 2" X 1" A105N GALV 3000# NPT (F) B16.11

2X1 PTR2ADAE0201AA0ATA

2

5 CPLG. FULL 2" A105N GALV 3000# NPT (F) B16.11

2 PX52ADAE02ZZAA0ATA

1

6 PIPE NIPP SML TBE 1" X 100MM A106-B GALV XS NPT (M) B36.10M

1 PP52AEAE01AAABVAUA

1

8 PLUG HEX HD 1" A105N GALV NPT (M) B16.11

1 PXC2ADAE01ZZZZAUA

1

VALVE

9 TAG NO V08-29-01-AS-AF-AA-BFI BALL VAL FB MSS-SP-110 1" B61/B62 BRONZE TRIM WITH RTFE SEAT 2/3 PIECE CONST,FLT TYP NPTF 150# LEVER OPT

1 V08290I01ASAFABFI

1

FLANGES

11 FLG SCRD RF 2" A105N GALV 150# 125 B16.5

2 PFH2ADAE02ZZAAAADH

1

SUPPORTS

17 PIPE SUPPORT

2 INSTL-STR-S3

2

18 PIPE SUPPORT

2 SH11-2-171-300

1

19 PIPE SUPPORT

2 31-2-A-808-500-A10-FP

1

20 PIPE SUPPORT

2 SH11-2-165-300

1

21 PIPE SUPPORT

2 SH11-2-159-300

1

22 PIPE SUPPORT

2 GPS-2-A5

1

NOTES :

1. ALL COORDINATES AND ELEVATIONS ARE IN 'METER' AND ALL DIMENSIONS ARE IN 'MM'.

2. PIPE QUANTITY IS IN METERS AND OTHER QUANTITY IN NUMBERS.

3. FOR STANDARD SUPPORT, REFER DOC. NO. "PP-866-ST-0001"

4. IN CASE OF ANY DISCREPANCY FOR LINE CONDITIONS, LINE DATA GIVEN IN LINE LIST SHALL GOVERN

5. FOR SMALL BORE LINES, DIMENSION & ROUTING SHALL BE FIELD ADJUSTED.

6. THE SPECIFIED THEORETICAL LOCATION OF EQUIPMENT NOZZLES, SUPPORTING STRUCTURE SHALL BE VERIFIED BEFORE INSTALLING THE PIPING & INTOLERABLE DISCREPANCIES SHALL BE DISCUSSED WITH DESIGN SITE ENGINEER.

7. ALL THREADED CONNECTION SHALL BE SEAL WELDED, EXCEPT DRAIN AND VENT PLUG.

8. REFER LINE LIST.

9. ALL PRESSURE WELDS, OTHER THAN BUTT WELDS, INCLUDING BRANCH CONNECTIONS SUCH AS BRANCH-OLETS, AND BOSS) SHALL BE 100% PTMT EXAMINED. ALL ATTACHMENT WELDS ON PRESSURIZED COMPONENTS THAT ARE NOT HYDROTESTED AFTER MAKING THE ATTACHMENT WELD SHALL BE 100% PTMT EXAMINED.

BUTT WELD

INSULATED PIPE

PIPE SUPPORT

SOCKET WELD

FIELD WELD

TRACED PIPE

PLATFORM PENETRATION

SCREWED JOINT

ISO For

ISO 001

STANDARD DETAIL REFERENCE DRAWINGS

DETAILS HEAVY WELDING BOSSSES FOR THREADED CONNECTIONS
CONSTRUCTION DETAILS AND DETAILS FOR ISOMETRIC PIPING
INSULATION DETAILS FOR HOT PIPING
INSTALLATION OF JACK SCREWS FOR FLANGED JOINTS

AE-036175
AD-036027
AA-036911
AA-036913
AC-036630

NOTES

1. MATERIAL SHOWN WITH A BROKEN LINE AND SPOOLS LISTED IN THE SAUDI ARAMCO FABRICATION LIST ARE NOT TO BE FURNISHED BY THE VENDOR.

2. PIPING DETAILS SHALL BE CUT AT ALL POINTS MARKED F.W. (FIELD WELD).

3. EACH FABRICATED SECTION SHALL BE CLEARLY MARKED WITH ITS CODE NUMBER.

4. UNLESS OTHERWISE NOTED, (A) ALL DIMENSIONS ARE TO FOR FACE OF FLANGES. (B) BOLT HOLES ON FLANGES STRADDLE C. (C) WELDING ELBOWS ARE LONG RADIUS.

5. FABRICATION SHALL BE IN ACCORDANCE WITH SAUDI ARAMCO SPECIFICATION 01-SAMSS-10.

6. GASKET ALLOWANCE

7. PIPING MATERIAL IS

PIPE SIZE

SCHEDULE

SPECIFICATION

WELDING STRESS RELIEF - YES ☐ NO ☐ 100% X-RAY ☐ SPOT X-RAY 01-SAMSS-10 ☐

TESTING SHOP HYDROSTATIC TEST - YES ☐ THE SHOP HYDROSTATIC TEST SHALL BE CARRIED OUT ON PIECES HAVING ALL ENDS FLANGED. HYDROSTATIC TEST PRESSURE

SAES-L-105 CLASS

ALL EXCEPTIONS ARE NOTED ON THE ISOMETRIC.

INSULATION REQUIRED - YES ☐ NO ☐

INSULATION SHOWN ON DRAWING

SPOOLS TO BE FABRICATED BY VENDOR

NO. OF PIECES

MARK NO.

SIZE

WEIGHT LBS

SPOOLS TO BE FABRICATED BY SAUDI ARAMCO

NO. OF PIECES

MARK NO.

SIZE

WEIGHT LBS

REFERENCE DRAWINGS

PIPING PLAN

P&ID NO.

YA-221234-001

PLOT PLAN KEY PLAN NO.

TA-293108

INDEX FOR PIPING ISO (AG)

PP-865-LI-0003

INDEX FOR PIPING ISO (UG)

PP-865-LI-0004

REV

DATE

DESCRIPTION

PROD BY

CHKD BY

APP BY

APP BY

REVISION STATUS

REVISION VALIDATION

THIS REVISION NO 00 IS COVERED, FOR ALL APPROVAL AND CERTIFICATION REQUIREMENTS, PER SAEP-33A, UNDER DRAWING COMPLETION CERTIFICATE NO:

10-14815-0003-000

DESIGN CERTIFICATION (DESIGN AGENCY)

REVIEW FOR KEY DRAWINGS (SAUDI ARAMCO)

OTHER

ENGG. DATE

CERTIFIED BY DATE

CONST. AGENCY DATE

OPERATIONS DATE

BY DATE

REV. NO.

DATE

REVISION DESCRIPTION

JOB ORDER/REVNO NO.

10-14815-0003

THIS REVISION IS NOT TO BE USED FOR CONSTRUCTION UNLESS CERTIFIED AND DATED

SAUDI ARABIAN OIL COMPANY

ISOM 2" - IA-00901-1CG0U01

IA SERVICE

JFGP GAS PROCESSING TRAIN-2

JAFURAH

SAUDI ARABIA

PLANT NO.

INDEX

DRAWING NUMBER

SHT. NO.

REV. NO.

865

L

YB-265450

020f06

00

SITE REV. NO.

001

RESTRICTED

SMART

CADD-03

THIS DRAWING AND THE INFORMATION CONTAINED HEREIN ARE THE SOLE PROPERTY OF SAUDI ARAMCO. NO REPRODUCTION IN FULL OR IN PART, SHALL BE OBTAINED FROM THIS DRAWING WITHOUT THE WRITTEN CONSENT OF SAUDI ARAMCO.