



Subject-level mean calibration gap (red = FDR-rejected at $\alpha=0.05$; gray = not rejected)


GPT-4o-mini

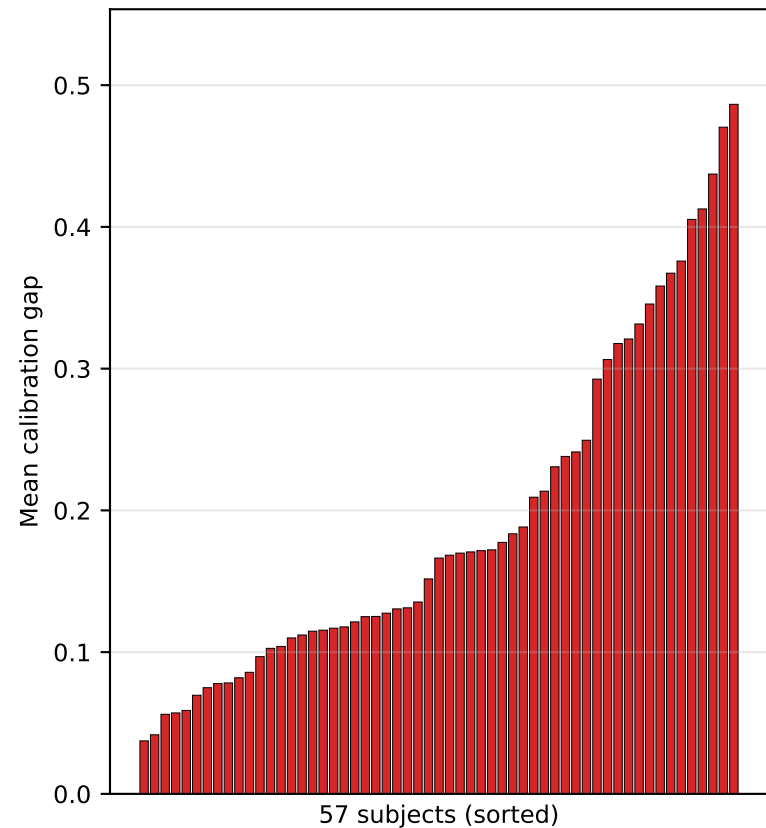

Llama-3-8B

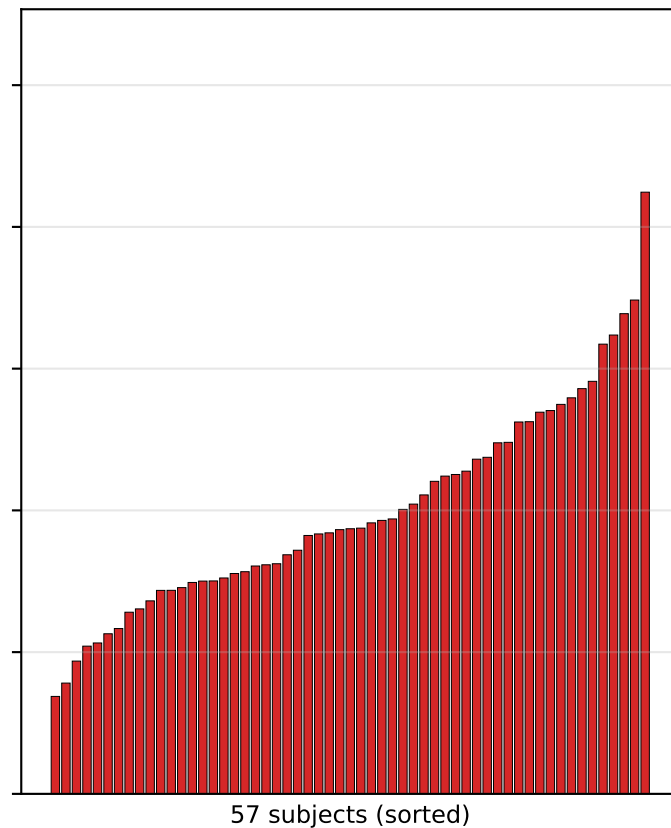

Qwen-1.5B

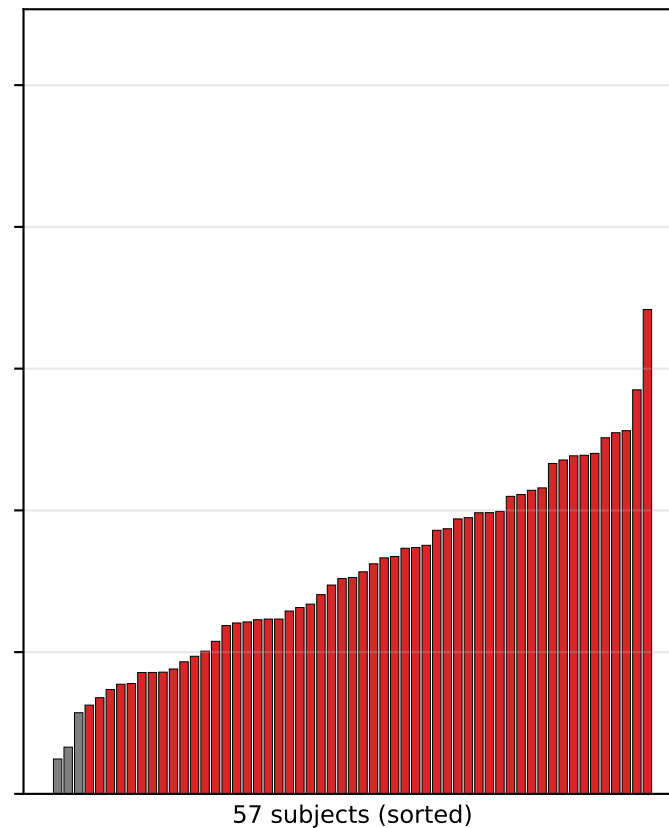

Qwen-7B

