Guidance

This form must be completed when inspecting a pedestrian ramp (curb ramp[1]). Existing pedestrian ramps must comply with the Americans with Disabilities Act Standards for Accessible Design (ADA). Construction of new pedestrian ramps, including upgrades and new installations, must comply with the latest version of the New York City Department of Transportation (NYC DOT) Highway Rules, Standard Specifications, Standard Details of Construction, and ADA.

Submit this form in pdf fillable format via email as follows. Please note that hand-written or scanned forms will not be accepted:

For BPP related applications: Email form in pdf fillable to pedrampBPP@dot.nyc.gov no later than seven (7) days after the construction of a ramp. Email subject line must include: Inspection Form, BBL, Corner ID.

For all other applications: This form must be submitted in pdf fillable format via email to pedramp@dot.nyc.gov no later than seven (7) days after the construction of a ramp.

Instructions

1. **INSPECTION INFORMATION:** INSPECTED BY: Enter the inspector's full name (no initials).

   INSPECTION DATE: Enter the date that the inspection was performed.

   ENTITY: Select the entity for which this corner has been constructed. For applicants submitting to the New York City Department of Buildings, select DOB. If your entity isn't listed select *Other* and specify in the ENTITY (IF OTHER) field.

2. **LOCATION INFORMATION:** For this inspection form, corner is defined as the location where the work is being performed, defined by intersecting streets and includes islands, medians, mid-block locations, and the top of T-intersections.

   BOROUGH: Enter the Borough.

   CORNER ID: Identifying numbers can be found at http://arcg.is/1D48GO.

   NORTH-SOUTH STREET and EAST-WEST STREET: Enter the full legal street names of the streets intersecting at the corner. If the corner is at a mid-block location, island, etc. enter the nearest cross street.

   TRAFFIC CONTROL: Enter either *Signal*, *Signal* with *Accessible Pedestrian Signal* (*APS)*, *Stop/Yield sign,* or *None*.

   CORNER TYPE: Select either *Intersection Corner*, *Island/Median*, *Mid-block, or Top of "T"*.

   CORNER DIRECTION: Enter the ordinal direction (*Southwest, Northwest, Northeast, or Southeast*) if the street is a three or four leg intersection; or secondarily the cardinal directions (*North, South, East*, or *West*) if the intersection contains more than four legs. The corner location for the top of a "T"-intersection is chosen as if they were part of a four-leg intersection with one of the legs missing; the four ordinal corners still remain.

   CORNER №: This field is to be used by NYC DOT inspectors.

   For NUMBER OF RAMPS AT CORNER: Enter the total number of ramps at the exact location being inspected. For most corners this will be two, however, apex and mid-block ramps have only one. In some instances there may be three ramps, such as at a bypass island.

   T-INTERSECTION: Select either *Yes* or *No*.

[1] Ramp cutting through a curb or built up to it.

PAINTED ROADWAY: Select either *Yes* or *No.*

> ***Advisory:*** *Painted Roadway refers to whether the corner is associated with an adjoining roadway that is designated a pedestrian space by means of paint, striping, etc.*

3. **CONSTRUCTION INFORMATION:** Enter CONTRACTOR NAME, PERMITTEE ID, FMS ID, PERMIT NUMBER, and CONSTRUCTION COMPLETION DATE.

   CONTRACT TYPE: For NYC DDC contracts, select whether the corner was constructed under a simple or complex contract. Otherwise, select simple.

   CURB MATERIAL: Enter either *Steel Faced Concrete Curb, Concrete Curb, Concrete Curb and Gutter, Granite, Bluestone, Cobblestone, or other*.

   SIDEWALK MATERIAL: Enter either *Concrete, Pigmented Concrete, Bluestone, Cobblestone, or other.*

4. **CORNER RAMP TYPE:** Select the corner ramp type that applies. *Perpendicular Ramp is a* ramp with a running slope and accessible route[2] perpendicular to the curb. *Parallel Ramp* is a ramp with a running slope and accessible route parallel to the curb. *Cut-Through* is not a ramp, but rather it is an accessible path that cuts through a built up roadway island or median.

5. **RAMP ATTRIBUTES:**

   In the RAMP LOCATION AT CORNER graphic inset, enter the street names at the corner and select the specific ramp location. The graphic allows for the selection of corner locations, mid-block locations, islands, medians, and bypass islands.

   RAMP GRAPHIC: Enter in all the applicable metrics, either in the graphic layout or in the fields below. For the metrics that do not apply, leave blank.

   RAMP ID: Identifying numbers can be found at http://arcg.is/1D48GO. Solely for the purposes of data collection on this form, pedestrian access routes at cut-throughs are being identified as ramps.

   IS THERE PONDING: Select either *Yes* or *No*. This question is answered only for observations made during inspection conditions. However, yes may be selected, if in one's judgment dry conditions indicate previous ponding such as heavy silting at the base of the ramp or cut-through.

   LEFT and RIGHT FLARE TRAVERSABLE PATH: Select either *Yes* or *No*. This answer is an indication of whether the left and/or right flare of a ramp are within the pedestrian access route.

   > ***Advisory:*** *The pedestrian access route is a 5-foot wide accessible path of travel that coincides with the pedestrian circulation path. If there is no space for an adequate landing at the top of the ramp, and a pedestrian must access the ramp using the flare, then that particular flare is considered to be located within the pedestrian access route and, is thus, considered part of the traversable path.*

   MAXIMUM CURB REVEAL AT RAMP: Enter maximum curb reveal as measured along the entire ramp width (excluding the flares). If curb reveal issues are caused by spalls in the asphalt pavement, indicate so in the COMMENTS section.

   > ***Advisory:*** *The maximum curb reveal cannot be greater than 0.25 inch.*

[2] Pedestrian Access Route is as a continuous and unobstructed path of travel provided for pedestrians with disabilities within or coinciding with a pedestrian circulation path as defined in Section R105 of the Proposed Accessibility Guidelines for Pedestrian Facilities in the Public Right-of-Way (PROWAG)dated July 26, 2011.

CLEAR SPACE WITHIN CROSSWALK: Select either *Yes* or *No*.

> ***Advisory:*** *Clear space is a 48-inch by 48-inch unobstructed area at the base of the ramp beyond the bottom grade break. The clear space must be located within the crosswalk, whether the crosswalk is marked or unmarked. The clear space of parallel ramps is located within the bottom landing.*

OUTSIDE OF PARALLEL TRAVEL LANE: Select either *Yes* or *No*.

> ***Advisory:*** *The clear space must be located outside of the parallel vehicular travel lane. The parallel vehicle travel lane is the travel lane parallel to the direction of travel of the pedestrian. If a pedestrian crossing a street enters a clear space that is within the parallel vehicle travel lane, the pedestrian and a vehicle may come into conflict, as they both typically share the same traffic signal phase. The clear space of parallel ramps is located within the bottom landing.*

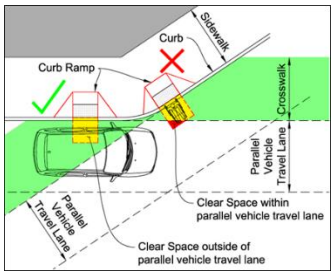


Figure 1 - Compliant and Non-Compliant Clear Spaces

DWS LENGTH MIN. 24 INCH: Select either *Yes* or *No*.

> ***Advisory:*** *Detectable Warning Surface (DWS) running length must be a minimum 24 inches.*

DWS FULL RAMP WIDTH: Select either *Yes* or *No*. Select *Yes* if the DWS is the full width of the ramp, else, select *No*.

> ***Advisory:*** *DWS must span the entire ramp or cut-through width (excluding the flares).*

DWS RAMP ALIGNMENT: Select either *Yes*, *No*, or *Not Applicable.* This question pertains to whether the domes of the DWS are in alignment with the ramp slope.

> ***Advisory:*** *At perpendicular ramps, DWS must allow the wheels of a wheelchair to align with the dome spaces. DWS must be aligned with the bottom grade break. If the DWS is located within a bottom landing or cut-through, then the DWS does not need to be aligned with the ramp or cut-through.*

DWS COLOR: Enter either *Red*, *White, Yellow,* or *Other*.

> ***Advisory:*** *NYC DOT specifications require that detectable warning surfaces on light-colored sidewalks be red color of Federal Standard #31350, or for dark-colored sidewalks (such as bluestone or pigmented concrete) be the Bright White of Federal Standard #27925. If another color is selected, it must comply with §705.1.3 of ADA 2010 (light on dark, or dark on light), and a signed maintenance agreement with DOT is required. Non-contrasting colors are not compliant with ADA.*

DWS MATERIAL: Enter either *Preformed Plastic*, *Cast-in-Place Plastic*, *Cast Iron*, *Stone*, or *Other*.

RAMP RUNNING SLOPE (including LEFT RAMP, RIGHT RAMP, or CUT-THROUGH): Enter the longitudinal slope of the pedestrian ramp or cut-through.

> ***Advisory:*** *A pedestrian ramp must have a running slope no steeper than 8.3%.*

DWS LEFT and RIGHT OFFSET FROM CURB: Enter the distance from the corner edge of the DWS to the bottom grade break or back of curb.

> **Advisory:** Some DWS products require a concrete border for proper installation. This concrete border must not exceed 2 inches.
>
> *DWS must not be placed on paving or expansion joints. The rows of truncated domes in detectable warning surfaces should be aligned perpendicular to the grade break between the ramp run and the street so pedestrians who use wheelchairs can "track" between the domes. Where detectable warning surfaces are provided on a surface with a slope that is less than 5 percent, dome orientation is less critical.*
>
> *On perpendicular ramps where the grade break occurs at the curb line, the DWS must be placed not to exceed 2 inches from the back of the curb.*
>
> *On perpendicular ramps where the grade break of neither end of the ramp occurs at a distance of 5.0 feet or less from the curb line, the DWS must be placed on the ramp run within one dome spacing of the bottom grade break.*
>
> *On perpendicular ramps where the grade break of either end of the ramp occurs at a distance greater than 5.0 feet or less from the curb line, the DWS must be placed on the lower landing at the back of curb.*
>
> *On parallel ramps, the DWS must be placed on the turning space as close to the back of as feasible, but not closer than 2 inches.*

RAMP CROSS SLOPE (including LEFT RAMP or RIGHT RAMP): Enter the transverse slope of the pedestrian ramp.

> ***Advisory:*** *The ramp cross slope must be no steeper than 2.0%.*

RAMP LENGTH (including LEFT RAMP or RIGHT RAMP): Enter the ramp length measured from the curb to the top of the ramp grade break along the ramp centerline.

> ***Advisory:*** *If the ramp length is 15 feet or greater, the running slope of the ramp may be steeper than 8.3%, to avoid chasing a steep sidewalk grade. Fill out a TIF to document the infeasible feature.*

RAMP WIDTH (including LEFT RAMP or RIGHT RAMP): Enter the ramp width.

> ***Advisory:*** *Existing ramps must be 36 inches minimum, newly constructed ramps must be 60 inches minimum. Any width less than 60 inches requires approval.*

LANDING RUNNING SLOPE (including BOTTOM LANDING): Enter landing running slope measured along the ramp centerline running through the landing area.

> ***Advisory:*** *LANDING RUNNING SLOPE is the longitudinal slope of the landing area at the top of the pedestrian ramp. The maximum landing slope must be no steeper than 2.0%.*

LANDING CROSS SLOPE (including BOTTOM LANDING or CUT-THROUGH): Enter the transverse slope of the landing measured perpendicular to the ramp centerline running through the landing area.

> ***Advisory:*** *The maximum landing cross slope must be no steeper than 2.0%.*

LANDING LENGTH (including BOTTOM LANDING or CUT-THROUGH): Enter the length of the landing measured parallel to the ramp centerline.

> ***Advisory:*** *The minimum acceptable LANDING LENGTH value is 48 inches. If the landing space is constrained at the back, for example by a wall or fence, then the LANDING LENGTH requirement is 60 inches.*

LANDING WIDTH (including BOTTOM LANDING or CUT-THROUGH): Enter the width of the landing measured perpendicular to the ramp centerline.

> ***Advisory:*** *For new and upgraded installations, 48 inches is the minimum acceptable value.*

LEFT and RIGHT FLARE SLOPE: Enter the slope of the flares measured parallel to the curb line.

> ***Advisory:*** *If the flare is within a pedestrian accessible route and there is no landing at the top of the curb ramp, then the flare may be used as a ramp to an alternate landing towards the side of the pedestrian ramp. If this is the case, the maximum acceptable slope of the flare is 8.3%. If there is a compliant landing at the top of the pedestrian ramp, the maximum acceptable slope of the flare is 10.0%. If the ramp is bounded by a non-pedestrian circulation path, (for example, a grass strip), the flare slope may be steeper or the flare may be omitted and replaced by a returned curb. However, no part of a returned curb may encroach into the pedestrian circulation path as it may cause a tripping hazard. The 10.0% slope is not intended to be used as a ramp, but rather is intended to prevent tripping hazards.*

GUTTER CROSS SLOPE (ROADWAY COUNTER SLOPE per ADA): Enter the cross slope of the gutter, at the base of the ramp measured parallel to the ramp centerline, perpendicular to the curb.

> ***Advisory:*** *The maximum acceptable value for the gutter cross slope is 5.0%. However, if the clear space in the roadway is also a turning space (i.e. the ramp is not aligned with the crosswalk) then the maximum acceptable value for the gutter cross slope is 2.0%.*

GUTTER FLOW SLOPE: Enter the slope of the bottom of curb at the base of the pedestrian ramp.

> ***Advisory:*** *The maximum acceptable value for the gutter flow slope is 2.0%.*

LEFT and RIGHT SIDEWALK APPROACH WIDTH: Enter the clear width of the sidewalks on either side of the ramp. The width to be measured is the pedestrian circulation path (walkable sidewalk; does not include grass, granite block pavers, etc.).

> ***Advisory:*** *The minimum acceptable value for the SIDEWALK APPROACH WIDTH is 48 inches. At pinch points, the clear width can be reduced to 32 inches minimum of a length of 24 inches, thus the sidewalk width measurement must be exclusive of pinch points. The NYC DOT preferred minimum sidewalk approach width is 60 inches, however, in certain circumstances, 48-inch minimum is acceptable. For double ramps at a corner, typically each ramp will have only one sidewalk approach.*

LEFT and RIGHT SIDEWALK RUNNING SLOPE: Enter the longitudinal slope of the sidewalk approach.

> ***Advisory:*** *The SIDEWALK APPROACH RUNNING SLOPE must be no steeper than 5%. If the SIDEWALK APPROACH RUNNING SLOPE is steeper than 5% and less than or equal to 8.3%, then the sidewalk approach is an ADA compliant ramp.*

LEFT and RIGHT SIDEWALK CROSS SLOPE: Enter the cross slope of the sidewalk approach.

> ***Advisory:*** *The maximum sidewalk approach cross slope must be no steeper than 2% for a minimum width is 60 inches. At constrained locations and at existing narrow sidewalks, the minimum width can be reduced to 48 inches. This is the pedestrian access route, as defined previously. Exclusive of the pedestrian access route, the sidewalk approach width may be steeper. Only record the cross slope of the pedestrian access route.*

CONSTRUCTION: Select either *Existing Ramp, Ramp Removed, New Install,* or *Upgrade*. *New Installation* is when a ramp is constructed where there was previously no ramp. *Upgrade* is when a ramp is being constructed to comply with ADA.

ACTION TAKEN: Select either *ADA Compliant Ramp Constructed*, *Constructed to the Maximum Extent Feasible*, *ADA Compliant Ramp Exists*, *Ramp Removed*, or *Other*. If ramps were constructed not in full compliance with ADA due to any technical infeasibility or a structural impracticability, an approved Technical Infeasibility/Structural Impracticability Form (TIF) is required prior to construction. If "*Other"* is selected please use the comments field to explain further.

COMMENTS: Enter any additional information that may be relevant including if there is any TIF associated with this ramp.

6. **PHOTO LOG:** Insert no less than four constructed condition photos of the ramp, showing the following:

- the ramp seen from the left at roughly 20 feet (four sidewalk flags) including the curb, gutter and any street furniture, if possible;
- the ramp seen from the right at roughly 20 feet (four sidewalk flags) including the curb, gutter and any street furniture, if possible;
- the ramp seen from the front (standing in the street) including the front of curb and back of sidewalk (including fence, building, landscaping &c.); and
- the ramp seen from the back, including the crosswalk (whether marked or unmarked) and the receiving ramp across the street.

7. **RAMP ATTRIBUTES:** Repeat instructions in section 5. RAMP ATTRIBUTES for each additional ramp.

8. **PHOTO LOG:** Repeat instructions in section 6. PHOTO LOG for each additional ramp.

Pedestrian Ramp Inspection Form

1. INSPECTION INFORMATION

INSPECTED BY: _____ **INSPECTION DATE:** _____

ENTITY: _____ **ENTITY (IF OTHER):** _____

2. LOCATION INFORMATION

BOROUGH: _____ **CORNER ID:** _____

NORTH-SOUTH STREET: _____ **EAST-WEST STREET:** _____

TRAFFIC CONTROL (NORTH-SOUTH): **TRAFFIC CONTROL (EAST-WEST):**

CORNER TYPE: ☐ **INTERSECTION CORNER** ☐ **ISLAND/MEDIAN** ☐ **MID-BLOCK** ☐ **TOP OF "T"**

CORNER DIRECTION: **CORNER №:** _____ **T-INTERSECTION:** ☐ **YES** ☐ **NO**

NUMBER OF RAMPS AT CORNER: _____ **PAINTED ROADWAY:** ☐ **YES** ☐ **NO**

3. CONSTRUCTION INFORMATION

CONTRACTOR NAME: _____ **PERMITTEE ID:** _____


FMS ID: _____ **PERMIT NUMBER:** _____


CONSTRUCTION COMPLETION DATE: _____ **CONTRACT TYPE:** ☐ **SIMPLE** ☐ **COMPLEX**


CURB MATERIAL: _____ **SIDEWALK MATERIAL:** _____

4. CORNER RAMP TYPE


☐ **PERPENDICULAR RAMP:** ☐ **PARALLEL RAMP:** ☐ **CUT THROUGH:**


PERPENDICULAR RAMP



PARALLEL RAMP


CUT THROUGH

5. RAMP ATTRIBUTES: PERPENDICULAR RAMP

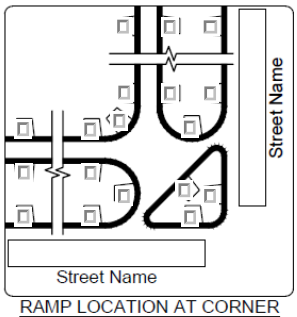

RAMP LOCATION AT CORNER

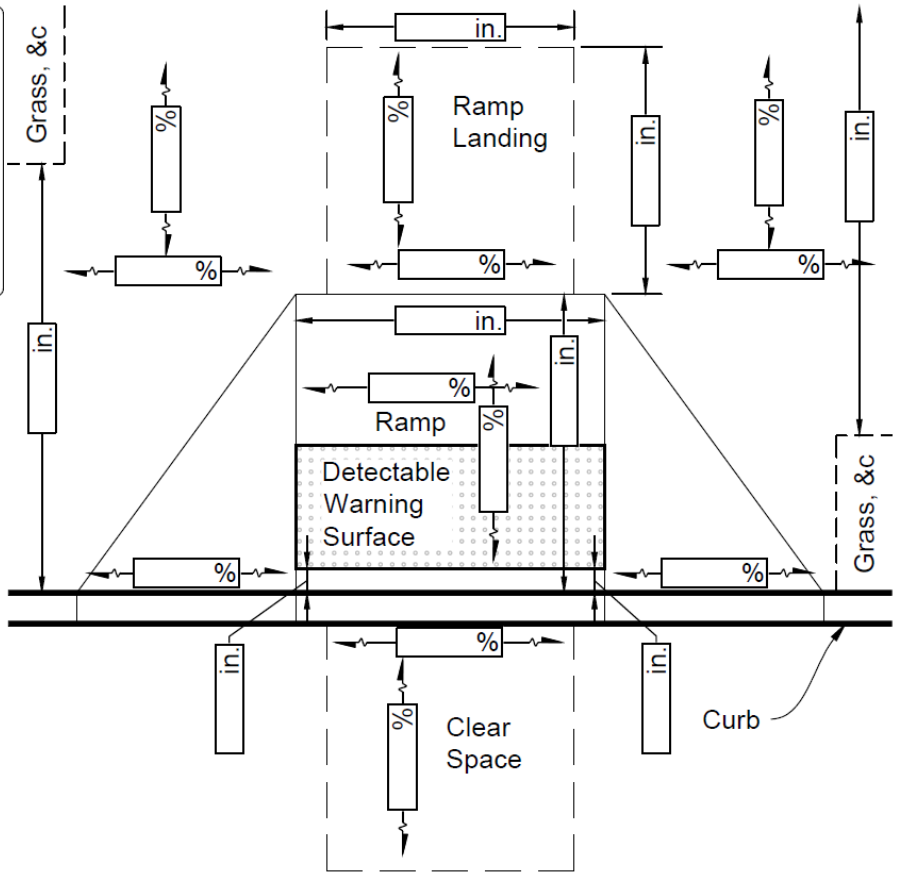

RAMP ID: _____

IS THERE PONDING: ☐ YES ☐ NO

LEFT FLARE IN TRAVERSABLE PATH: ☐ YES ☐ NO

RIGHT FLARE IN TRAVERSABLE PATH: ☐ YES ☐ NO

MAXIMUM CURB REVEAL AT RAMP: _____

CLEAR SPACE WITHIN CROSSWALK: ☐ YES ☐ NO

OUTSIDE OF PARALLEL TRAVEL LANE: ☐ YES ☐ NO

DWS LENGTH MIN. 24 INCH: ☐ YES ☐ NO

DWS FULL RAMP WIDTH: ☐ YES ☐ NO

DWS ALIGNED WITH RAMP: ☐ N/A ☐ YES ☐ NO

DWS LEFT OFFSET FROM CURB: _____ **IN.**

DWS RIGHT OFFSET FROM CURB: _____ **IN.**

DWS COLOR:

DWS MATERIAL: _____

CONSTRUCTION:

ACTION TAKEN:

COMMENTS:

RAMP RUNNING SLOPE: _____ **%**

RAMP CROSS SLOPE: _____ **%**

RAMP LENGTH: _____ **IN.**

RAMP WIDTH: _____ **IN.**

LANDING RUNNING SLOPE: _____ **%**

LANDING CROSS SLOPE: _____ **%**

LANDING LENGTH: _____ **IN.**

LANDING WIDTH: _____ **IN.**

LEFT FLARE SLOPE: _____ **%**

RIGHT FLARE SLOPE: _____ **%**

GUTTER CROSS SLOPE: _____ **%**

GUTTER FLOW SLOPE: _____ **%**

LEFT SIDEWALK APPROACH WIDTH: _____ **IN.**

LEFT SIDEWALK RUNNING SLOPE: _____ **%**


LEFT SIDEWALK CROSS SLOPE: _____ **%**

RIGHT SIDEWALK APPROACH WIDTH: _____ **IN.**

RIGHT SIDEWALK RUNNING SLOPE: _____ **%**

RIGHT SIDEWALK CROSS SLOPE: _____ **%**

5. RAMP ATTRIBUTES: PARALLEL RAMP

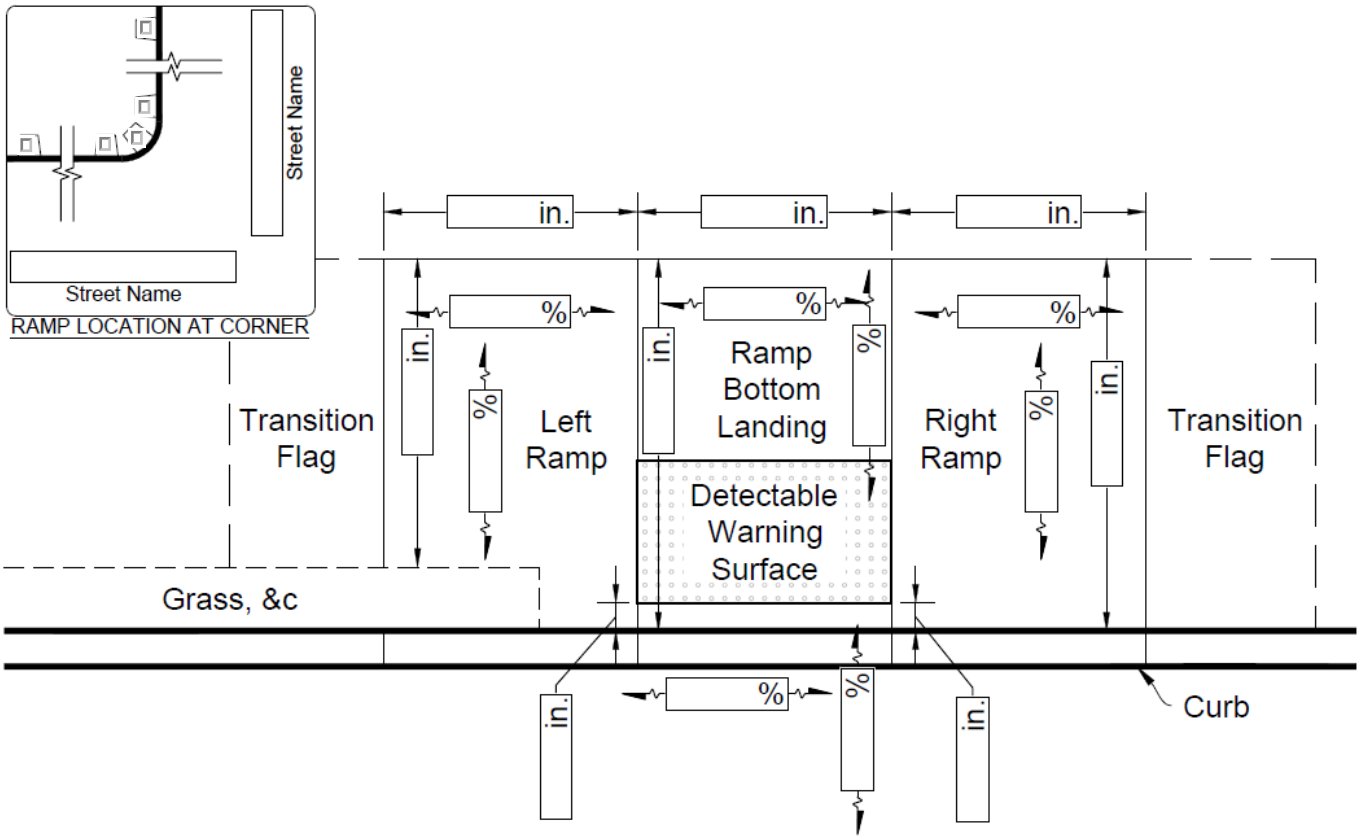

RAMP ID: _____

IS THERE PONDING: ☐ YES ☐ NO

MAXIMUM CURB REVEAL AT RAMP: _____

CLEAR SPACE WITHIN CROSSWALK: ☐ YES ☐ NO

DWS LENGTH MIN. 24 INCH: ☐ YES ☐ NO

DWS FULL RAMP WIDTH: ☐ YES ☐ NO

DWS ALIGNED WITH RAMP: ☐ N/A ☐ YES ☐ NO

DWS LEFT OFFSET FROM CURB: _____ IN.

DWS RIGHT OFFSET FROM CURB: _____ IN.

DWS COLOR: _____

DWS MATERIAL: _____

CONSTRUCTION: _____

ACTION TAKEN: _____

COMMENTS:

BOTTOM LANDING RUNNING SLOPE: _____ %

BOTTOM LANDING CROSS SLOPE: _____ %

BOTTOM LANDING LENGTH: _____ IN.

BOTTOM LANDING WIDTH: _____ IN.

LEFT RAMP RUNNING SLOPE: _____ %

LEFT RAMP CROSS SLOPE: _____ %

LEFT RAMP LENGTH: _____ IN.

LEFT RAMP WIDTH: _____ IN.

RIGHT RAMP RUNNING SLOPE: _____ %

RIGHT RAMP CROSS SLOPE: _____ %


RIGHT RAMP LENGTH: _____ IN.


RIGHT RAMP WIDTH: _____ IN.

GUTTER CROSS SLOPE: _____ %

GUTTER FLOW SLOPE: _____ %

5. RAMP ATTRIBUTES: CUT-THROUGH

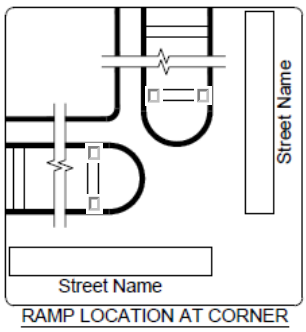

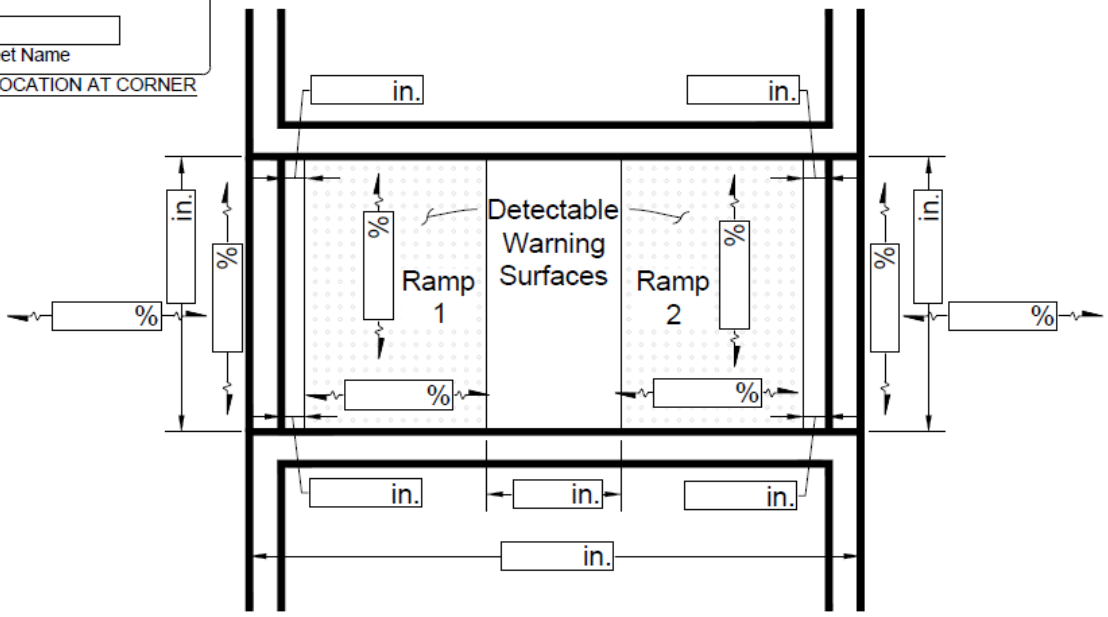

RAMP 1 ID: _____

MAXIMUM CURB REVEAL AT CUT-THROUGH 1: _____

DWS 1 LENGTH MIN. 24 INCH: ☐ YES ☐ NO

DWS 1 FULL CUT-THROUGH WIDTH: ☐ YES ☐ NO

DWS 1 COLOR: _____

DWS 1 MATERIAL: _____

DWS 1 LEFT OFFSET FROM CURB: _____ **IN.**

DWS 1 RIGHT OFFSET FROM CURB: _____ **IN.**

RAMP 1 RUNNING SLOPE: _____ **%**

RAMP 1 CROSS SLOPE: _____ **%**

GUTTER 1 CROSS SLOPE: _____ **%**

GUTTER 1 FLOW SLOPE: _____ **%**

RAMP 1 WIDTH: _____ **IN.**

IS THERE PONDING: ☐ YES ☐ NO

CONSTRUCTION: _____

ACTION TAKEN: _____

RAMP 2 ID: _____

MAXIMUM CURB REVEAL AT CUT-THROUGH 2: _____

DWS 2 LENGTH MIN. 24 INCH: ☐ YES ☐ NO

DWS 2 FULL CUT-THROUGH WIDTH: ☐ YES ☐ NO

DWS 2 COLOR: _____

DWS 2 MATERIAL: _____

DWS 2 LEFT OFFSET FROM CURB: _____ **IN.**

DWS 2 RIGHT OFFSET FROM CURB: _____ **IN.**

RAMP 2 RUNNING SLOPE: _____ **%**

RAMP 2 CROSS SLOPE: _____ **%**

GUTTER 2 CROSS SLOPE: _____ **%**

GUTTER 2 FLOW SLOPE: _____ **%**

RAMP 2 WIDTH: _____ **IN.**

IS THERE PONDING: ☐ YES ☐ NO

CONSTRUCTION: _____

ACTION TAKEN: _____

CUT-THROUGH LENGTH: _____ **IN.**

MIN. CLEARANCE BETWEEN DWS: _____ **IN.**

COMMENTS:

6. PHOTO LOG

CONSTRUCTION PHOTOS

1



2



3



4




5




6



7. RAMP ATTRIBUTES: PERPENDICULAR RAMP

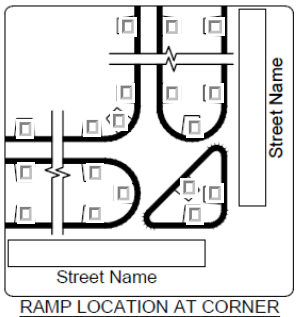

RAMP LOCATION AT CORNER

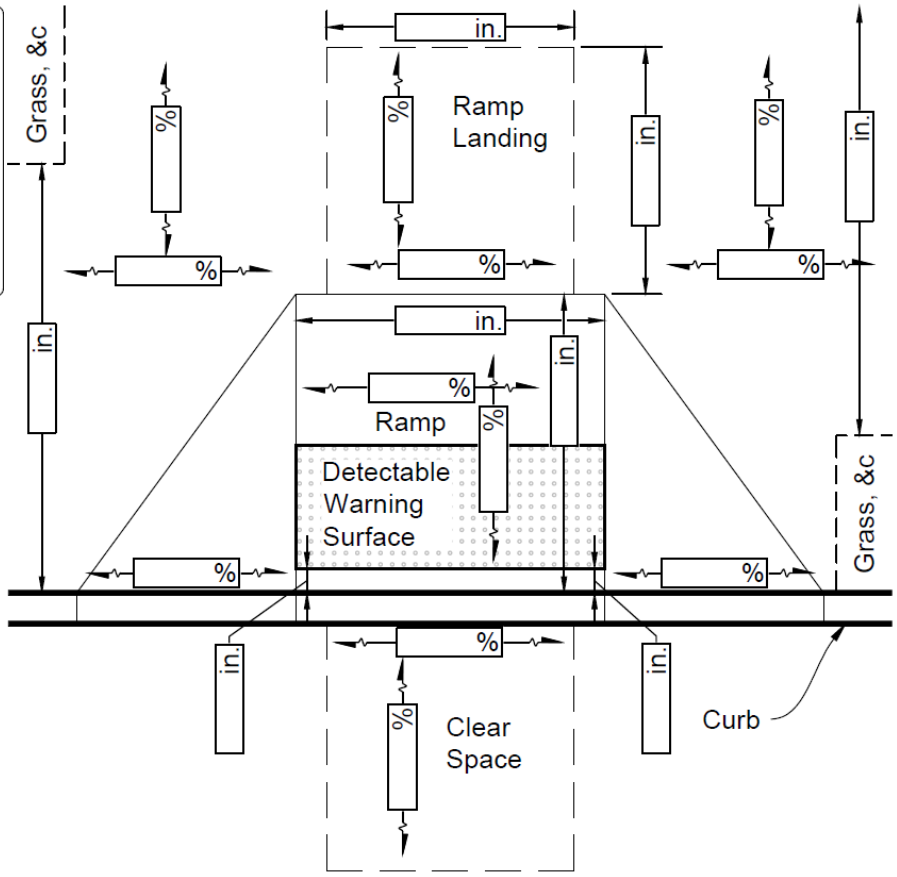

RAMP ID: _____

IS THERE PONDING: ☐ YES ☐ NO

LEFT FLARE IN TRAVERSABLE PATH: ☐ YES ☐ NO

RIGHT FLARE IN TRAVERSABLE PATH: ☐ YES ☐ NO

MAXIMUM CURB REVEAL AT RAMP: _____

CLEAR SPACE WITHIN CROSSWALK: ☐ YES ☐ NO

OUTSIDE OF PARALLEL TRAVEL LANE: ☐ YES ☐ NO

DWS LENGTH MIN. 24 INCH: ☐ YES ☐ NO

DWS FULL RAMP WIDTH: ☐ YES ☐ NO

DWS ALIGNED WITH RAMP: ☐ N/A ☐ YES ☐ NO

DWS LEFT OFFSET FROM CURB: _____ **IN.**

DWS RIGHT OFFSET FROM CURB: _____ **IN.**

DWS COLOR: _____

DWS MATERIAL: _____

CONSTRUCTION: _____

ACTION TAKEN: _____

COMMENTS:

RAMP RUNNING SLOPE: _____ **%**

RAMP CROSS SLOPE: _____ **%**

RAMP LENGTH: _____ **IN.**

RAMP WIDTH: _____ **IN.**

LANDING RUNNING SLOPE: _____ **%**

LANDING CROSS SLOPE: _____ **%**

LANDING LENGTH: _____ **IN.**

LANDING WIDTH: _____ **IN.**

LEFT FLARE SLOPE: _____ **%**

RIGHT FLARE SLOPE: _____ **%**

GUTTER CROSS SLOPE: _____ **%**

GUTTER FLOW SLOPE: _____ **%**

LEFT SIDEWALK APPROACH WIDTH: _____ **IN.**

LEFT SIDEWALK RUNNING SLOPE: _____ **%**


LEFT SIDEWALK CROSS SLOPE: _____ **%**

RIGHT SIDEWALK APPROACH WIDTH: _____ **IN.**

RIGHT SIDEWALK RUNNING SLOPE: _____ **%**

RIGHT SIDEWALK CROSS SLOPE: _____ **%**

7. RAMP ATTRIBUTES: PARALLEL RAMP

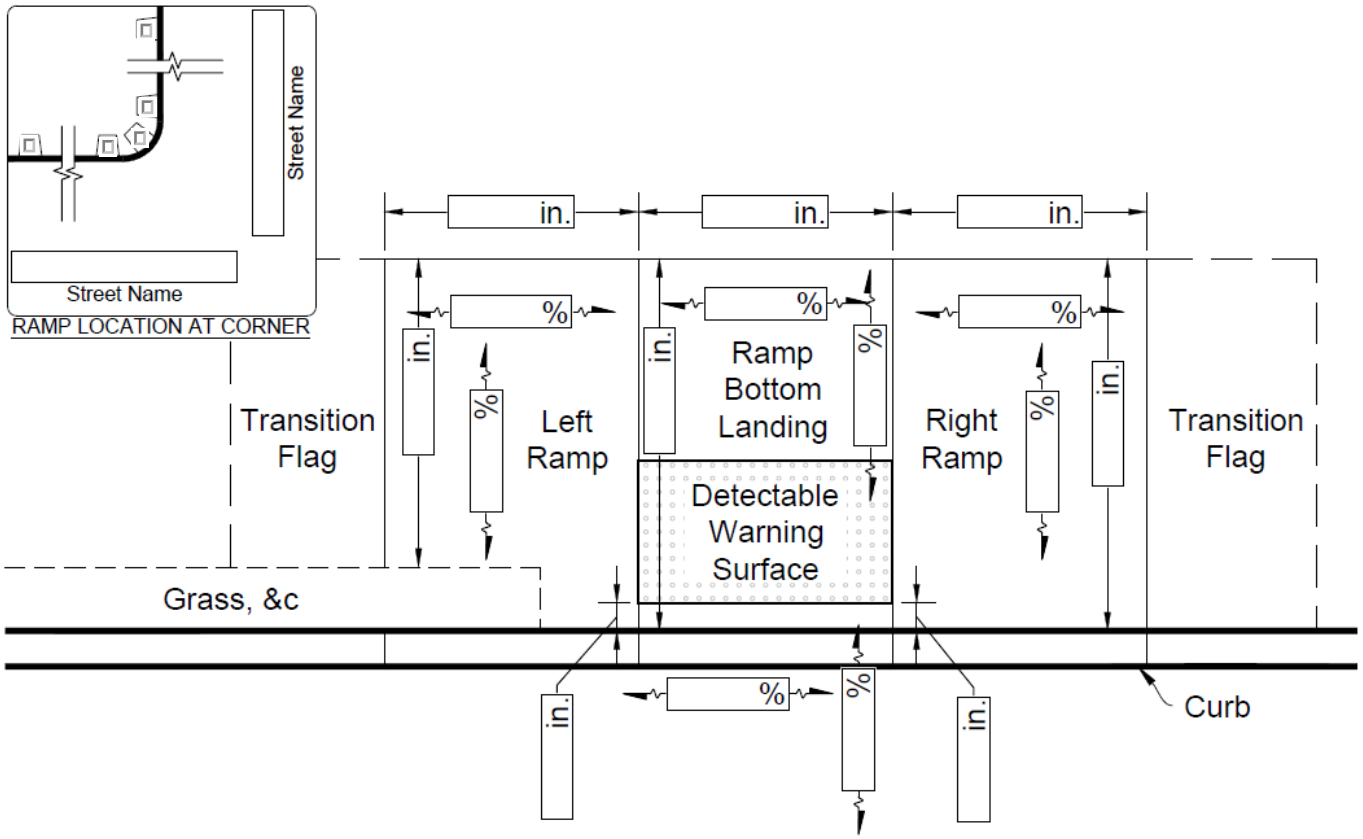

RAMP ID: _____

IS THERE PONDING: ☐ YES ☐ NO

MAXIMUM CURB REVEAL AT RAMP: _____

CLEAR SPACE WITHIN CROSSWALK: ☐ YES ☐ NO

DWS LENGTH MIN. 24 INCH: ☐ YES ☐ NO

DWS FULL RAMP WIDTH: ☐ YES ☐ NO

DWS ALIGNED WITH RAMP: ☐ N/A ☐ YES ☐ NO

DWS LEFT OFFSET FROM CURB: _____ IN.

DWS RIGHT OFFSET FROM CURB: _____ IN.

DWS COLOR: _____

DWS MATERIAL: _____

CONSTRUCTION: _____

ACTION TAKEN: _____

COMMENTS:

BOTTOM LANDING RUNNING SLOPE: _____ %

BOTTOM LANDING CROSS SLOPE: _____ %

BOTTOM LANDING LENGTH: _____ IN.

BOTTOM LANDING WIDTH: _____ IN.

LEFT RAMP RUNNING SLOPE: _____ %

LEFT RAMP CROSS SLOPE: _____ %

LEFT RAMP LENGTH: _____ IN.

LEFT RAMP WIDTH: _____ IN.

RIGHT RAMP RUNNING SLOPE: _____ %

RIGHT RAMP CROSS SLOPE: _____ %

RIGHT RAMP LENGTH: _____ IN.

RIGHT RAMP WIDTH: _____ IN.

GUTTER CROSS SLOPE: _____ %

GUTTER FLOW SLOPE: _____ %

8. PHOTO LOG

CONSTRUCTION PHOTOS

1




2



3



4



5



6

