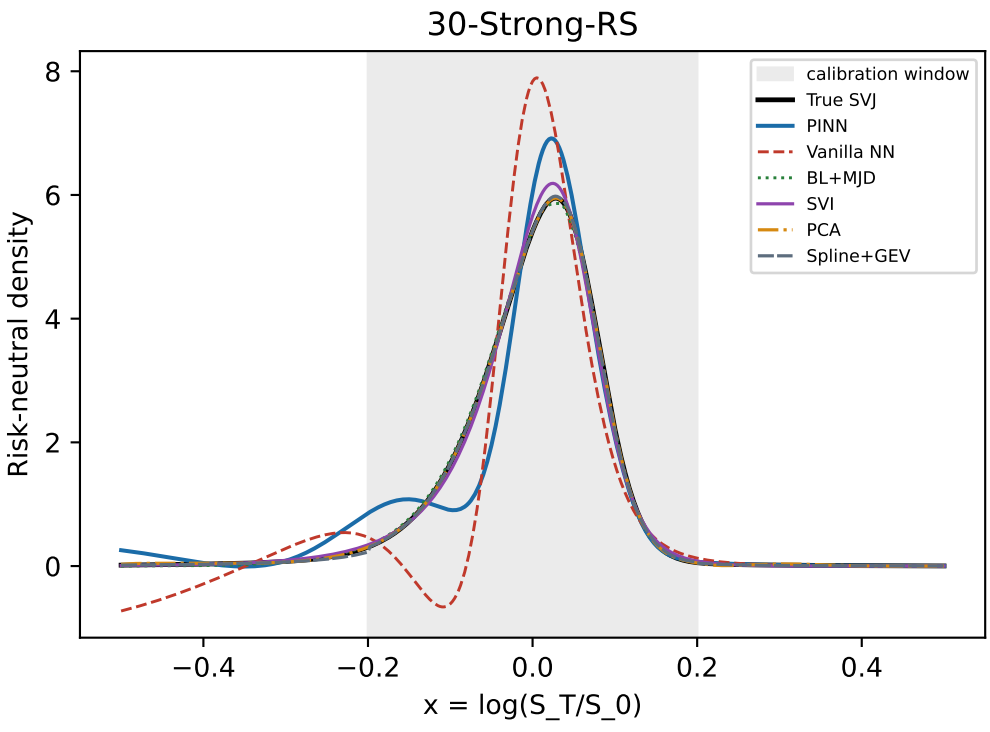
30-Strong-RS
calibration window
True SVJ
PINN
Vanilla NN
BL+MJD
SVI
PCA
Spline+GEV
Risk-neutral density
8
6
4
2
0
−0.4
−0.2
0.0
0.2
0.4
x = log(S_T/S_0)