



Frozen v4 sensitivity register

One-at-a-time checks, scenarios, and alternative prescriptions

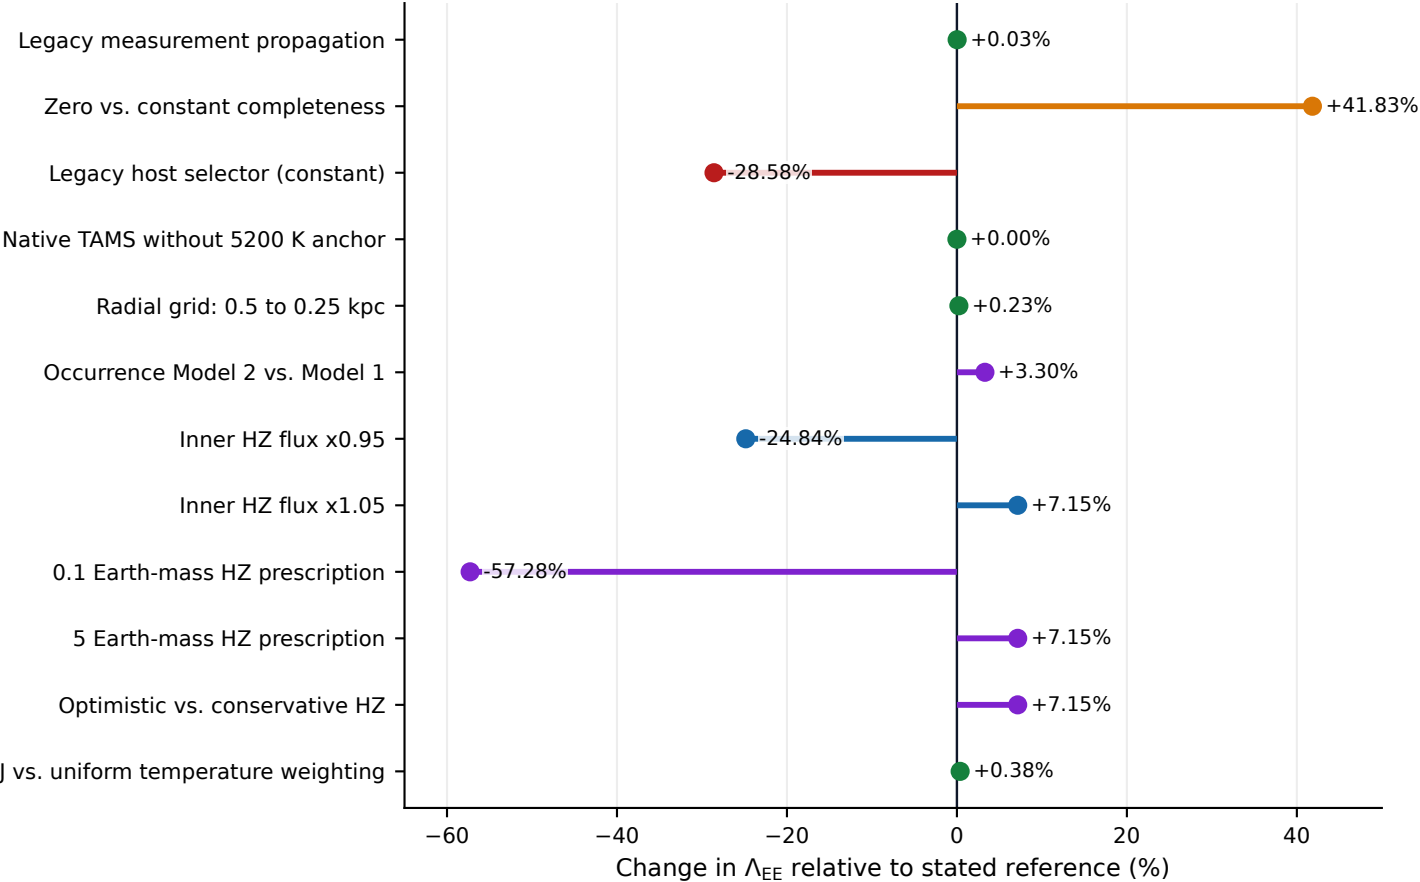

Alternative spatial estimands (not uncertainty intervals)

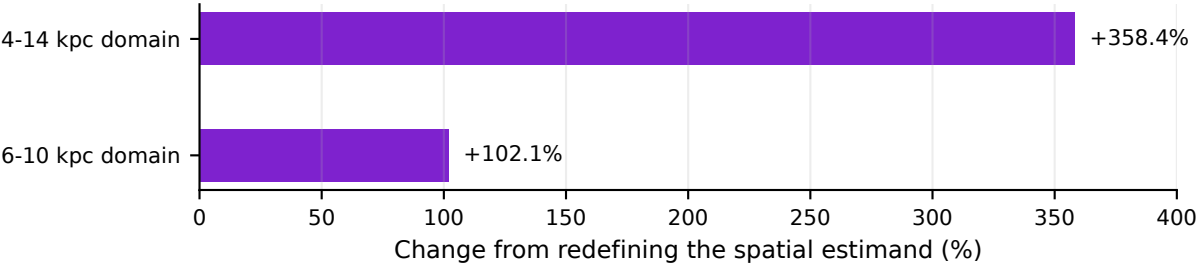

Categorical findings: direct local DR25 support = ABSENT; metallicity-dependent TAMS test = EXCLUDED.