


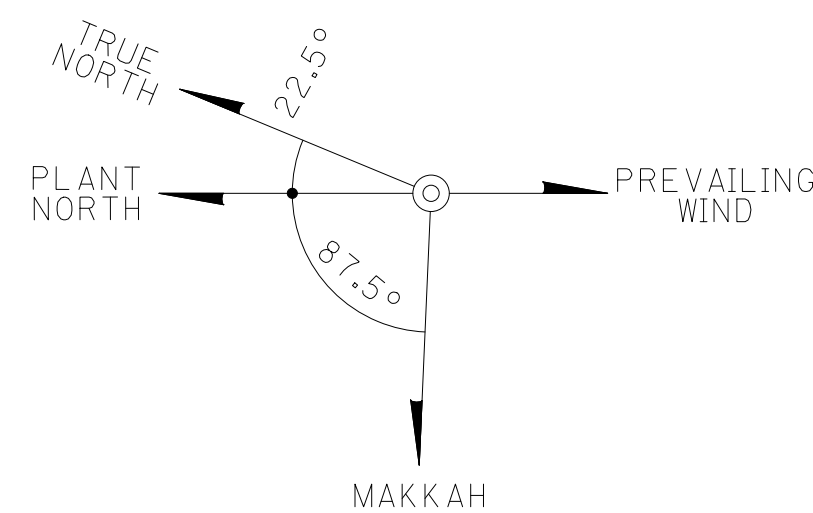

CONT'D LEGEND:

- CABLE INSTALLED IN CABLE TRAY
- CABLE IN CONDUIT RUN EXPOSED
- CABLE IN CONDUIT RUN CONCEALED
- CABLE IN CONDUIT UNDER ACCESS FLOOR
- CABLING UNDER GROUND DIRECT BURIED TRENCH
- CABLING UNDER GROUND DUCT BANK

CONT'D NOTES:

- ALL CONDUIT SHALL HAVE PROTECTIVE BUSHING PLACED AT ALL CONNECTION POINTS TO PREVENT DAMAGE TO CABLES.
- ALL CONDUIT RUN SHALL NOT EXCEED 30M OF STRAIGHT RUN OR TWO 90 DEGREE BENDS. OTHERWISE PULL BOXES ARE REQUIRED.
- INDOOR CONDUIT BEND SHALL HAVE A MINIMUM BENDING RADIUS OF TEN TIMES THE INTERNAL CONDUIT DIAMETER.
- CONDUITS AND SLOTS/SLEEVES SHALL BE SEALED WITH AN APPROVED SEAL OR FIRESTOP MATERIAL. FIRESTOP AND SEALS SHALL BE IN ACCORDANCE WITH SAES-T-629 AND SAES-T-916.
- THE CONDUIT PIPES INSIDE THE BUILDING SHOULD USE EMT TYPE, AND THE CONDUIT PIPES OUTDOORS SHOULD USE RSC TYPE.

NOTES:

- ALL DIMENSIONS ARE IN MILLIMETERS. OTHERWISE NOTED.
- THE IPPS INSTALLATION SHALL BE COMPLIED WITH SAES-T-481
- LOUDSPEAKERS SHALL BE INSTALLED AT A HEIGHT OF MIN. 2.5 METERS ABOVE FIXED FLOOR LEVEL.
- OUTDOOR PAGING STATION SHOULD BE INSTALLED 1.65 METERS ABOVE FINISH FLOOR OR GROUND LEVEL MEASURED UP TO THE CENTER OF THE CALL STATION OR ACCORDING TO MANUFACTURER RECOMMENDATION.
- PAGING STATION INTERCONNECTION CABLE SHALL BE UL LISTED FOR INDOOR AND OUTDOOR APPLICATION AS SAES-T-481.
- THE LOCATION OF LOUD SPEAKER IS BASED ON ACOUSTIC COVERAGE STUDY RESULT.
- MAIN FIBER OPTIC CABLE IS USED THE PCS FIBER OPTIC CABLE.
- ALL IN-PLANT PAGING OUTDOOR EQUIPMENT SHALL BE CERTIFIED FOR USE IN HAZARDOUS AREA.
- THE PULLBOX FOR IPPS SYSTEM SHALL BE CONSIDERED FOR 25% SPARE.
- CONDUIT/DEVICE LOCATION CAN BE ADJUSTABLE AS PER SITE CONDITION.
- HEIGHT OF CONDUIT AND TRAYS FOR COMMUNICATION CABLE ARE NO GREATER THAN 3.4M ABOVE FINISHED FLOOR.


LEGEND

- MASTER MULTI-PARTY OPERATOR ACCESS PANEL
- INDOOR MULTI-PARTY PAGING STATION, WALL MOUNTED
- OUTDOOR MULTI-PARTY PAGING STATION, WALL MOUNTED WITH LOUDSPEAKER, BEACON AND ACOUSTIC HOOD CERTIFIED FOR USE IN HAZARDOUS AREAS
- CEILING LOUD SPEAKER (6W)
- HORN LOUD SPEAKER (25W)
- HORN LOUD SPEAKER (15W) / TAPPED TO 7.5W
- JUNCTION BOX FOR IPPS
- JUNCTION BOX FOR SPEAKER
- WP : WEATHER PROOF
- EX : EXPLOSION PROOF
- PULL BOX
- C.O.S CENTER OF SLEEVE
- B.O.O BOTTOM OF OPENING
- SCT SINGLE CABLE TRANSIT
- SECTION, DETAIL OR PLAN IDENTIFICATION LETTER OR NUMBER
- SHEET NUMBER OF TYPICAL INSTALL DWG WHERE SECTION, DETAIL OR PLAN IS SHOWN. SEE DWG. YA-208041-XXX FOR DETAIL


REFERENCE DRAWINGS

GENERAL NOTE&SYMBOL&LEGEND FOR TELECOMMUNICATION	YB-208068-001
FUNCTIONAL SPECIFICATIONS FOR TELECOMMUNICATION SYSTEM	YE-208998-001
SCOPE OF WORK FOR TELECOMMUNICATION SYSTEM	YE-208999-001
CABLE & CONDUIT LAYOUT	YA-208299-001-YA-208307-001
INST TRAY & TRENCH LAYOUT	YB-174891-001-YB-174898-001
ACOUSTIC COVERAGE STUDY FOR IPPS, ESS SYSTEM	YE-208010-001
CABLE ROUTING PLAN - OME BUILDING 10	YA-181490-001
TYPICAL INSTALLATION DETAIL-IN-PLANT PAGING SYSTEM	YA-208041-001

KEY PLAN

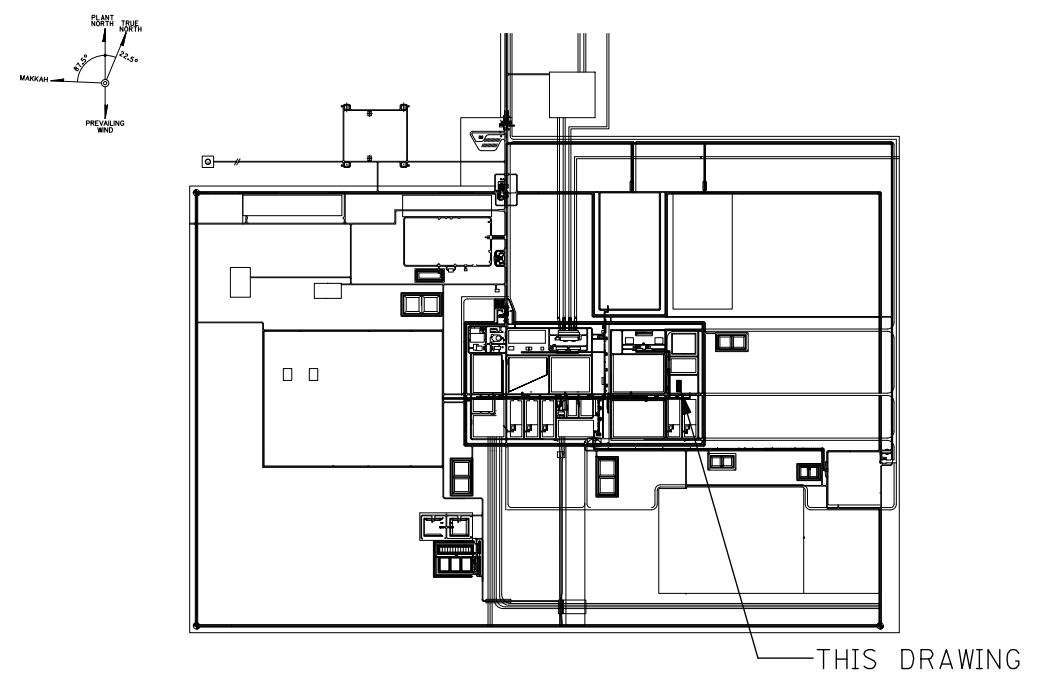

REV	DATE	DESCRIPTION	DSNDR BY	CHKD BY	APPR BY
00B	06/15/26	ISSUED FOR CONSTRUCTION	CK	SKH	WSJ
00A	10/09/24	ISSUED FOR CONSTRUCTION	CK	SKH	SDL
00	09/09/24	ISSUED FOR CONSTRUCTION	CK	SKH	CHK
A	07/02/24	ISSUED FOR REVIEW	CK	SKH	CHK

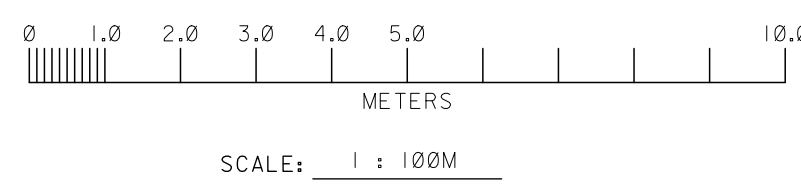

REVISION VALIDATION

THIS REVISION NO. 00B IS COVERED, FOR ALL APPROVAL AND CERTIFICATION REQUIREMENTS, PER SAEP-334, UNDER DRAWING COMPLETION CERTIFICATE NO. 10-14815-0004-001

DESIGN CERTIFICATION	REVIEW FOR KEY DRAWINGS (DESIGN AGENCY)	OTHER
ENGR./DATE SKH 06/15/26	CERTIFIED BY/DATE CONST. AGENCY/DATE 06/15/26	OPERATIONS/DATE BY/DATE
REVNO./DATE 00B 06/15/26	REVISION DESCRIPTION ISSUED FOR CONSTRUCTION	

JOB ORDER/EWO NO. 10-14815-0004 THIS REVISION IS NOT TO BE USED FOR CONSTRUCTION UNTIL CERTIFIED AND DATED

SAUDI ARABIAN OIL COMPANY			
IN-PLANT PAGING LAYOUT		DRAWING TYPE	
OME10		CBL	
JAFURAH INLET, STORAGE AND EXPORT			
JAFURAH		SAUDI ARABIA	
PLANT NO.	INDEX	DRAWING NUMBER	SHT. NO. REV. NO.
863	T	YA-208134	001 00B

CABLE LIST

SYMBOL	DESCRIPTION	CONDUIT SIZE	REMARK
(A1)	4P-18AWG	TRAY	FOR OUTDOOR HANDSET
(A2)	4P-18AWG	1-1/4"	"
(B1)	1P-12AWG	TRAY	FOR SPEAKER
(B2)	1P-12AWG	1"	"
(C)	F0 CABLEx2	-	SHARED PCS F0 CABLE (REDUNDANT)
(D)	UTP CAT. 6	1"	FOR IPPS WS
(E)	8P-12AWG	2-1/2"	FOR IPPS OUTDOOR JB
(F1)	6P-12AWG	TRAY	FOR IPPS BLDG JB
(F2)	6P-12AWG	2-1/2"	"
(G1)	2P-18AWG	TRAY	FOR BLDG HANDSET
(G2)	2P-18AWG	1"	"
(H)	2P-12AWG	1-1/4"	FOR BEACON

EQUIPMENT LIST

NO.	SYMBOL	QUANTITY	DESCRIPTION	DETAIL NO.
1	(C1) 00B	3EA	HORN LOUD SPEAKER (25W)	T-13
2	(C2)	18EA	HORN LOUD SPEAKER (15W)	T-14
3	(C3) 00B	36EA	CEILING LOUD SPEAKER (6W) W/JUNCTION BOX	T-11
4	(P1)	1EA	INDOOR MULTI-PARTY PAGING STATION, DESK MOUNTED	T-26

- *S1 50mm PVC SLEEVE C.O.S EL. 103.450 X 37EA
- *S2 50mm PVC SLEEVE & SCT RS43 C.O.S EL. 103.450 X 8EA
- *S3 90mm PVC SLEEVE & SCT RS68 C.O.S EL. 103.450 X 1EA
- *W01 WALL OPENING (W200 x H150) B.O.O EL. 102.950 X 4EA
- *T1 PERFORATED CABLE TRAY (W150 X H50) EL. 101.050
- *T2 PERFORATED CABLE TRAY (W100 X H50) EL. 103.000