


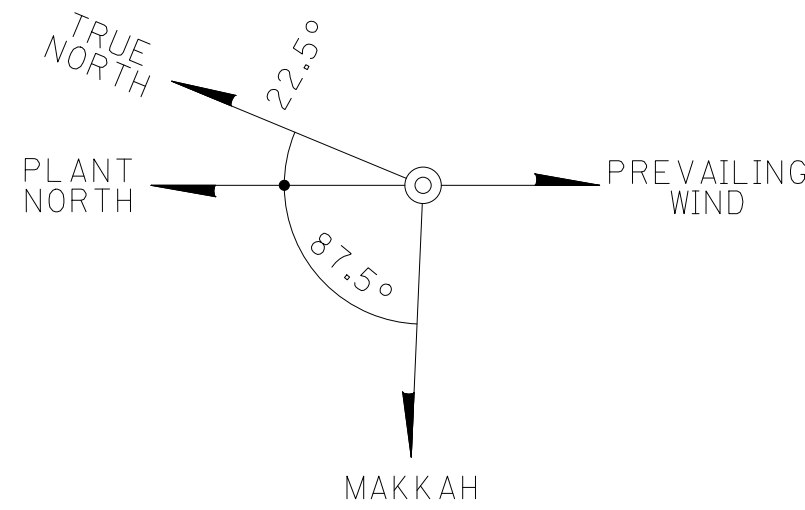

CONT'D NOTES:

- ALL CONDUIT SHALL HAVE PROTECTIVE BUSHING PLACED AT ALL CONNECTION POINTS TO PREVENT DAMAGE TO CABLES.
- THE IPPS INSTALLATION SHALL BE COMPLIED WITH SAES-T-481.
- LOUDSPEAKERS SHALL BE INSTALLED AT A HEIGHT OF MIN. 2.5 METERS ABOVE FIXED FLOOR LEVEL.
- OUTDOOR PAGING STATION SHOULD BE INSTALLED 1.65 METERS ABOVE FINISH FLOOR OR GROUND LEVEL MEASURED UP TO THE CENTER OF THE CALL STATION OR ACCORDING TO MANUFACTURER RECOMMENDATION.
- PAGING STATION INTERCONNECTION CABLE SHALL BE UL LISTED FOR INDOOR AND OUTDOOR APPLICATION AS SAES-T-481.
- THE LOCATION OF LOUD SPEAKER IS BASED ON ACOUSTIC COVERAGE STUDY RESULT.
- MAIN FIBER OPTIC CABLE IS USED THE PCS FIBER OPTIC CABLE.
- ALL IN-PLANT PAGING OUTDOOR EQUIPMENT SHALL BE CERTIFIED FOR USE IN HAZARDOUS AREA.
- THE PULLBOX FOR IPPS SYSTEM SHALL BE CONSIDERED FOR 25% SPARE.
- CONDUIT/DEVICE LOCATION CAN BE ADJUSTABLE AS PER SITE CONDITION.
- HEIGHT OF CONDUIT AND TRAYS FOR COMMUNICATION CABLE ARE NO GREATER THAN 3.4M ABOVE FINISHED FLOOR/IN FALSE CEILING AREA.

CONT'D LEGEND:

- CABLE INSTALLED IN CABLE TRAY
- CABLE IN CONDUIT RUN EXPOSED
- CABLE IN CONDUIT RUN CONCEALED
- CABLE IN CONDUIT UNDER ACCESS FLOOR
- CABLING UNDER GROUND DIRECT BURIED TRENCH
- CABLING UNDER GROUND DUCT BANK


LEGEND

- MASTER MULTI-PARTY OPERATOR ACCESS PANEL
- INDOOR MULTI-PARTY PAGING STATION, DESK MOUNTED
- INDOOR MULTI-PARTY PAGING STATION, WALL MOUNTED
- OUTDOOR MULTI-PARTY PAGING STATION, WALL MOUNTED WITH LOUDSPEAKER, BEACON AND ACOUSTIC HOOD CERTIFIED FOR USE IN HAZARDOUS AREAS
- CEILING LOUD SPEAKER (6W)
- HORN LOUD SPEAKER (25W)
- HORN LOUD SPEAKER (15W)
- JUNCTION BOX FOR IPPS
- JUNCTION BOX FOR SPEAKER
 - WP : WEATHER PROOF
 - EX : EXPLOSION PROOF
- PULL BOX
- C.O.S CENTER OF SLEEVE
- SCT SINGLE CABLE TRANSIT
- B.O.O BOTTOM OF OPENING
- MCT MULTI CABLE TRANSIT
- SECTION, DETAIL OR PLAN IDENTIFICATION LETTER OR NUMBER
- SHEET NUMBER OF TYPICAL INSTALL DWG. WHERE SECTION, DETAIL OR PLAN IS SHOWN. SEE DWG. YA-208041-XXX FOR DETAIL

REFERENCE DRAWINGS


GENERAL NOTE&SYMBOL&LEGEND	YB-208068-001
FOR TELECOMMUNICATION	YB-208068-002
FUNCTIONAL SPECIFICATIONS FOR TELECOMMUNICATION SYSTEM	YE-208998-001
SCOPE OF WORK FOR TELECOMMUNICATION	YE-208999-001
ACOUSTIC COVERAGE STUDY FOR IPPS, ESS	YE-208010-001
TYPICAL INSTALLATION DETAIL FOR IPPS	YA-208041-001
ELECTRICAL EQUIPMENT LAYOUT FOR SUBSTATION I2	YA-181429-001
CABLE & CONDUIT LAYOUT	YA-208303-001
INST TRAY & TRENCH LAYOUT	YB-174943-013

KEY PLAN

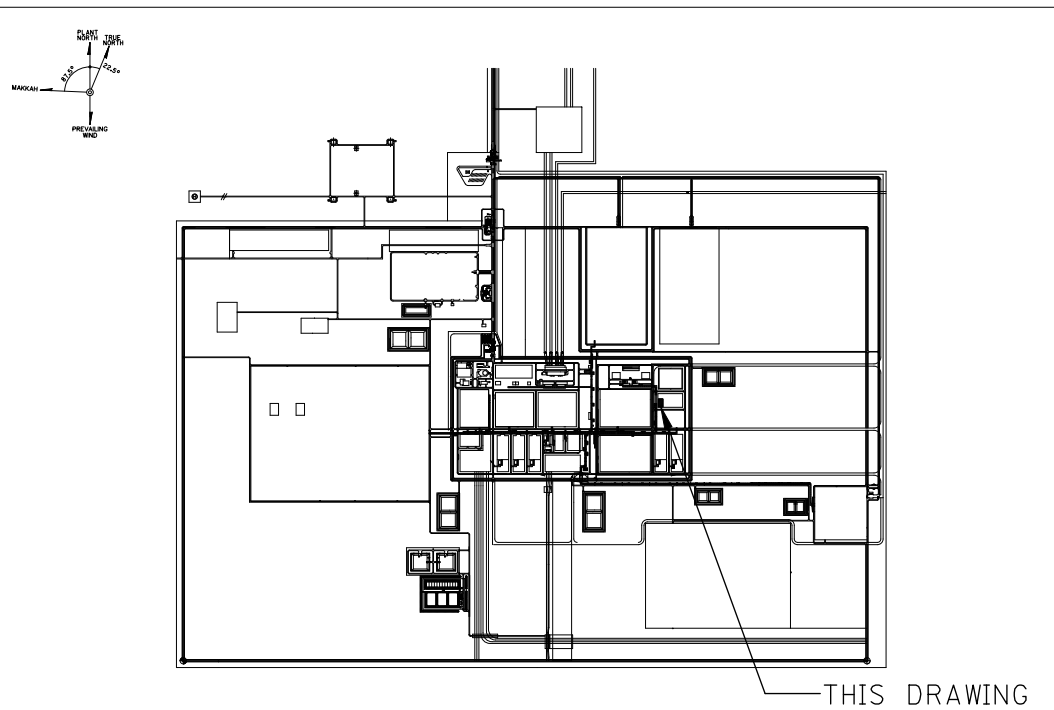

THIS DRAWING

REV	REV	DESCRIPTION	DSND BY	SKH BY	APPR BY
00C	06/14/26	ISSUED FOR CONSTRUCTION	DKC	SKH	WSJ
00B	12/10/25	ISSUED FOR CONSTRUCTION	DKC	SKH	WSJ
00A	10/09/24	ISSUED FOR CONSTRUCTION	DKC	SKH	SDL
00	09/09/24	ISSUED FOR CONSTRUCTION	DKC	SKH	CHK
A	07/02/24	ISSUED FOR REVIEW	DKC	SKH	CHK

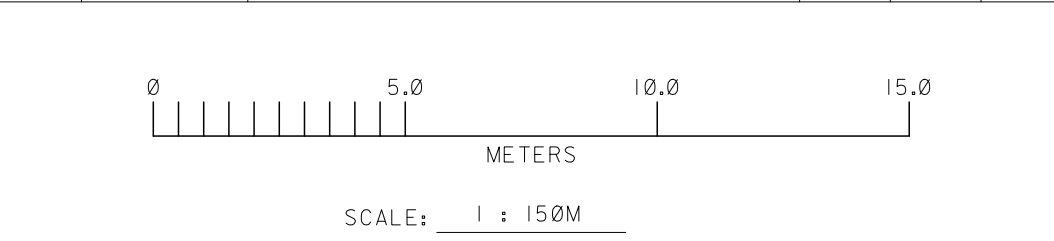

REVISION VALIDATION

THIS REVISION NO. 00C IS COVERED, FOR ALL APPROVAL AND CERTIFICATION REQUIREMENTS, PER SAEP-334, UNDER DRAWING COMPLETION CERTIFICATE NO. 10-14815-0004-001

DESIGN CERTIFICATION	REVIEW FOR KEY DRAWINGS (REQUIRED)	OTHER
ENGG./DATE SKH 06/14/26	CERTIFIED BY/DATE WSJ 06/14/26	CONST. AGENCY/DATE OPERATIONS/DATE BY/DATE

REVISION DESCRIPTION	REVISION DESCRIPTION
00C 06/14/26	ISSUED FOR CONSTRUCTION

JOB ORDER/REV NO. 10-14815-0004 THIS REVISION IS NOT TO BE USED FOR CONSTRUCTION UNTIL CERTIFIED AND DATED

SAUDI ARABIAN OIL COMPANY
IN-PLANT PAGING LAYOUT



SUBSTATION I2
JFGP COMMON FACILITIES

JAFURAH SAUDI ARABIA
PLANT NO. INDEX DRAWING NUMBER SHT. NO. REV. NO.


862 T YA-208132 001 00C

RESTRICTED

SAUDI ARAMCO 2634 ENG. (05/08) CADD-00

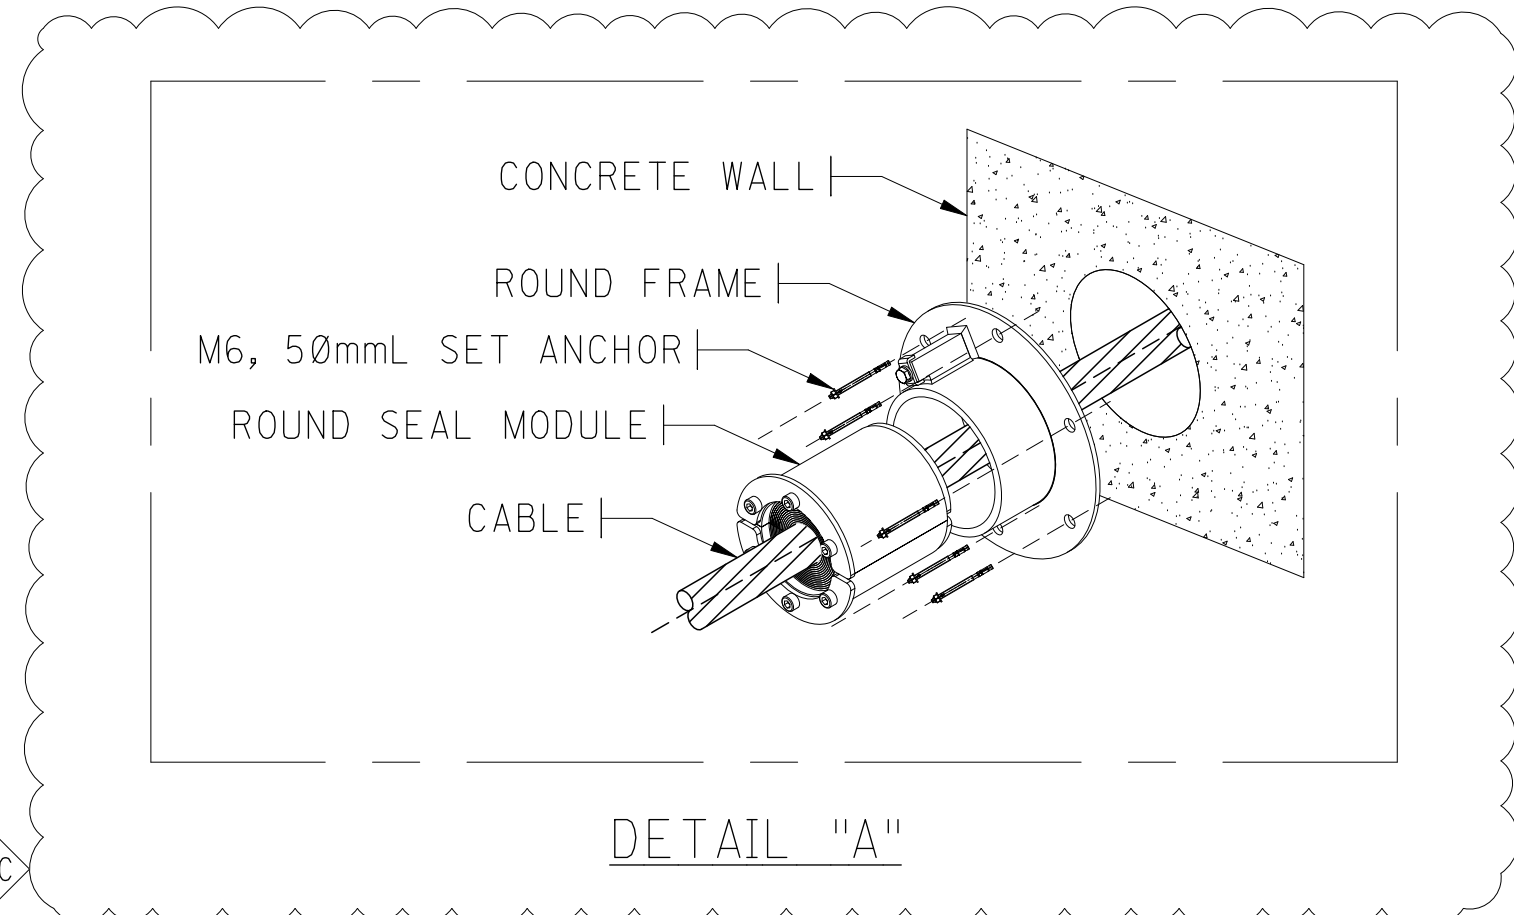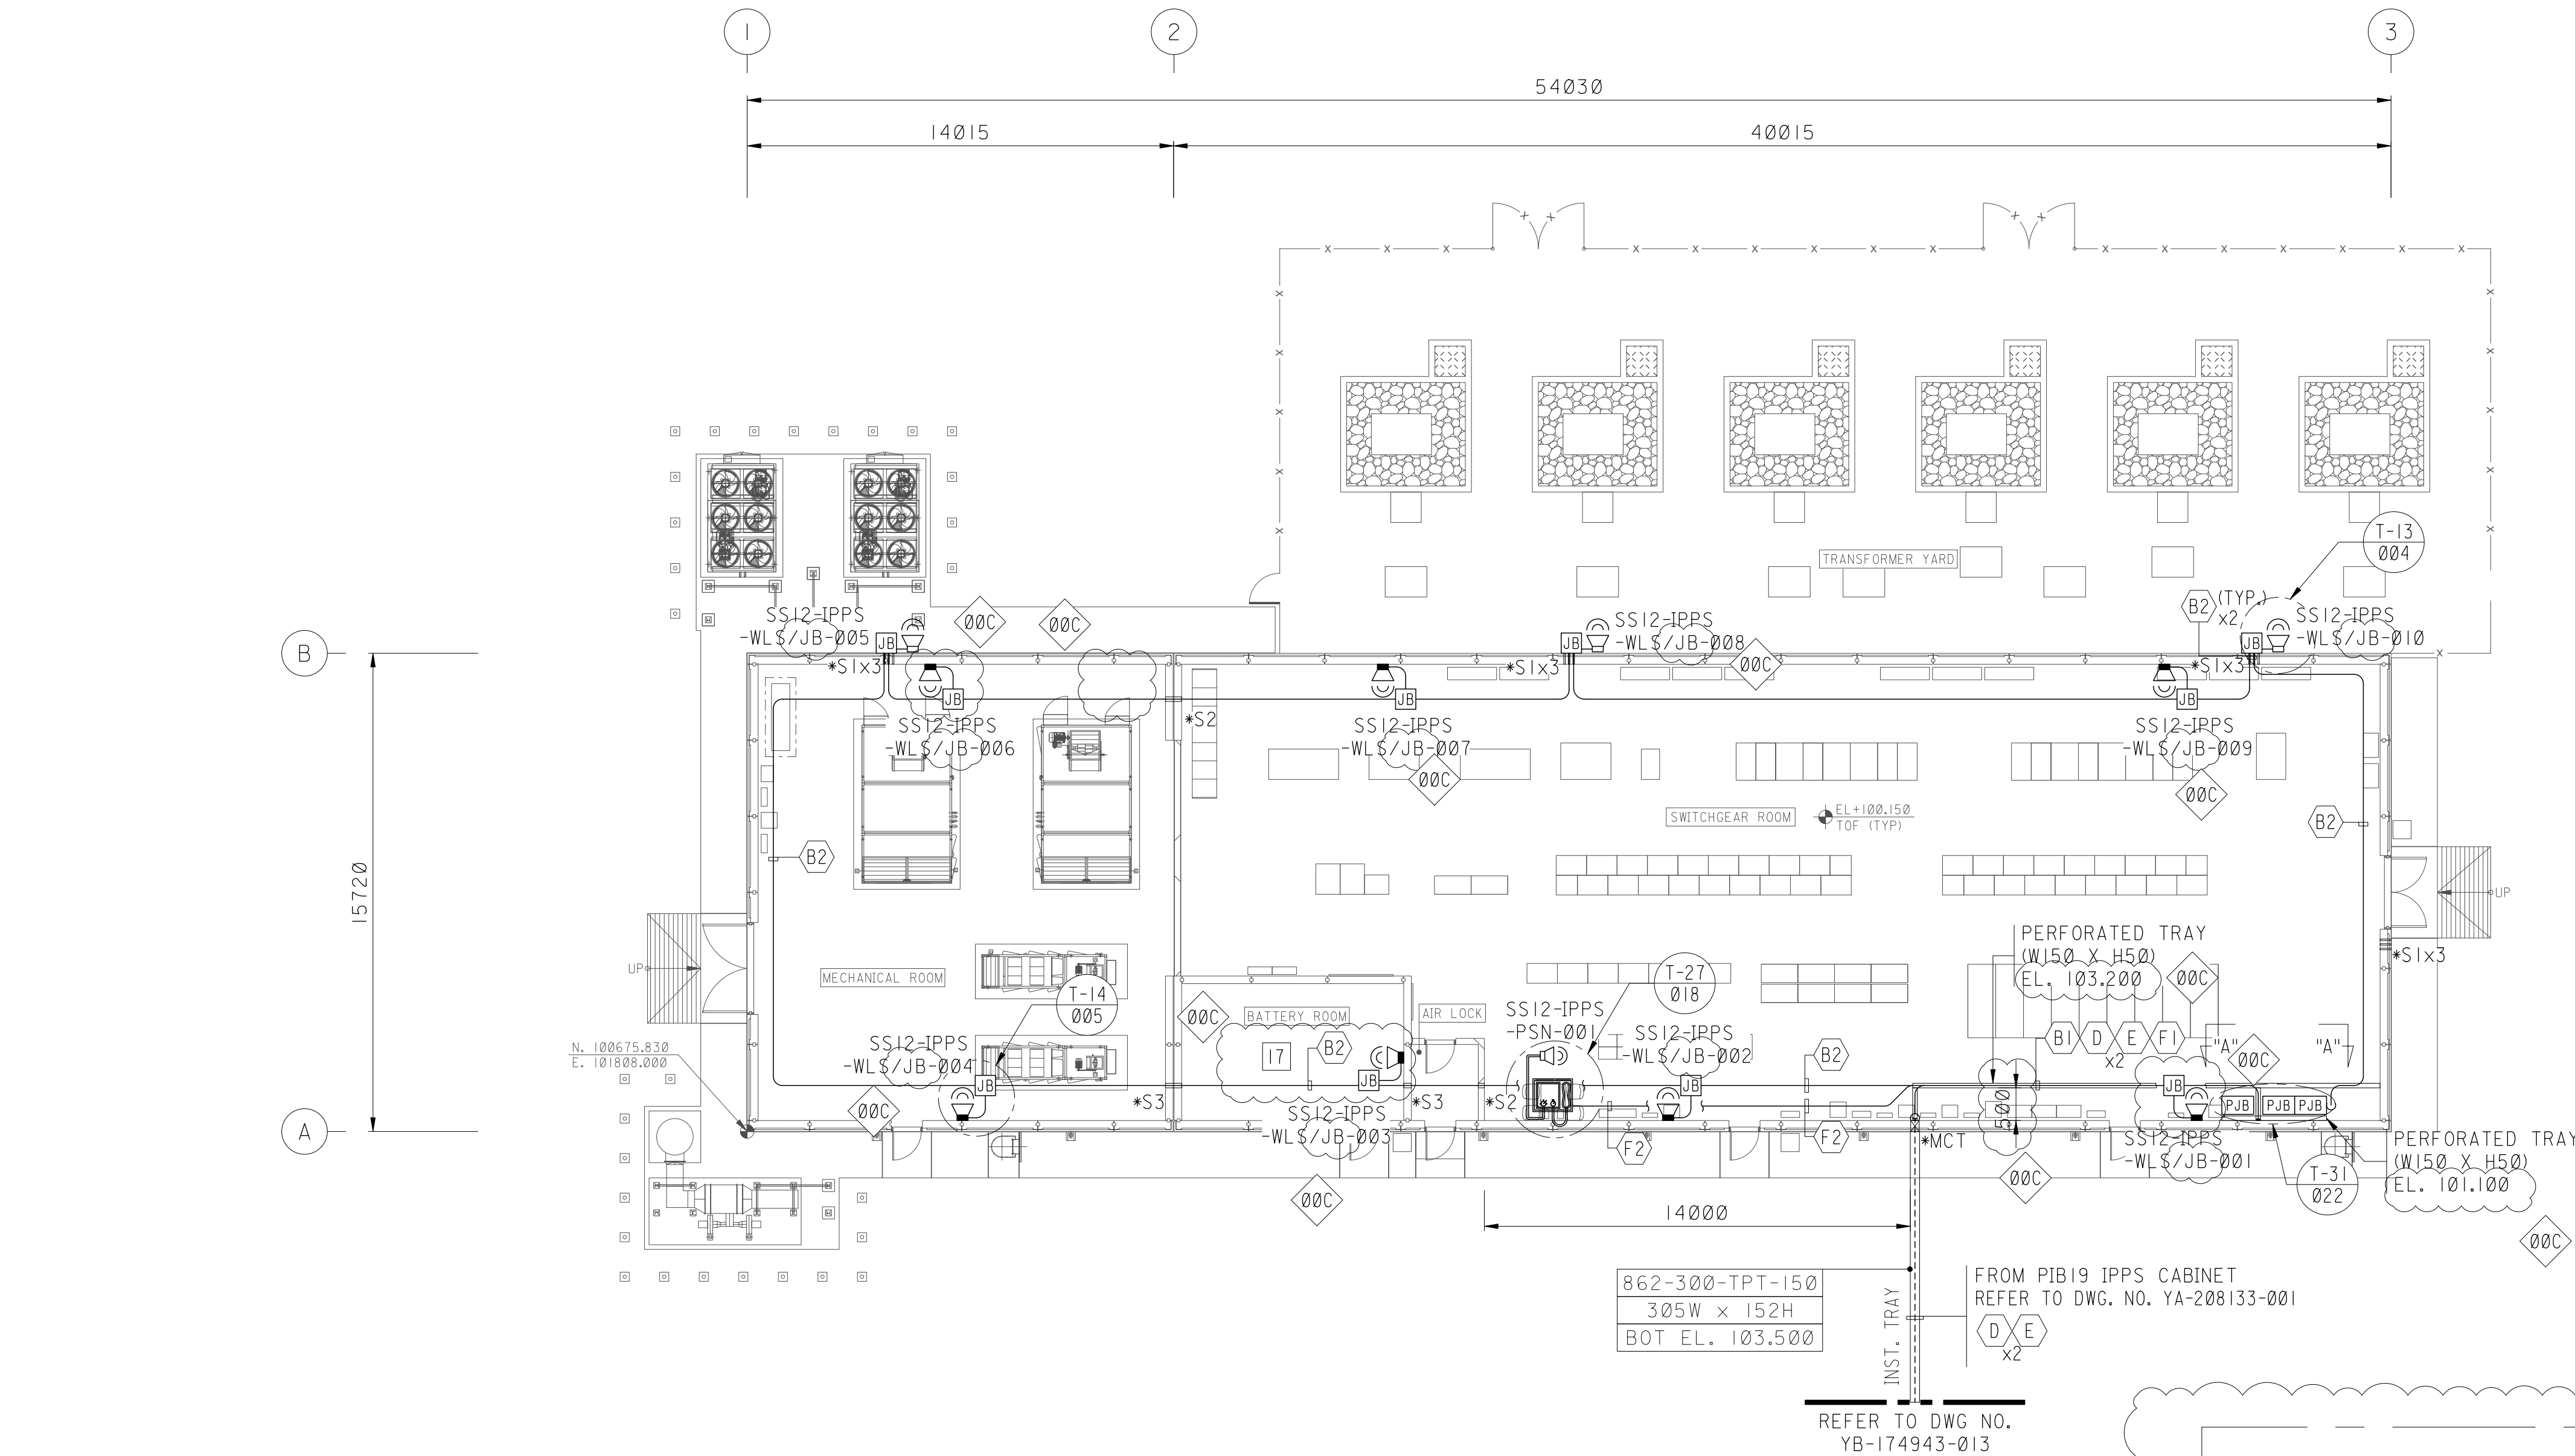

DETAIL "A"

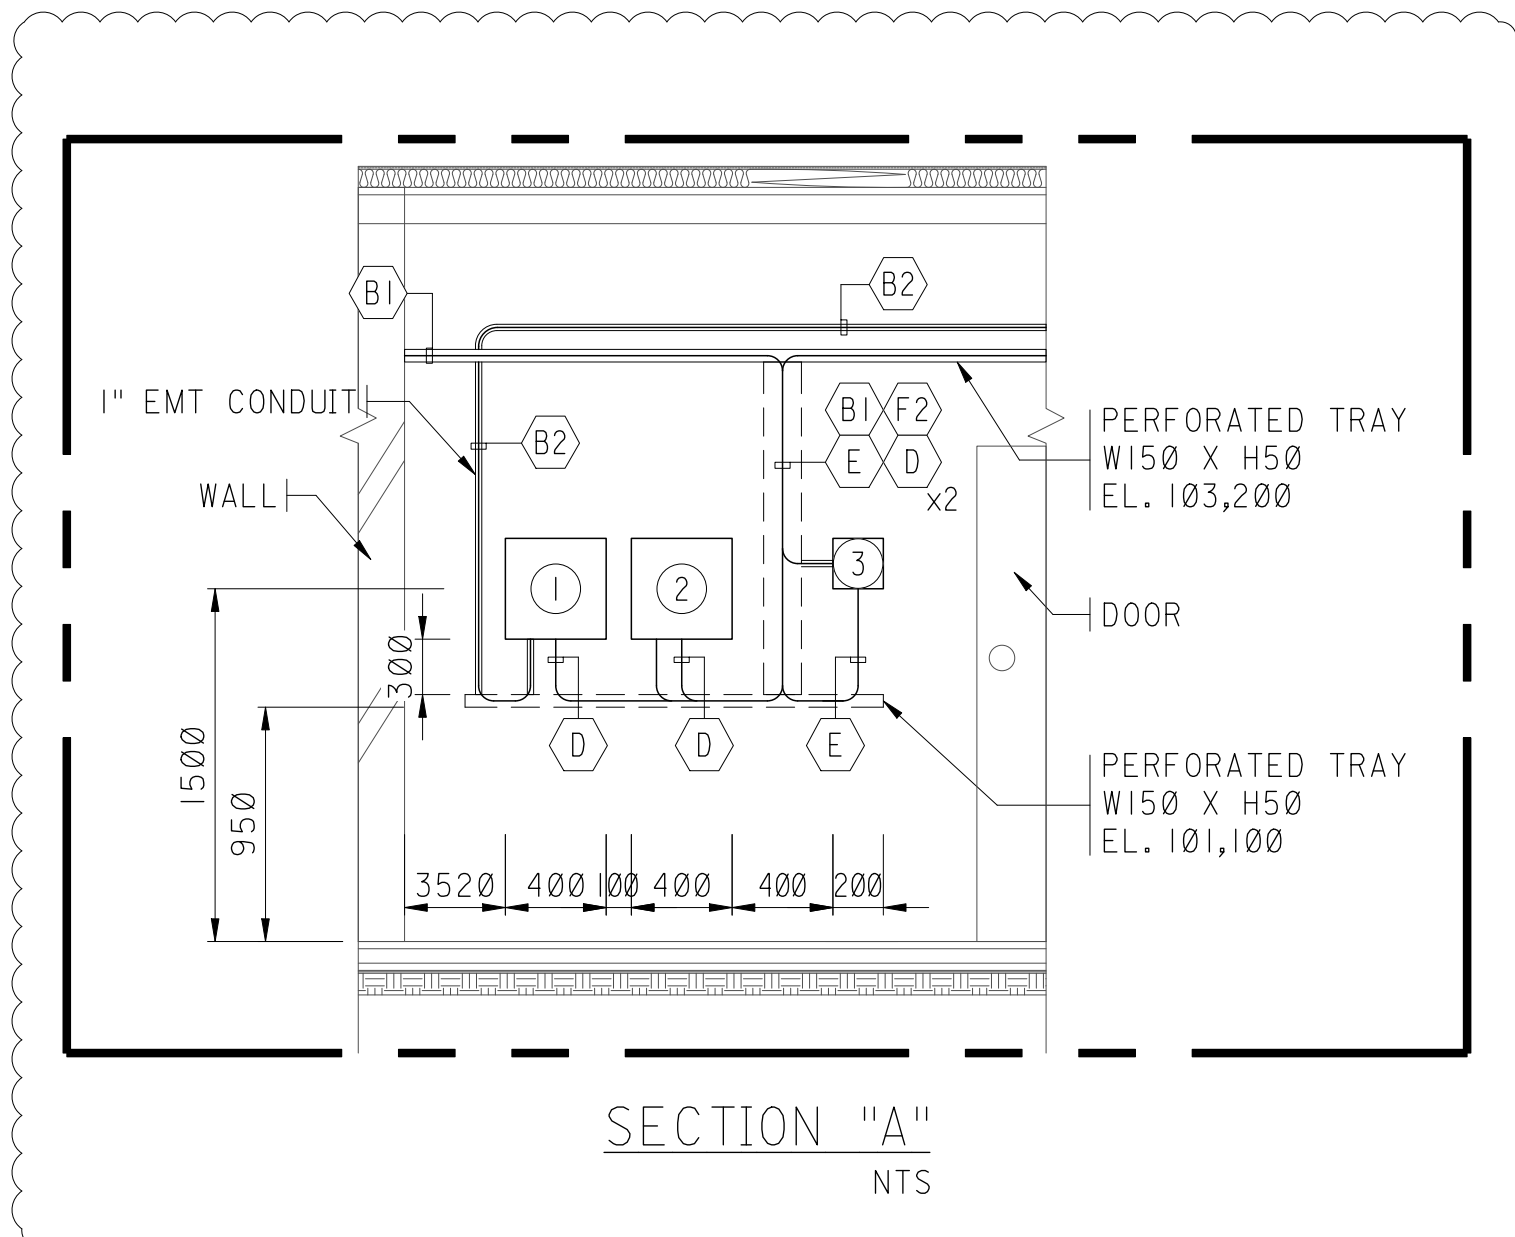

- *S1 50mm PVC SLEEVE C.O.S. EL. 103.050 X 2EA
- *S2 50mm PVC SLEEVE C.O.S. EL. 103.450 X 2EA
- *S3 50mm PVC SLEEVE & SCT RS43 C.O.S. EL. 103.450 X 12EA
- *MCT MCT WALL OPENING (BY CI.) (W280 x H190) B.O.O EL. 103.500

CABINET LIST

NO.	EQUIPMENT NO.	REMARKS
①	SS12-IPPS-PJB-001A	MARSHALLING JUNCTION BOX
②	SS12-IPPS-PJB-002B	MARSHALLING JUNCTION BOX
③	SS12-IPPS-PJB-002	PAGING JUNCTION BOX

CABLE LEGEND

SYMBOL	CABLE SCHEDULE	CONDUIT SIZE	REMARK
(A)	FIBER OPTIC PATCH CORD	TRAY	
(B1)	SPEAKER : IP-12AWG	TRAY	
(B2)	SPEAKER : IP-12AWG	1"	
(C)	IPPS JB : 8P-12AWG	TRAY	OUTDOOR
(D)	IPPS JB : 6P-12AWG	TRAY	OUTDOOR
(E)	HANDSET : 4P-18AWG	TRAY	OUTDOOR
(F1)	HANDSET : 2P-18AWG	TRAY	
(F2)	HANDSET : 2P-18AWG	1"	
(G)	BEACON : 2P-12AWG	TRAY	
(H)	IPPS WS : UTP CAT.6A	1"	BY VENDER

EQUIPMENT LIST

NO.	SYMBOL	QUANTITY	DESCRIPTION	DETAIL NO.
1	(C)	3EA	HORN LOUD SPEAKER (25W)	T-13
2	(C)	7EA	HORN LOUD SPEAKER (15W)	T-14
3	(C)	-	CEILING LOUD SPEAKER (6W)	T-11
4	(D)	1EA	INDOOR MULTI-PARTY PAGING STATION, WALL MOUNTED	T-27