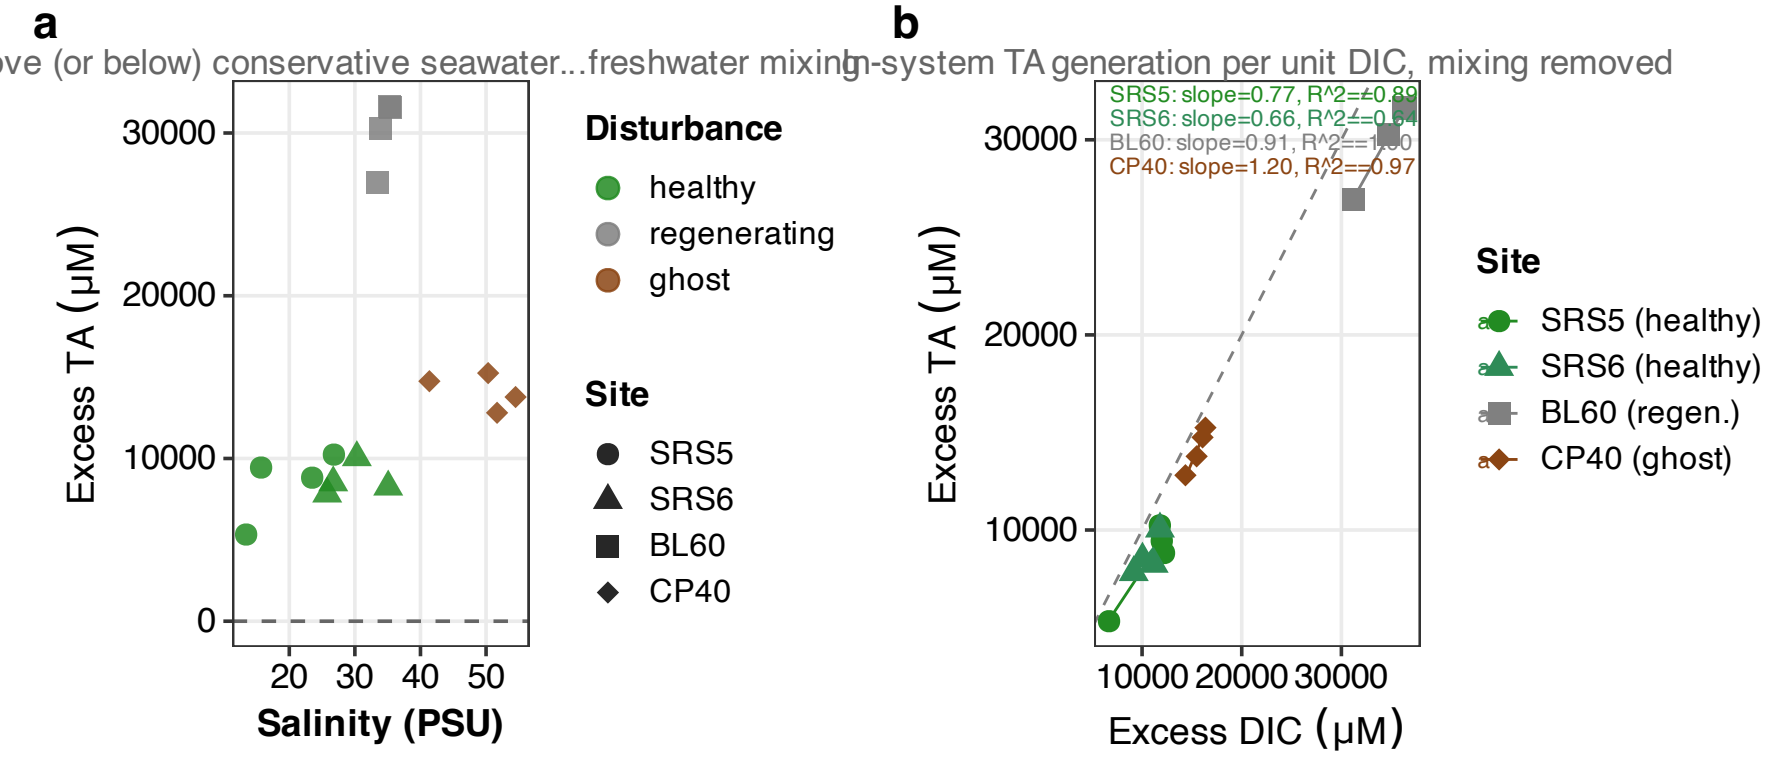
a
ve (or below) conservative seawater...freshwater mixing
Excess TA (µM)
30000
20000
10000
0
20
30
40
50
Salinity (PSU)
Disturbance
healthy
regenerating
ghost
Site
SRS5
SRS6
BL60
CP40
b
n-system TA generation per unit DIC, mixing removed
SRS5: slope=0.77, R^2=0.89
SRS6: slope=0.66, R^2=0.64
BL60: slope=0.91, R^2=1.00
CP40: slope=1.20, R^2=0.97
Excess TA (µM)
30000
20000
10000
10000 20000 30000
Excess DIC (µM)
Site
SRS5 (healthy)
SRS6 (healthy)
BL60 (regen.)
CP40 (ghost)