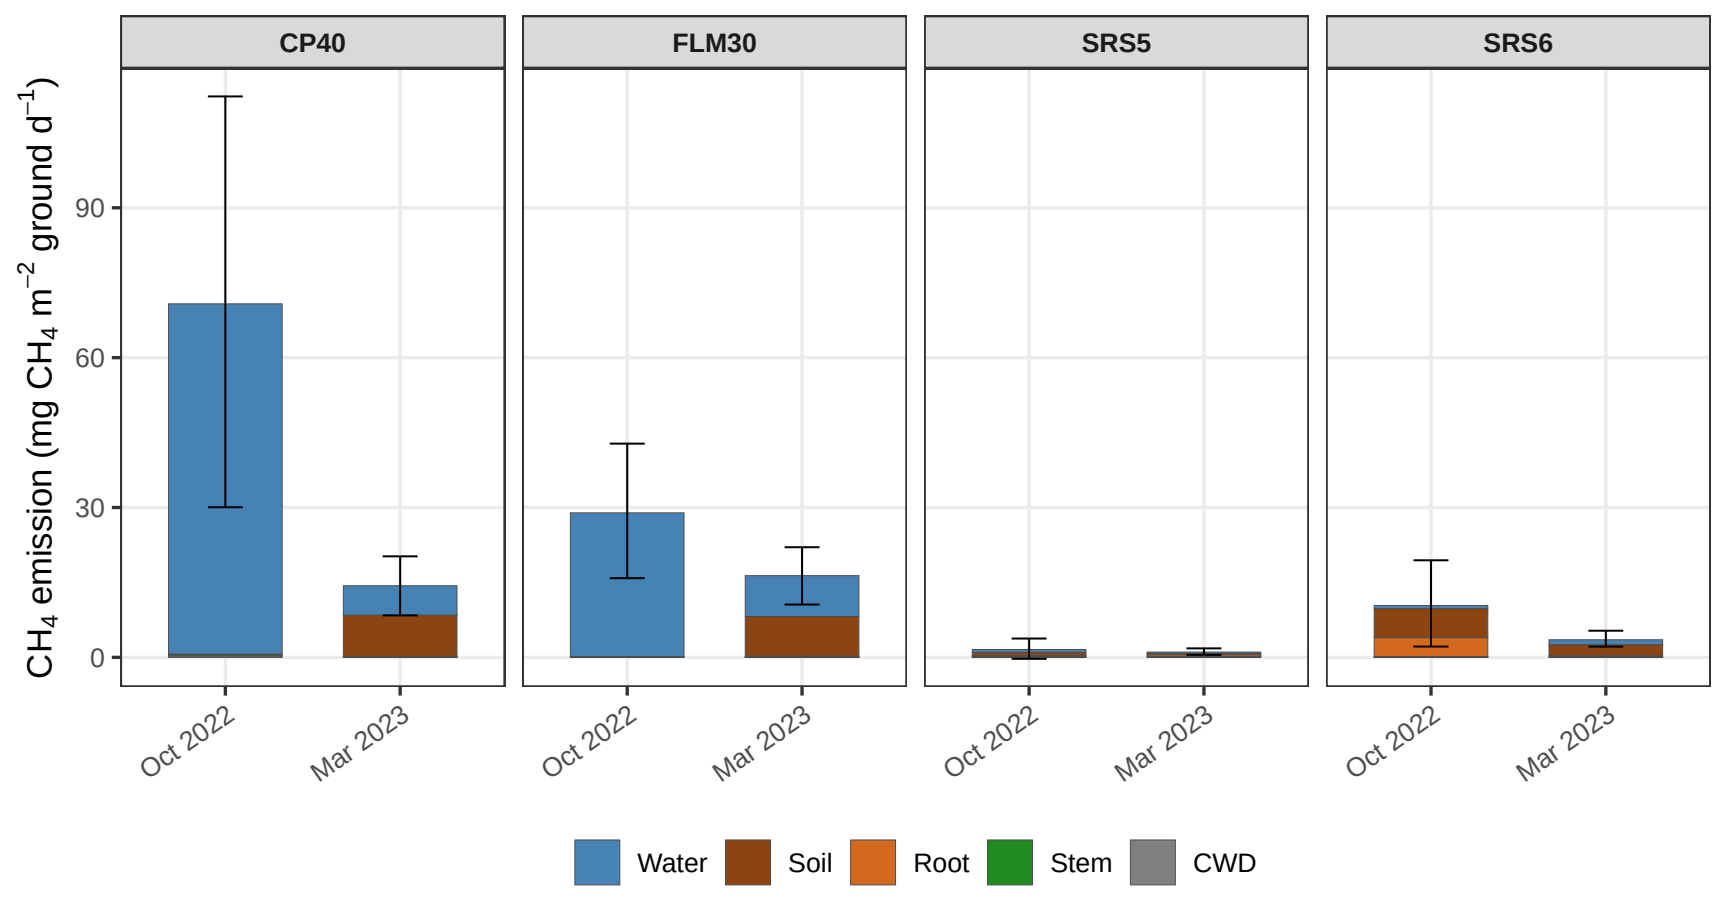
CP40
FLM30
SRS5
SRS6
CH4 emission (mg CH4 m−2 ground d−1)
0
30
60
90
Oct 2022
Mar 2023
Water
Soil
Root
Stem
CWD