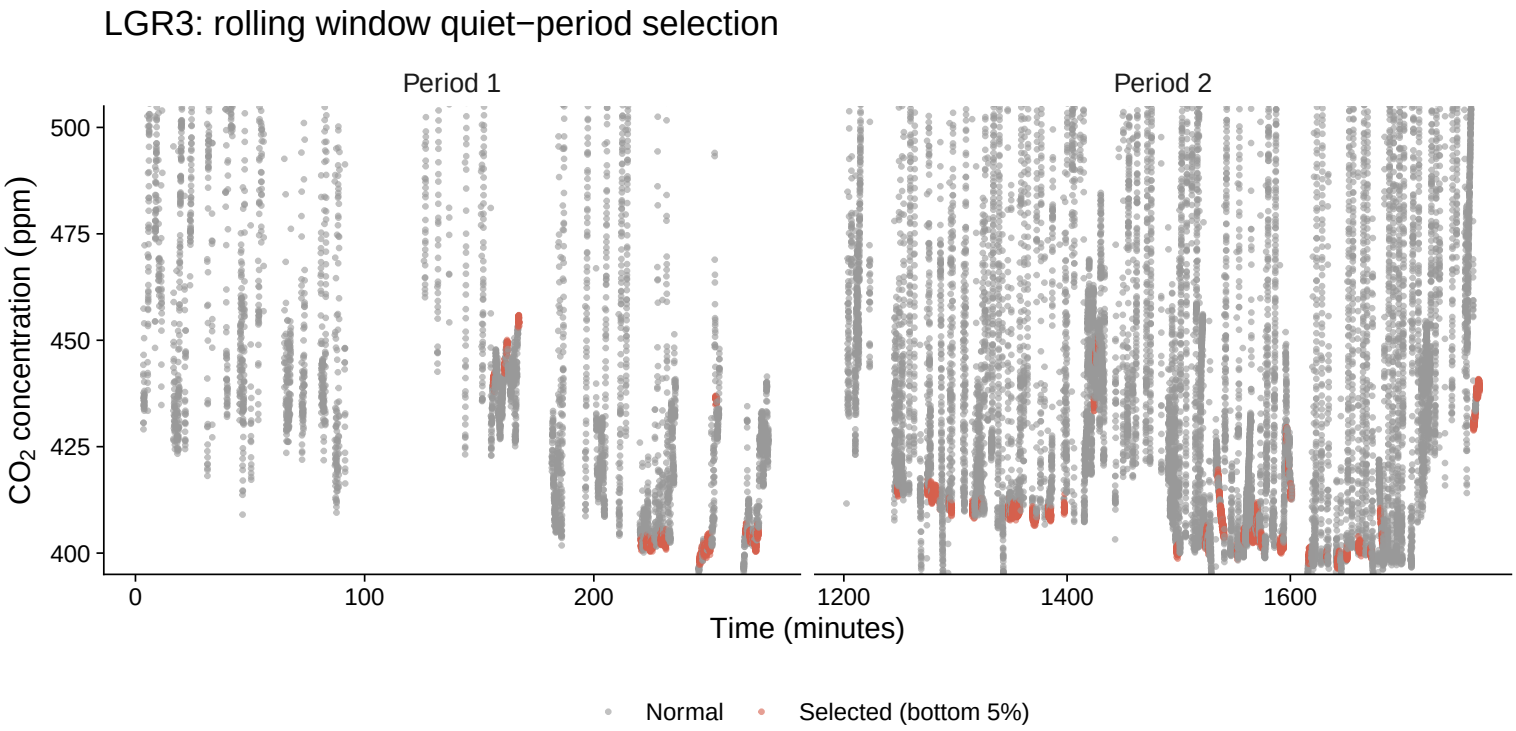
LGR3: rolling window quiet−period selection
Period 1
Period 2
CO2 concentration (ppm)
500
475
450
425
400
0
100
200
1200
1400
1600
Time (minutes)
Normal
Selected (bottom 5%)