



## ERCOT Grid Operations

### ESR Integration Report : 06/26/2024

#### Current Daily Values:

Installed ESR Discharge Capacity*	7,890 MW
Total ESR Discharge Capacity**	9,048 MW
Installed ESR Charge Capacity+	8,993 MW
Total ESR Charge Capacity++	8,993 MW

Peak Load	78,955 MW
Peak Load Hour (HE)	17
ESR Discharge at Peak Load Hour	89 MW
ESR Charge at Peak Load Hour	270 MW
ESR Net Charge/Discharge at Peak Load Hour^	-181 MW

Max ESR Discharge Generation	1,270 MW
Max ESR Discharge Time	20:16
Penetration at Max ESR Discharge Time	1.68%

Max ESR Charge Load	1,169 MW
Max ESR Charge Time	08:19
Penetration at Max ESR Charge Time	1.93%

Max ESR Discharge Penetration	1.68%
Max ESR Discharge Penetration Time	20:16
ESR Discharge Generation at Max ESR Discharge Penetration Time	1,270 MW

Max ESR Charge Penetration	1.93%
Max ESR Charge Penetration Time	08:19
ESR Charge Load at Max ESR Charge Penetration Time	1,169 MW

\* Sum of maximum capacity (i.e. seasonal net max. sustainable rating in RIOO) of all ESR generators modeled in ERCOT's network operations model and are commercially operable (estimated based on Commercial Operations Date in RIOO).

\*\* Sum of maximum capacity (i.e. seasonal net max. sustainable rating in RIOO) of all ESR generators modeled in ERCOT's network operations model.

+ Sum of maximum capacity (i.e. maximum point of delivery total load in RIOO) of all ESR CLRs that are modeled in ERCOT's network operations model and are commercially operable (estimated based on Commercial Operations Date in RIOO).


++ Sum of maximum capacity (i.e. maximum point of delivery total load in RIOO) of all ESR CLRs that are modeled in ERCOT's network operations model.

^ ESR Net Charge/Discharge = Total Discharging from ESR generators - Total Charging from ESR CLRs. Positive represents Net Discharge; negative represents Net Charge.


Note that generation, generation record, and generator capacity values in following pages of this report are based on units modeled in ERCOT's network operations model.

# Hourly Average Actual Load vs. Actual ESR Output


06/26/2024

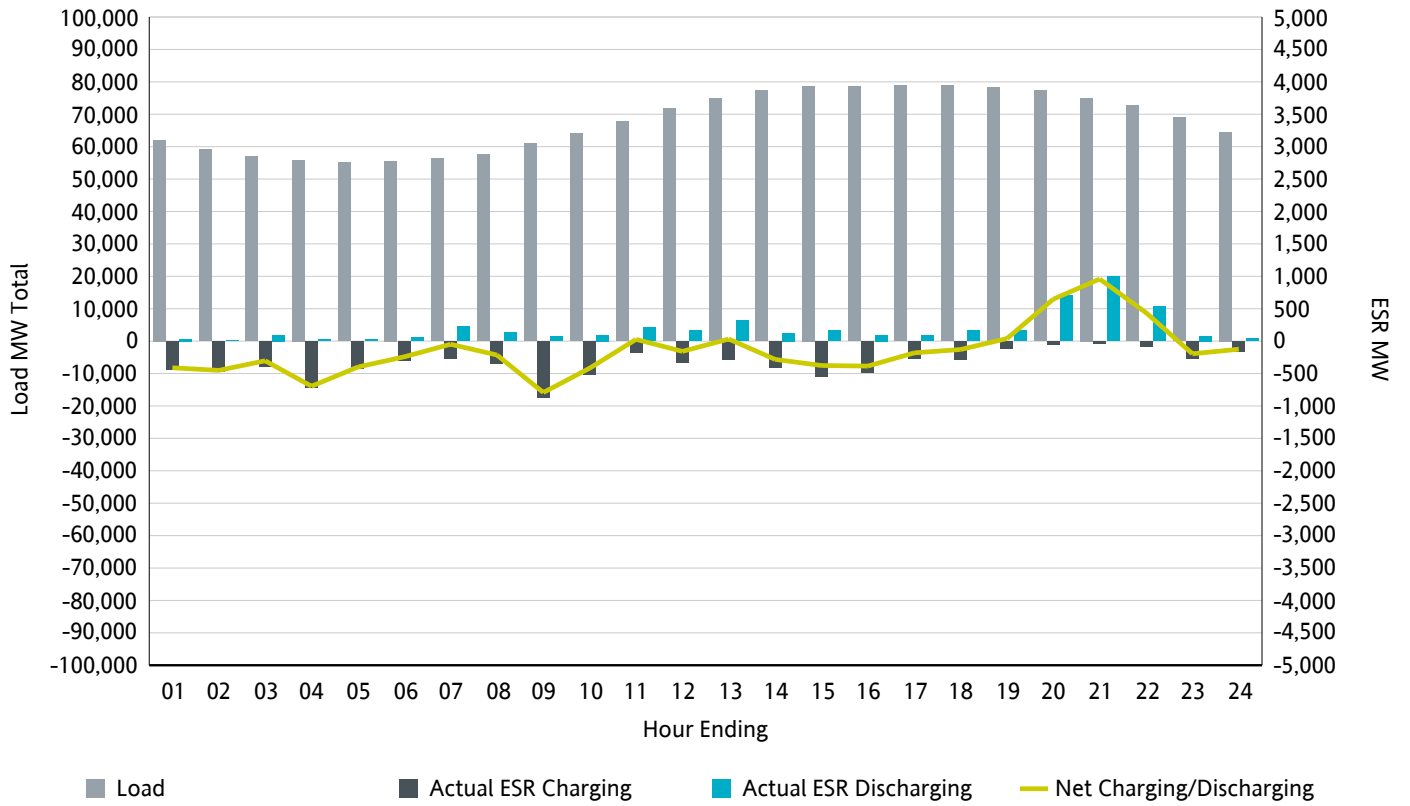

## Actual ESR Discharging Output as a Percentage of Total Installed ESR Discharge Capacity 06/26/2024

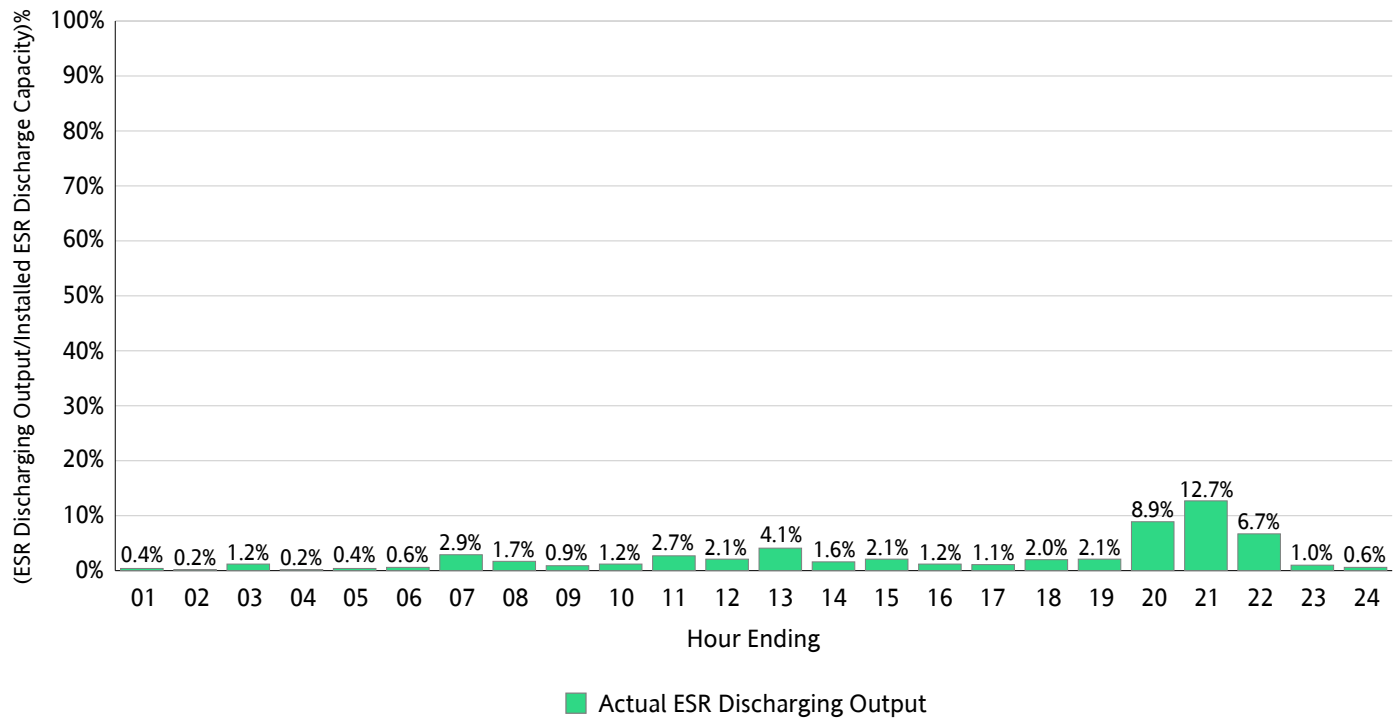


## Actual ESR Charging Output as a Percentage of Total Installed ESR Charge Capacity 06/26/2024

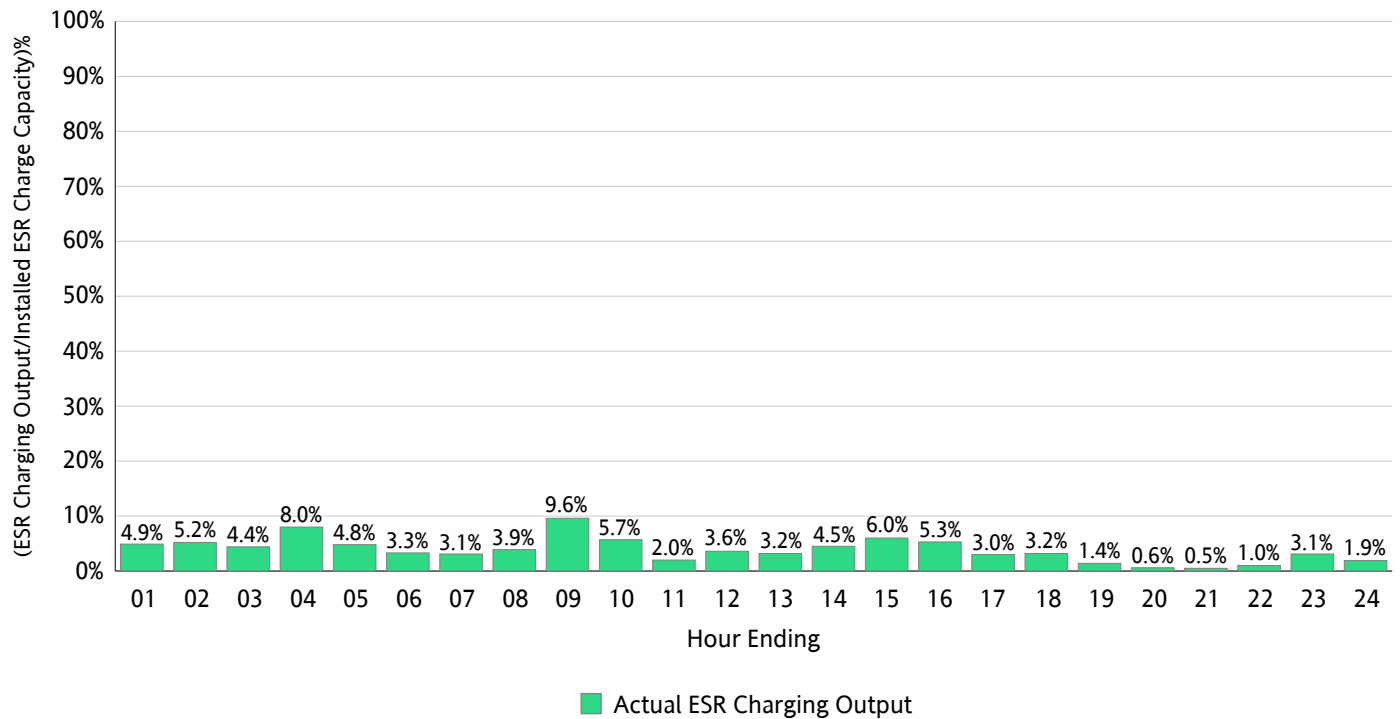

## Actual ESR Net Output as a Percentage of ERCOT Load

### 06/26/2024

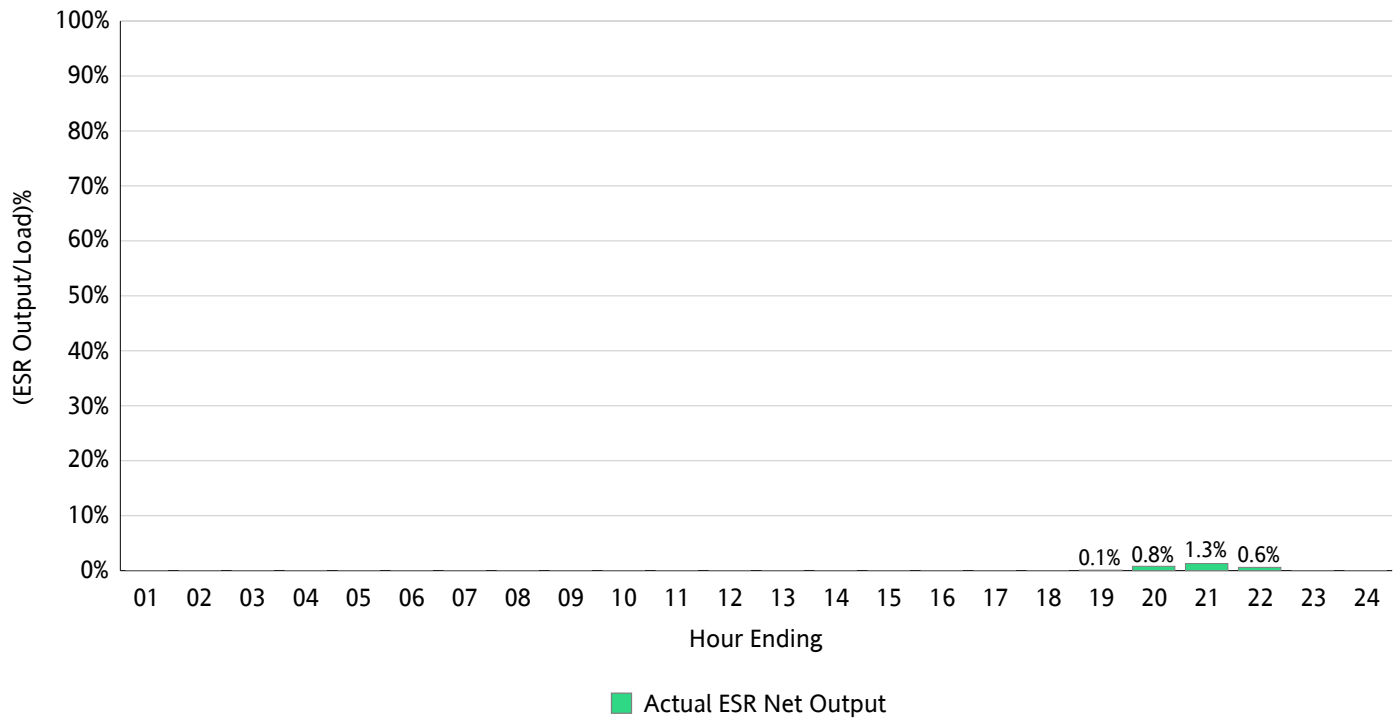

ERCOT Load vs. Actual ESR Net Output  
06/19/2024 - 06/26/2024

