



## ERCOT Grid Operations

### ESR Integration Report : 04/23/2024

#### Current Daily Values:

Installed ESR Discharge Capacity*	7,250 MW
Total ESR Discharge Capacity**	8,215 MW
Installed ESR Charge Capacity+	8,167 MW
Total ESR Charge Capacity++	8,167 MW

Peak Load	50,147 MW
Peak Load Hour (HE)	21
ESR Discharge at Peak Load Hour	1,098 MW
ESR Charge at Peak Load Hour	45 MW
ESR Net Charge/Discharge at Peak Load Hour^	1,053 MW

Max ESR Discharge Generation	1,706 MW
Max ESR Discharge Time	20:20
Penetration at Max ESR Discharge Time	3.39%

Max ESR Charge Load	1,014 MW
Max ESR Charge Time	15:54
Penetration at Max ESR Charge Time	2.04%

Max ESR Discharge Penetration	3.39%
Max ESR Discharge Penetration Time	20:20
ESR Discharge Generation at Max ESR Discharge Penetration Time	1,706 MW

Max ESR Charge Penetration	2.15%
Max ESR Charge Penetration Time	23:59
ESR Charge Load at Max ESR Charge Penetration Time	938 MW

\* Sum of maximum capacity (i.e. seasonal net max. sustainable rating in RIOO) of all ESR generators modeled in ERCOT's network operations model and are commercially operable (estimated based on Commercial Operations Date in RIOO).

\*\* Sum of maximum capacity (i.e. seasonal net max. sustainable rating in RIOO) of all ESR generators modeled in ERCOT's network operations model.

+ Sum of maximum capacity (i.e. maximum point of delivery total load in RIOO) of all ESR CLR's that are modeled in ERCOT's network operations model and are commercially operable (estimated based on Commercial Operations Date in RIOO).


++ Sum of maximum capacity (i.e. maximum point of delivery total load in RIOO) of all ESR CLR's that are modeled in ERCOT's network operations model.

^ ESR Net Charge/Discharge = Total Discharging from ESR generators - Total Charging from ESR CLR's. Positive represents Net Discharge; negative represents Net Charge.


Note that generation, generation record, and generator capacity values in following pages of this report are based on units modeled in ERCOT's network operations model.

## Hourly Average Actual Load vs. Actual ESR Output


04/23/2024

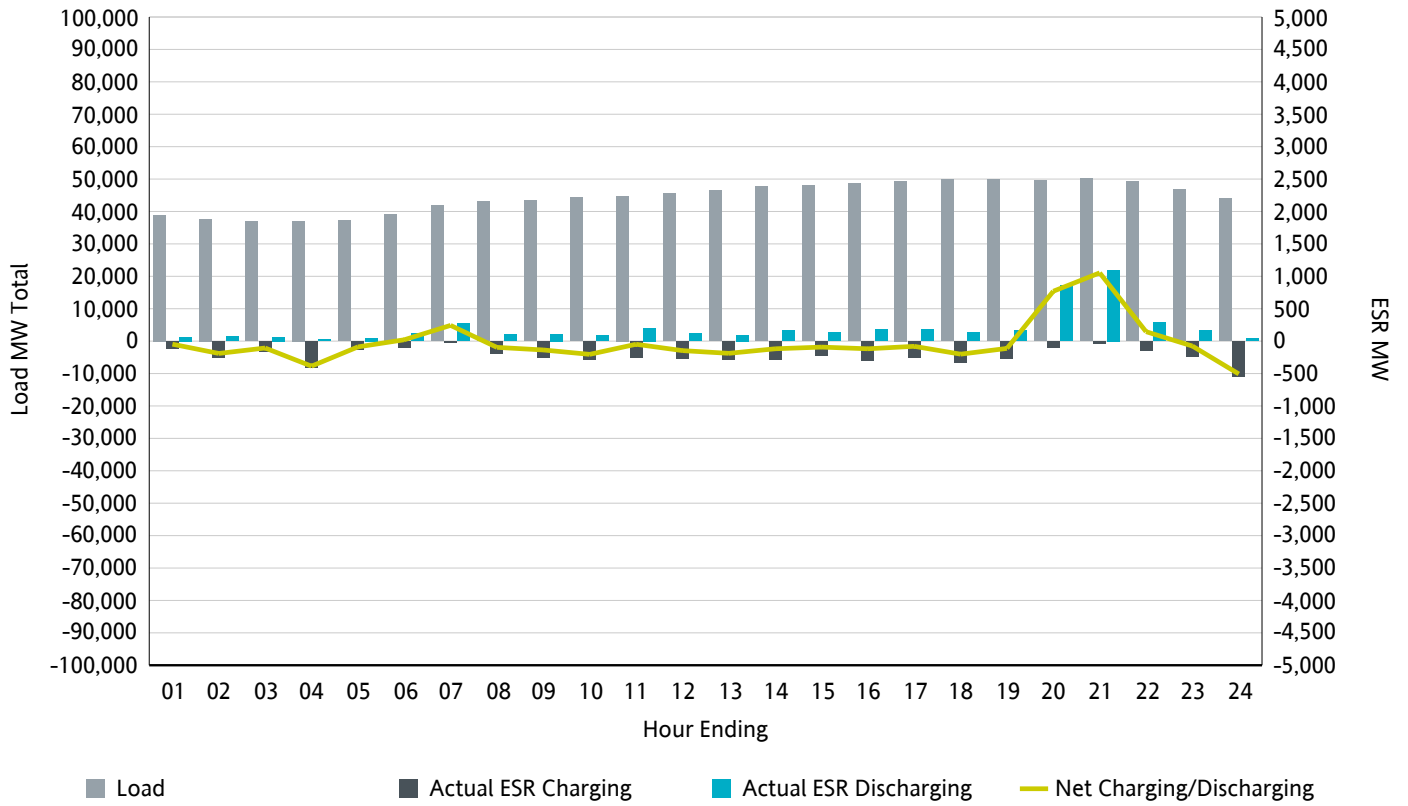


## Actual ESR Discharging Output as a Percentage of Total Installed ESR Discharge Capacity 04/23/2024

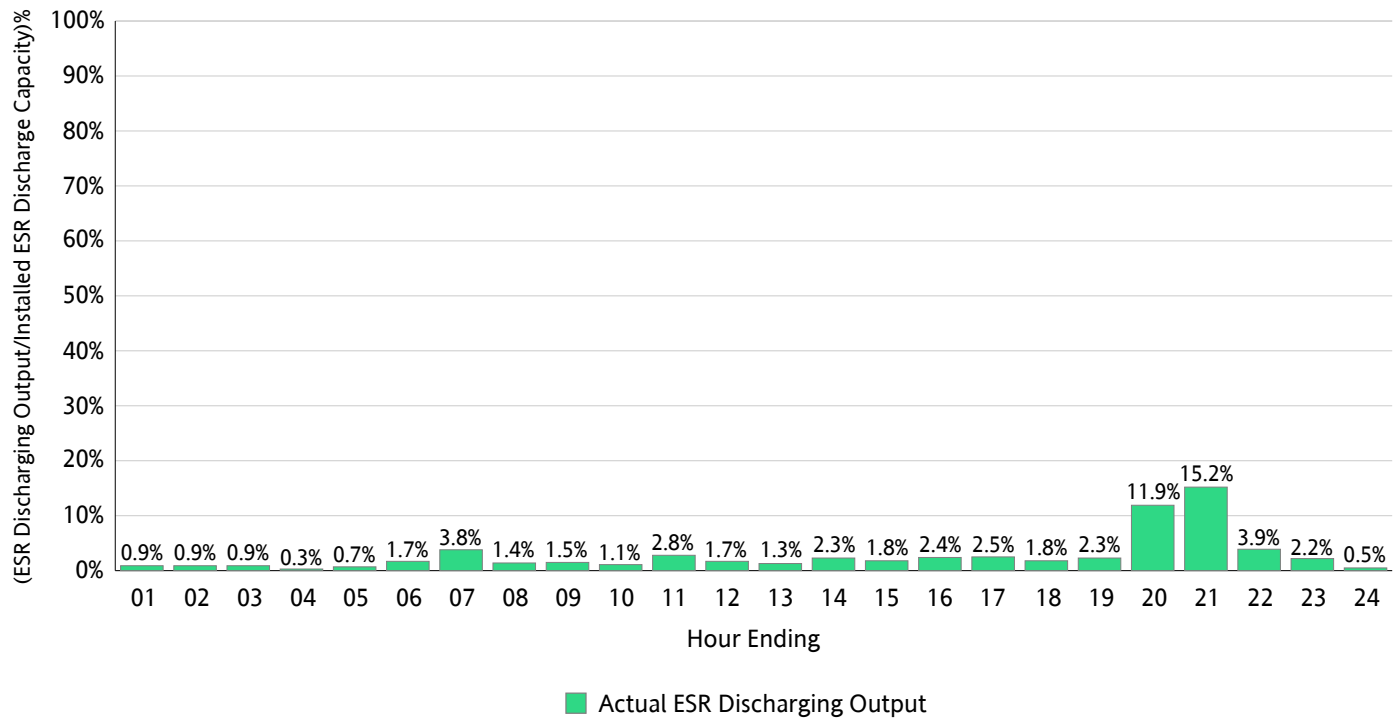

## Actual ESR Charging Output as a Percentage of Total Installed ESR Charge Capacity 04/23/2024

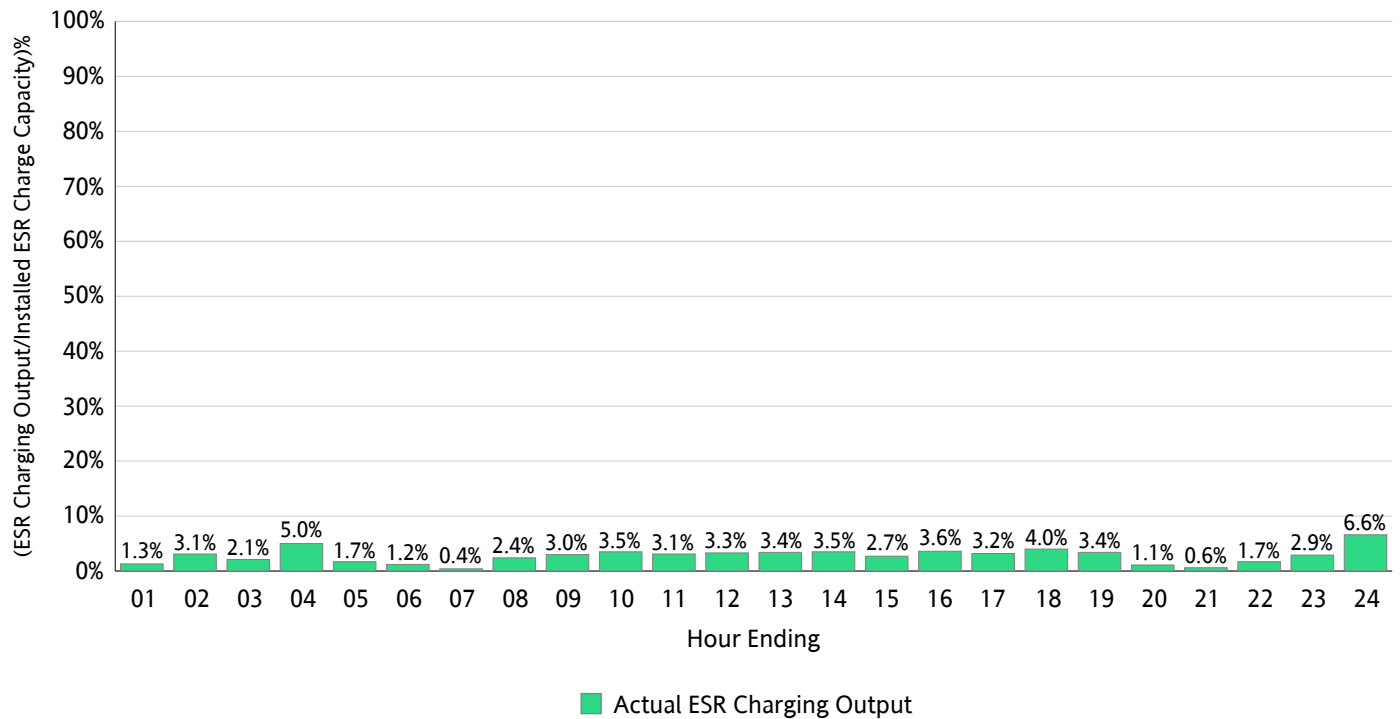

## Actual ESR Net Output as a Percentage of ERCOT Load 04/23/2024

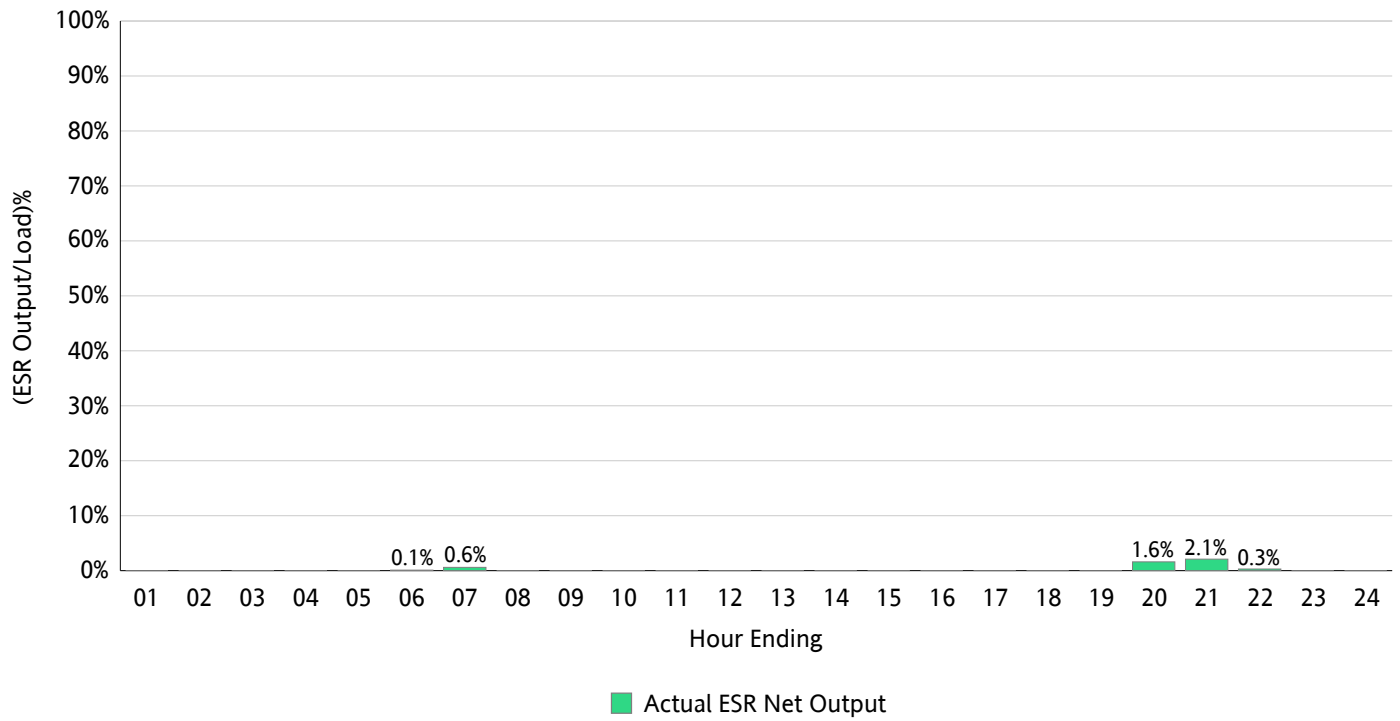

ERCOT Load vs. Actual ESR Net Output  
04/16/2024 - 04/23/2024

