



ERCOT Grid Operations

ESR Integration Report : 11/22/2024

Current Daily Values:

Installed ESR Discharge Capacity*	9,540 MW
Total ESR Discharge Capacity**	10,867 MW
Installed ESR Charge Capacity+	10,793 MW
Total ESR Charge Capacity++	10,793 MW

Peak Load	48,481 MW
Peak Load Hour (HE)	9
ESR Discharge at Peak Load Hour	59 MW
ESR Charge at Peak Load Hour	1,143 MW
ESR Net Charge/Discharge at Peak Load Hour^	-1,084 MW

Max ESR Discharge Generation	3,183 MW
Max ESR Discharge Time	17:23
Penetration at Max ESR Discharge Time	6.63%

Max ESR Charge Load	2,159 MW
Max ESR Charge Time	01:10
Penetration at Max ESR Charge Time	5.03%

Max ESR Discharge Penetration	6.63%
Max ESR Discharge Penetration Time	17:23
ESR Discharge Generation at Max ESR Discharge Penetration Time	3,183 MW

Max ESR Charge Penetration	5.03%
Max ESR Charge Penetration Time	01:10
ESR Charge Load at Max ESR Charge Penetration Time	2,159 MW

* Sum of maximum capacity (i.e. seasonal net max. sustainable rating in RIOO) of all ESR generators modeled in ERCOT's network operations model and are commercially operable (estimated based on Commercial Operations Date in RIOO).

** Sum of maximum capacity (i.e. seasonal net max. sustainable rating in RIOO) of all ESR generators modeled in ERCOT's network operations model.

+ Sum of maximum capacity (i.e. maximum point of delivery total load in RIOO) of all ESR CLRs that are modeled in ERCOT's network operations model and are commercially operable (estimated based on Commercial Operations Date in RIOO).


++ Sum of maximum capacity (i.e. maximum point of delivery total load in RIOO) of all ESR CLRs that are modeled in ERCOT's network operations model.

^ ESR Net Charge/Discharge = Total Discharging from ESR generators - Total Charging from ESR CLRs. Positive represents Net Discharge; negative represents Net Charge.


Note that generation, generation record, and generator capacity values in following pages of this report are based on units modeled in ERCOT's network operations model.

Hourly Average Actual Load vs. Actual ESR Output


11/22/2024

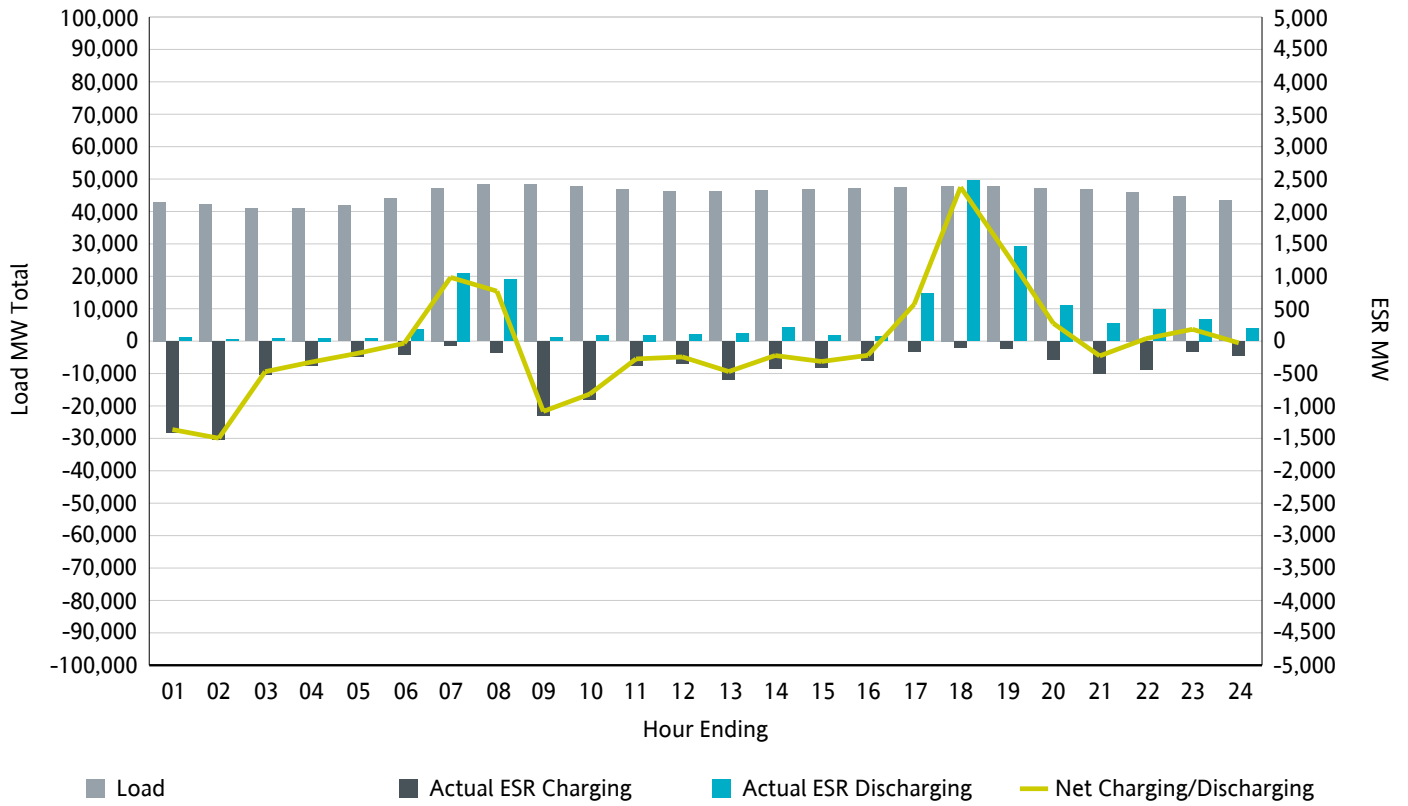


Actual ESR Discharging Output as a Percentage of Total Installed ESR Discharge Capacity 11/22/2024

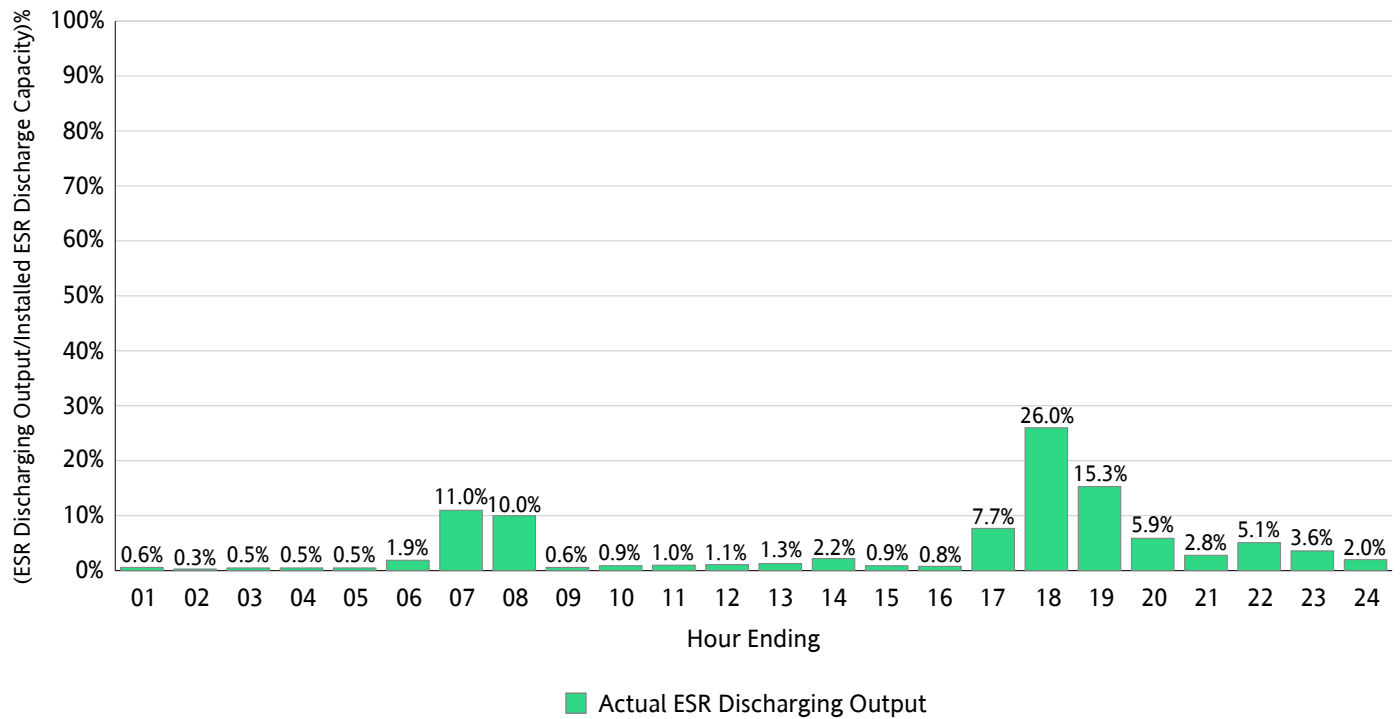

Actual ESR Charging Output as a Percentage of Total Installed ESR Charge Capacity 11/22/2024

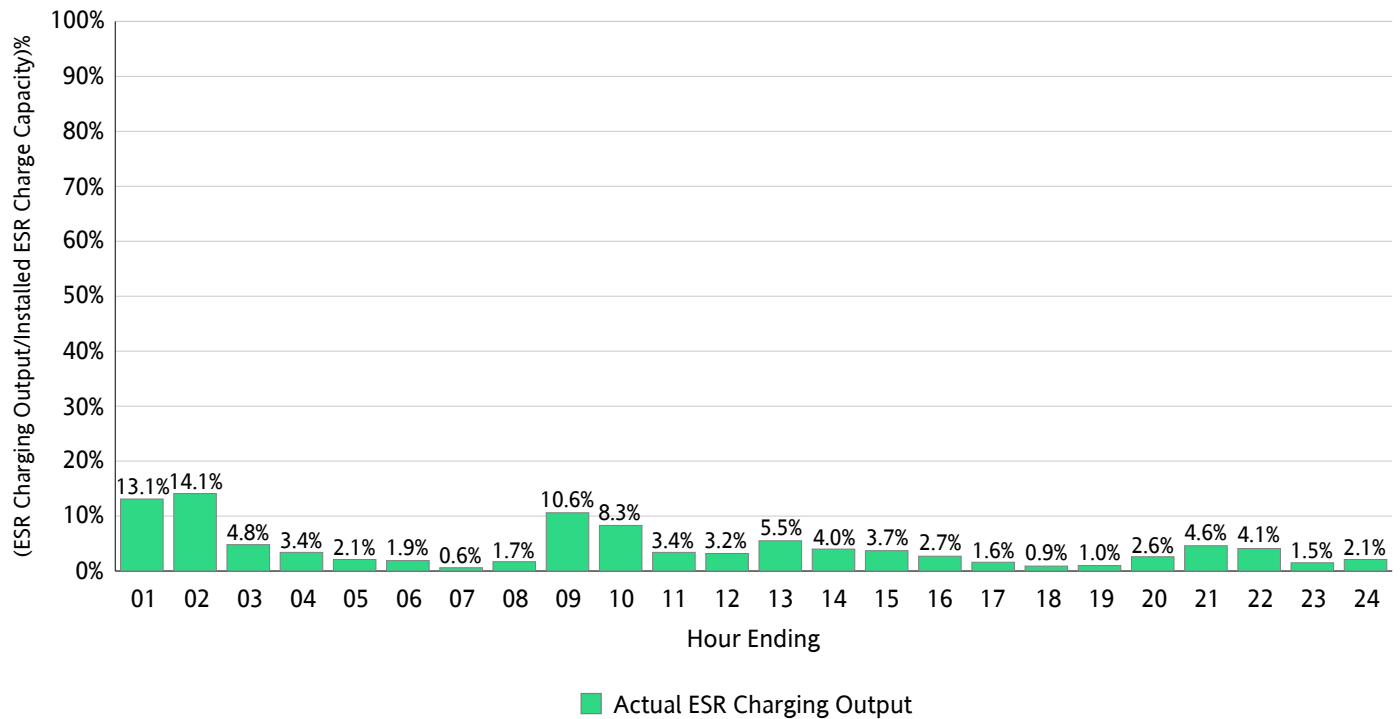

Actual ESR Net Output as a Percentage of ERCOT Load 11/22/2024

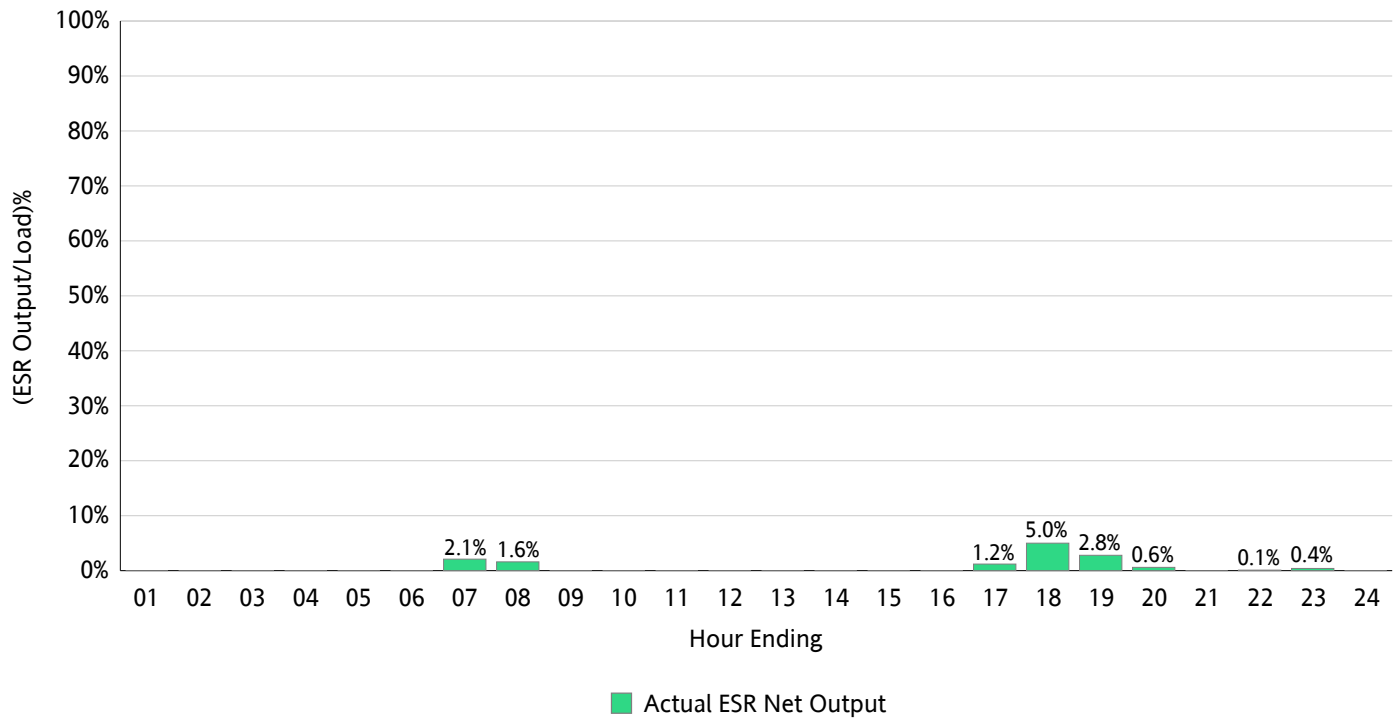

ERCOT Load vs. Actual ESR Net Output
11/15/2024 - 11/22/2024

