





Bringing water to life®

CARTERVILLE RWWTF, IL
CLARIFIER & SEL CONTROL PANEL

ELECTRICAL DRAWING INDEX	
DWG #	SHEET DESRIPTION
CSW1902-221 SHT1	COVER SHEET AND TABLE OF CONTENT
CSW1902-221 SHT2	CONTROL PANEL LAYOUT AND CONSTRUCTION NOTES
CSW1902-221 SHT3	SUB-PANEL LAYOUT AND SWING OUT PANEL LAYOUT
CSW1902-221 SHT4	EXPANDED VIEWS & PANEL TAGS
CSW1902-221 SHT5	EXPANDED VIEWS
CSW1902-221 SHT6	BILL OF MATERIAL
CSW1902-221 SHT7	POWER AND CONTROL SCHEMATICS OF E-300 RELAY
CSW1902-221 SHT8	POWER AND CONTROL SCHEMATICS
CSW1902-221 SHT9	CONTROL SCHEMATICS 120V AC INPUT
CSW1902-221 SHT10	CONTROL SCHEMATICS 24V DC INPUT
CSW1902-221 SHT11	PLC DIGITAL INPUT SCHEMATICS
CSW1902-221 SHT12	PLC DIGITAL OUTPUT & ANALOG INPUT SCHEMATICS
CSW1902-221 SHT13	PLC ANALOG OUTPUT SCHEMATICS
CSW1902-221 SHT14	ACTUATOR POWER AND CONTROL SCHEMATICS
CSW1902-221 SHT15	LAYOUT FOR LEVEL SENSOR MOUNTING
CSW1902-221 SHT16	NETWORK COMMUNICATIONS LAYOUT
CSW1902-221 SHT17	P&ID DIAGRAM

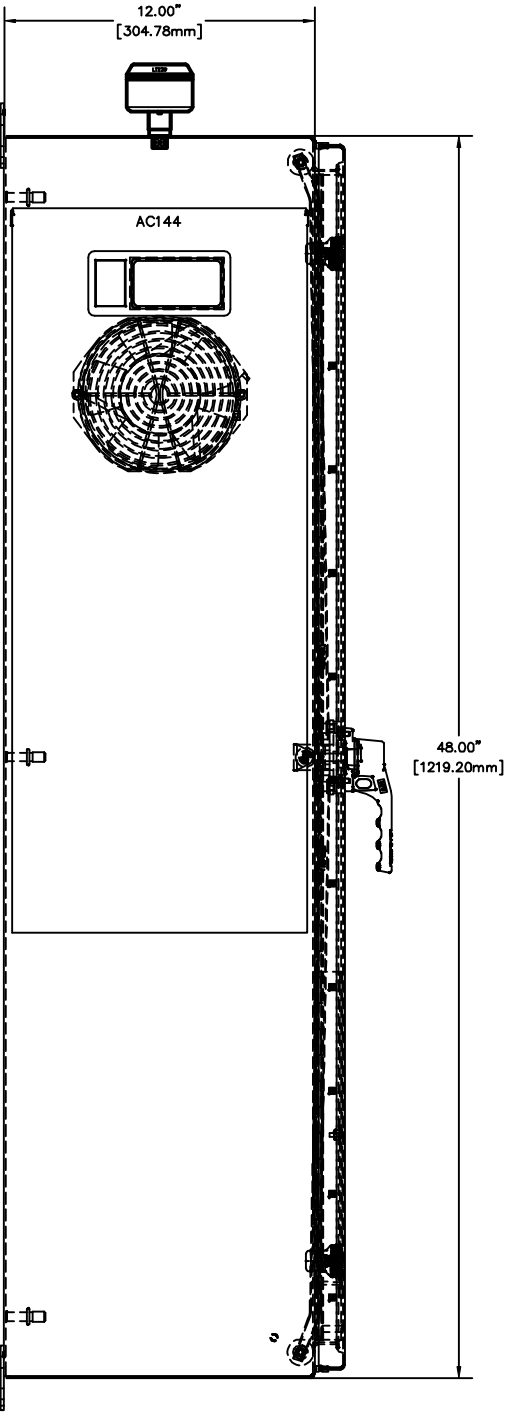

SIDE VIEW

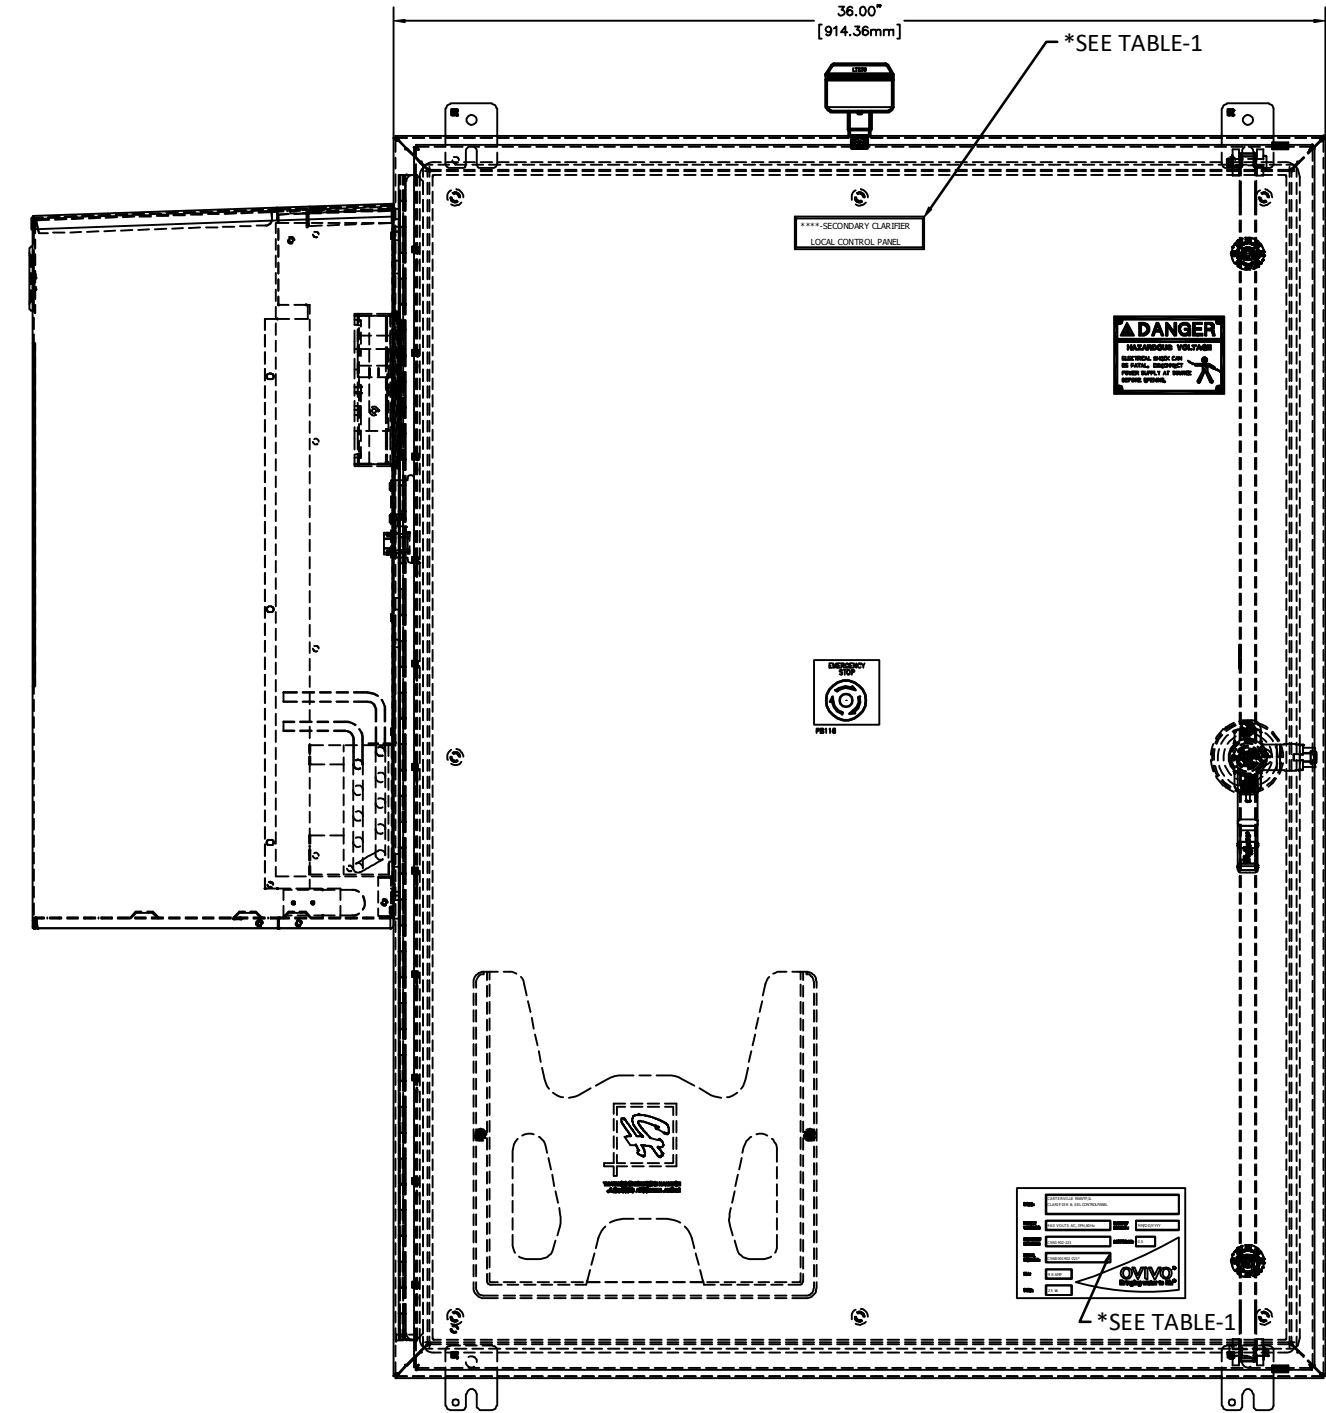

FRONT VIEW


ENCLOSURE LAYOUT
NEMA 4X ENCLOSURE
TYPICAL OF 2
















TABLE-1		
SERIAL NUMBER	EQUIPMENT ID (LINE 1)	DESCRIPTION (LINE 2)
CSW0001902-221A	WEST-SECONDARY CLARIFIER	LOCAL CONTROL PANEL
CSW0001902-221B	EAST-SECONDARY CLARIFIER	LOCAL CONTROL PANEL

CONTROL PANEL SPECIFICATIONS





- COMPONENTS SPECIFIC**
 - ENCLOSURE TO BE NEMA 4X, 304 SS CONSTRUCTION.
 - ENCLOSURE MAIN ID NAMEPLATE TO BE 16 GAUGE S.S., BLACK LETTERS (HEIGHT 1/2") ON WHITE BACKGROUND.
 - ATTACH NAMEPLATES WITH MANUFACTURER'S RECOMMENDED ADHESIVE TO MAINTAIN NEMA STANDARD OF ENCLOSURE.
 - CONTROL PANEL SHALL BE LABELED WITH SERIALIZED UL LABEL 
 - ALL RELAY CONTACTS ARE RATED AT 10 AMPS UNLESS OTHERWISE NOTED.
 - COMPONENT IMAGES MAY NOT ACCURATELY REPRESENT THE ACTUAL DEVICE IN SOME INSTANCES. DIMENSIONS OF DEVICES, HOWEVER, WILL BE ACCURATE FOR PURPOSES OF LAYOUT AND SPACING.
 - SUBSTITUTIONS FOR COMPONENTS MAY BE PERMITTED UPON APPROVAL BY OVIVO ENGINEERS.
 - PANEL OPERATOR AND INDICATOR TAGS ON THE FRONT PANEL SHALL BE BLACK LETTERS ON WHITE BACKGROUND.
- WIRE SIZING & TYPE**
 - WIRE SIZING SHALL BE NO LESS THAN AS FOLLOWS (UNLESS OTHERWISE NOTED):
 - 480 3 PHASE - 12 AWG TYPE: MTW
 - 120 1 PHASE - LINE SIDE OF FUSES - 12 AWG TYPE: MTW
 - 120 1 PHASE - LOAD SIDE OF FUSES - 16 AWG TYPE: MTW
- WIRE COLOR**
 - WIRE COLOR SHALL BE AS FOLLOWS:
 - POWER (480 VOLTS)
 - GREEN - GROUND
 - BLACK - ALL PHASES
 - CONTROL (120 VAC)
 - RED - LOAD WIRES FOR ALL LOCAL CONTROL CIRCUITS
 - WHITE - NEUTRAL FOR ALL LOCAL CONTROL CIRCUITS
 - YELLOW - FOREIGN POWER IN PANEL
 - CONTROL (24 VDC)
 - BLUE - LOAD WIRES FOR ALL LOCAL CONTROL CIRCUITS
 - WHITE WITH BLUE STRIPE - NEUTRAL FOR ALL LOCAL CONTROL CIRCUITS
- CONNECTIONS**
 - ALL CONNECTIONS SHALL BE POINT TO POINT WITHOUT SPLICES. EXCEPTIONS APPLY TO SOLENOIDS AND FACTORY WIRED COMPONENTS.
 - ALL CONDUCTORS MUST BE MARKED WITH MACHINE PRINTED TAGS AT EACH TERMINATION. MARKERS SHALL BE OF HEAT SHRINK TYPE.
 - ALL WIRE TERMINATIONS SHOULD HAVE FERRULES.
- DOCUMENTATION**
 - FABRICATOR SHALL PROVIDE ONE COPY OF ALL DOCUMENTS SUPPLIED WITH THE COMPONENTS SUPPLIED BY THE FABRICATOR. THIS INFORMATION INCLUDES BUT IS NOT LIMITED TO MANUFACTURERS SPECIFICATIONS, INSTALLATION MANUALS AND OPERATION MANUALS.
 - ANY OVIVO APPROVED CHANGES OR MARK-UPS TO THE SCHEMATICS, PANEL LAYOUTS AND ANY OTHER PERTAINING DOCUMENTS SHALL BE MAINTAINED AND DELIVERED TO OVIVO AT ACCEPTANCE OF THE PANEL.
- TESTING**
 - OVIVO ENGINEERS OR OVIVO APPROVED FABRICATOR, WILL PERFORM A POINT TO POINT CONTINUITY TEST ON THE PANEL.
 - WHEN APPLICABLE, THE FABRICATOR WILL ALSO PROVIDE POWER TO THE 120VAC CIRCUITS FOR VERIFICATION AND TESTING. FABRICATOR SHALL ALLOW A MINIMUM OF 2 HOUR OF ACCESS TO THE CONTROL PANEL BY AN OVIVO ENGINEER FOR THIS AND PREVIOUSLY STATED TEST.

SUB-PANEL LAYOUT
TYPICAL OF 2





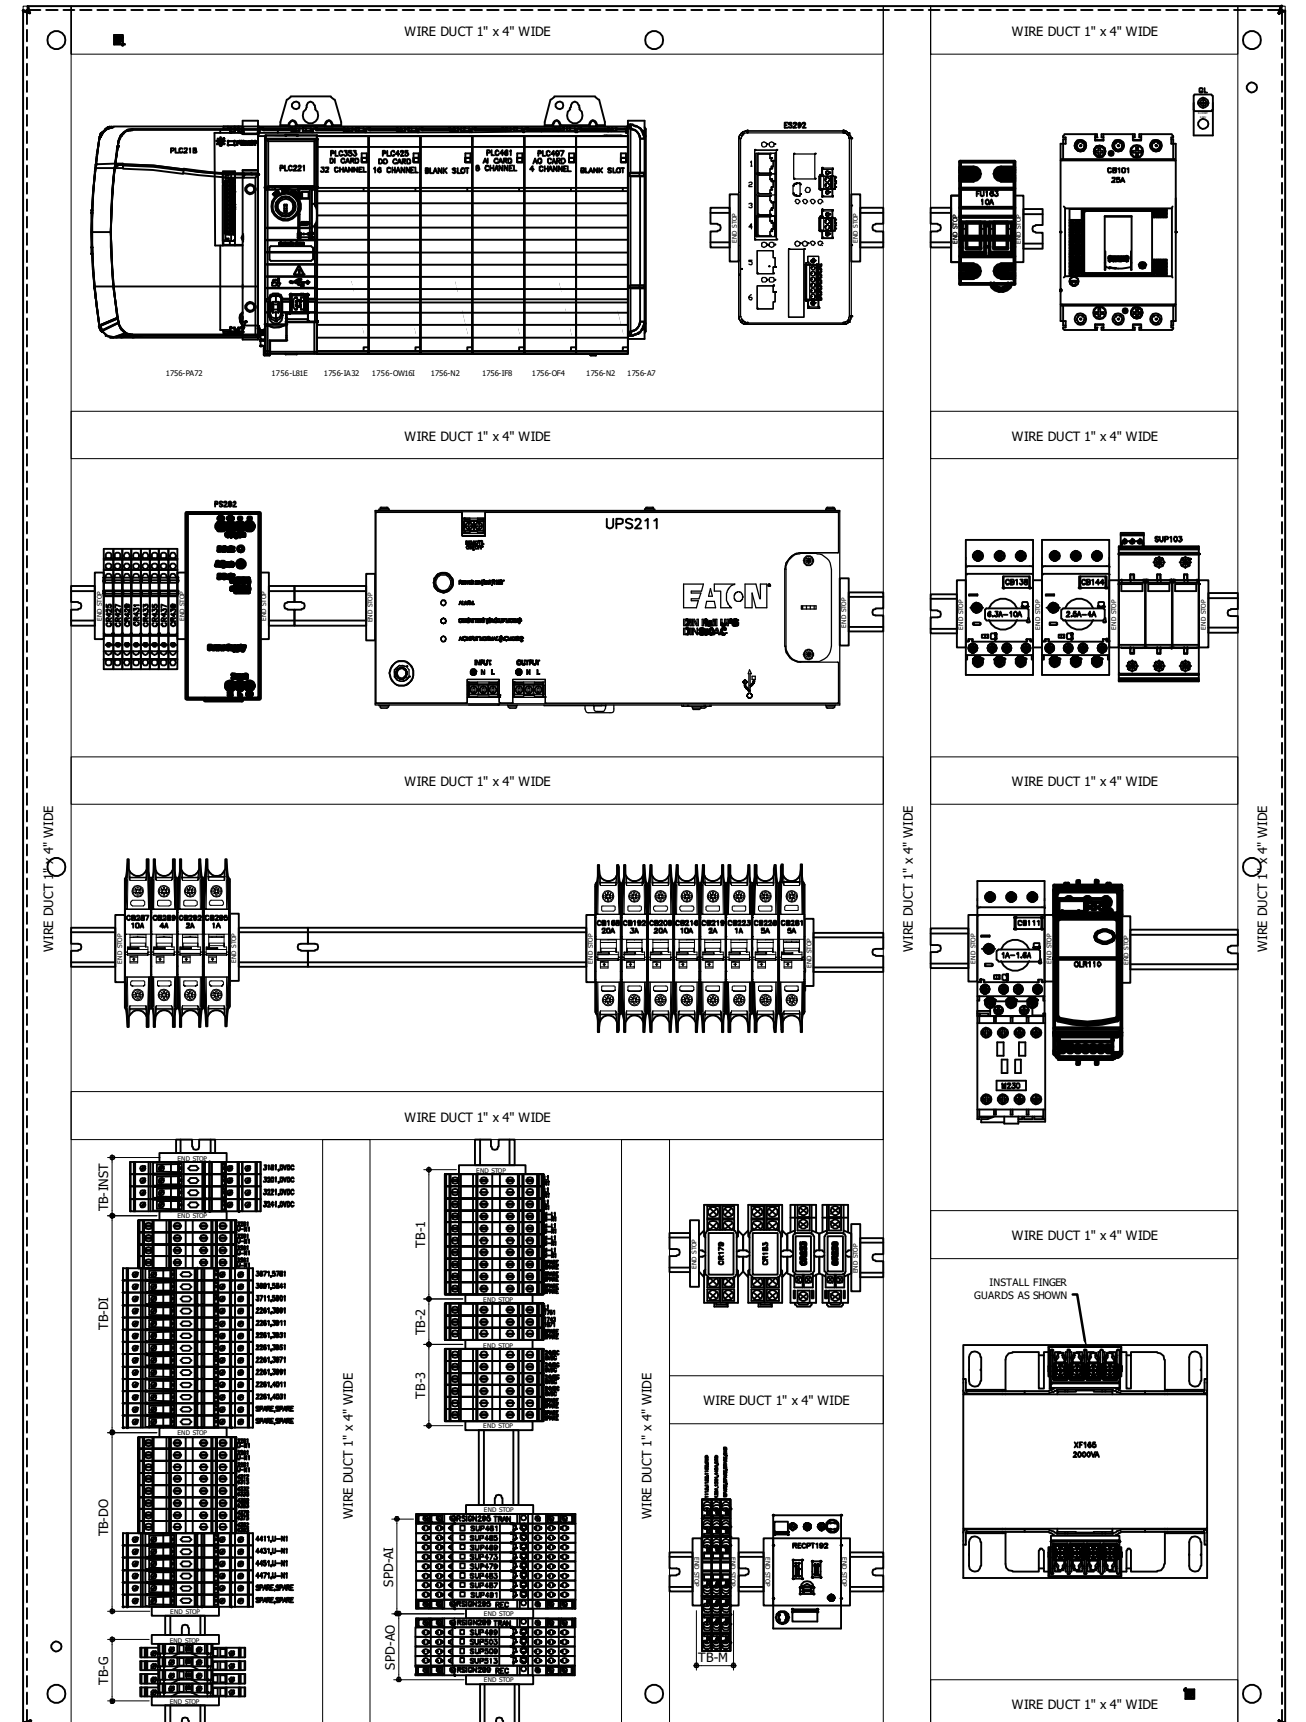


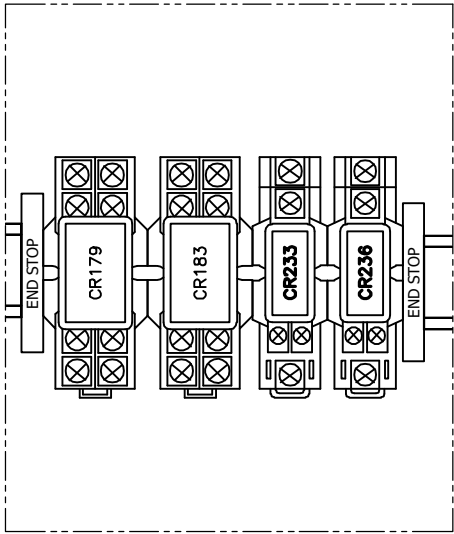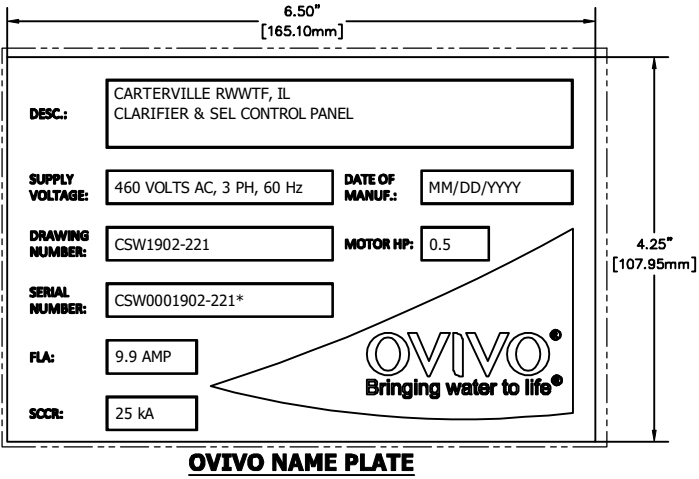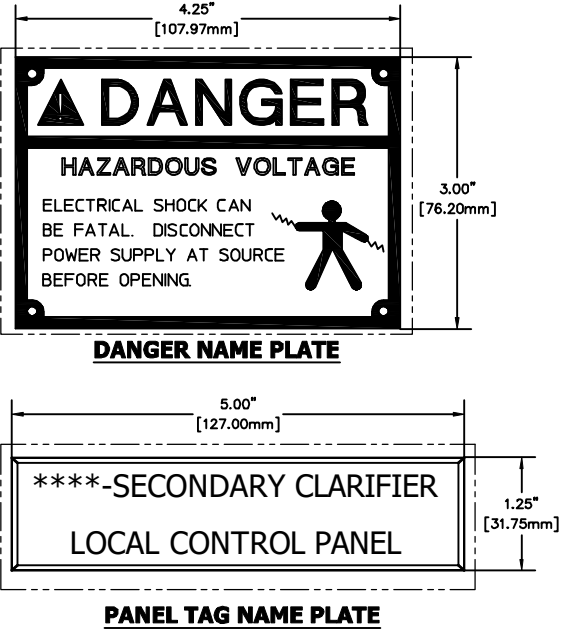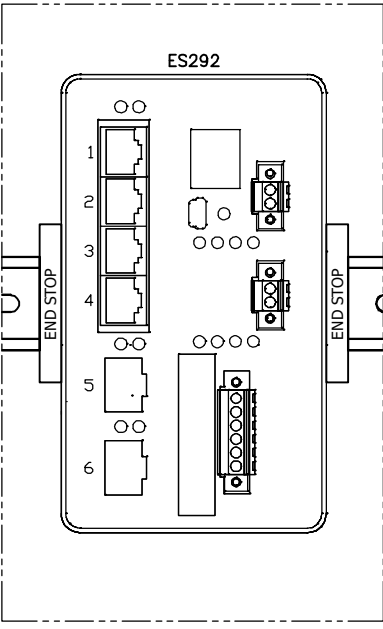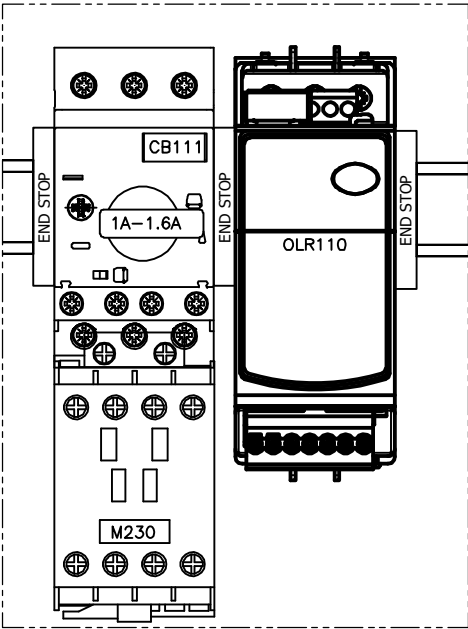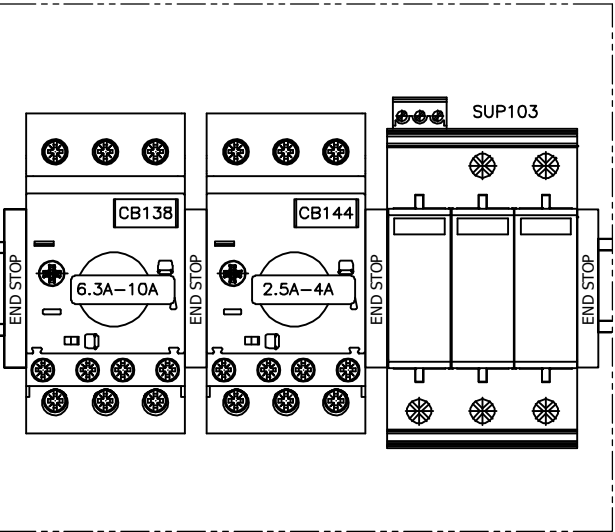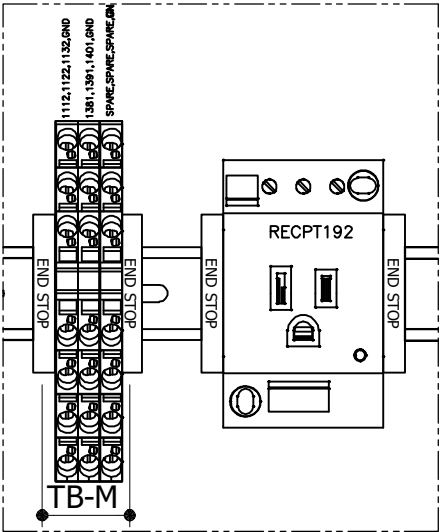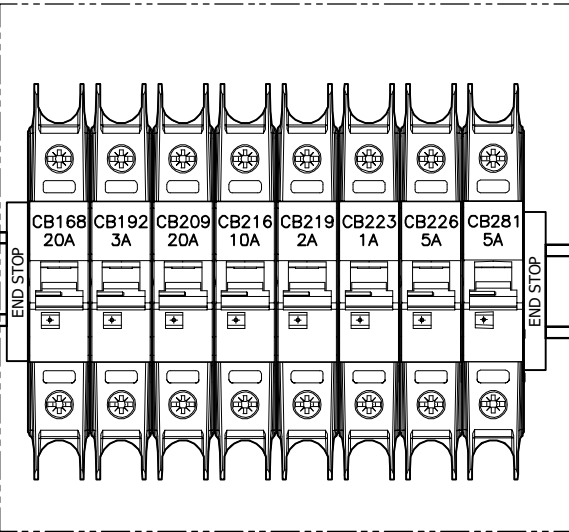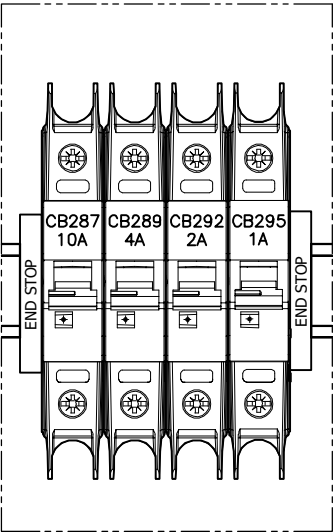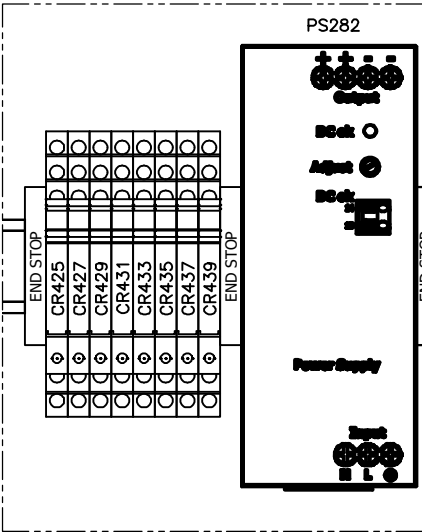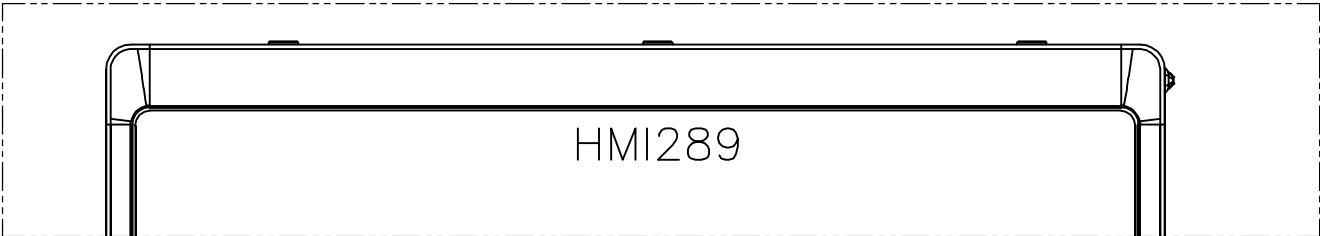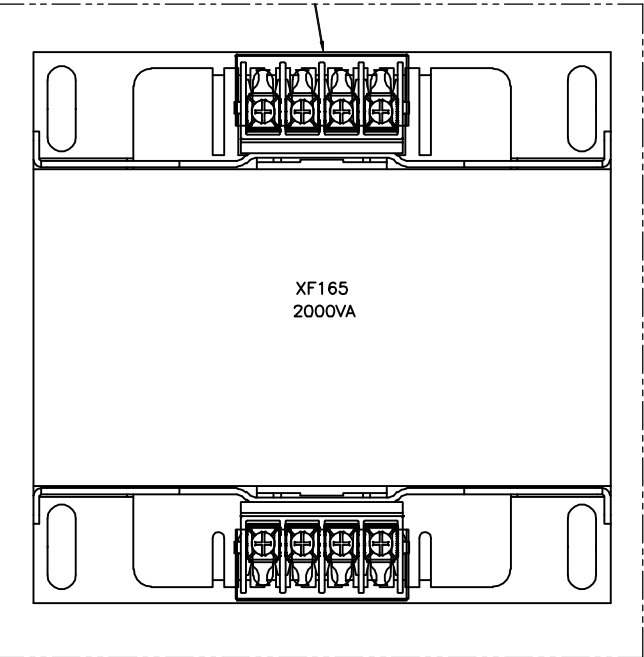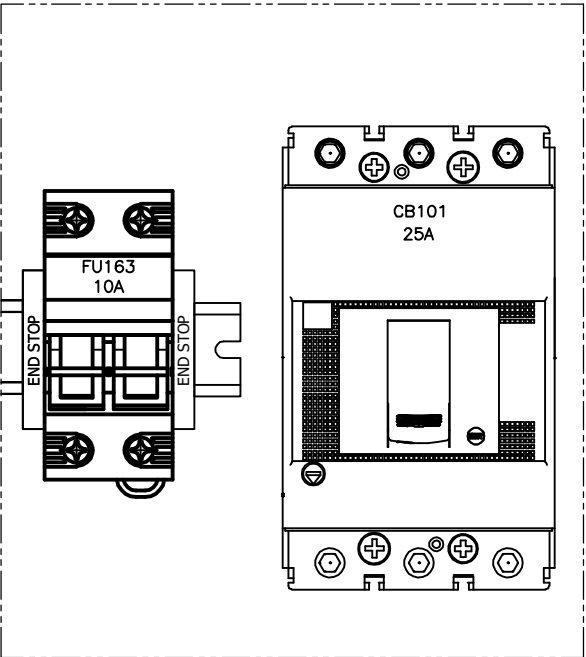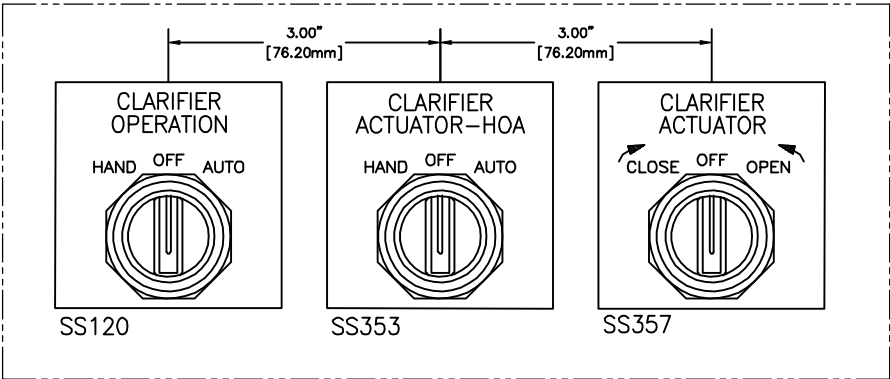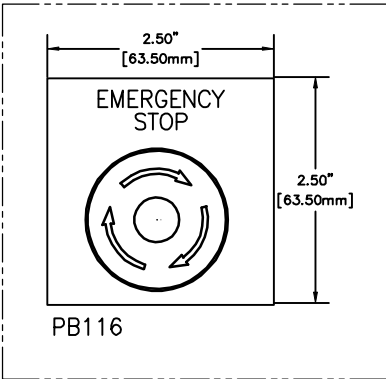

TYP. FOR TWO LEVEL TERMINALS

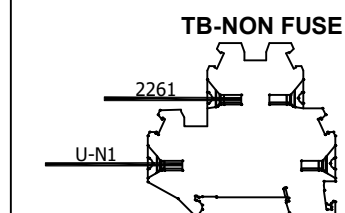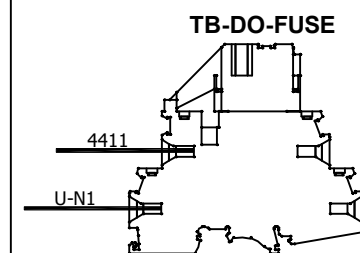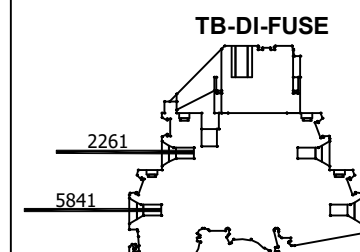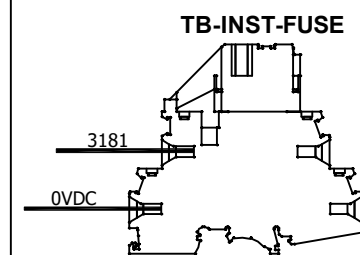


TYP. FOR TB-M

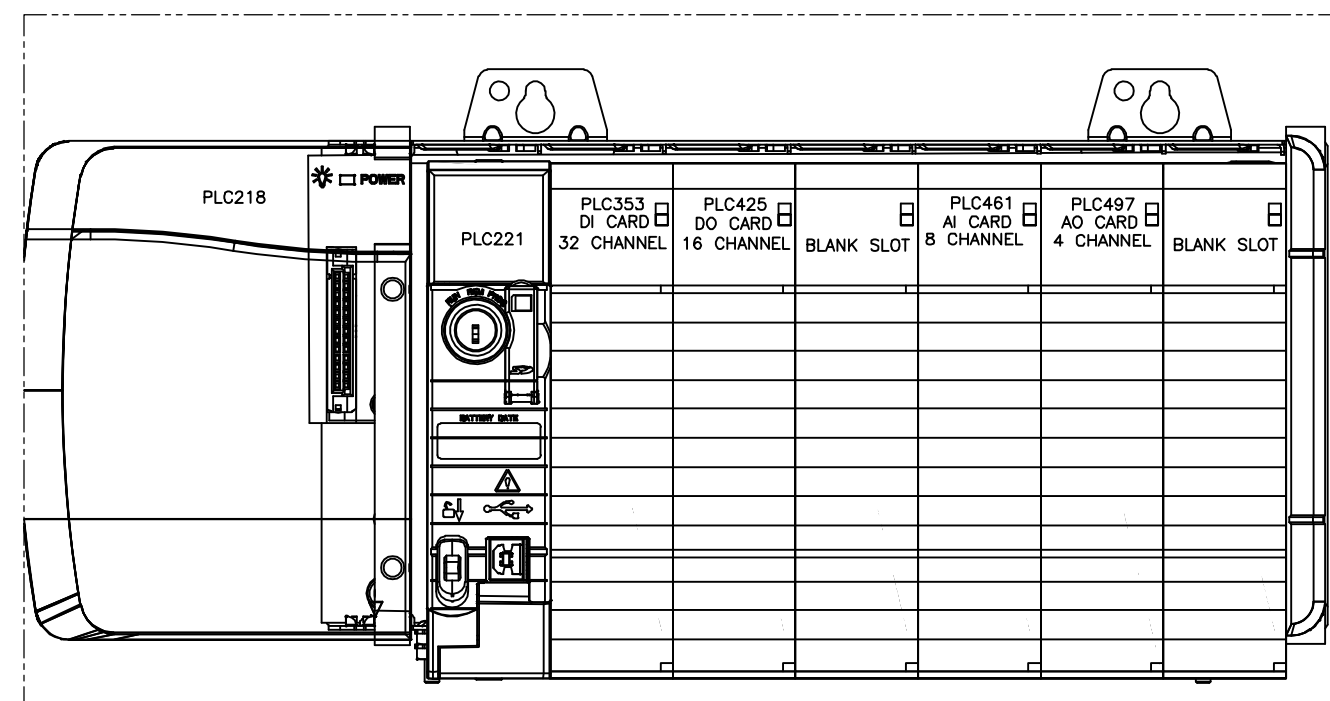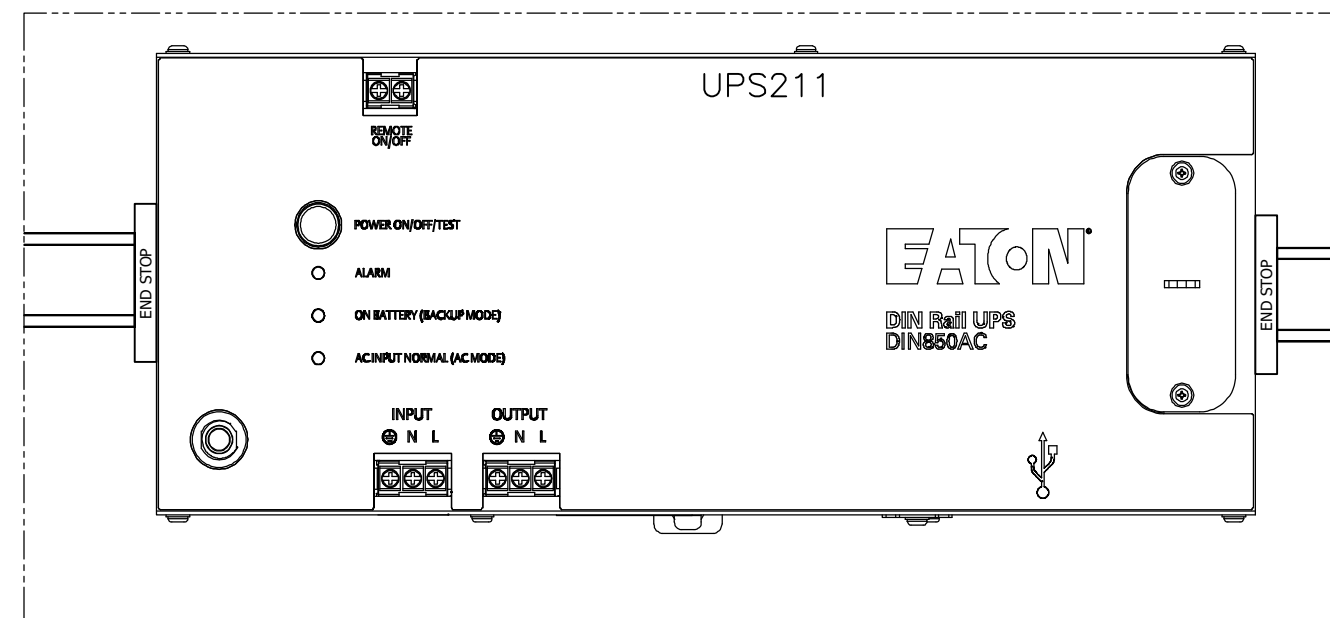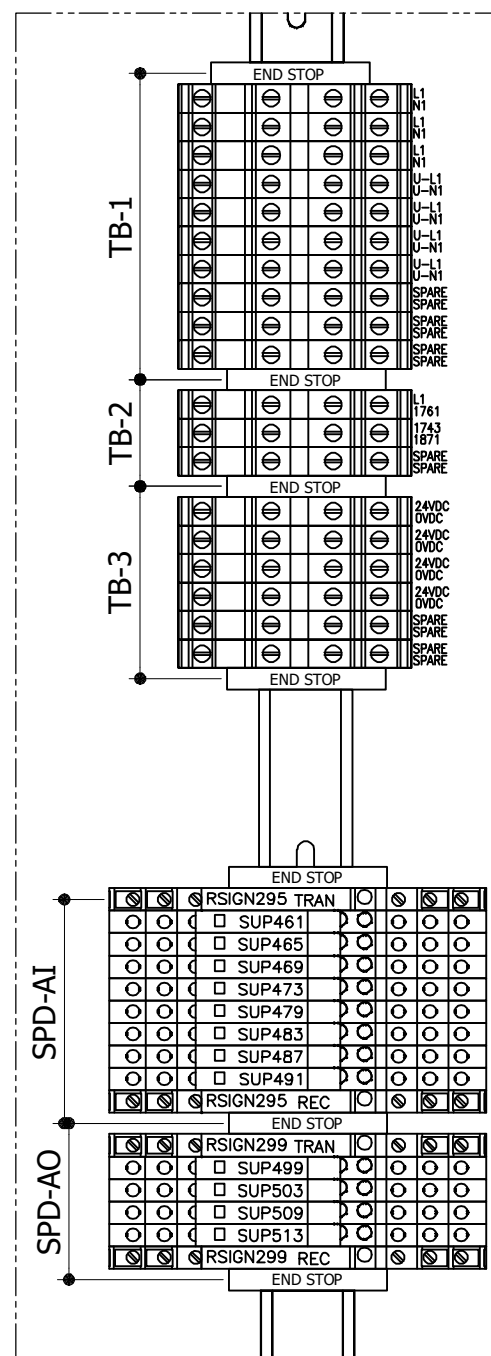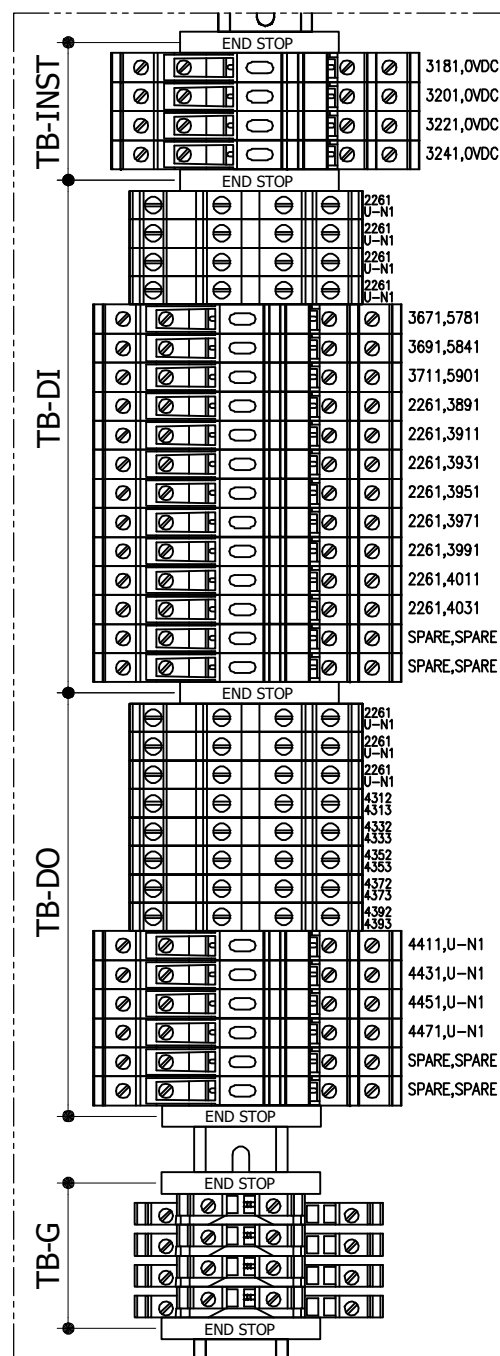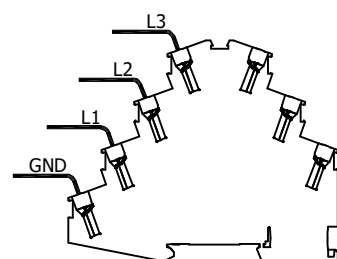

BILL OF MATERIALS (TYPICAL OF 2)


ITEM	QTY	CATALOG	DESCRIPTION	MFG	TAGS
1	A/R	DUCT, COVER, 1, GREY	NER FOR 1 INCH, WHITE COLOR	ABB	AS SHOWN
2	A/R	DUCT, 1x4, GREY	T 1" X 4" HIGH, WHITE COLOR	ABB	AS SHOWN
3	1	140G-G2C3-C25	MOLDED CASE CIRCUIT BREAKER, G FRAME, 25 KA AT 480V, T/M - FIXED THRM / FIXED MGNTC, 3 POLES, 25A	ALLEN BRADLEY	CB101
4	1	140G-G-RVM12B	MOLDED CASE CIRCUIT BREAKER, G FRAME, ROTARY OPERATING MECH, ROTARY HANDLE, 12", BLACK	ALLEN BRADLEY	CB101
5	1	140M-C-PEC23	ECO CONNECTING MODULE TO CONNECT 140MT-C TO C03...C23 CONTACTORS	ALLEN BRADLEY	CB111
6	1	140MT-C3E-B16	MOTOR PROTECTION CIRCUIT BREAKER, C FRAME, 1A-1.6A, TRIP CLASS 10, STANDARD BREAKING CAPACITY, STD MGNTC TRP	ALLEN BRADLEY	CB111
7	1	140MT-C3E-C10	MOTOR PROTECTION CIRCUIT BREAKER, C FRAME, 6.3A-10A, TRIP CLASS 10, STANDARD BREAKING CAPACITY, STD MGNTC TRP	ALLEN BRADLEY	CB138
8	1	140MT-C3E-B40	MOTOR PROTECTION CIRCUIT BREAKER, C FRAME, 2.5A-4A, TRIP CLASS 10, STANDARD BREAKING CAPACITY, STD MGNTC TRP	ALLEN BRADLEY	CB144
9	2	1489-M1C200	1489-M MINIATURE CIRCUIT BREAKER, STANDARD CONFIGURATION, 1 POLE CONFIGURATION, TRIP CURVE C, 20A	ALLEN BRADLEY	CB168,CB209
10	1	1489-M1C030	1489-M MINIATURE CIRCUIT BREAKER, STANDARD CONFIGURATION, 1 POLE CONFIGURATION, TRIP CURVE C, 3A	ALLEN BRADLEY	CB192
11	2	1489-M1C100	1489-M MINIATURE CIRCUIT BREAKER, STANDARD CONFIGURATION, 1 POLE CONFIGURATION, TRIP CURVE C, 10A	ALLEN BRADLEY	CB216,CB287
12	2	1489-M1C020	1489-M MINIATURE CIRCUIT BREAKER, STANDARD CONFIGURATION, 1 POLE CONFIGURATION, TRIP CURVE C, 2A	ALLEN BRADLEY	CB219,CB292
13	2	1489-M1C010	1489-M MINIATURE CIRCUIT BREAKER, STANDARD CONFIGURATION, 1 POLE CONFIGURATION, TRIP CURVE C, 1A	ALLEN BRADLEY	CB223,CB295
14	2	1489-M1C050	1489-M MINIATURE CIRCUIT BREAKER, STANDARD CONFIGURATION, 1 POLE CONFIGURATION, TRIP CURVE C, 5A	ALLEN BRADLEY	CB226,CB281
15	1	1489-M1C040	1489-M MINIATURE CIRCUIT BREAKER, STANDARD CONFIGURATION, 1 POLE CONFIGURATION, TRIP CURVE C, 4A	ALLEN BRADLEY	CB289
16	1	1783-CM56P	STRATIX 5200 SWITCH, MANAGED, 4 FAST ETHERNET COPPER PORTS, 2 FAST ETHERNET COMBO PORTS, CIP SYNC	ALLEN BRADLEY	ES292
17	1	1783-SFP100LX	TRANSRECEIVER PLUGGABLE, 100 BASE-LX SINGLE MODE FIBER	ALLEN BRADLEY	ES292
18	1	2711P-T10C22D9P-B	PANELVIEW PLUS 7 STANDARD 10.4 IN TFT ETHERNET, EMBEDDED SWITCH/DLR, 24V DC OPERATED	ALLEN BRADLEY	HM289
19	1	100C09UD10	100-C SERIES CONTACTOR UP TO 9A RATING, 120V AC COIL VOLTAGE, COIL ON LOAD SIDE	ALLEN BRADLEY	M230
20	1	193-ECM-ETR	E300 OVERLOAD RELAY, ETHERNET IP COMMUNICATION MODULE	ALLEN BRADLEY	OLR110
21	1	193-EIO-43-120	OVERLOAD RELAYS, ELECTRONIC IN/OUT CONTROL MODULE, 4 IN / 3 OUT, 120V AC OPERATED	ALLEN BRADLEY	OLR110
22	1	193-ESM-VIG-30A-T	OVERLOAD RELAYS, CURRENT/GROUND FAULT SENSING MODULE, VOLTAGE/CURRENT/GROUND FAULT SENSING MODULE	ALLEN BRADLEY	OLR110
23	1	800H-TFRXT6A	800H PB,30MM TRIGGER ACTION E STOP,TRIGGER ACTION,30MM E STOP,TWO POSITION MAINTAINED,TWIST RELEASE,45MM PLASTIC HEAD,RED,1 NO 1 NC STANDARD CONTACTS	ALLEN BRADLEY	PB116
24	1	1756-A7	ALLEN-BRADLEY 1756-A7 - CONTROLLOGIX 7 SLOTS CHASSIS (BABA)	ALLEN BRADLEY	PLC ACC
25	2	1756-N2	SLOT FILLER MODULE FOR EMPTY SLOTS IN STANDARD CONTROLLOGIX CHASSIS (BABA)	ALLEN BRADLEY	PLC ACC
26	1	1756-PA72	ALLEN-BRADLEY 1756-PA72 - CONTROLLOGIX POWER SUPPLY, 85-265V AC INPUT SUPPLY (BABA)	ALLEN BRADLEY	PLC218
27	1	1756-L81E	CONTROLLER,CONTROLLOGIX,3 MB USER MEMORY,USB PORT,1GB ETHERNET PORT,100 ETHERNET/IP DEVICES,4 CHARACTER ALPHA/NUMERIC DISPLAY (BABA)	ALLEN BRADLEY	PLC221
28	1	1756-IA32	INPUT MODULE,CONTROLLOGIX,AC DIGITAL,32 POINT,74 132VAC,INPUT AND COMMUNICATION STATUS AND MODULE HEALTH DISPLAY (BABA)	ALLEN BRADLEY	PLC353
29	3	1756-TBCH	TERMINAL BLOCK,CONTROLLOGIX,SCREW,36 PIN,WITH LOW PROFILE HOUSING (BABA)	ALLEN BRADLEY	PLC353,PLC425,PLC461
30	1	1756-OW16I	OUTPUT MODULE,CONTROLLOGIX,AC DIGITAL,16 POINT,74 265VAC,1 A OUTPUTS,INDIVIDUALLY ISOLATED (BABA)	ALLEN BRADLEY	PLC425
31	1	1756-IF8	ANALOG INPUT MODULE,CONTROLLOGIX,ANALOG,8 POINT, 8 SINGLE ENDED INPUTS,4 DIFFERENTIAL INPUTS OR 2 DIFFERENTIAL HIGH SPEED INPUTS,CURRENT AND VOLTAGE (BABA)	ALLEN BRADLEY	PLC461
32	1	1756-OF4	ANALOG OUTPUT MODULE,CONTROLLOGIX,ANALOG,4 POINT,SINGLE ENDED OUTPUTS,CURRENT AND VOLTAGE (BABA)	ALLEN BRADLEY	PLC497
33	1	1756-TBNH	TERMINAL BLOCK,CONTROLLOGIX,SCREW,20 PIN,WITH LOW PROFILE HOUSING (BABA)	ALLEN BRADLEY	PLC497
34	1	1606-XLB240E	SWITCHED MODE POWER SUPPLY, INPUT 100-240 VAC AND OUTPUT 24VDC, 240 WATT, 10 A	ALLEN BRADLEY	PS282
35	2	800H-JR2B	800H PB, 30MM SELECTOR SWITCH, 3 POSITION, STANDARD KNOB MAINTAINED, , 2-NO 2-NC STANDARD CONTACTS	ALLEN BRADLEY	SS120,SS353
36	1	800H-JR91B	800H PB, 30MM SELECTOR SWITCH, 3 POSITION, STANDARD KNOB , SPRING RETURN FROM BOTH THE SIDES, , 2-NO 2-NC STANDARD CONTACTS HOLE ADAPTER KIT	ALLEN BRADLEY	SS357
37	1	855PC-810LE422 WITH 855P-AHA1	LIGHT AND SOUND COMB ALARM,120V AC,65 MM DIAMETER SOUNDER AND LED,RED,22.5 MM ROUND MOUNTING HOLE	ALLEN BRADLEY	LT239
38	1	KA2U	GROUND LUG	BURNDY	GL
39	2	FNQ-R-10	EATON BUSSMANN SERIES FNQ-R FUSE, 10 A, CLASS CC, NON-INDICATING, 12 SEC AT 200%, 200 KAIC, MELAMINE TUBE, 600 V	BUSSMAN	FU163
40	1	LPSC0021D	FUSE HOLDER, WITH BLOWN FUSE FUSE INDICATION	BUSSMAN	FU163
41	1	DIN850AC	EATON 850VA 5.10W 120V AC DIN RAIL INDUSTRIAL UPS - HARDWIRE INPUT/OUTPUT (BABA)	EATON	UPS211
42	4	GRAVOPLY ULTRA	GENERIC OPERATOR TAG - ENGRAVE AS SHOWN	GRAVOGRAPH	AS SHOWN
43	1	SP2000ACP	CONTROL TRANSFORMER 480V TO 120VAC, 2000 VA	HAMMOND	XF165
44	2	SPFG1	FINGER GUARGS FOR TRANSFORMER TERMINALS	HAMMOND	XF165
45	1	N280446G151	SPECTRA-COOL NARROW INDOOR/OUTDOOR AC WITH HEAT, 4000 BTU 460V, BRUSHED SS304, 460V AC INPUT, 1172W	HOFFMAN	AC144
46	1	A48H3612SSLP3PTW	WALL-MOUNT ENCLOSURE WITH 3 POINT LATCH TYPE, 48" X 36" X 12", 304 SS, NEMA 4X WHITE IN COLOR (BABA)	HOFFMAN	ENCLOSURE
47	2	A48P36	ENCLOSURE, BACK PANEL STEEL FITS 48" X 36" (BABA)	HOFFMAN	ENCLOSURE
48	1	ANADFK	CONCEPT SWING OUT PANEL HARDWARE	HOFFMAN	ENCLOSURE
49	2	RH2B-ULC-AC120V	RELAY, DPDT, WITH INDICATOR AND CHECK BUTTON 120VAC COIL	IDEC	CR179,CR183
50	2	SH2B-05C	SOCKET, RELAY, FINGERSAFE TERMINALS	IDEC	CR179,CR183
51	2	RH1B-ULC-AC120V	RELAY, SPDT, WITH INDICATOR AND CHECK BUTTON 120VAC COIL	IDEC	CR233,CR236
52	2	SH2B-05C	SOCKET, RELAY, FINGERSAFE TERMINALS	IDEC	CR233,CR236
53	1	592273	ENCLOSURE TAG ID	OVIVO	AS SHOWN
54	1	679001	NAME PLATE (ETCH AS SHOWN)	OVIVO	AS SHOWN
55	1	49046A	NAME PLATE - "DANGER"	OVIVO	AS SHOWN
56	38	0800866	E/NS 35 N, END BRACKET	PHOENIX CONTACT	AS SHOWN
57	1	DIN, 35mm, STANDARD	35/7.5, PERFORATED	PHOENIX CONTACT	AS SHOWN
58	8	2966197	PLC-INTERFACE RELAY, SCREW CONNECTION AND PLUG-IN MINIATURE RELAY, INPUT VOLTAGE 120V AC, 1 CHANGEOVER	PHOENIX CONTACT	CR425,CR427,CR429,CR431,CR433,CR435,CR437,CR439
59	1	0804155	SOCKET, WITH LIGHT INDICATOR, PIN CONNECTOR PATTERN TYPE AB 15A, CONNECTION METHOD: SCREW CONNECTION, COLOR: GRAY, NOM. VOLTAGE: 125 V AC (60 HZ), NOMINAL CURRENT: 15 A, DIN RAIL UL 508	PHOENIX CONTACT	RECPT192
60	2	2907810	MODULE SET FOR THE OPTICAL MONITORING AND FLOATING REMOTE SIGNALING OF ADJACENT SURGE PROTECTIVE DEVICES IN THE TERMITRAB COMPLETE OR CLIXTRAB PRODUCT FAMILY. SUITABLE FOR DIRECTLY GROUNDED DIN RAILS.	PHOENIX CONTACT	RSIGN295,RSIGN299
61	1	2910386	TYPE 2 SURGE PROTECTION DEVICE, 3-CHANNEL WITH REMOTE INDICATOR CONTACT FOR 480 VAC DELTA	PHOENIX CONTACT	SUP103
62	12	2906738	SURGE PROTECTION, CONSISTING OF PROTECTIVE PLUG AND BASE ELEMENT, WITH INTEGRATED STATUS INDICATOR AND DISCONNECT KNIFE FOR A 2-WIRE FLOATING SIGNAL CIRCUIT, E.G., 0(4) ... 20 MA CURRENT LOOP, HART-COMPATIBLE	PHOENIX CONTACT	SUP461,SUP465,SUP469,SUP473,SUP479,SUP483,SUP487,SUP491,SUP499,SUP503,SUP509,SUP513
63	31	3044814	FEED-THROUGH TERMINAL BLOCK, 2-LEVEL, SCREW CONNECTION, AWG 24-12, GRAY, 24 AMP, 500 VOLTS	PHOENIX CONTACT	TB-1, TB-2,TB-D,TB-DO
64	5	3047293	END COVER, GRAY COLOR	PHOENIX CONTACT	TB-1, TB-2,TB-D,TB-DO
65	23	3214325	FUSE MODULAR TERMINAL BLOCKFUSE TYPE: G/ 5 X 20, NOM. VOLTAGE: 400 V, NOMINAL CURRENT: 32 A, CONNECTION METHOD: SCREW CONNECTION, MOUNTING TYPE: NS 35/7.5, NS 35/15, NS 32, COLOR: BLACK	PHOENIX CONTACT	TB-DI,TB-D-O,TB-INST
66	4	3044759	GROUND MODULAR TERMINAL BLOCK, 2-LEVEL, SPRING-CAGE CONNECTION, AWG 28-12, GREEN-YELLOW COLOR	PHOENIX CONTACT	TB-G
67	1	3047293	PARTITION PLATE FOR GROUND TERMINAL BLOCKS	PHOENIX CONTACT	TB-G
68	3	3214259 & 3044128	TERMINAL BLOCK, 4-LEVEL, SPRING-CAGE CONNECTION, AWG 2.8-10, GRAY COLOR, 32A, 600 VOLTS	PHOENIX CONTACT	TB-M

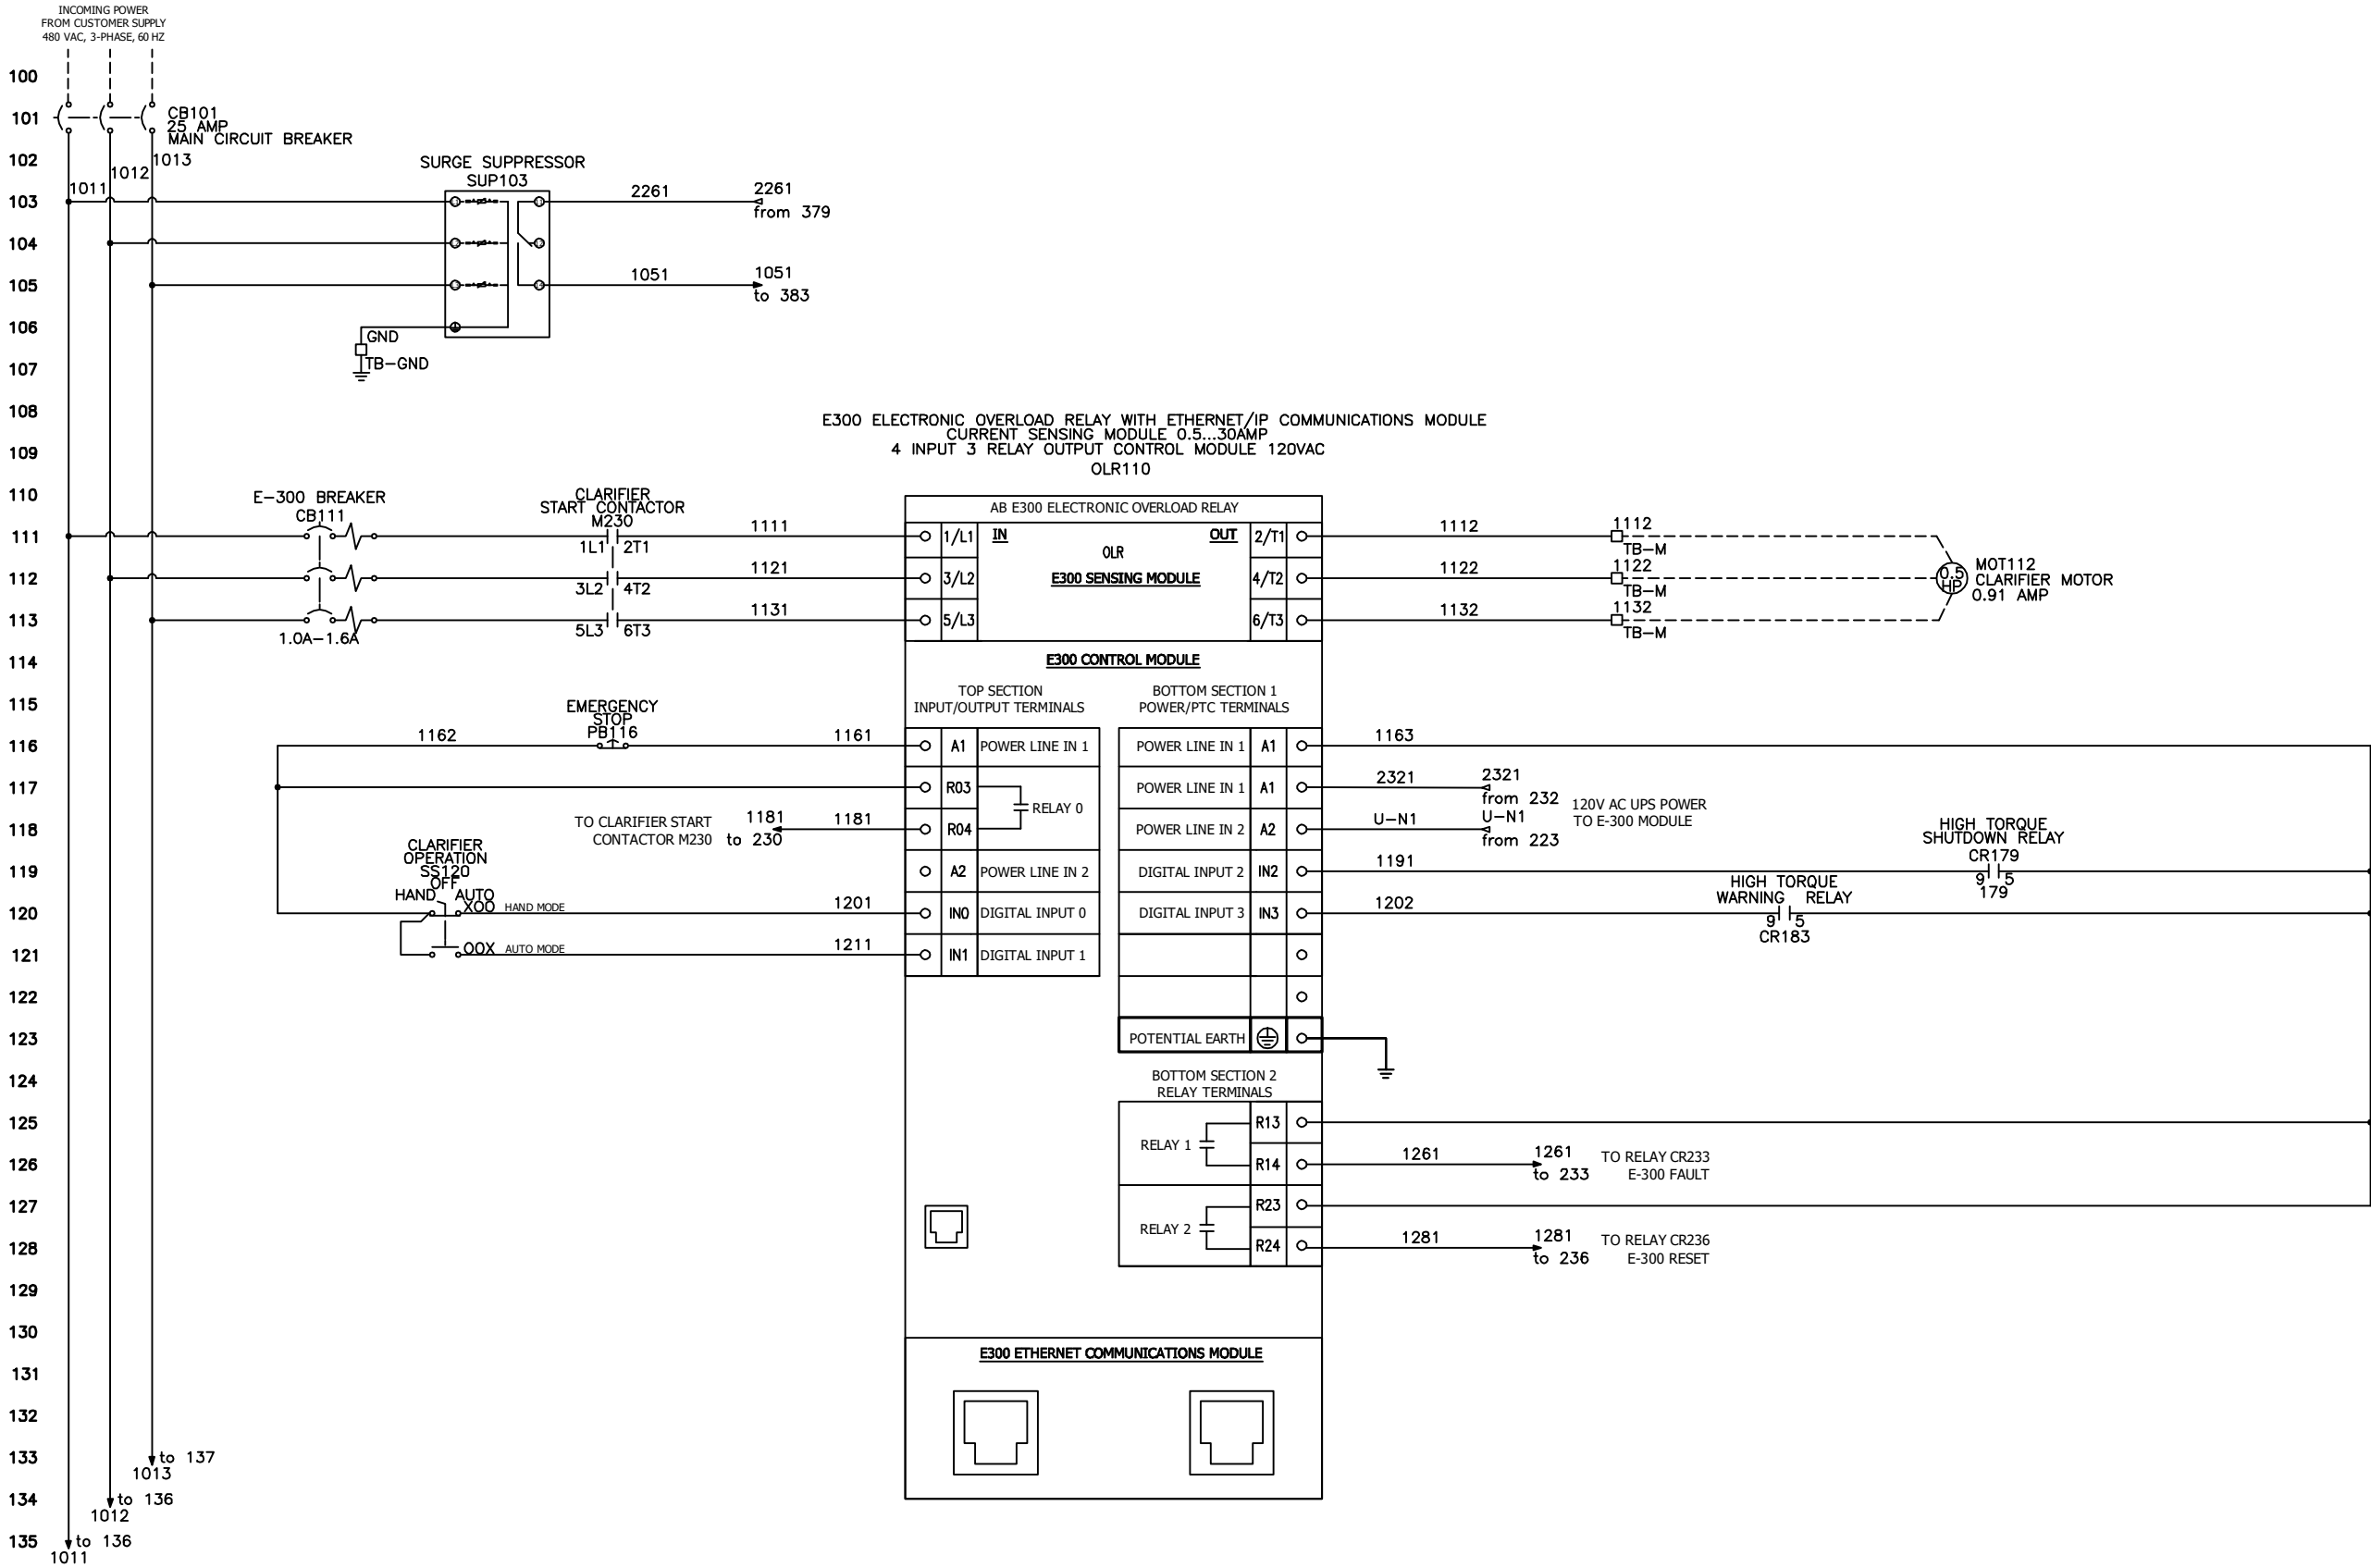




WIRING LEGEND:


INTERNAL PANEL WIRING




FIELD WIRING (NOT BY OVIVO)

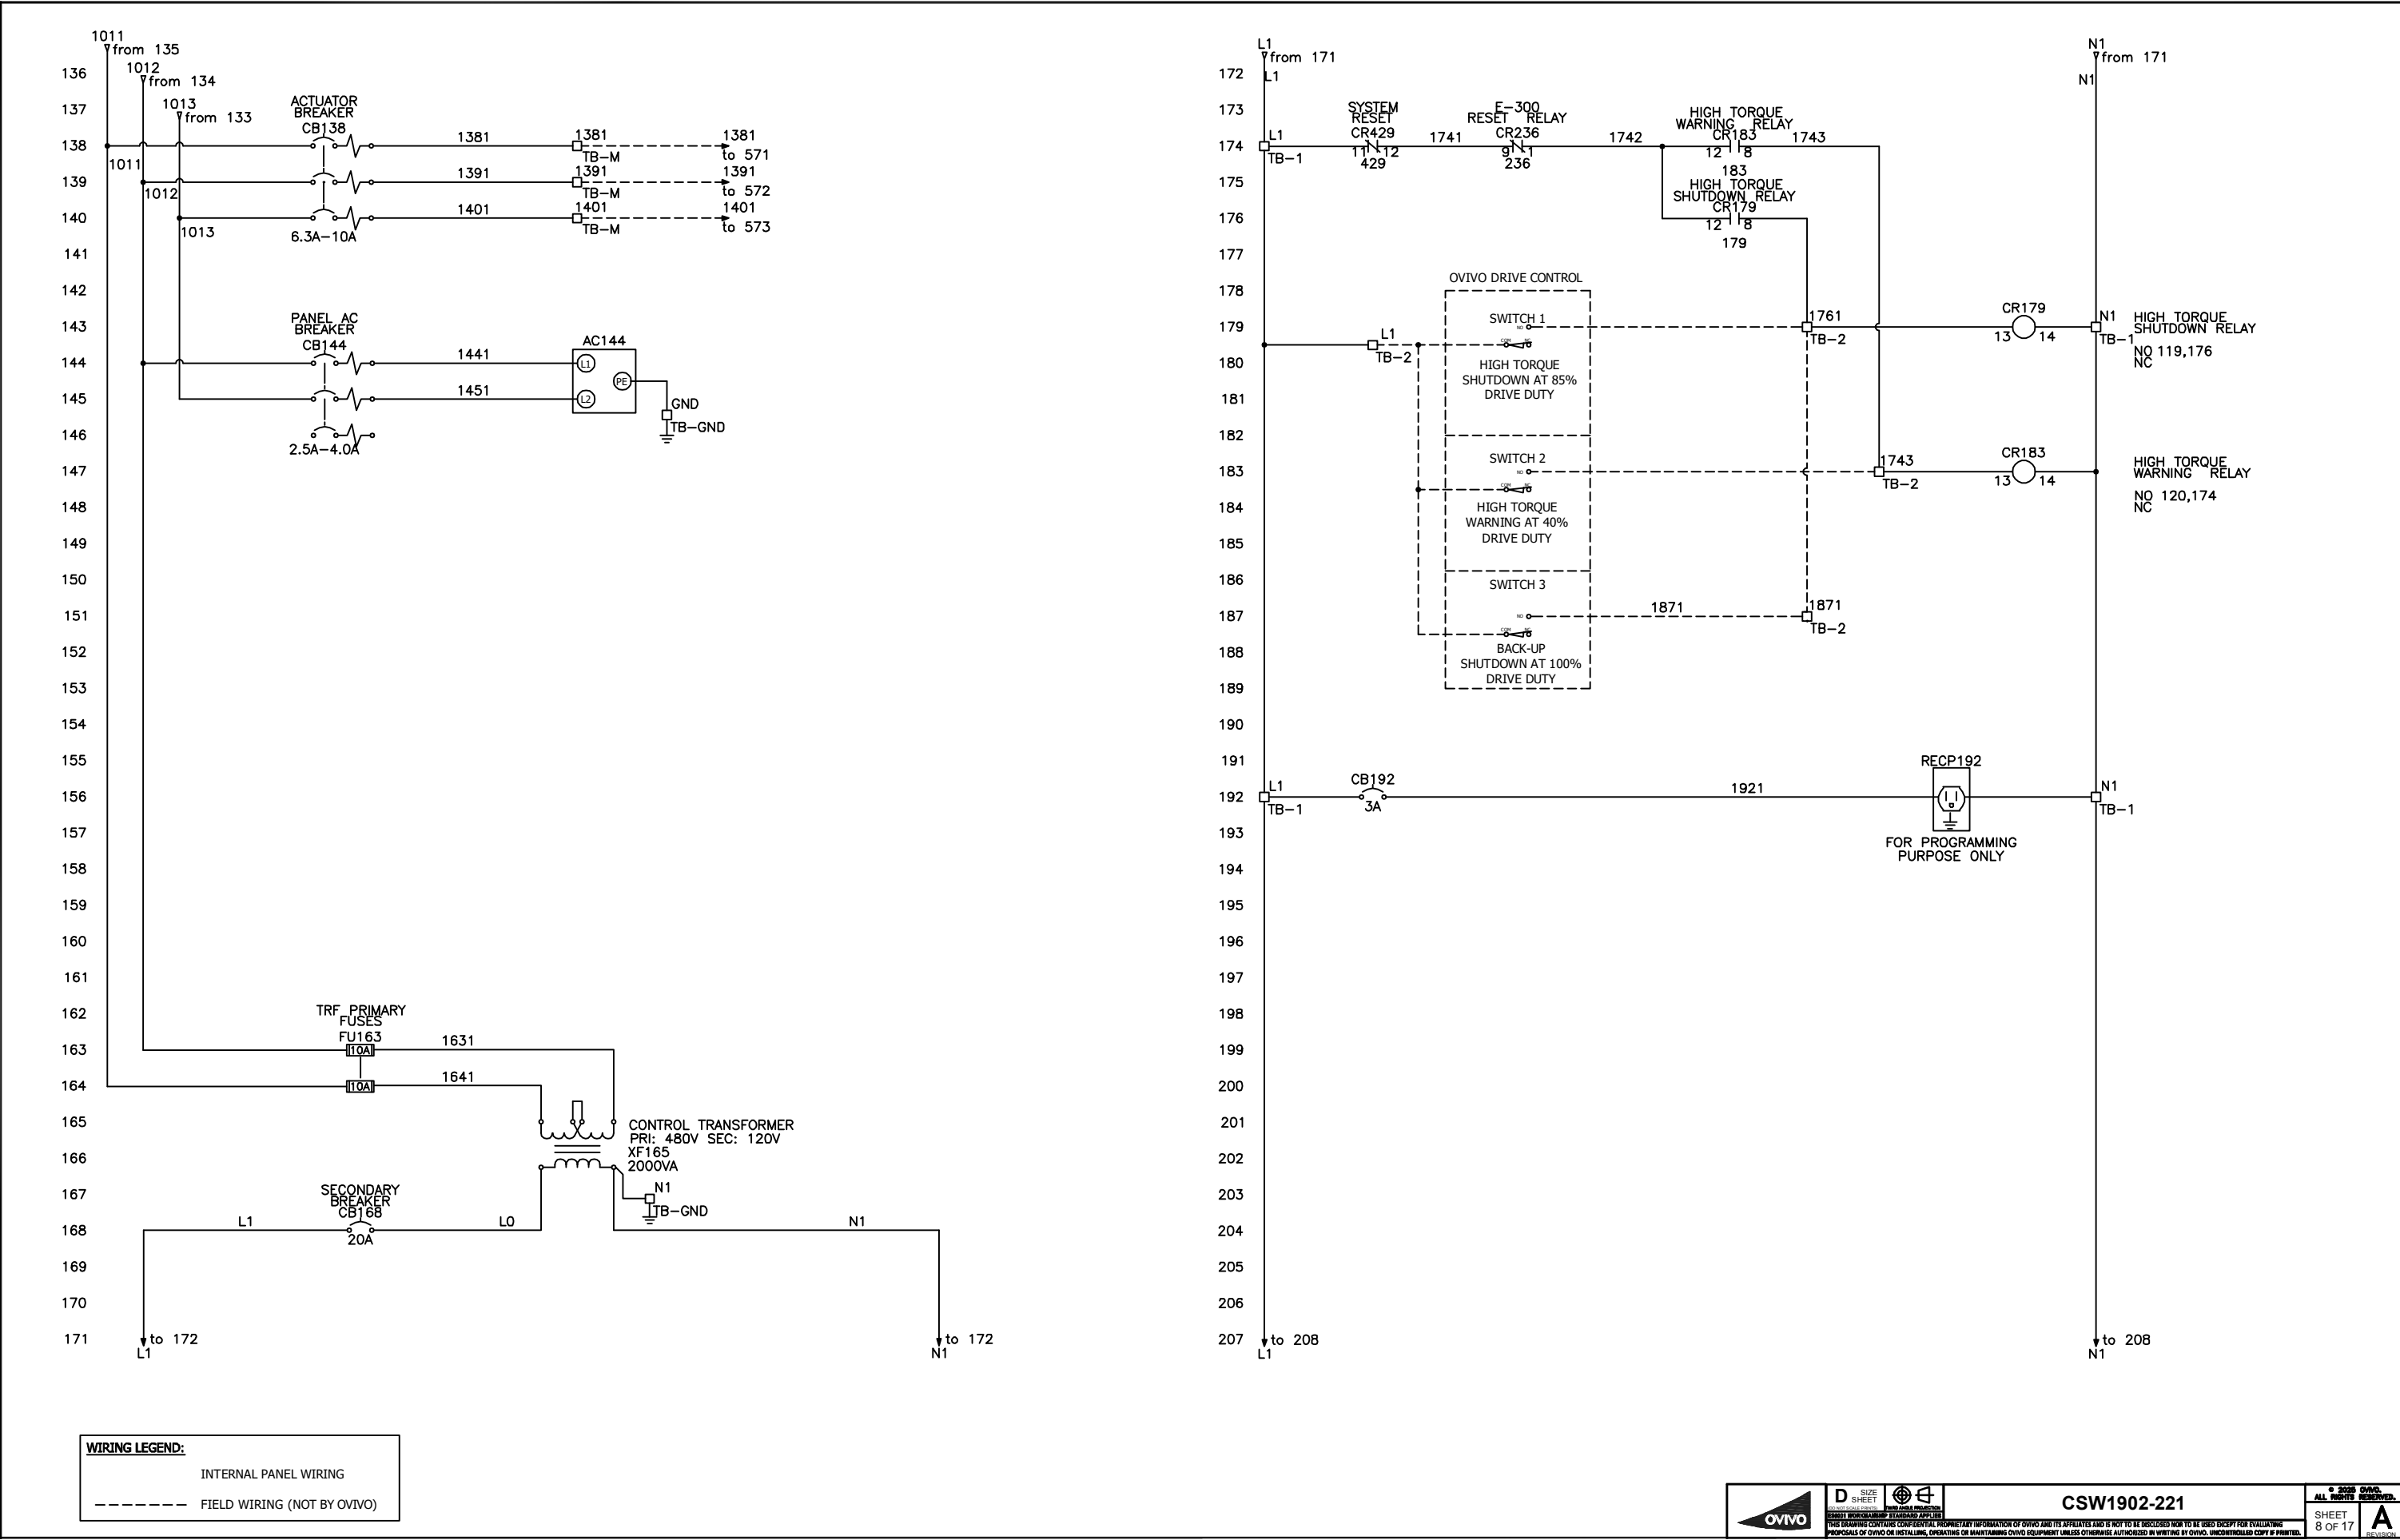


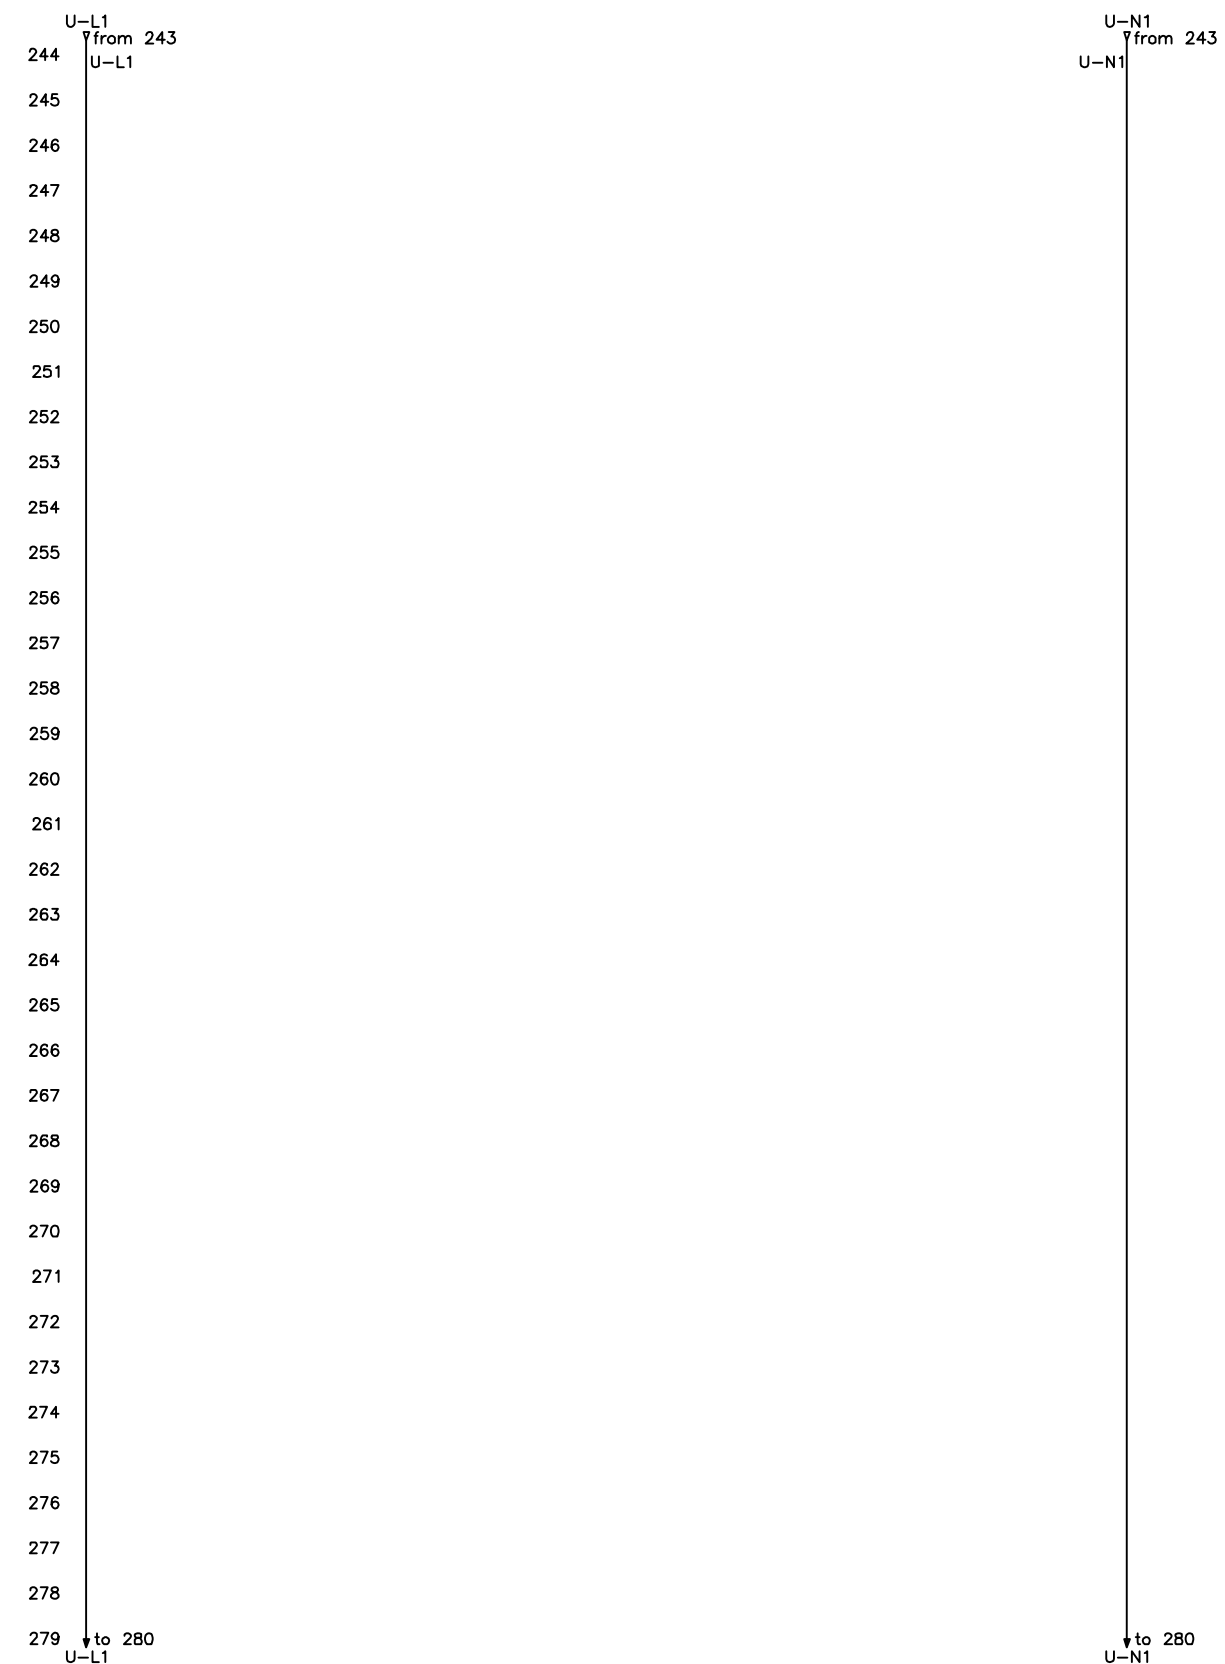

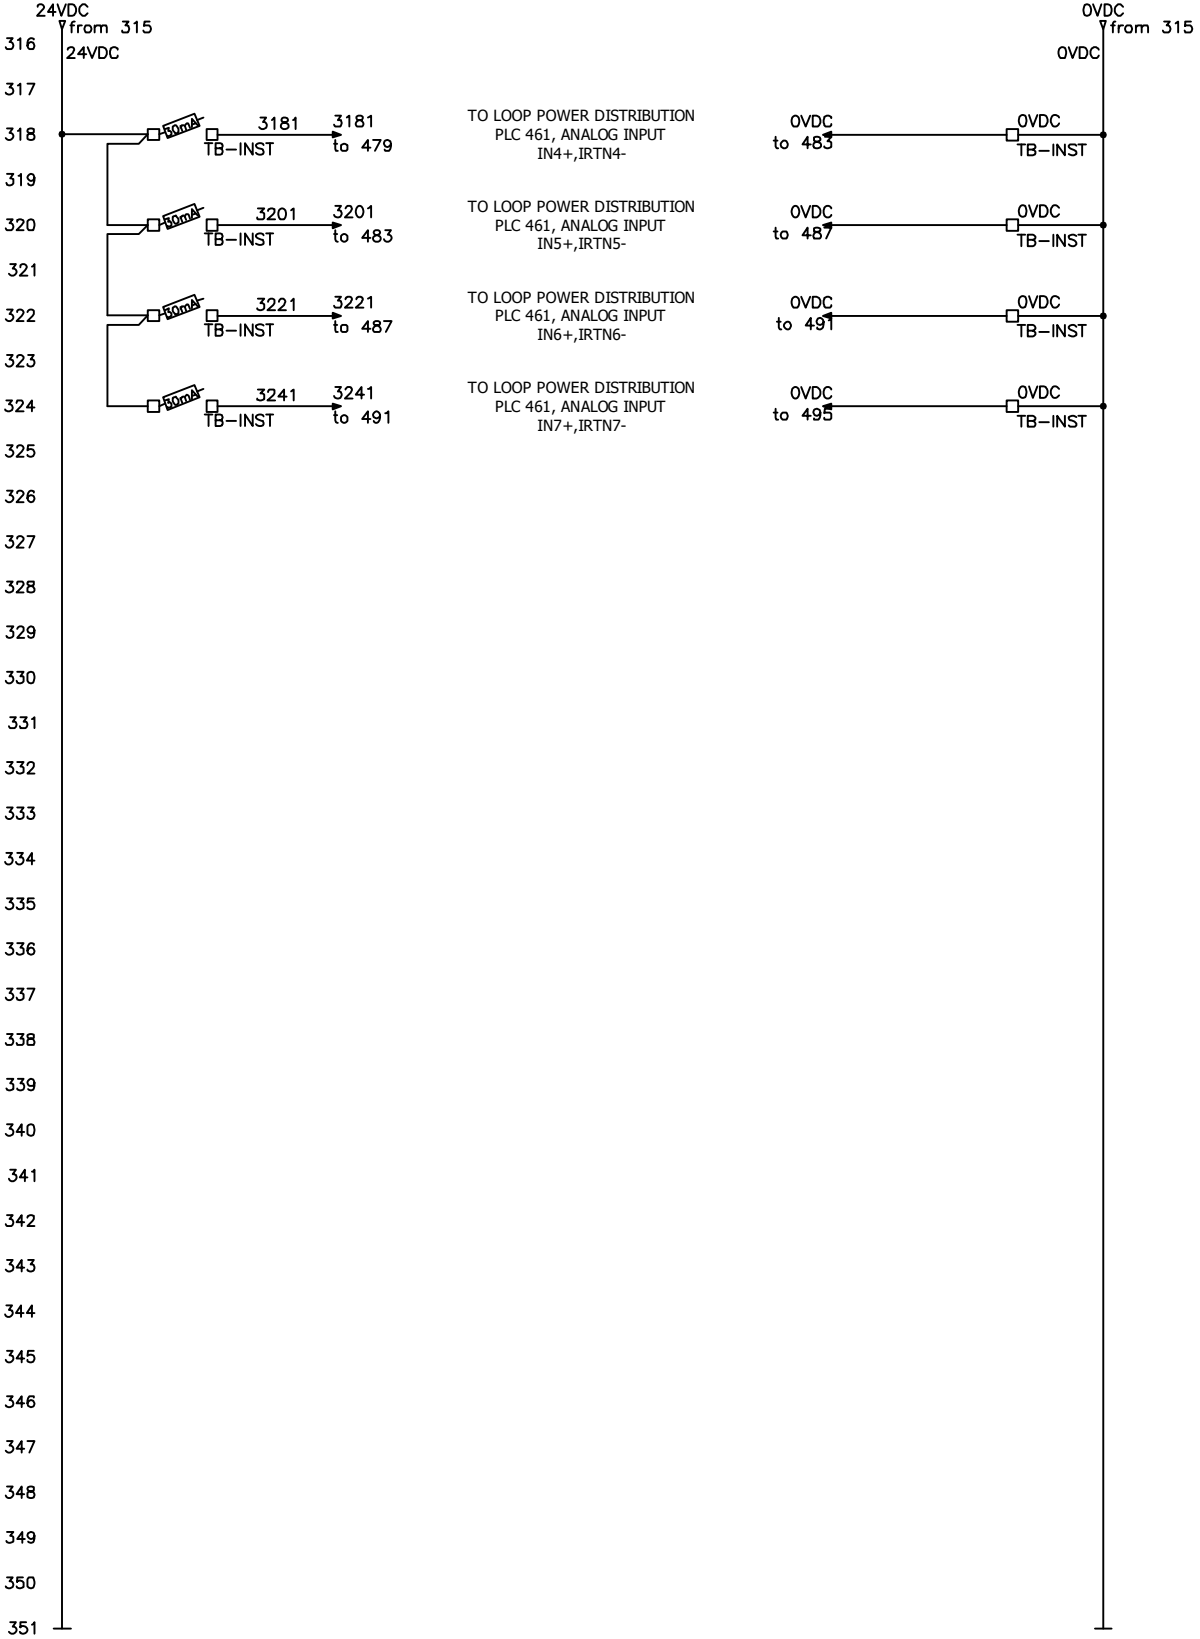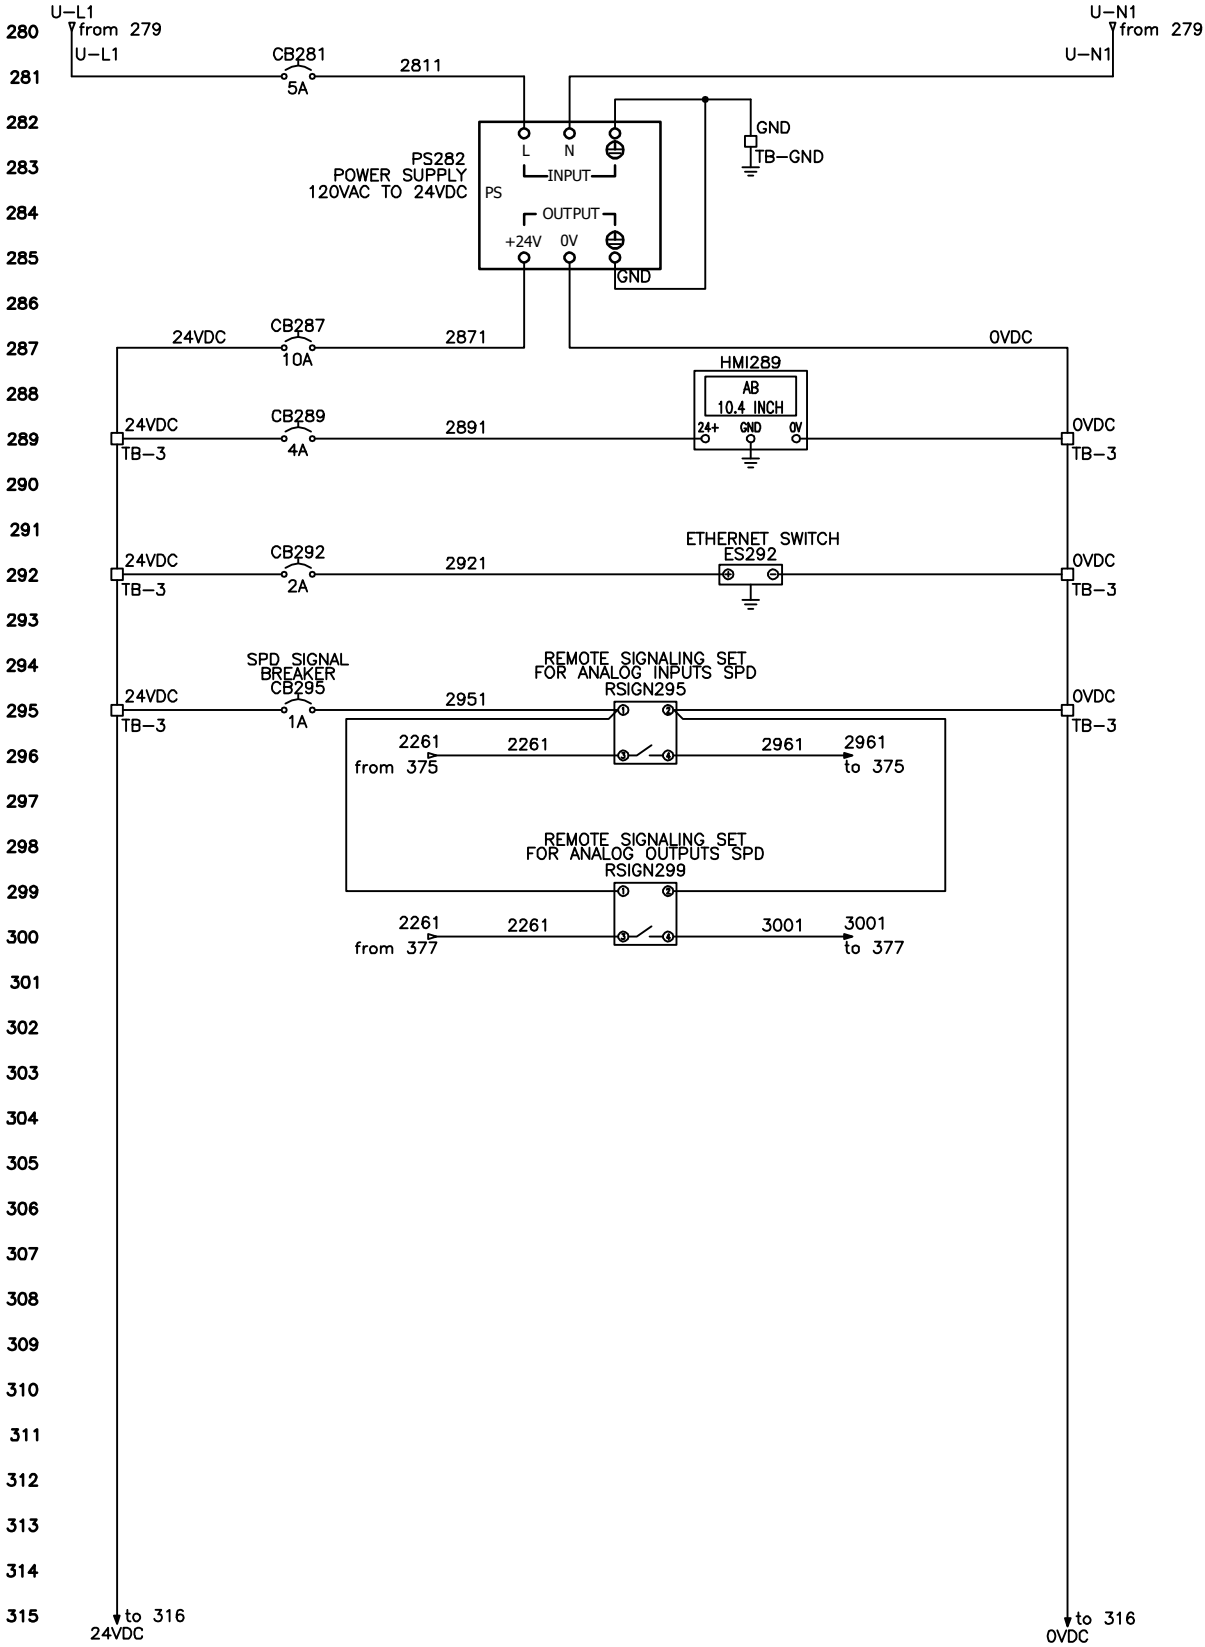

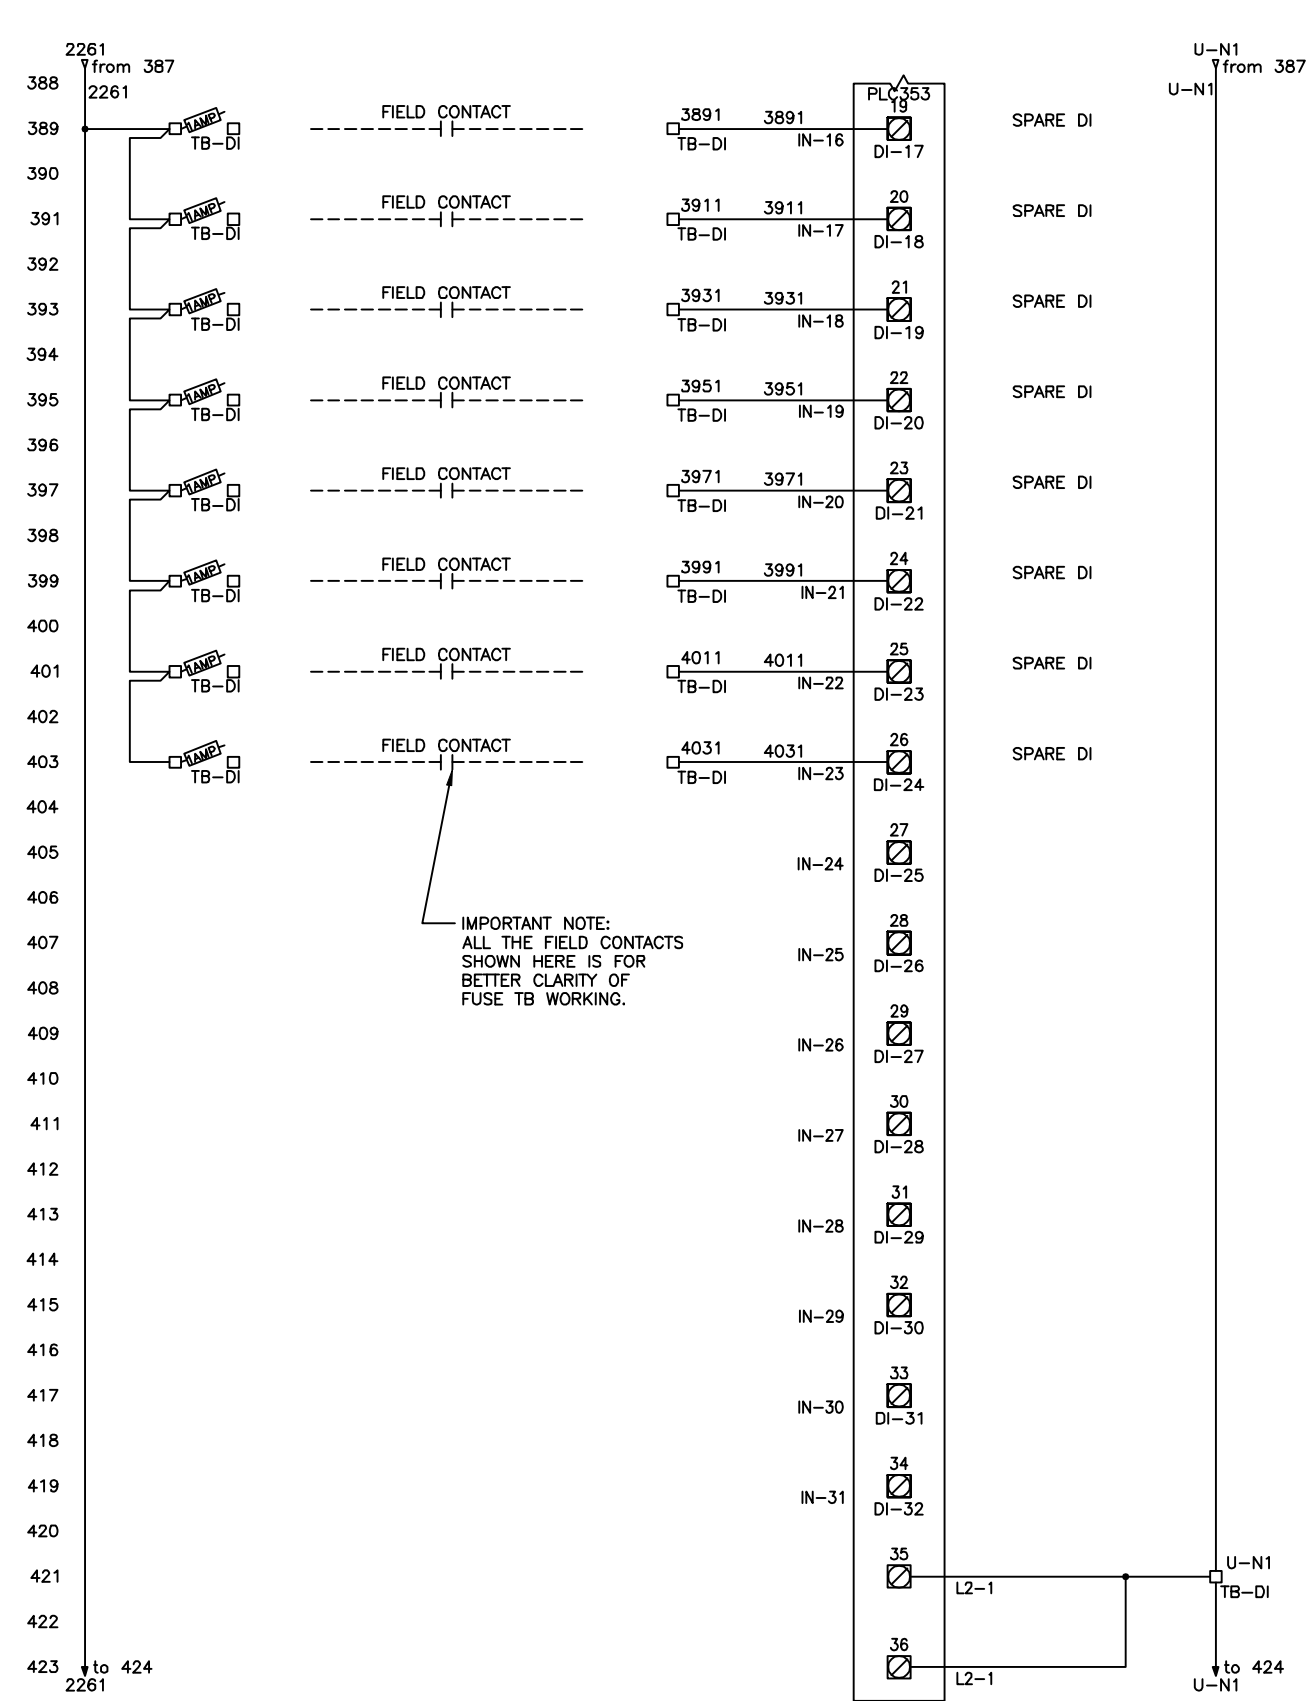

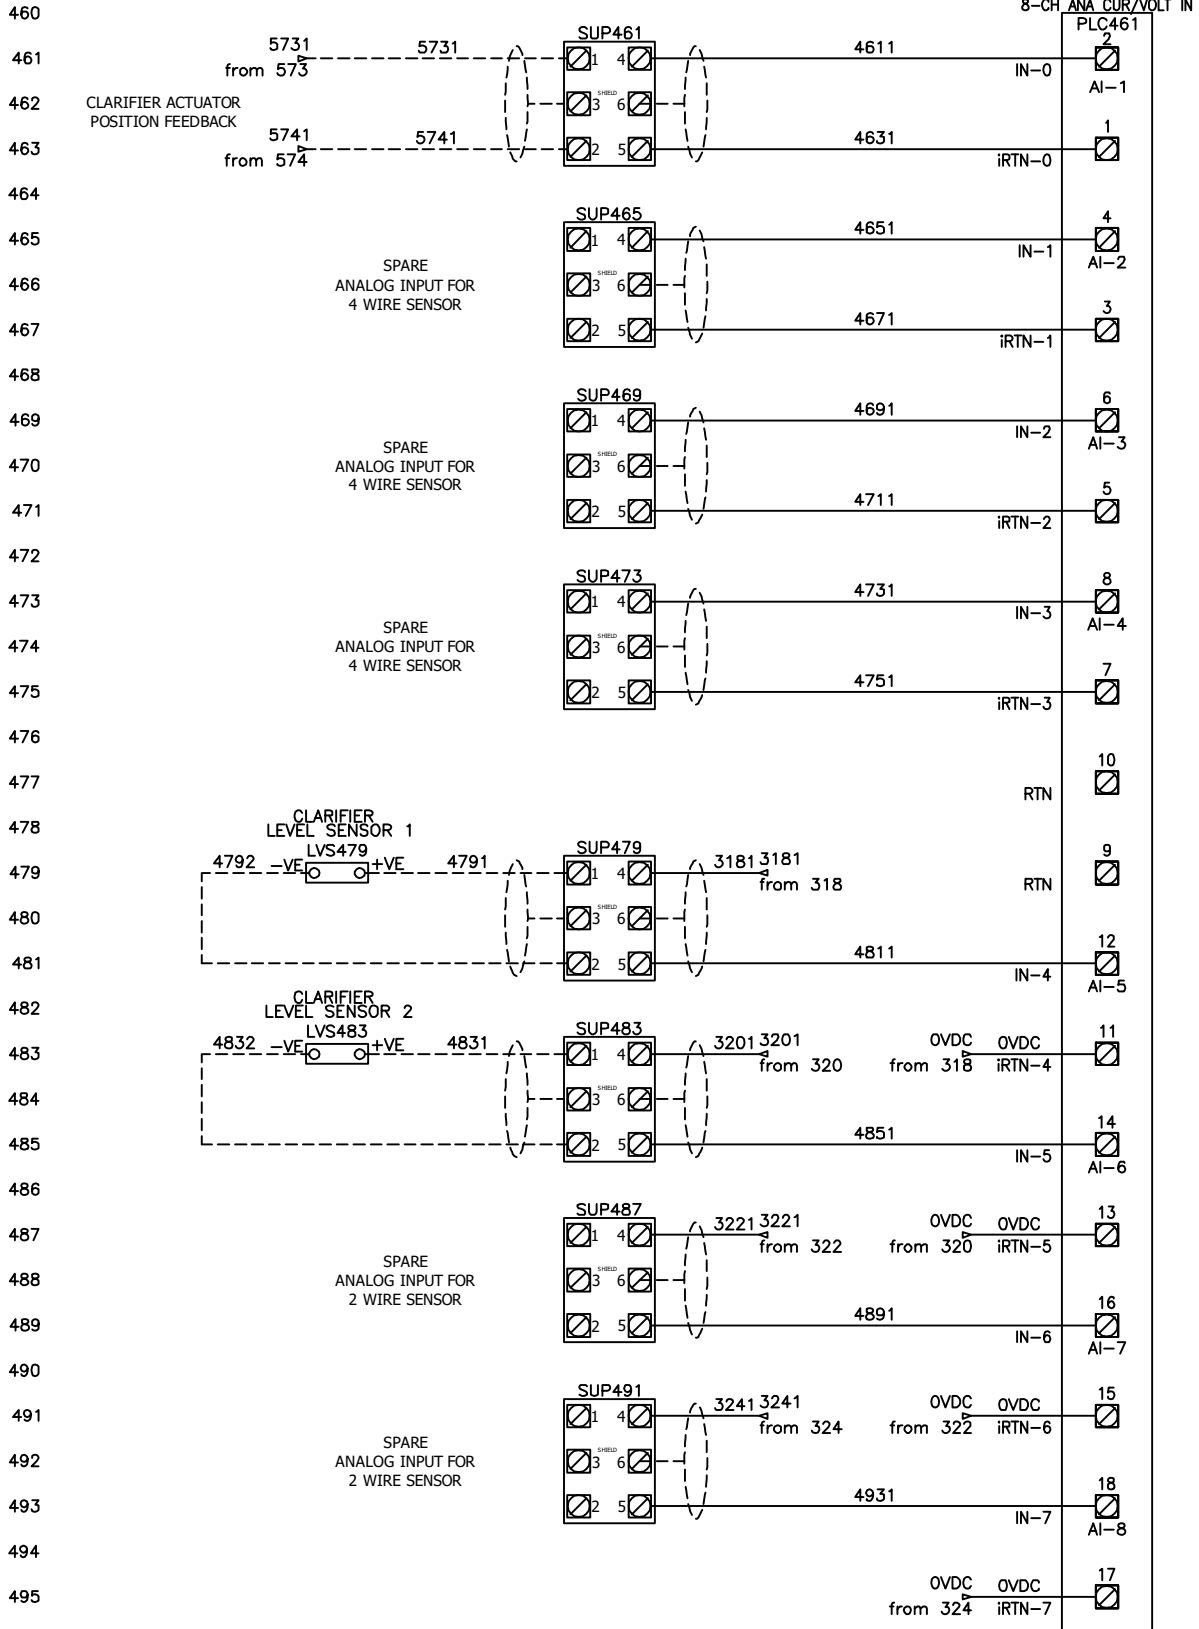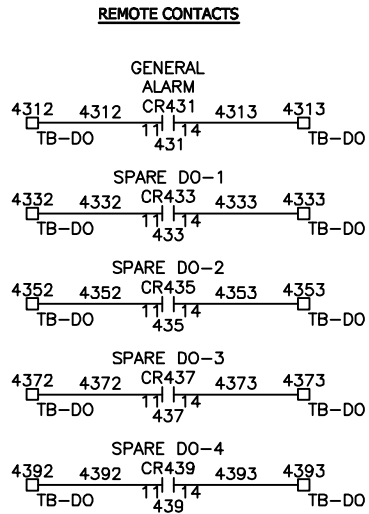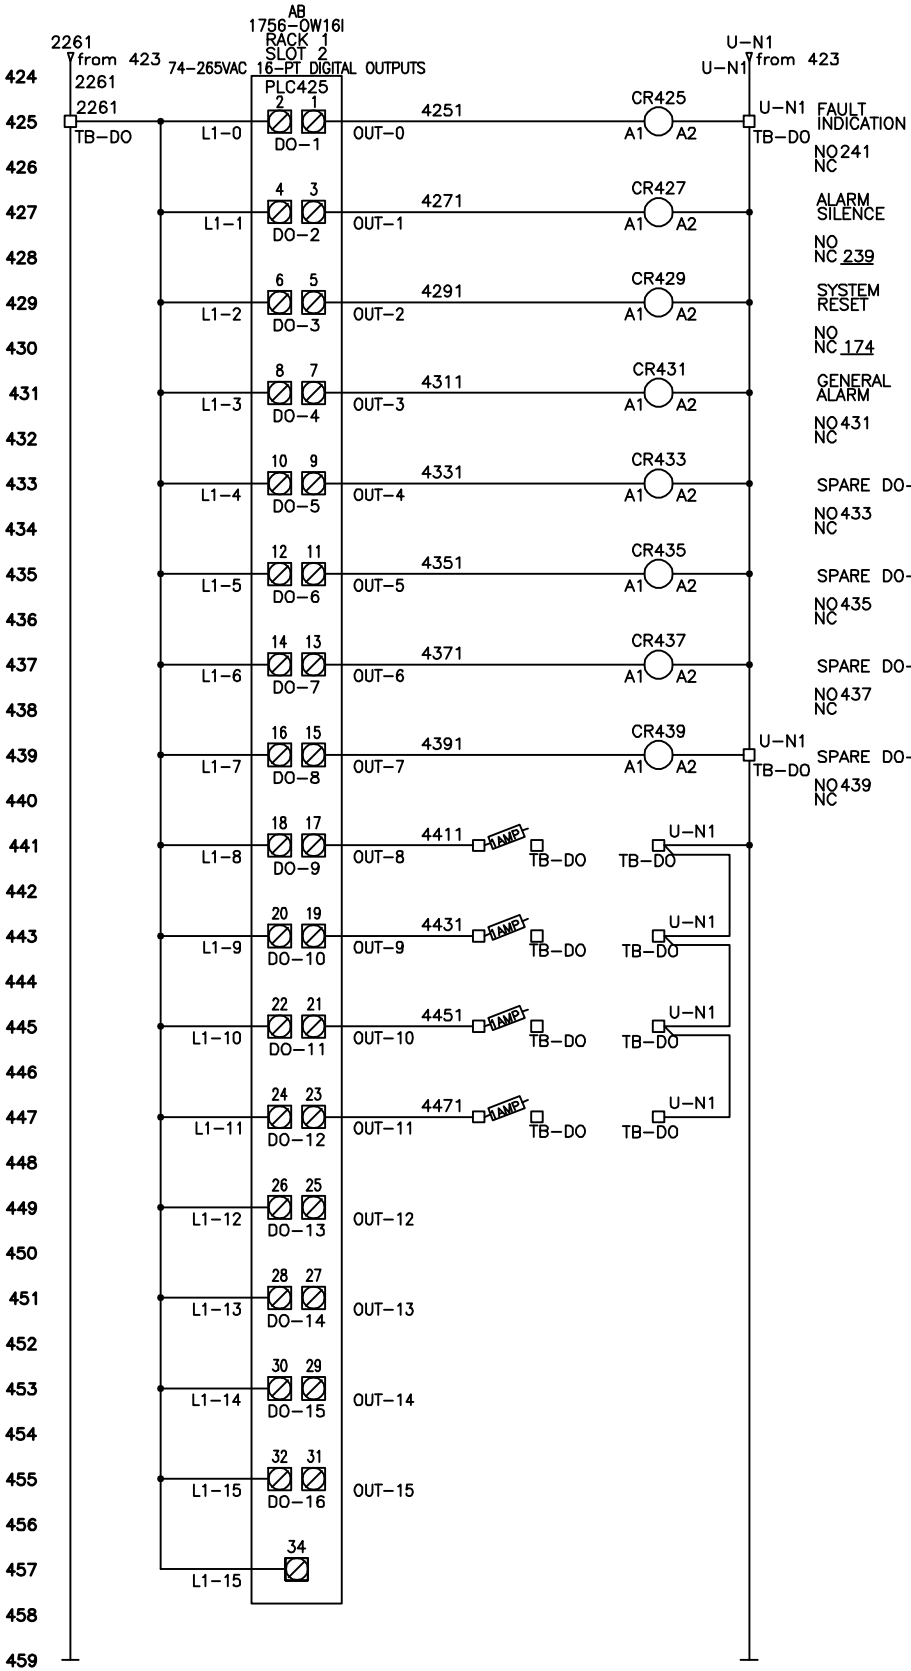

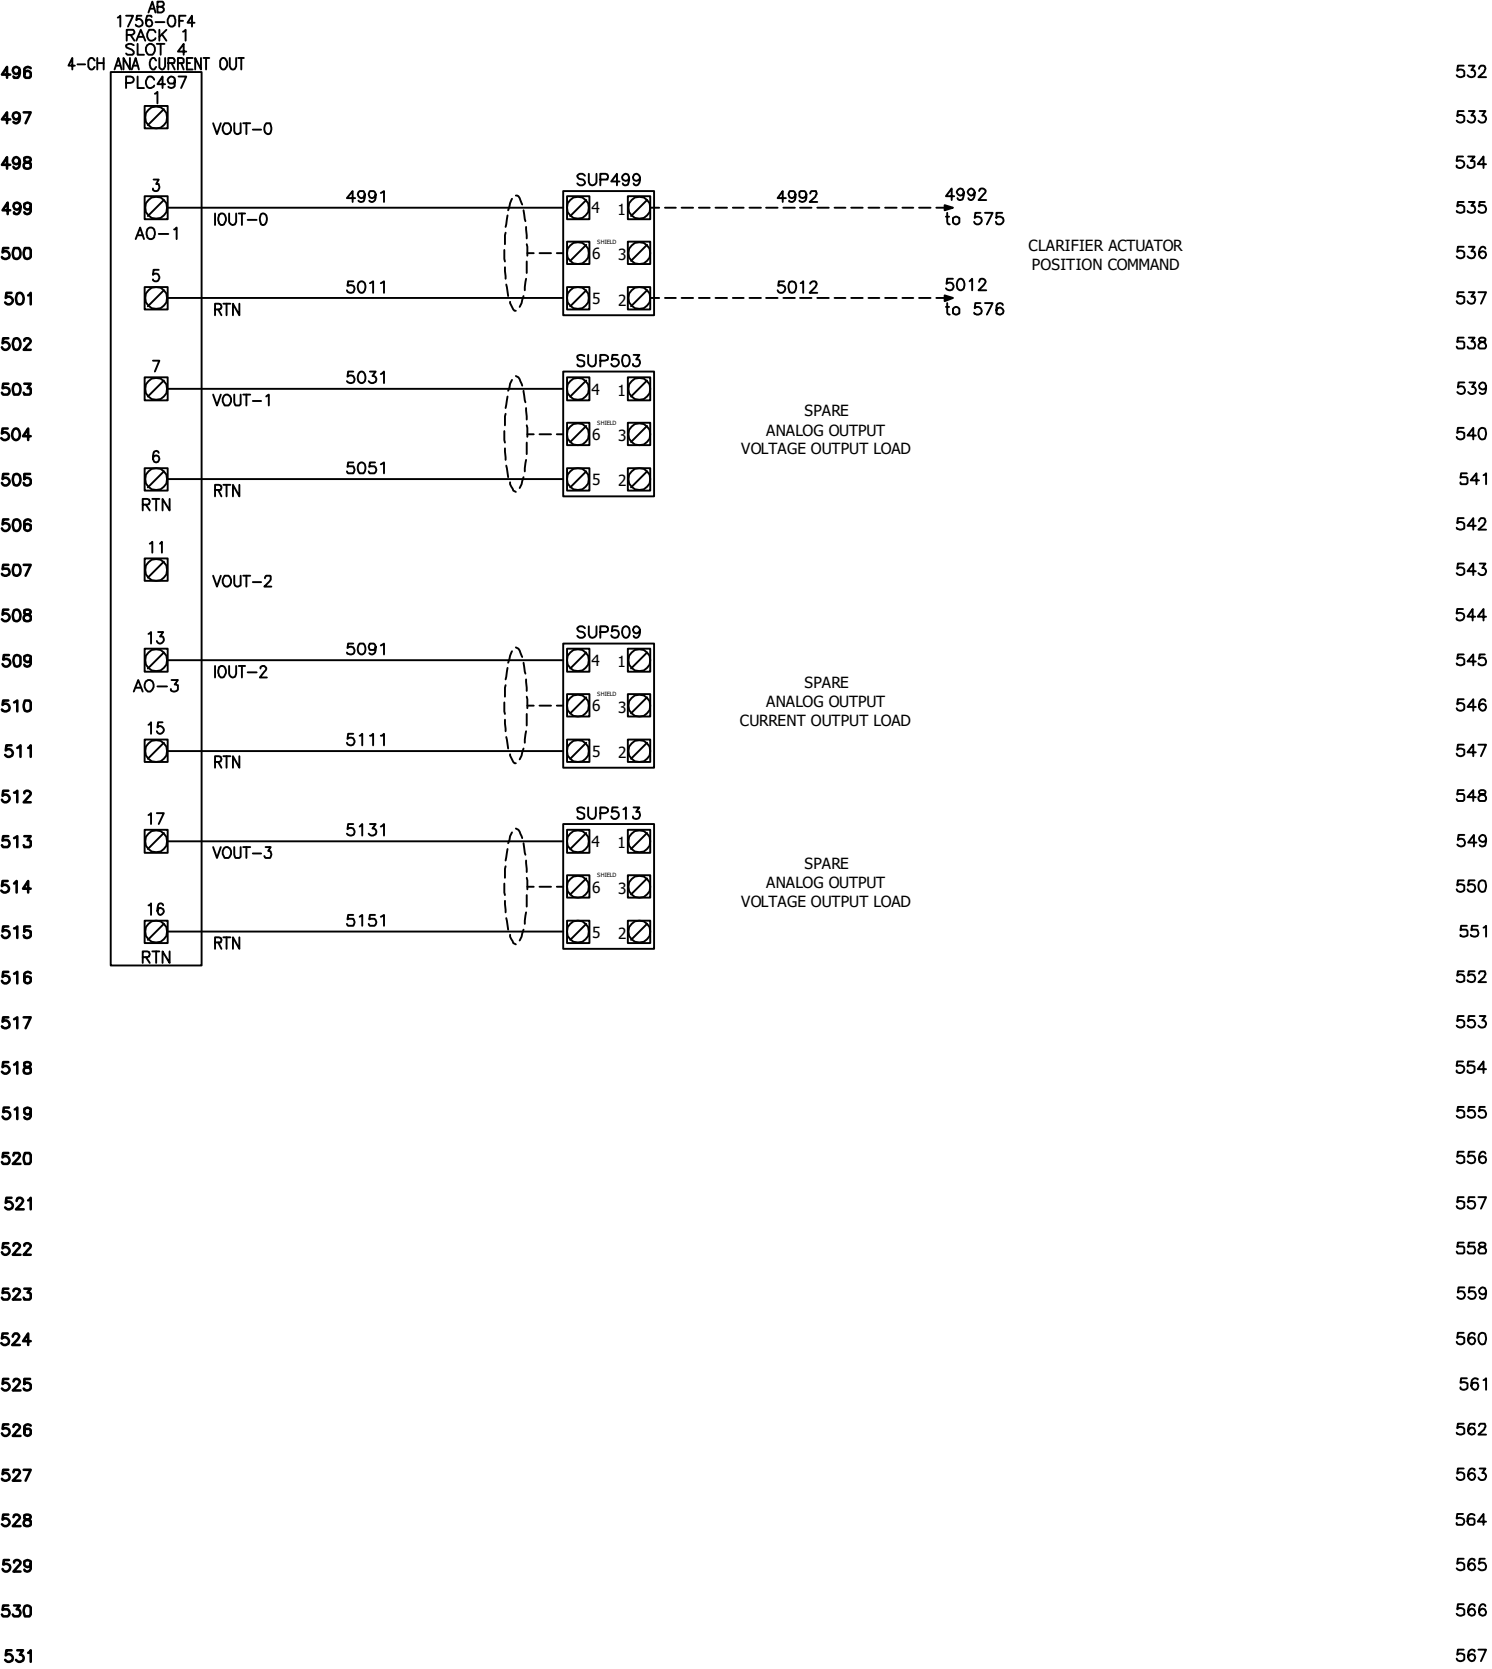


568
569
570
571
572
573
574
575
576
577
578
579
580
581
582
583
584
585
586
587
588
589
590
591
592
593
594
595
596
597
598
599
600
601
602
603

S1 CONFIGURED FOR
STATUS (REMOTE SELECTED)

S2 CONFIGURED FOR
VALVE ALARMS

S3 CONFIGURED FOR
ACTUATOR ALARMS

S4 CONFIGURED FOR
SERVICE ALARMS

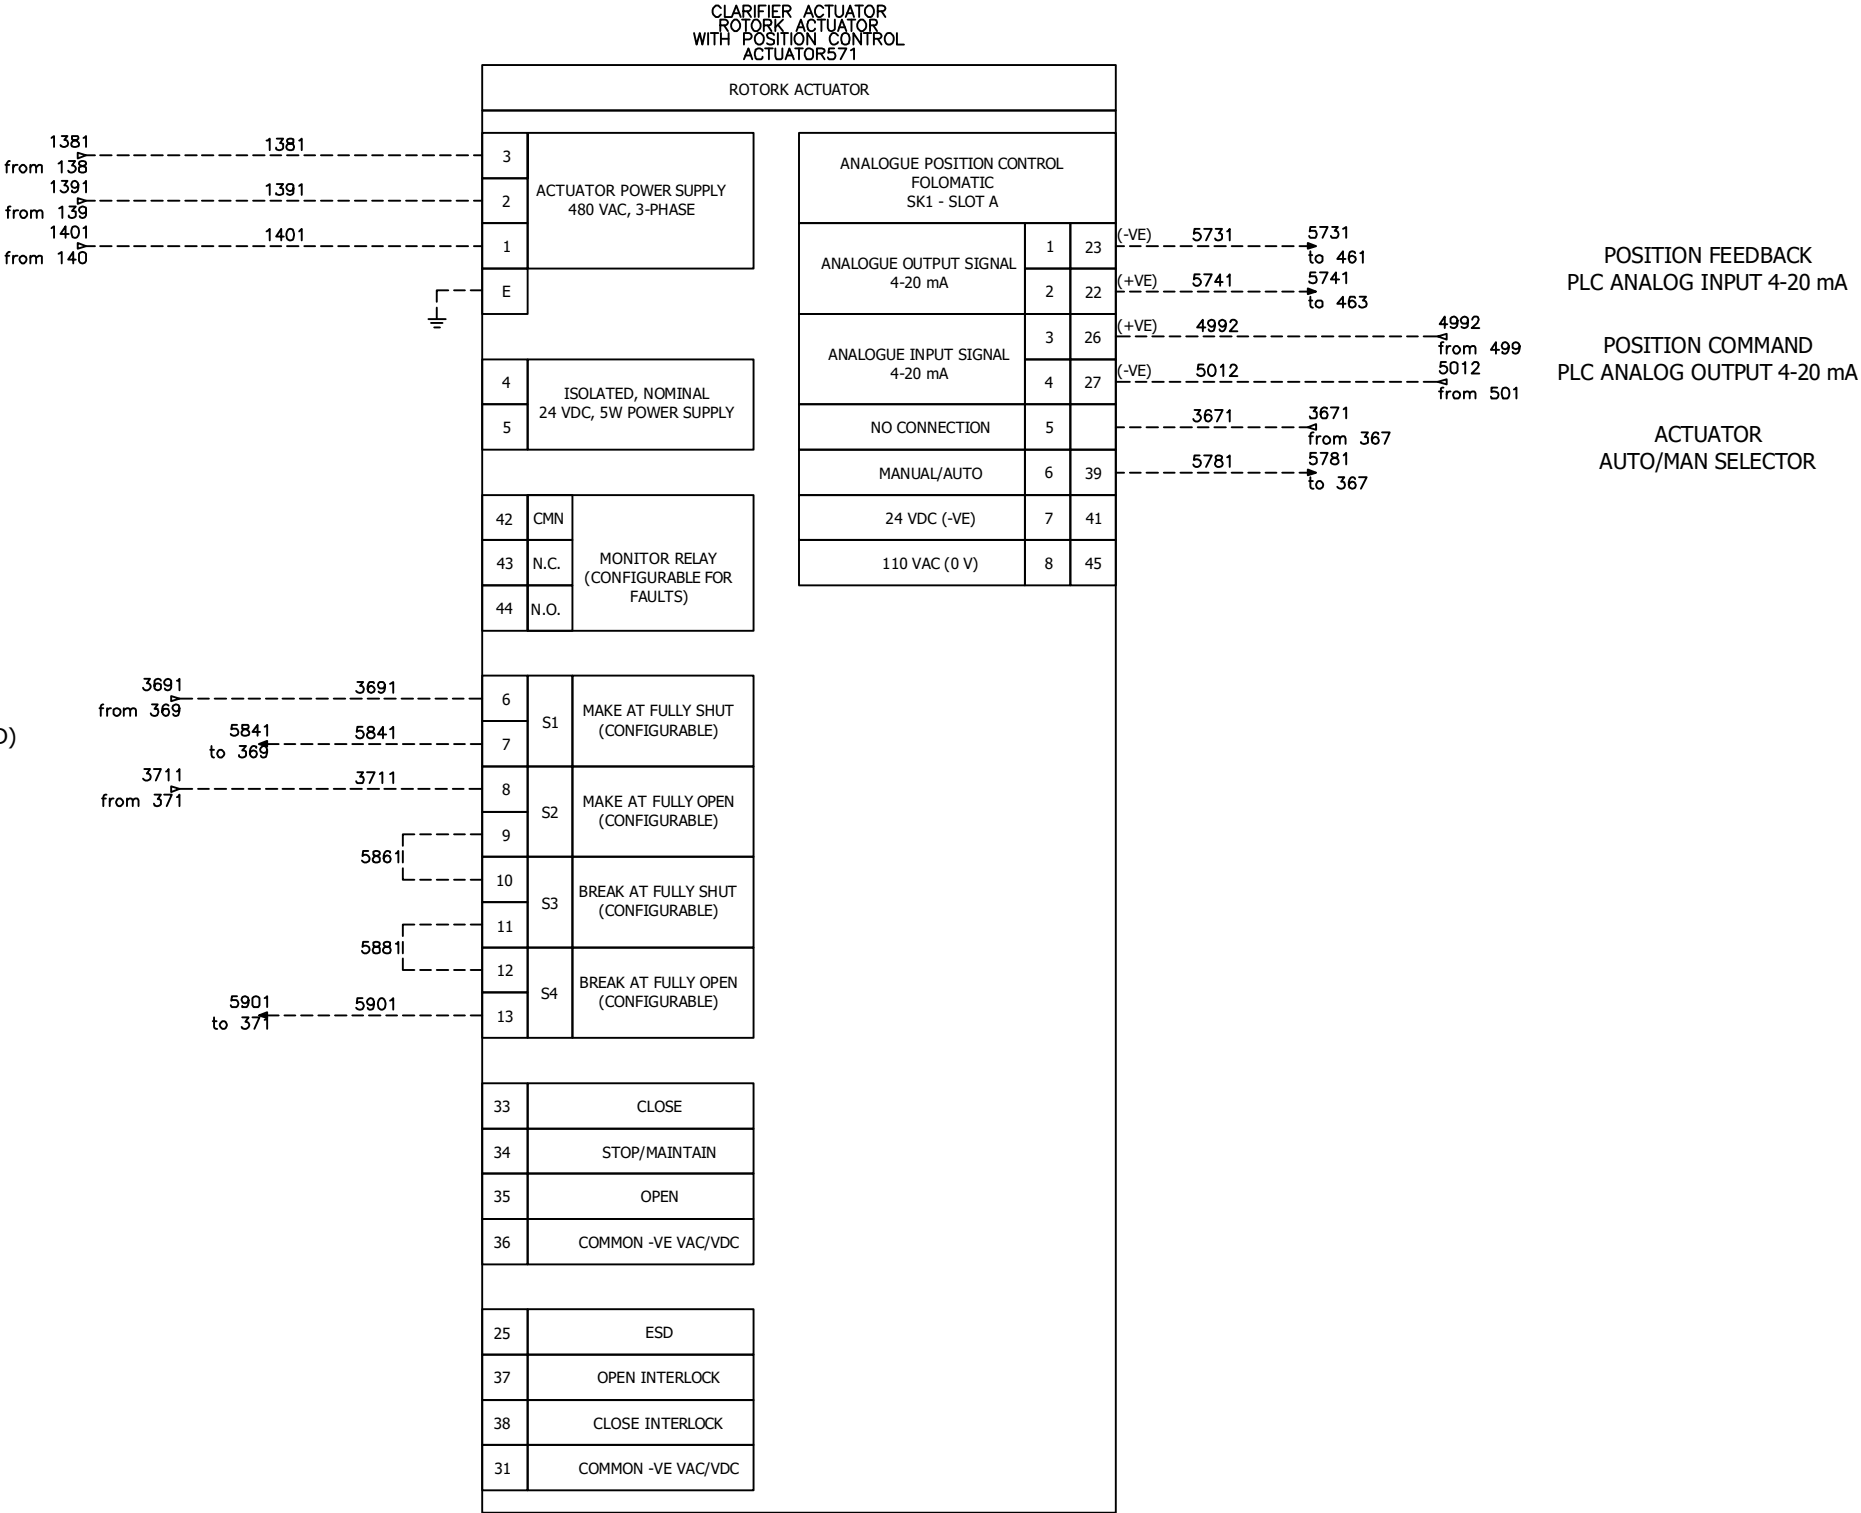


- INSTALL SLIDE GATE & ACTUATOR
-INSTALL LEVEL TRANSMITTERS W/BRACKETS SUPPLIED
-SUPPLY MOUNTING CHANNELS & HARDWARE

ELECTRICAL CONTROL PANEL NOTES

- ONE CONTROL PANEL TO CONTROL ONE SEL™ UNIT
-CONTROL PANEL TO BE LOCATED ON AUXILIARY BRIDGE WALKWAY, LOCATION DETERMINED BY ENGINEER
-CONTROL PANEL TO BE SUPPLIED WITH 460 VAC FROM CUSTOMER
-CONTROL WIRING TO GO FROM (1) CONTROL PANEL TO (1) SEL™ UNIT
-CONTOL WIRING TO INCLUDE (FOR EACH SEL™ UNIT):
 - 4-20mA INPUT SIGNALS FROM 2 WATER LEVEL SENSORS
 - 4-20mA INPUT SIGNAL FROM ACTUATOR POSITION FEED BACK
 - 4-20mA OUTPUT TO ACTUATOR FOR POSITION COMMAND

ELECTRICAL REQUIREMENTS


- SUPPLY POWER TO SLIDE GATE ACTUATOR IN CONDUIT
-SUPPLY CONTROL WIRING TO SLIDE GATE IN SHIELDED CONDUIT
-SUPPLY CONTROL WIRING TO LEVEL TRANSMITTERS IN SHIELDED CONDUIT
-ALL CONTROL WIRING BACK TO CONTROL PANEL

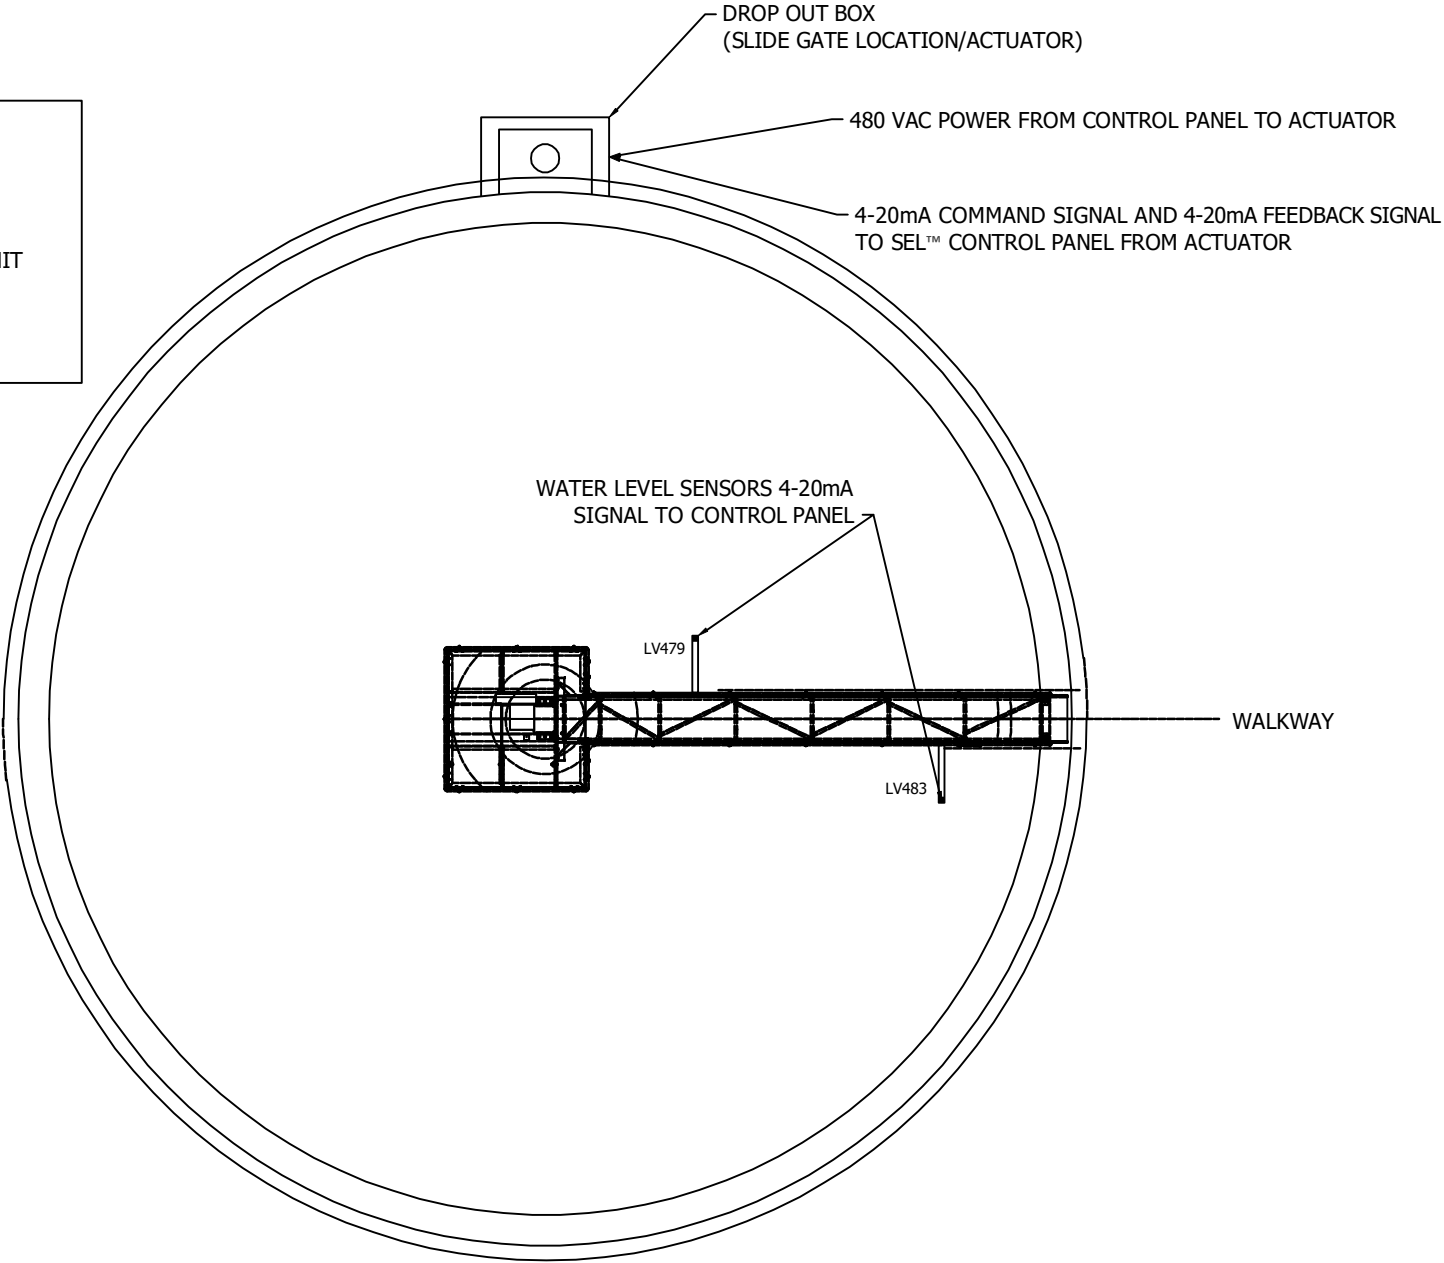

TYPICAL OF SEL™ UNITS

NETWORK COMMUNICATIONS

MASTER CONTROL PANEL

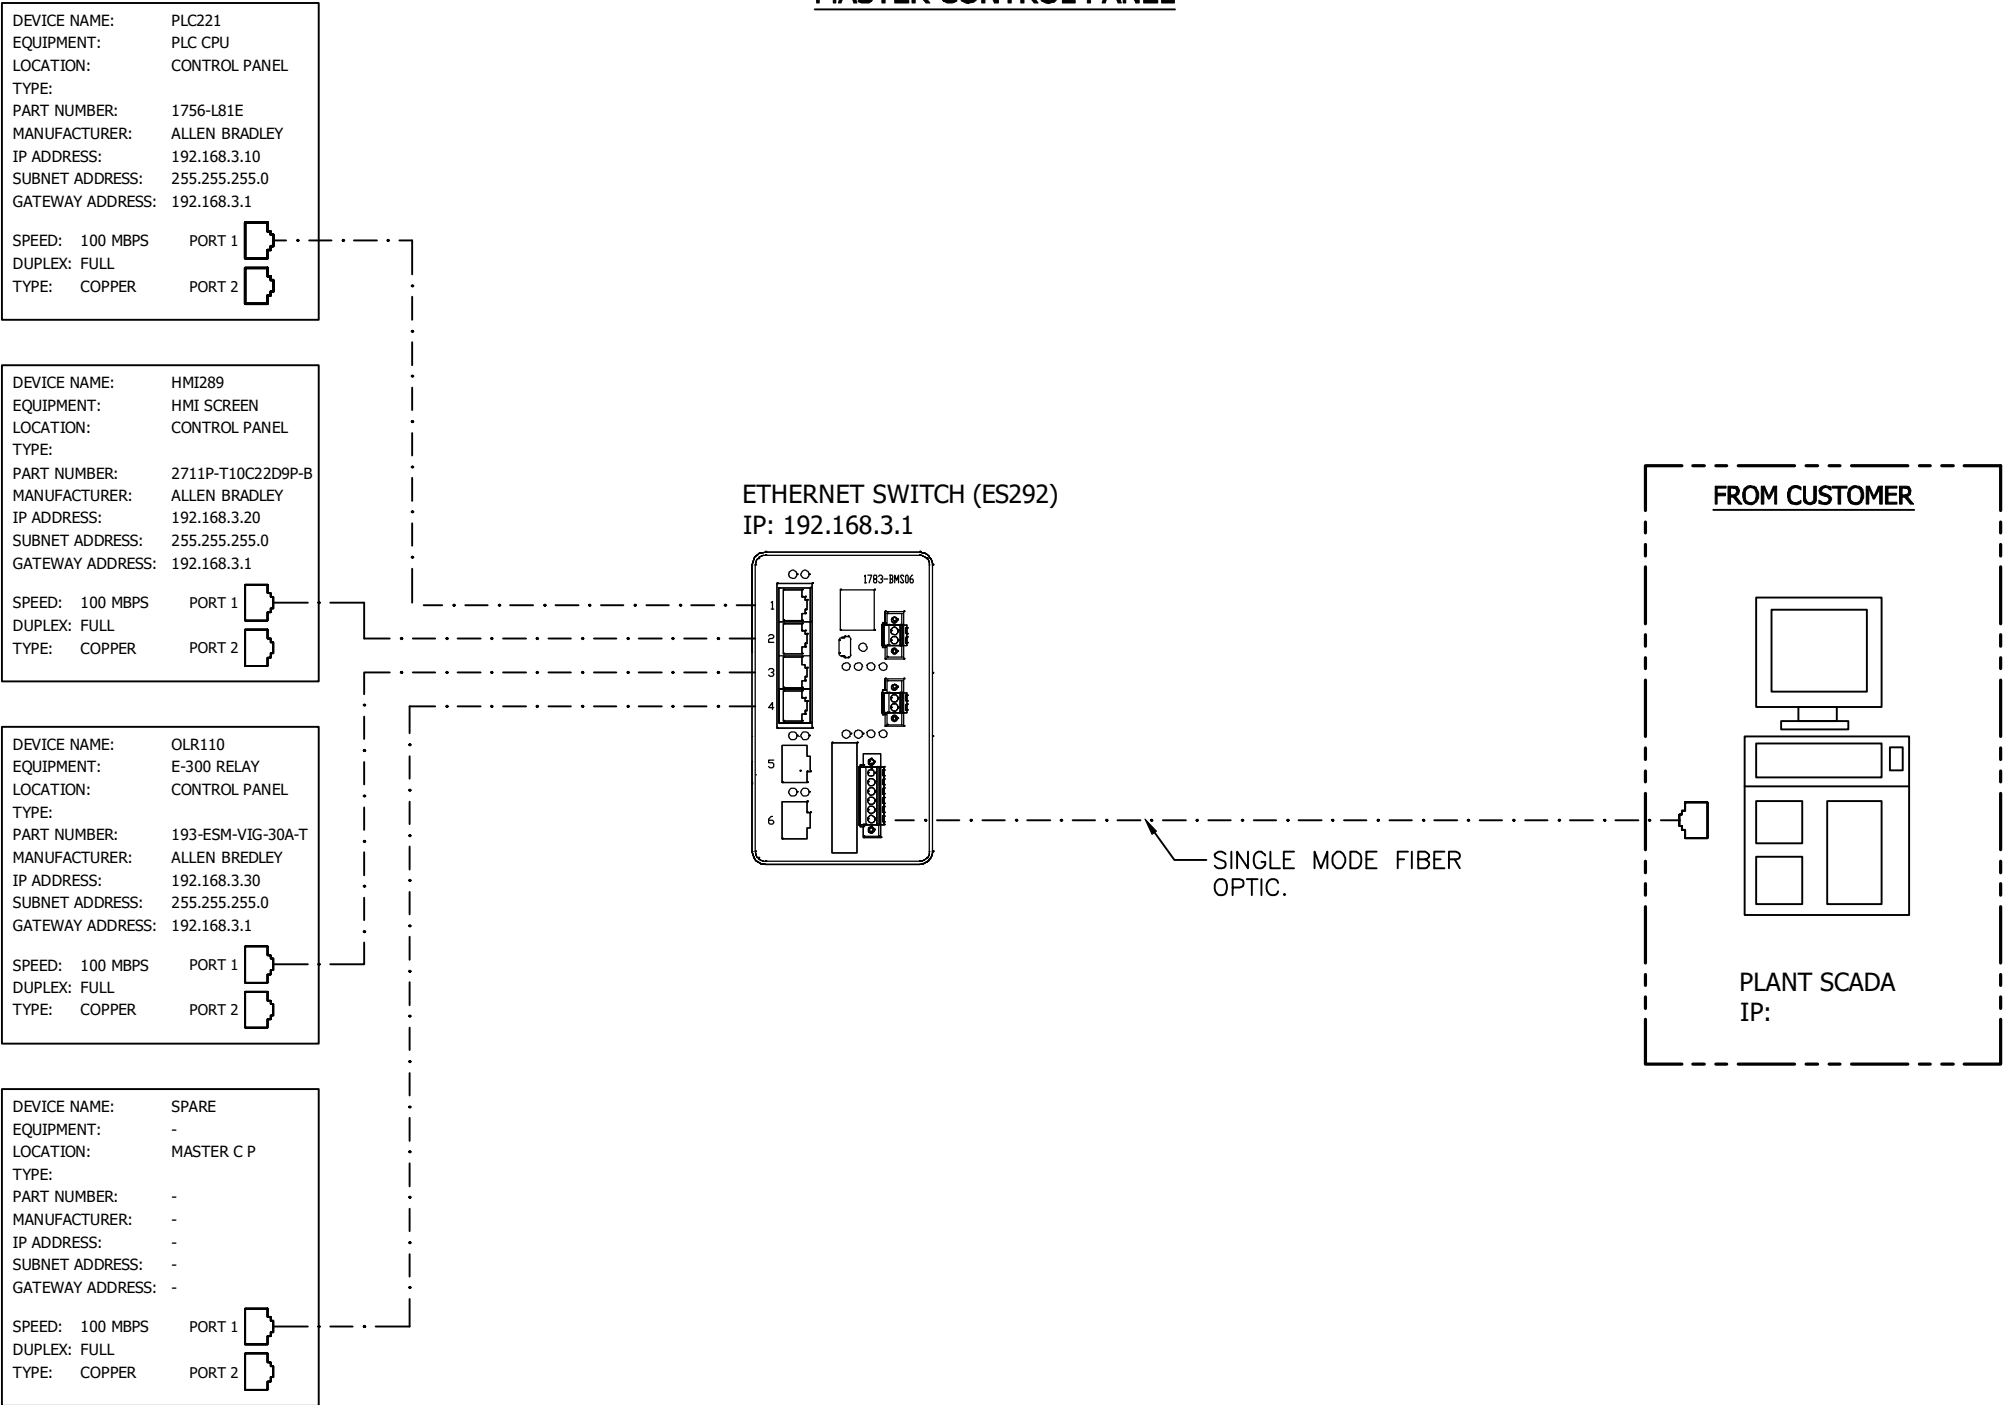

INSTRUMENT & FUNCTION LEGEND		LINE SYMBOL LEGEND	
	FIELD MOUNTED INSTRUMENT		SOFTWARE OR DATA LINK (ETHERNET, MODBUS, DEVICENET)
	INSTRUMENT MOUNTED ON FACE OF LOCAL PANEL		DISCRETE INSTRUMENT SIGNAL (120VAC, 24VDC)
	INSTRUMENT MOUNTED BEHIND OR INSIDE OF LOCAL PANEL		ANALOG INSTRUMENT SIGNAL (4-20mA)
	INSTRUMENT MOUNTED ON FACE OF FIELD PANEL		480VAC ELECTRICAL POWER
	PLC CONTROL FUNCTION		DISCRETE INPUT/OUTPUT
			ANALOG INPUT/OUTPUT

