



Bringing water to life®

REDMOND WETLANDS WWTP, OR
SCREEN SYSTEM PACKAGE CONTROL
PANEL (LCP-1100)

ELECTRICAL DRAWING INDEX	
SHEET	SHEET DESRIPTION
1	COVER SHEET INCLUDING TABLE OF CONTENTS, PANEL DESIGNATIONS
2	GENERAL DRAWING NOTES
3	ONE LINE 480 VAC
4	ONE LINE 120 VAC & 24VDC
5	NETWORK LAYOUT INCLUDING IP ADDRESSES
6	NETWORK LAYOUT INCLUDING IP ADDRESSES CONTINUE
7	CONTROL PANEL ASSEMBLY
8	INTERIOR PANEL DETAIL VIEW SHEET 1
9	INTERIOR PANEL DETAIL VIEW SHEET 2
10	BILL OF MATERIALS
11	MAIN POWER SCHEMATIC 1
12	MAIN POWER SCHEMATIC 2
13	MAIN POWER SCHEMATIC 3
14	CONTROL POWER SCHEMATIC SHEET 1
15	CONTROL POWER SCHEMATIC SHEET 2
16	CONTROL POWER SCHEMATIC SHEET 3
17	CONTROL POWER SCHEMATIC SHEET 4
18	CONTROL POWER SCHEMATIC SHEET 5
19	CONTROL POWER SCHEMATIC SHEET 6
20	CONTROL POWER SCHEMATIC SHEET 7
21	CONTROL POWER SCHEMATIC SHEET 8
22	CONTROL POWER SCHEMATIC SHEET 9
23	CONTROL POWER SCHEMATIC SHEET 10

CONSTRUCTION NOTES

CONTROL PANEL SPECIFICATIONS

COMPONENTS SPECIFIC

- 1.1 ENCLOSURE TO BE NEMA 4X SS304 CONSTRUCTION.
- 1.2 ATTACH NAMEPLATES WITH MANUFACTURER'S RECOMMENDED ADHESIVE TO MAINTAIN NEMA STANDARD OF ENCLOSURE
- 1.3 CONTROL PANEL SHALL BE LABELED WITH SERIALIZED UL LABEL
- 1.4 PANEL WILL BE LABELED WITH IDENTIFICATION PLATE AS NOTED ON ENCLOSURE DRAWING.
- 1.5 ALL RELAY CONTACTS ARE RATED AT 10 AMPS UNLESS OTHERWISE NOTED.
- 1.6 COMPONENT IMAGES MAY NOT ACCURATELY REPRESENT THE ACTUAL DEVICE IN SOME INSTANCES. DIMENSIONS OF DEVICES, HOWEVER, WILL BE ACCURATE FOR PURPOSES OF LAYOUT AND SPACING.
- 1.7 SUBSTITUTIONS FOR COMPONENTS MAY BE PERMITTED UPON APPROVAL BY OVIVO ENGINEERS.

WIRE SIZING & TYPE

WIRE SIZING SHALL BE NO LESS THAN AS FOLLOWS (UNLESS OTHERWISE NOTED):

- 480 3 PHASE - 14 AWG TYPE: MTW
- 120 1 PHASE - 16 AWG TYPE: MTW
- 24 VDC - 16 AWG TYPE: MTW

WIRE COLOR

WIRE COLOR SHALL BE AS FOLLOWS:

POWER (480 VOLTS)

- GREEN - GROUND
- L1 - BROWN
- L2 - ORANGE
- L3 - YELLOW
- PHASE TAPED

CONTROL (120 VAC)

- RED - LOAD WIRES FOR ALL LOCAL CONTROL CIRCUITS
- WHITE - NEUTRAL FOR ALL LOCAL CONTROL CIRCUITS
- YELLOW - FOREIGN POWER IN PANEL
- WHITE W/ YELLOW STRIPE - NEUTRAL FOR FOREIGN POWER IN PANEL

CONTROL (24 VDC)

- BLUE - LOAD WIRES FOR ALL LOCAL CONTROL CIRCUITS
- WHITE W/BLUE STRIPE - COMMON FOR ALL LOCAL CONTROL CIRCUITS

CONNECTIONS

- 4.1 ALL CONNECTIONS SHALL BE POINT TO POINT WITHOUT SPLICES. EXCEPTIONS APPLY TO SOLENOIDS AND MOTORS AND FACTORY WIRED COMPONENTS.
- 4.2 ALL CONDUCTORS MUST BE MARKED WITH MACHINE PRINTED TAGS AT EACH TERMINATION. MARKERS SHALL BE OF HEAT SHRINK TYPE.

DOCUMENTATION

- 5.1 FABRICATOR SHALL PROVIDE ONE COPY OF ALL DOCUMENTS SUPPLIED WITH THE COMPONENTS SUPPLIED BY THE FABRICATOR. THIS INFORMATION INCLUDES BUT IS NOT LIMITED TO MANUFACTURERS SPECIFICATIONS, INSTALLATION MANUALS AND OPERATION MANUALS.
- 5.2 ANY OVIVO APPROVED CHANGES OR MARK-UPS TO THE SCHEMATICS, PANEL LAYOUTS AND ANY OTHER PERTAINING DOCUMENTS SHALL BE MAINTAINED AND DELIVERED TO OVIVO AT ACCEPTANCE OF THE PANEL.

TESTING


- 6.1 OVIVO ENGINEERS OR OVIVO APPROVED FABRICATOR, WILL PERFORM A POINT TO POINT CONTINUITY TEST ON THE PANEL.
- 6.2 WHEN APPLICABLE, THE FABRICATOR WILL ALSO PROVIDE POWER TO THE 480VAC OR 120VAC CIRCUITS WHERE APPLICABLE FOR VERIFICATION AND TESTING. FABRICATOR SHALL ALLOW A MINIMUM OF 2 HOURS OF ACCESS TO THE CONTROL PANEL BY ENGINEER FOR THIS AND PREVIOUSLY STATED TEST.

WIRING CONNECTIONS

- 7.1 INTERNAL PANEL WIRING
- 7.2 FIELD WIRING (NOT OVIVO SCOPE)
- 7.3 FIELD WIRING (PROVIDED BY OVIVO, INSTALLATION BY OTHERS)
- 7.4 COMMUNICATION

GENERAL DRAWING NOTES

480 VAC 3-PHASE POWER DISTRIBUTION

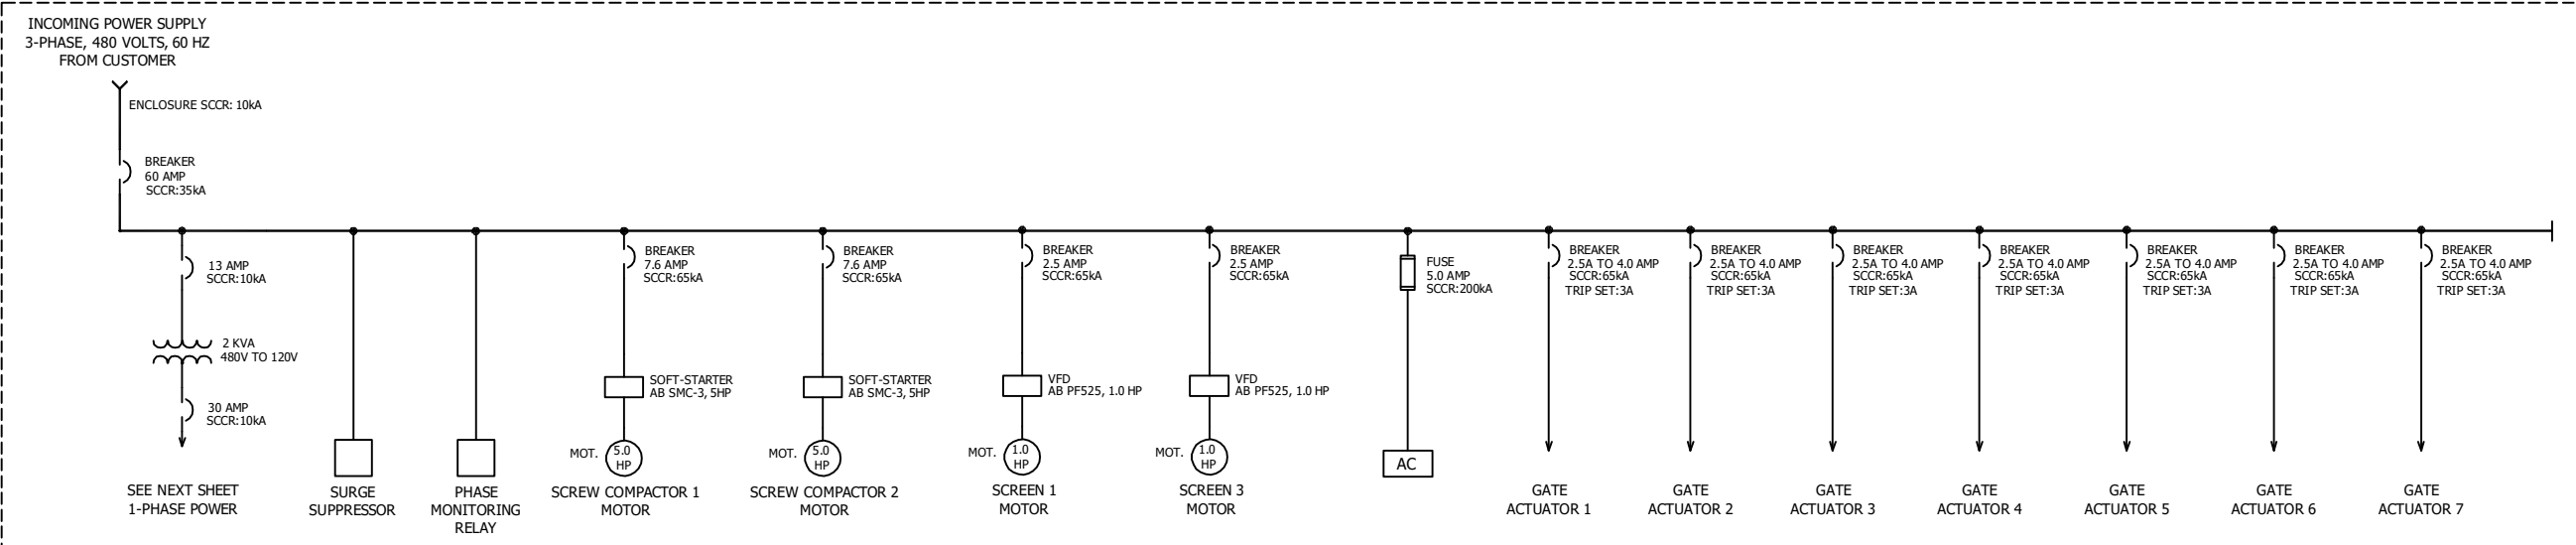

ONE LINE 480 VAC



D SIZE SHEET
(DO NOT SCALE PRINTS)


 **THIRD ANGLE PROJECTION**

CSW1927-121

SHEET
3 OF 23

THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY INFORMATION OF OMVO AND ITS AFFILIATES AND IS NOT TO BE DISCLOSED NOR TO BE USED EXCEPT FOR EVALUATING PROPOSALS OF OMVO OR INSTALLING, OPERATING OR MAINTAINING OMVO EQUIPMENT UNLESS OTHERWISE AUTHORIZED IN WRITING BY OMVO. UNCONTROLLED COPY IS PROHIBITED.

120 VAC 1-PHASE POWER DISTRIBUTION

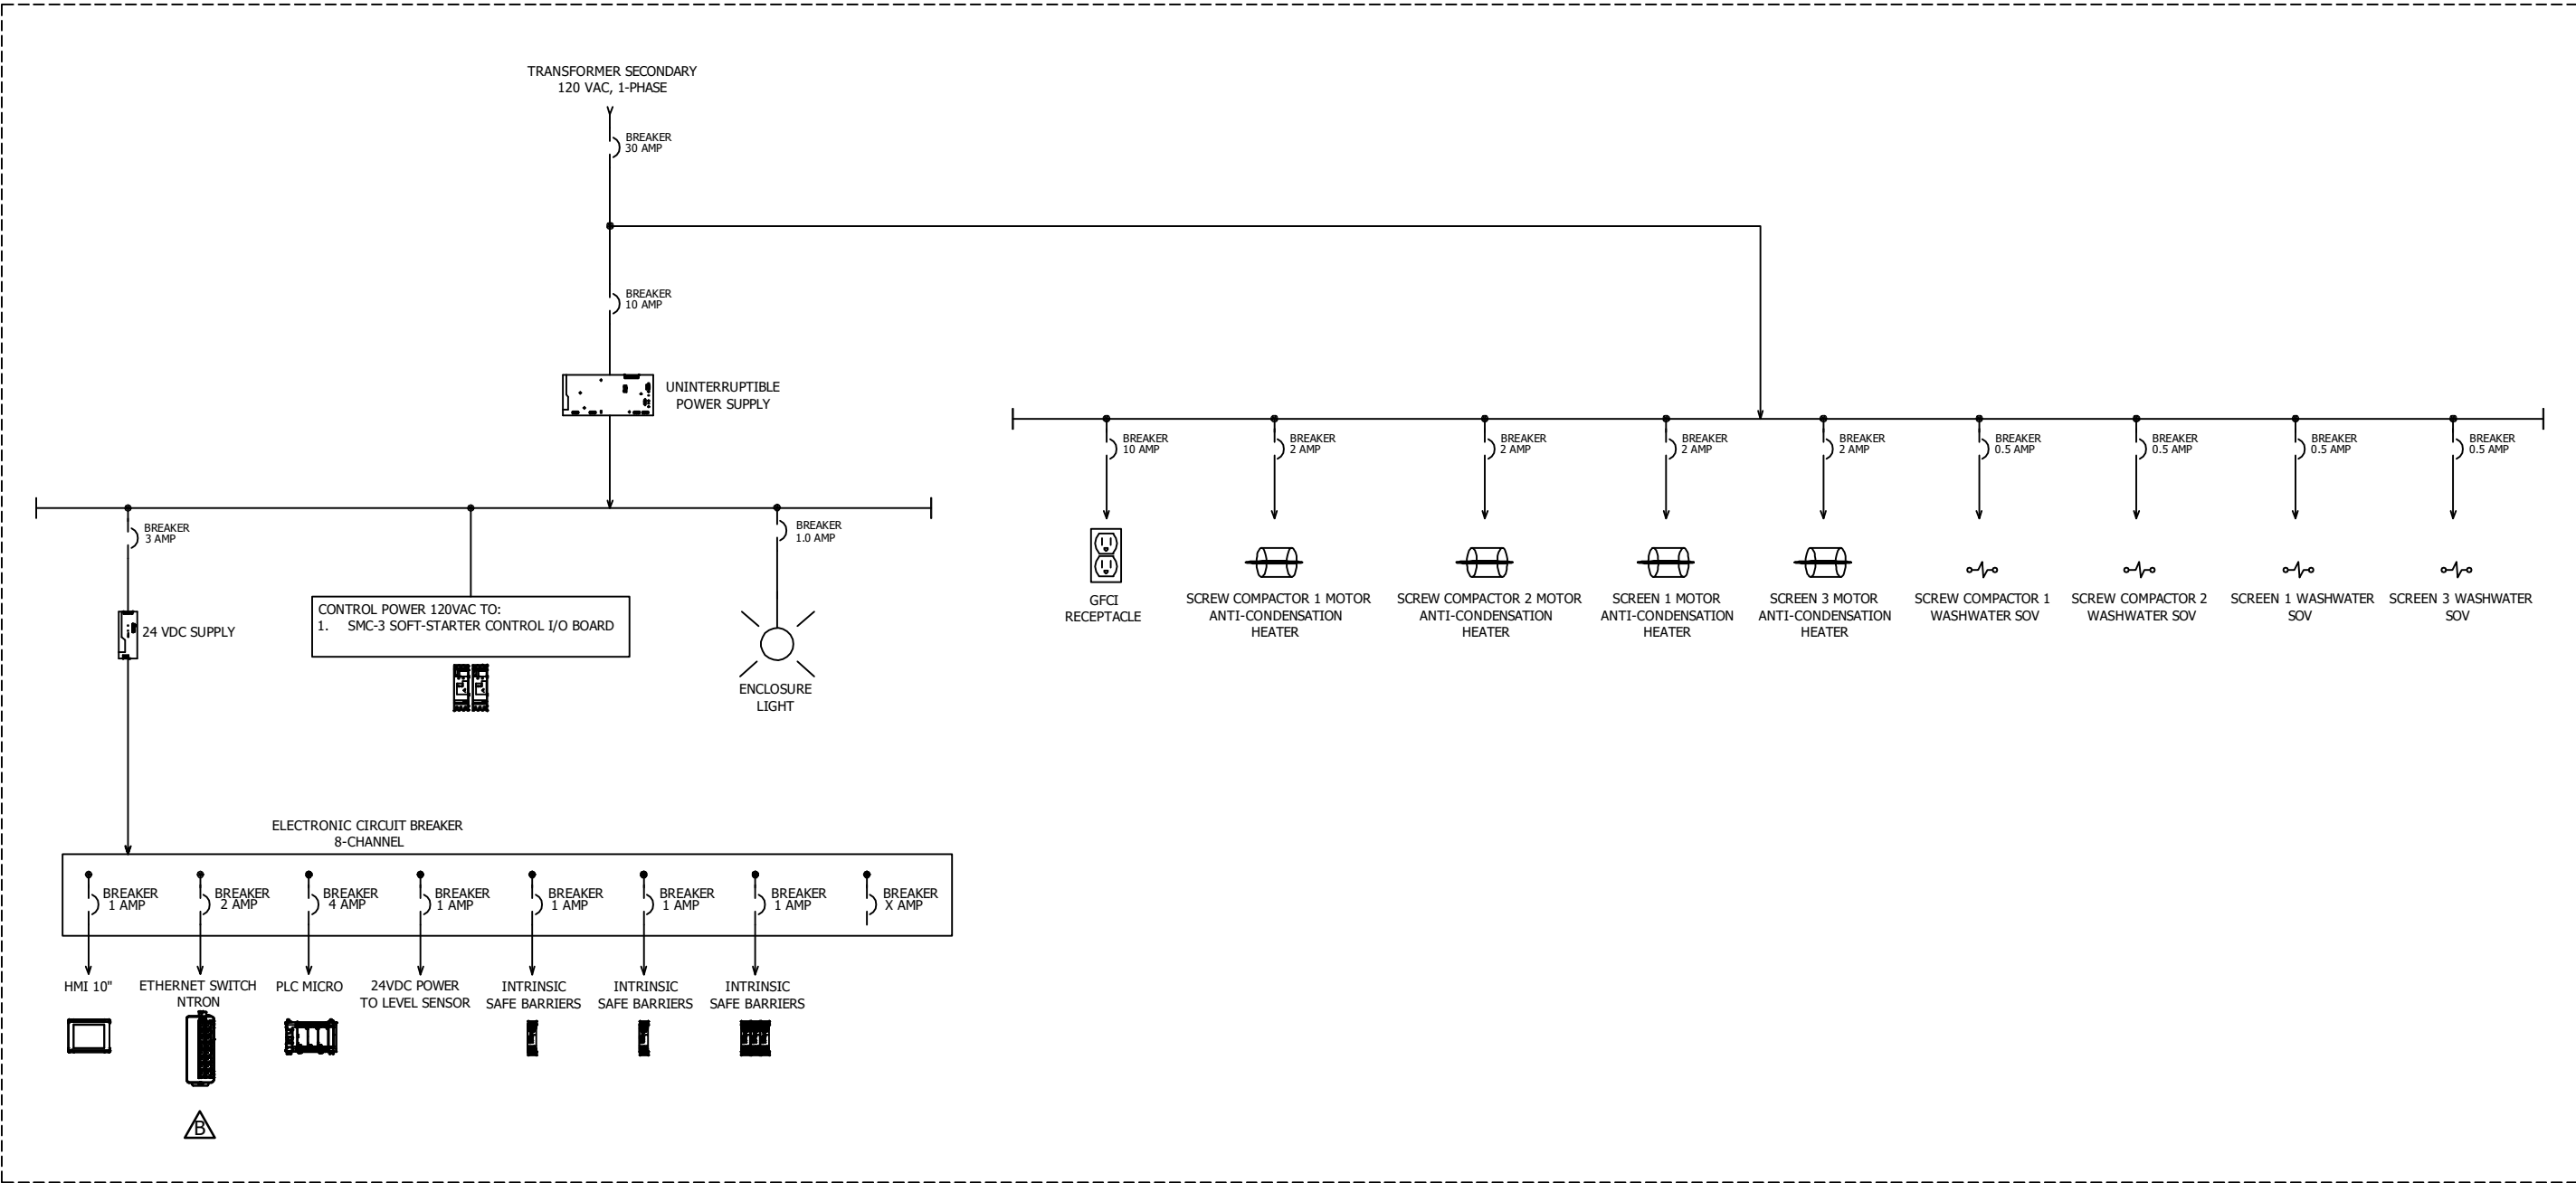

ONE LINE 120 VAC & 24VDC




CSW1927-121

SHEET 4 OF 23

REVISION B

THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY INFORMATION OF OVIVO AND ITS AFFILIATES AND IS NOT TO BE DISCLOSED NOR TO BE USED EXCEPT FOR EVALUATING PROPOSALS OF OVIVO OR INSTALLING, OPERATING OR MAINTAINING OVIVO EQUIPMENT UNLESS OTHERWISE AUTHORIZED IN WRITING BY OVIVO. UNCONTROLLED COPY & PRINTED. ALL RIGHTS RESERVED.

NETWORK COMMUNICATIONS LAYOUT

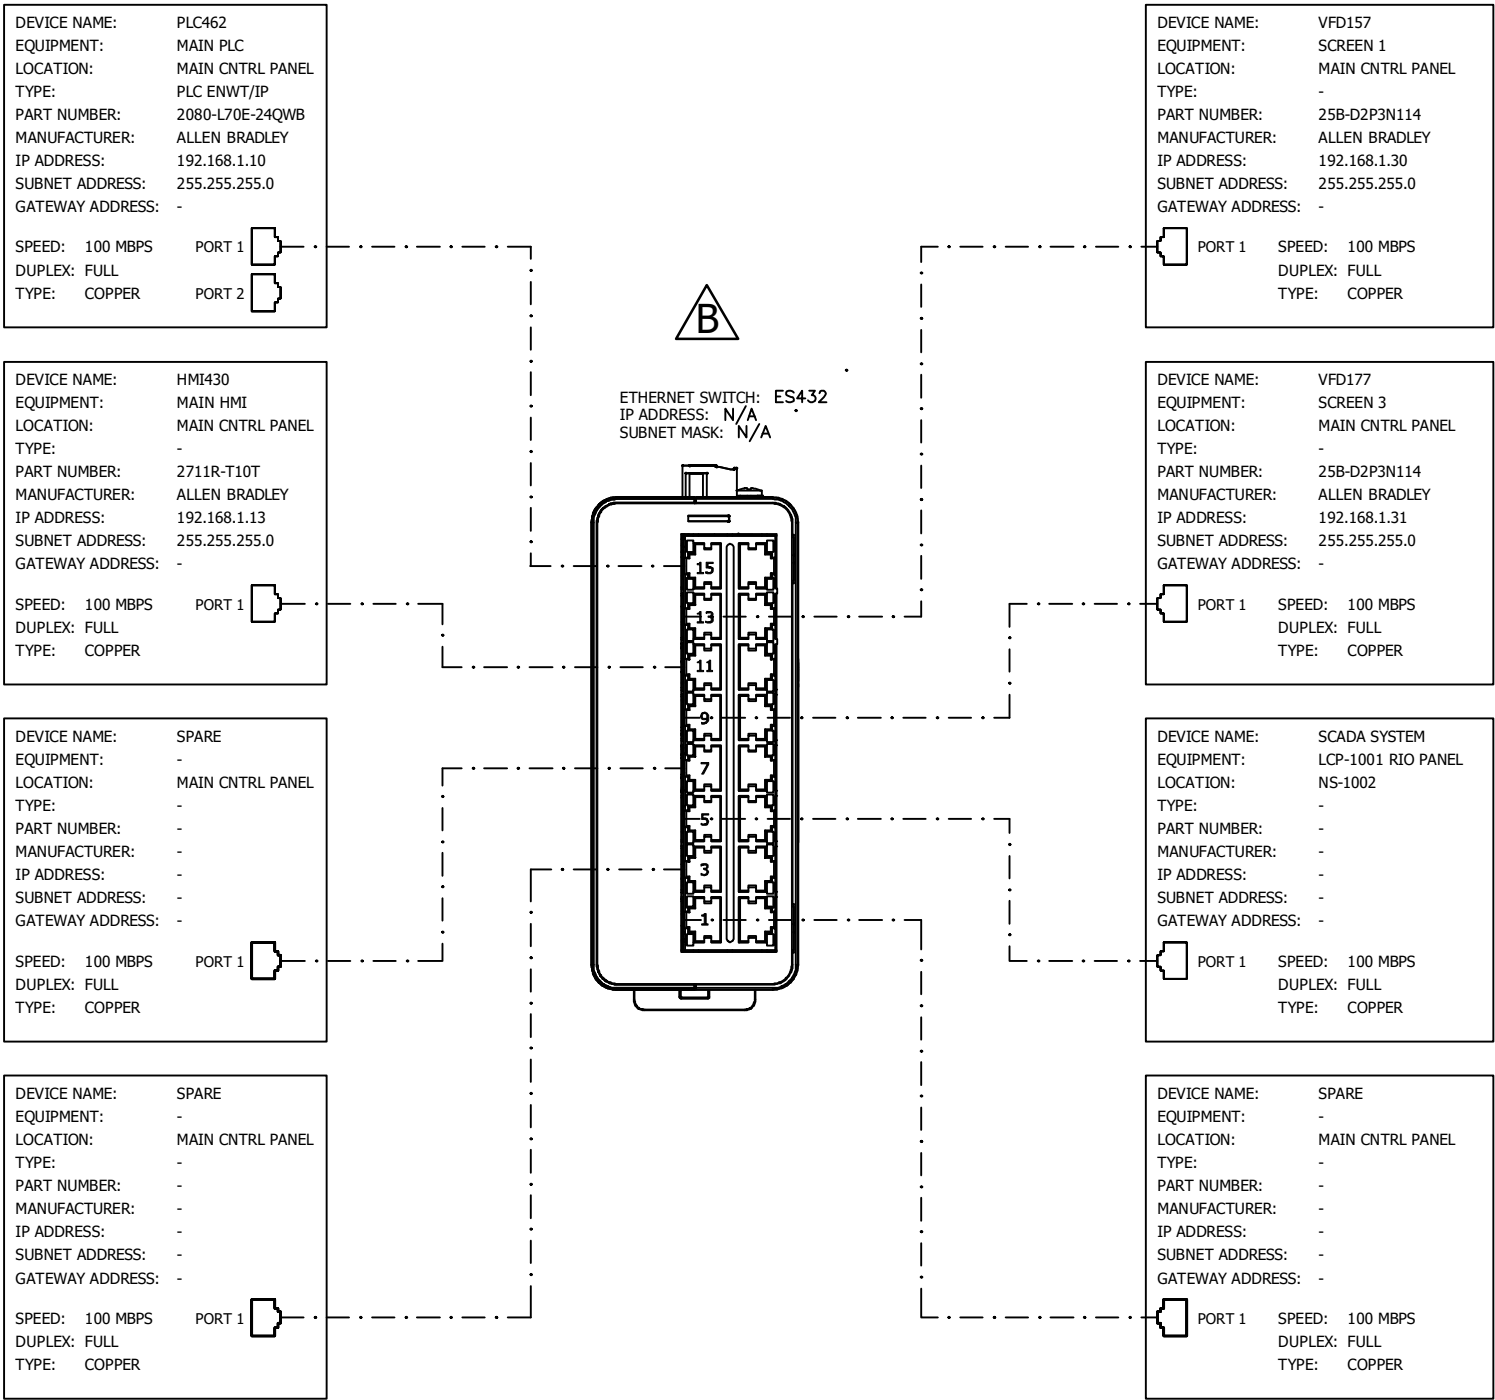

NETWORK LAYOUT INCLUDING IP ADDRESSES

NETWORK COMMUNICATIONS LAYOUT

FIELD INSTALLED

MAIN CONTROL PANEL (LCP-1100)

FIELD INSTALLED

DEVICE NAME: GATE ACT. 1110
EQUIPMENT: SCREEN 1 INLET
LOCATION: FROM FIELD
TYPE: -
PART NUMBER: 88-109
MANUFACTURER: BECK
IP ADDRESS: 192.168.1.50
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -

SPEED: 100 MBPS PORT 1
DUPLEX: FULL
TYPE: COPPER PORT 2

DEVICE NAME: GATE ACT. 1118
EQUIPMENT: SCREEN 1 OUTLET
LOCATION: FROM FIELD
TYPE: -
PART NUMBER: 88-109
MANUFACTURER: BECK
IP ADDRESS: 192.168.1.51
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -

SPEED: 100 MBPS PORT 1
DUPLEX: FULL
TYPE: COPPER PORT 2


DEVICE NAME: GATE ACT. 1120
EQUIPMENT: SCREEN 3 INLET
LOCATION: FROM FIELD
TYPE: -
PART NUMBER: 88-109
MANUFACTURER: BECK
IP ADDRESS: 192.168.1.52
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -

SPEED: 100 MBPS PORT 1
DUPLEX: FULL
TYPE: COPPER PORT 2

DEVICE NAME: GATE ACT. 1128
EQUIPMENT: SCREEN 3 OUTLET
LOCATION: FROM FIELD
TYPE: -
PART NUMBER: 88-109
MANUFACTURER: BECK
IP ADDRESS: 192.168.1.53
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -

SPEED: 100 MBPS PORT 1
DUPLEX: FULL
TYPE: COPPER PORT 2

FIELD WIRING BY OTHERS
(TYPICAL)

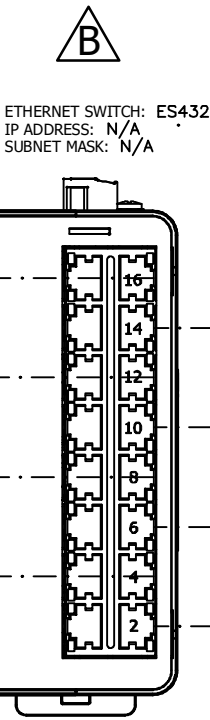

DEVICE NAME: GATE ACT. 1030
EQUIPMENT: FUT. SCREEN INLET
LOCATION: MAIN CNTRL PANEL
TYPE: -
PART NUMBER: 88-109
MANUFACTURER: BECK
IP ADDRESS: 192.168.1.54
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -

PORT 1 SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: GATE ACT. 1038
EQUIPMENT: FUT. SCREEN OUTLET
LOCATION: MAIN CNTRL PANEL
TYPE: -
PART NUMBER: 88-109
MANUFACTURER: BECK
IP ADDRESS: 192.168.1.55
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -

PORT 1 SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: GATE ACT. 1041
EQUIPMENT: LEVEL CONTROL WEIR
LOCATION: MAIN CNTRL PANEL
TYPE: -
PART NUMBER: 88-109
MANUFACTURER: BECK
IP ADDRESS: 192.168.1.56
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -










PORT 1 SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: SPARE
EQUIPMENT: -
LOCATION: MAIN CNTRL PANEL
TYPE: -
PART NUMBER: -
MANUFACTURER: -
IP ADDRESS: -
SUBNET ADDRESS: -
GATEWAY ADDRESS: -















PORT 1 SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

FIELD WIRING BY OTHERS
(TYPICAL)

NETWORK LAYOUT INCLUDING IP ADDRESSES CONTINUE

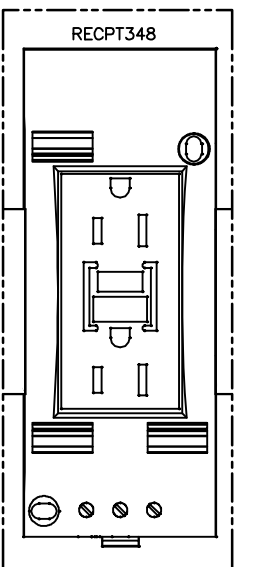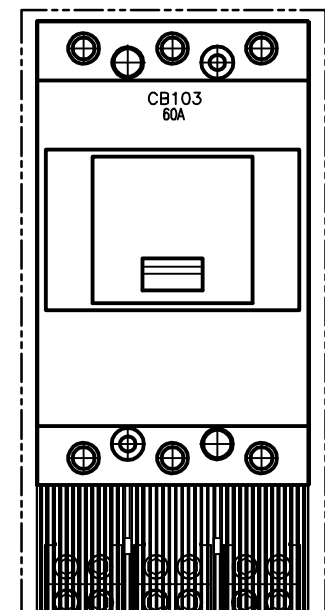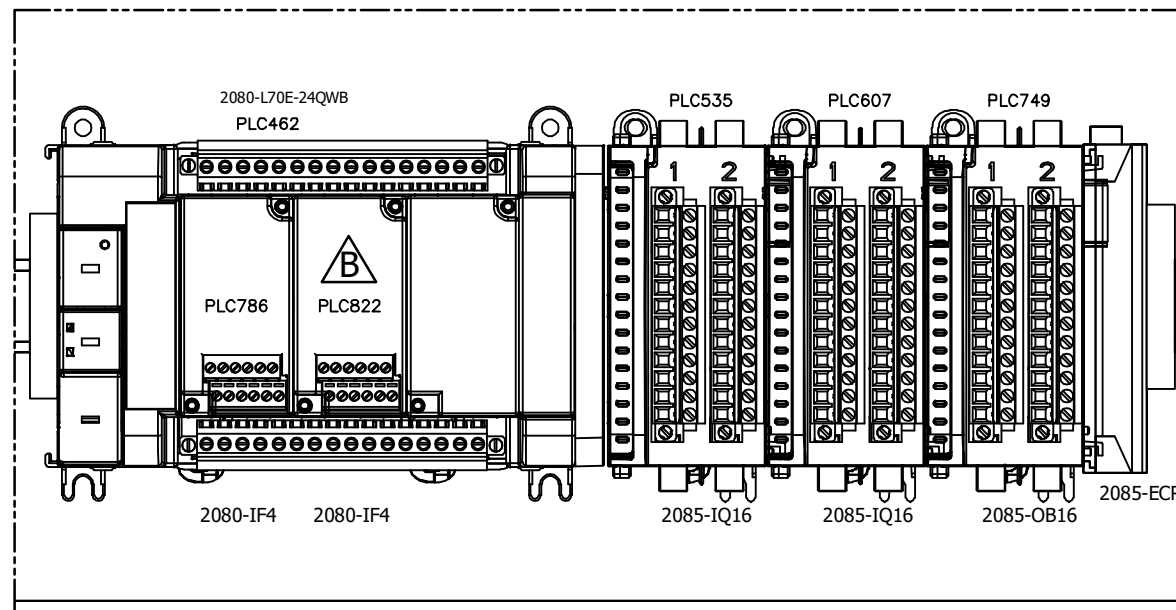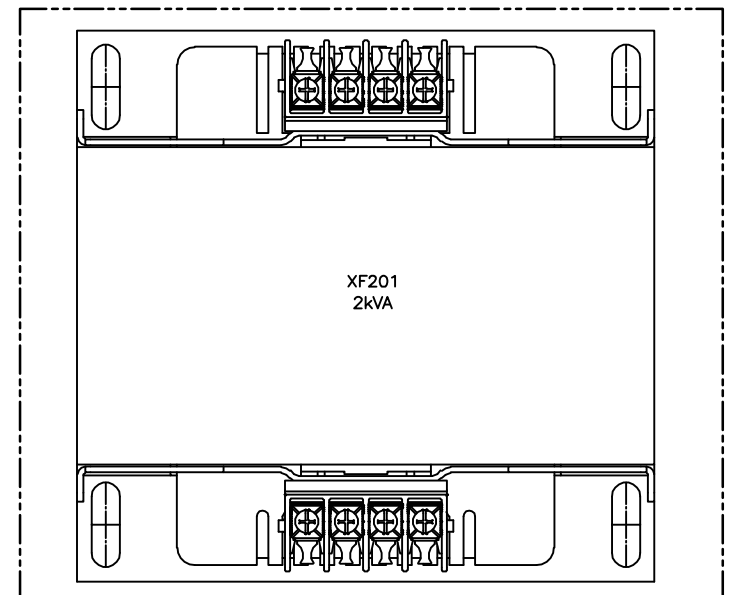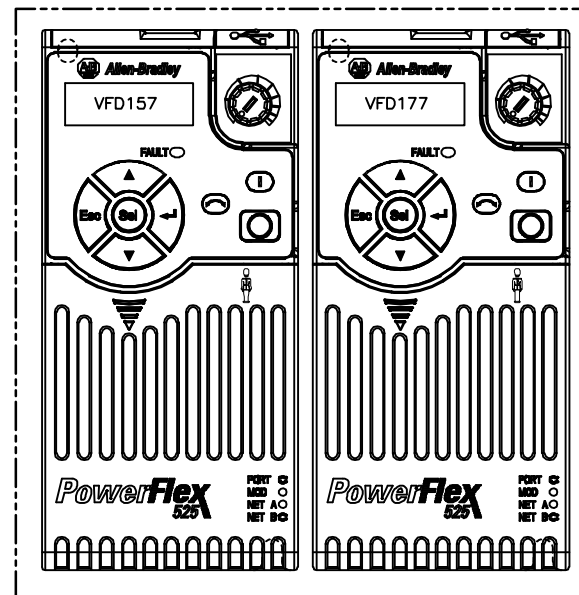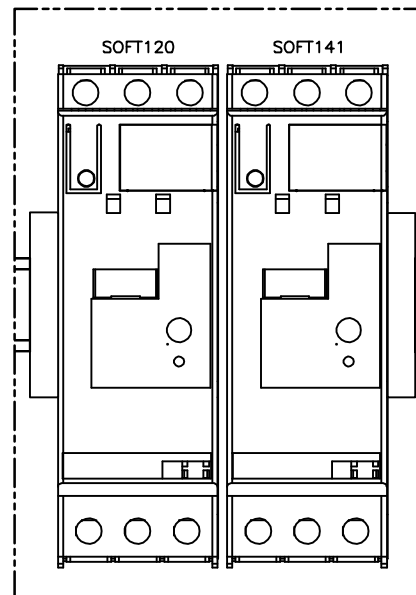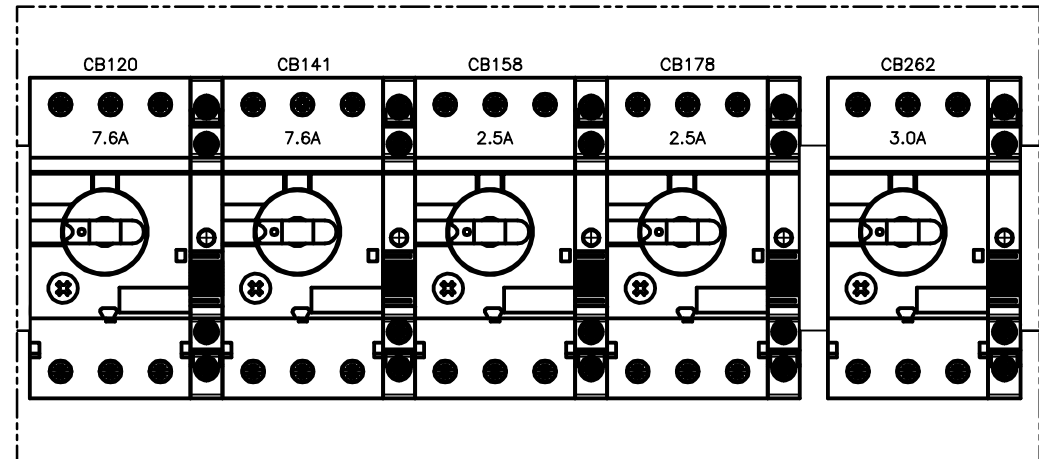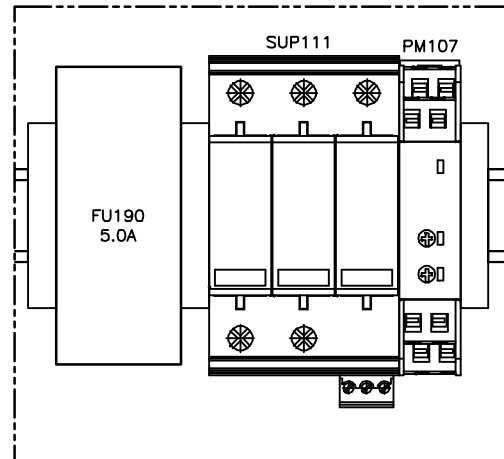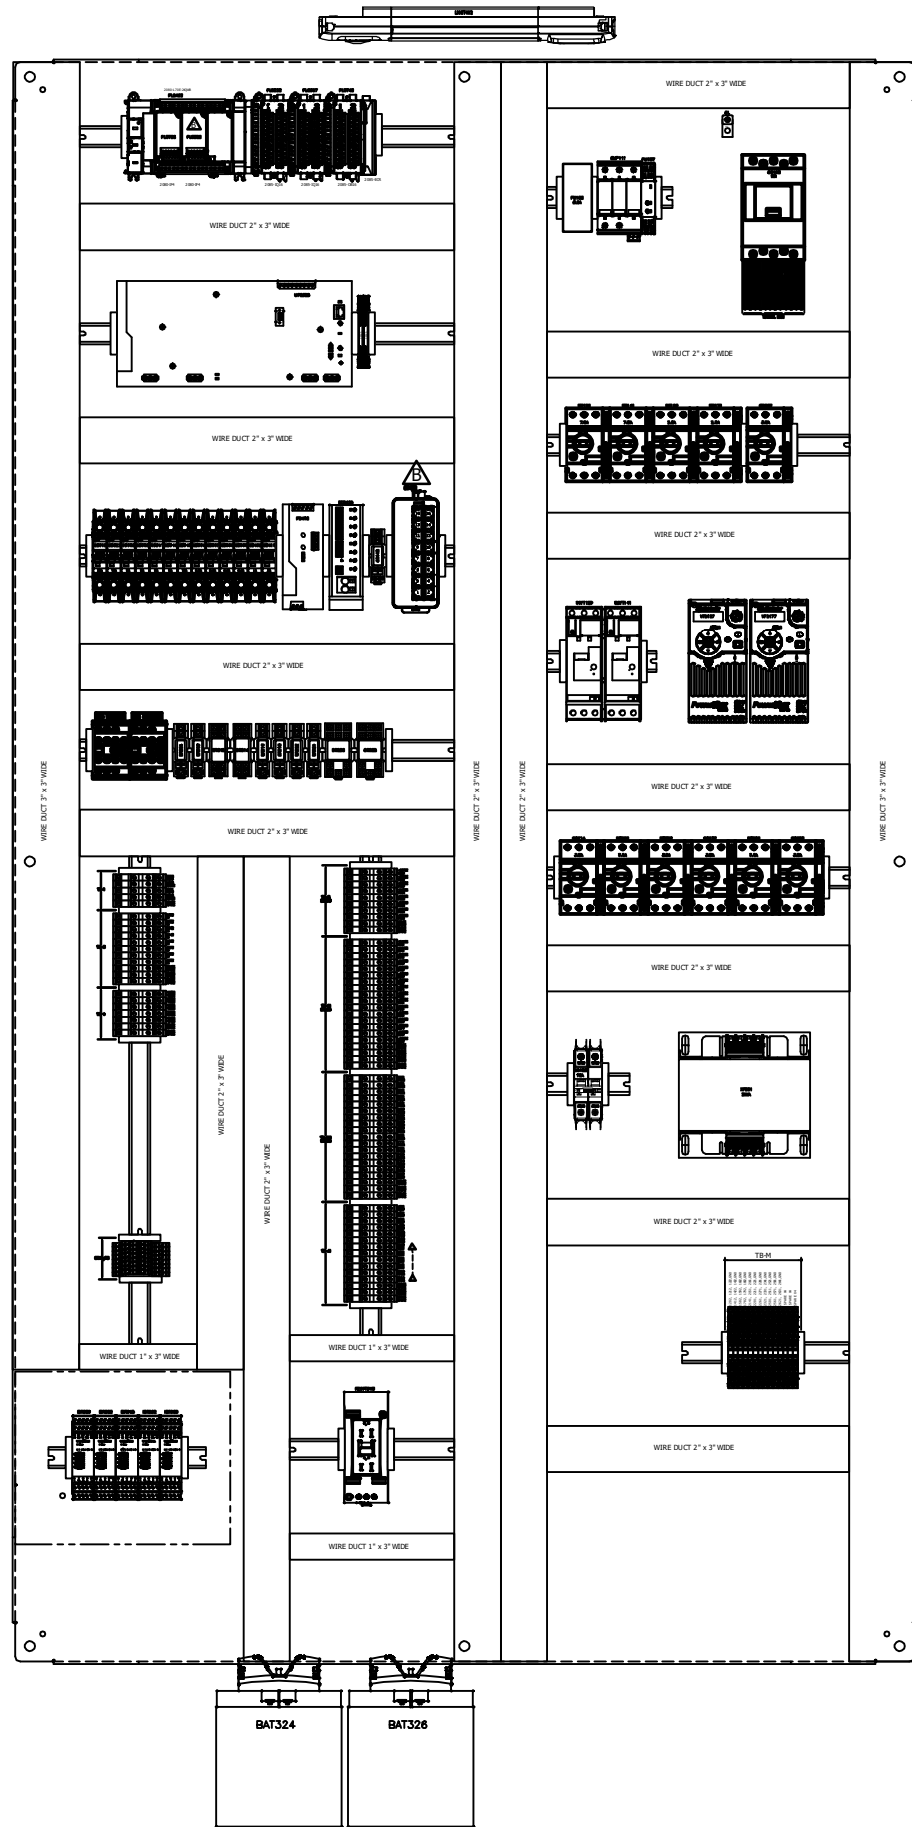

INTERIOR PANEL DETAIL VIEW SHEET 1

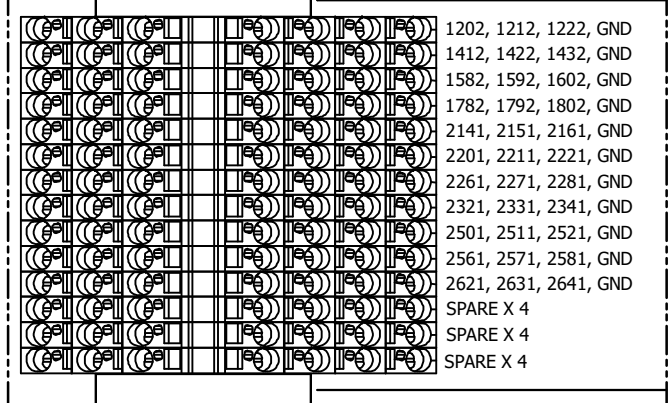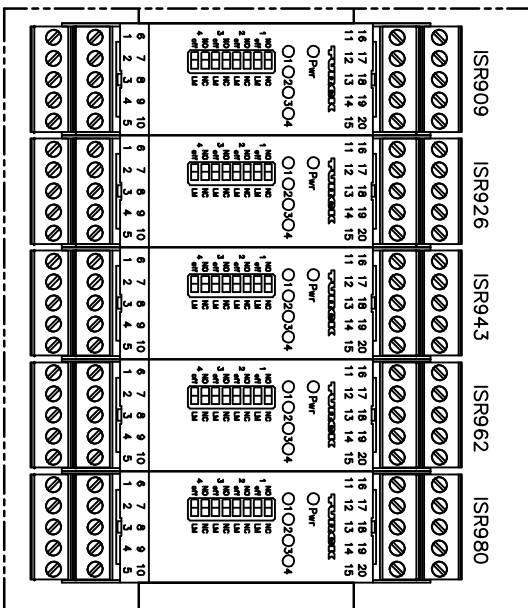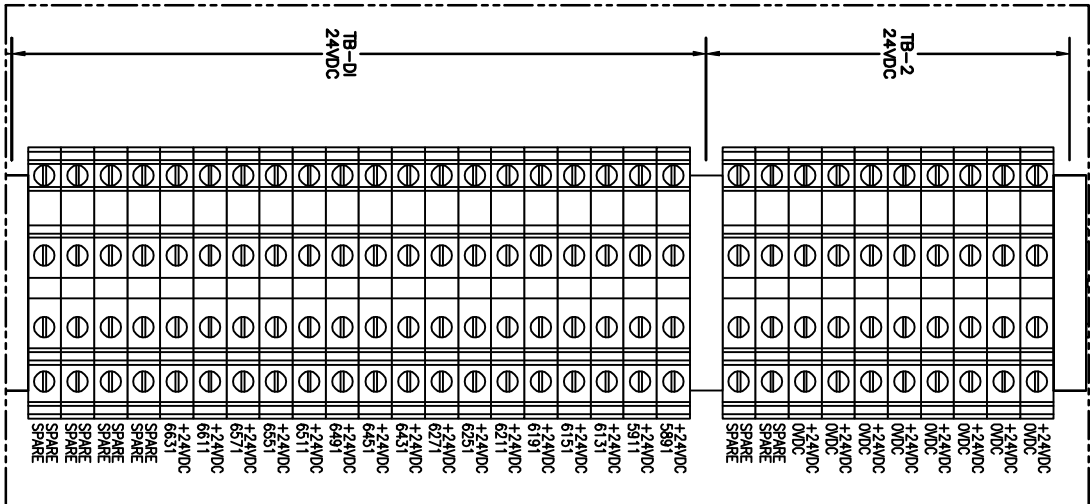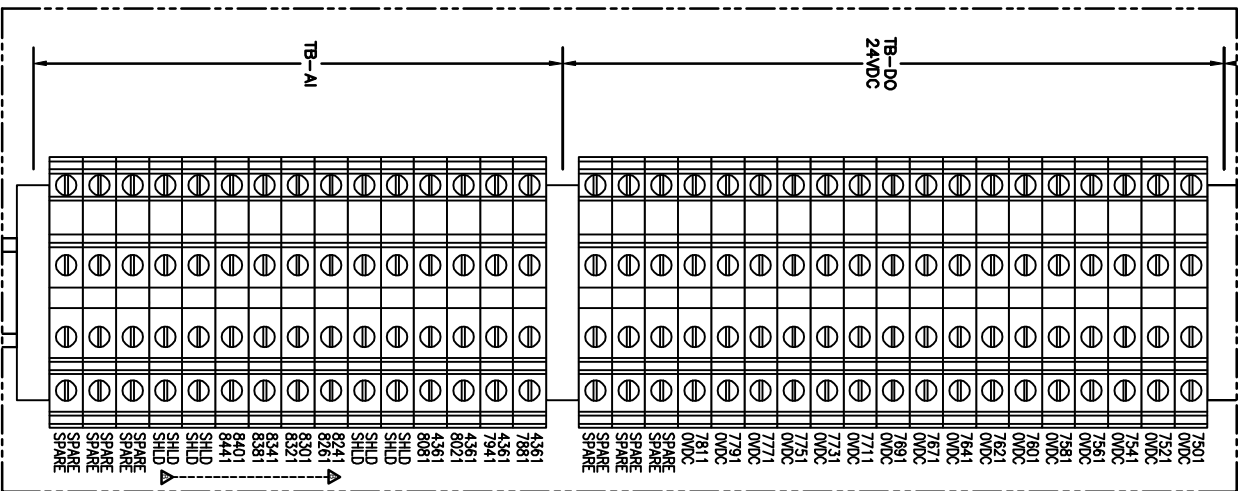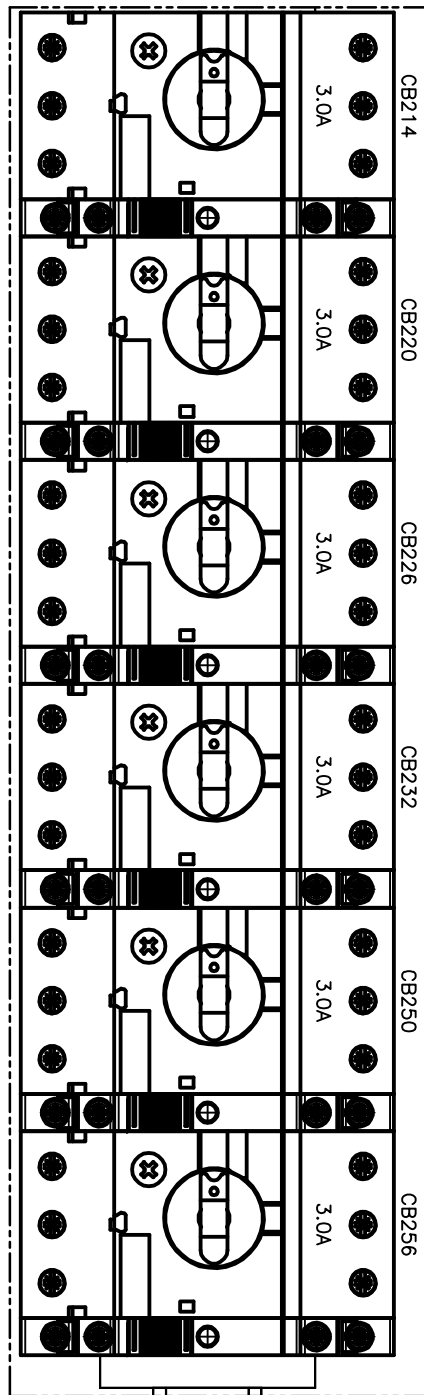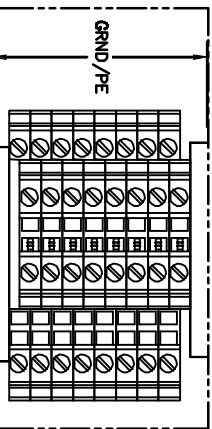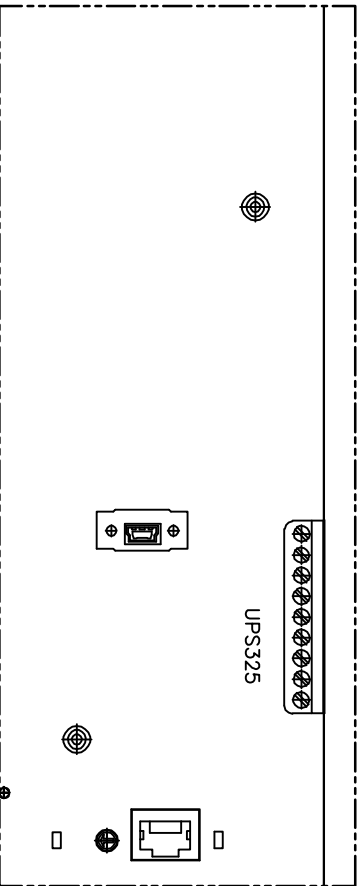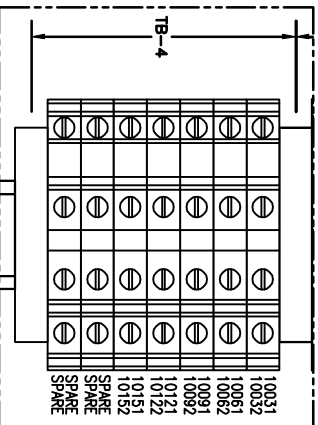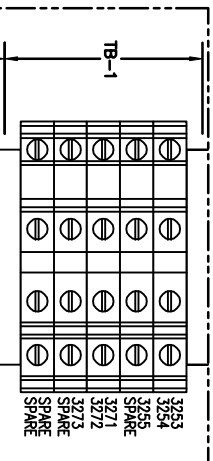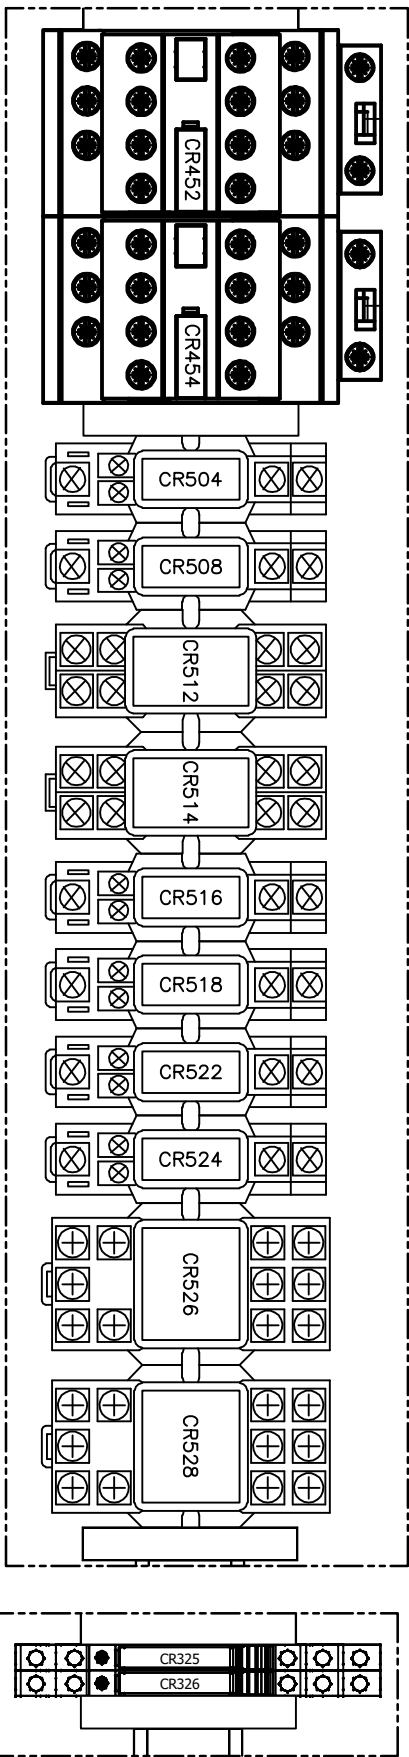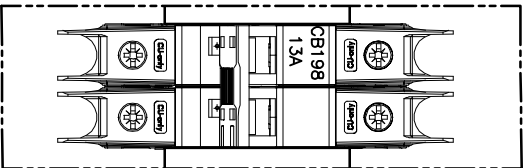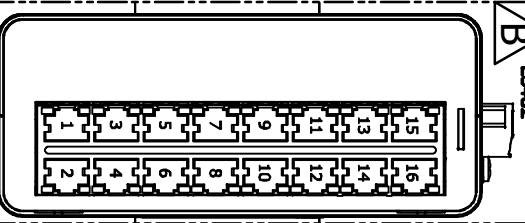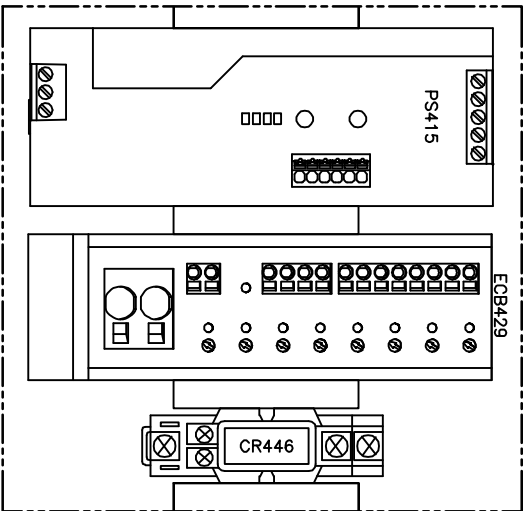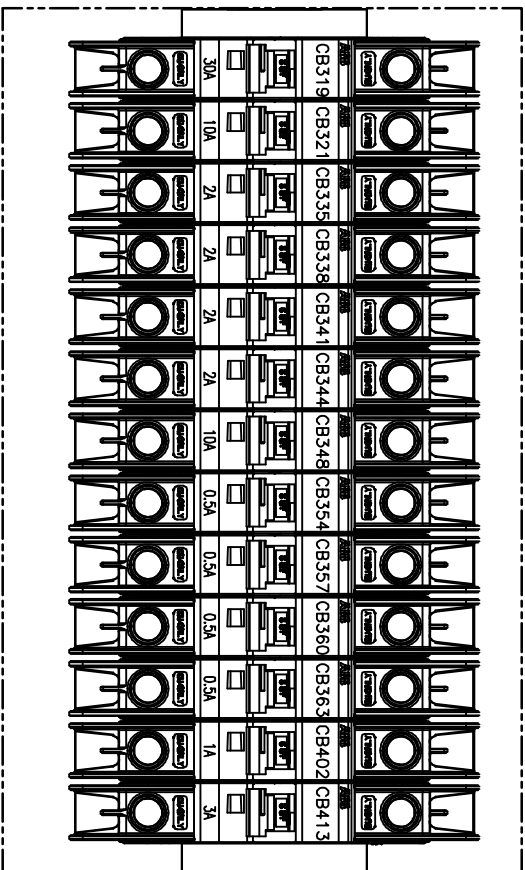

BILL OF MATERIALS

ITEM	QTY	TAG	CATALOG	MAKE	DESCRIPTION
1	1	ENCLOSURE	SCE-90EL4820SFSFD	SAGINAW	SS EL FSD DOUBLE DOOR ENCLOSURE, 90"X48"X20", SS304, NEMA 4X
2	1	ENCLOSURE ACCESSORY	SCE-90P48F1	SAGINAW	SUB-PANEL, FULL 78" x 44"
3	1	AC190	SCE-AC3400B460VSS	SAGINAW	AIR CONDITIONER, 3400 BTU/Hr, 460V AC
4	1	LIGHT402	SCE-LF18	SAGINAW	FIXTURE, LED LIGHT 120VAC
5	1	LS402	SCE-LSA	SAGINAW	ASSEMBLY, LIGHT SWITCH
6	1	CB103	XT1SU3060AFF000XXX	ABB	MOLDED CASE CIRCUIT BREAKER, THREE POLE, THERMAL MAGNETIC FIXED, 60 AMP, 480 VAC RATED, SCCR 35 kA, TYPE XT1
7	1	CB103	KXTARHE5500 KXTARHEHST	ABB	ADJUSTABLE DEPTH ROTARY HANDLE ROD, 500MM, RHE S SERIES ROTARY HANDLE EXTENDED RHE_HXT1..XT4EXT ROT HNDL
8	1	CB103	KXTBRHEBFP	ABB	RHE_B XT1->XT3 F/P BASE R.DIST.ADJ.ROT.HA
9	1	CB103	1SDA066921R1	ABB	KIT MC QuAl 6x2.5...35mm2XT1 3pcs MULTICABLE TERMINAL FOR CABLES
10	1	PM107	2903528	PHOENIX CONTACT	PHASE MONITORING RELAY, FOR PHASE SEQUENCE AND ASYMMETRY OF 3-PHASE VOLTAGES 480VAC, 1PDT, WITH SCREW CONNECTION
11	1	SUP111	2910386	PHOENIX CONTACT	TYPE 2 SURGE PROTECTION DEVICE, 3-CHANNEL WITH REMOTE INDICATOR CONTACT FOR 480 VAC DELTA
12	1	GROUND	KA2U	BURNDY	GROUND LUG
13	2	CB120, CB141	MS132-10 WITH MS132-SK1-11	ABB	MOTOR PROTECTION CIRCUIT BREAKER, STANDARD MAGNETIC TRIP, 65kA SCCR, 6.3...10 AMPS, WITH SIGNALLING CONTACT, 1 N.O. + 1 N.C. CONTACTS, RIGHT SIDE MOUNT
14	9	CB158, CB178, CB214, CB220, CB226, CB232, CB250, CB256, CB262	MS132-4.0 WITH MS132-SK1-11	ABB	MOTOR PROTECTION CIRCUIT BREAKER, STANDARD MAGNETIC TRIP, 65kA SCCR, 2.5...4.0 AMPS, WITH SIGNALLING CONTACT, 1 N.O. + 1 N.C. CONTACTS, RIGHT SIDE MOUNT
15	2	SOFT120, SOFT141	150-C16NBD	ROCKWELL AUTOMATION	SOFT STARTER SMC-3 SERIES, 480 VAC, 3-PHASE, 5...10 HP, 5.3...16 AMPS, 120VAC CONTROL VOLTAGE
16	2	VFD157, VFD177	25B-D2P3N114	ROCKWELL AUTOMATION	POWERFLEX 525 AC DRIVE, WITH EMBEDDED ETHERNET/IP, 480VAC, 3-PHASE, 1.0 HP, HEAVY DUTY, 2.3AMPS, FRAME A, OPEN TYPE, FILTER
17	1	FU190	CHCC2DIU	EATON	EATON BUSSMANN SERIES CHCC MODULAR FUSE HOLDER, 600VAC, 30 A, TWO-POLE, WITH INDICATOR
18	2	FU190	FNQ-R-5	BUSSMANN	EATON BUSSMANN SERIES FNQ-R FUSE, 5 A, CLASS CC, NON-INDICATING, FERRULE END X FERRULE END, 12 SEC AT 200%, 200 KAC, MELAMINE TUBE, STANDARD, 600 V
19	1	CB198	SU202M-K13	ABB	MINIATURE CIRCUIT BREAKER, 2-POLE, 13 AMP, SCCR: 10kA, K-CURVE
20	1	CB319	SU201M-K30	ABB	MINIATURE CIRCUIT BREAKER, 1-POLE, 30 AMP, SCCR: 10kA, K-CURVE
21	2	CB321, CB348	SU201M-K10	ABB	MINIATURE CIRCUIT BREAKER, 1-POLE, 10 AMP, SCCR: 10kA, K-CURVE
22	1	CB413	SU201M-K3	ABB	MINIATURE CIRCUIT BREAKER, 1-POLE, 3 AMP, SCCR: 10kA, K-CURVE
23	4	CB335, CB338, CB341, CB344	SU201M-K2	ABB	MINIATURE CIRCUIT BREAKER, 1-POLE, 2 AMP, SCCR: 10kA, K-CURVE
24	1	CB402	SU201M-K1	ABB	MINIATURE CIRCUIT BREAKER, 1-POLE, 1 AMP, SCCR: 10kA, K-CURVE
25	4	CB354, CB357, CB360, CB363	SU201M-K0.5	ABB	MINIATURE CIRCUIT BREAKER, 1-POLE, 0.5 AMP, SCCR: 10kA, K-CURVE
26	1	XF201	SP2000ACP	HAMMOND	INDUSTRIAL CONTROL TRANSFORMER, PRIMARY 240/480 VOLTS, SECONDARY 120/115/110 VAC, RATING 2KVA, 60HZ, SCREW TERMINALS
27	2 SETS	XF201	SPFG1	HAMMOND	FINGER-GUARDS FOR TRANSFORMER
28	1	UPS325	2320283	PHOENIX CONTACT	UNINTERRUPTABLE POWER SUPPLY, QUINT 4, 1 PHASE aC TO 1 PHASE AC, 1 KVA
29	2	BAT324, BAT326	1348516	PHOENIX CONTACT	ENERGY STORAGE (BATTERY UNIT) FOR UPS, 24VDC, 20AH
30	2	BAT324, BAT326	2320788	PHOENIX CONTACT	BATTERY MOUNTING KIT
31	1	PS415	2904601	PHOENIX CONTACT	Primary-switched QUINT POWER power supply with free choice of output characteristic curve, SFB (selective fuse breaking) technology, and NFC interface, input: 1-phase, output: 24 V DC/10 A
32	1	ECB429	2905744	PHOENIX CONTACT	8 CHANNEL ELECTRONICS CIRCUIT BREAKER WITH ACTIVE CURRENT LIMITATION FOR PROTECTING EIGHT LOADS ATA 24V DC IN THE EVENT OF OVERLOAD AND SHORT CIRCUIT. WITH NORMAL CURRENT ASSISTANT AND ELECTRONICS LOCKING OF THE SET NOMINAL CURRENTS, FOR INSTALLATION ON DIN RAILS.
33	5	ISR909, ISR926, ISR943, ISR962, ISR980	IML-451EX-R	TURCK	ISOLATING SWITCHING AMPLIFIER, 4-CHANNEL
34	1	PLC462	2080-L70E-24QWB	ROCKWELL AUTOMATION	PROGRAMMABLE CONTROLLER, MICRO 870, ETHERNET I/P CONTROLLER 24 POINT, 14 X 24 VOLT DC INPUTS, 10 RELAY OUTPUTS, 24 VOLT DC, FIXED TERMINAL
35	2	PLC535, PLC607	2085-IQ16	ROCKWELL AUTOMATION	MICRO800 INPUT MODULE, DIGITAL, 16 POINT, 12/24VDC, SINK/SOURCE
36	1	PLC749	2085-OB16	ROCKWELL AUTOMATION	MICRO800 OUTPUT MODULE, DIGITAL, 16 POINT, 12/24VDC, SOURCE
37	2	PLC786, PLC822	2080-IF4	ROCKWELL AUTOMATION	MICRO800 4 POINT ANALOG INPUT MODULE PLUG IN
38	1	PLC ACCESSORY	2085-ECR	ROCKWELL AUTOMATION	MICRO800 EXPANSION MODULE END CAP
39	1	HMI430	2711R-T10T	ROCKWELL AUTOMATION	OPERATOR INTERFACE, PANELVIEW 800, 10", HMI TERMINAL, TOUCH SCREEN TFT
40	1	ES432	NT116	NTRON	NT-116 UNMANAGED INDUSTRIAL ETHERNET SWITCH, 16-PORTS, HIGH PERFORMANCE 10/100 BASE TX COPPER PORTS
41	1	PB452	AVD301NUR	IDEC	MUSHROOM HEAD BUTTON, NEMA 4X/13 RED, PUSH LOCK-TURN RESET, WITH (1) N.C. CONTACT
42	1	PB452	GRAVOPLY ULTRA	GRAVOGRAPH	DOOR OPERATOR TAG
43	2	CR452, CR454	AFS09-30-22-11	ABB	AFS SERIES, ABB SAFETY CONTACTOR SERIES AFS09-30-22-11, 20-60VDC CONTACTOR
44	2	CR526, CR528	RH3B-ULCDC24V/ WITH SH3B-05 SOCKET	IDEC	CONTROL RELAY, 3PDT, 10 AMP CONTACT RATING, 24VDC COIL VOLTAGE, WITH INDICATOR AND CHECK BUTTON
45	2	CR512, CR514	RH2B-ULCDC24V/ WITH SH2B-05 SOCKET	IDEC	CONTROL RELAY, 2PDT, 10 AMP CONTACT RATING, 24VDC COIL VOLTAGE, WITH INDICATOR AND CHECK BUTTON
46	7	CR446, CR504, CR508, CR516, CR518, CR522, CR524	RH1B-ULCDC24V/ WITH SH1B-05 SOCKET	IDEC	CONTROL RELAY, SPDT, 10 AMP CONTACT RATING, 24VDC COIL VOLTAGE, WITH INDICATOR AND CHECK BUTTON
47	2	CR325, CR326	2966171	PHOENIX CONTACT	TERMINAL STYLE PLC RELAY, 1PDT, 24VDC COIL VOLTAGE, 250VAC SWITCHING VOLTAGE, WITH LED INDICATING LIGHT
48	1	RECPT348	1263628	PHOENIX CONTACT	DOUBLE SOCKET, (GFCI CLASS A), PIN CONNECTOR PATTERN TYPE AB 15A, SCREW CONNECTION, GRAY, 125 V AC (60 HZ), 15 A, DIN RAIL OR DIRECT MOUNTING, UL 508A
49	88	TB-1, TB-2, TB-3, TB-4, TB-DI, TB-DO, TB-AI	2770011	PHOENIX CONTACT	DOUBLE-LEVEL TERMINAL BLOCK, SCREW CONNECTION, GRAY, 24 AMP, 500 V
50	7	ALL TBs END	2770024	PHOENIX CONTACT	END COVER

ITEM	QTY	TAG	CATALOG	MAKE	DESCRIPTION
51	8	GROUND TB AS SHOWN	3044665	PHOENIX CONTACT	DOUBLE LEVEL TERMINAL BLOCK, GROUND BLOCK
52	1	AS SHOWN	3047293	PHOENIX CONTACT	END COVER, FOR GROUND TERMINAL BLOCK
53	48	AS REQUIRED	0800886	PHOENIX CONTACT	END CLAMP
54	A/R	AS REQUIRED	0807012	PHOENIX CONTACT	DIN-RAIL, NS 35/7.5, PERFORATED, 1 M
55	14	TB-M	3038338	PHOENIX CONTACT	MOTOR TERMINAL BLOCK, 4-LEVEL, 28 AMP RATED CURRENT
56	A/R	WIRE DUCT	TYD1X3WPW6 WITH COVER TYD1CPW6	THOMAS & BETTS BY ABB	WIDE SLOT WIRING DUCT, PVC, 1 INCHES X 3 INCHES, WHITE WITH COVER
57	A/R	WIRE DUCT	TYD2X3WPW6 WITH COVER TYD2CPW6	THOMAS & BETTS BY ABB	WIDE SLOT WIRING DUCT, PVC, 2 INCHES X 3 INCHES, WHITE WITH COVER
58	A/R	WIRE DUCT	TYD3X3WPW6 WITH COVER TYD3CPW6	THOMAS & BETTS BY ABB	WIDE SLOT WIRING DUCT, PVC, 3 INCHES X 3 INCHES, WHITE WITH COVER
59	1	ENCLOSURE NAMEPLATE	679001	OVIVO PROPRIETARY TAG	ENCLOSURE NAMEPLATE
60	1	ENCLOSURE TAG	49046A	OVIVO PROPRIETARY TAG	DANGER TAG
61	1	ENCLOSURE TAG	592273	OVIVO PROPRIETARY TAG	ENCLOSURE IDENTIFICATION TAG "LCP-1100 SCREENING CONTROL PANEL" ENGRAVE AS SHOWN
62	A/R	ETHERNET PATCH CORD	BY FABRICATOR	SHOP MAKE BY FABRICATOR	CAT5e F/UTP RATED FOR 600V

BILL OF MATERIALS



D SIZE SHEET
(DO NOT SCALE PICTURES)



1"=4'-0"

CSW1927-121

SHEET 10 OF 23



REVISION

© 2024 OVIVO

ALL RIGHTS RESERVED

THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY INFORMATION OF OVIVO AND ITS AFFILIATES AND IS NOT TO BE DISCLOSED NOR TO BE USED EXCEPT FOR EVALUATING PROPOSALS OF OVIVO ON INSTALLING, OPERATING OR MAINTAINING OVIVO EQUIPMENT UNLESS OTHERWISE AUTHORIZED IN WRITING BY OVIVO. UNCONTROLLED COPY IS PROHIBITED.

480 VAC, 3-PHASE, 60HZ
POWER SUPPLY INPUT FROM CUSTOMER

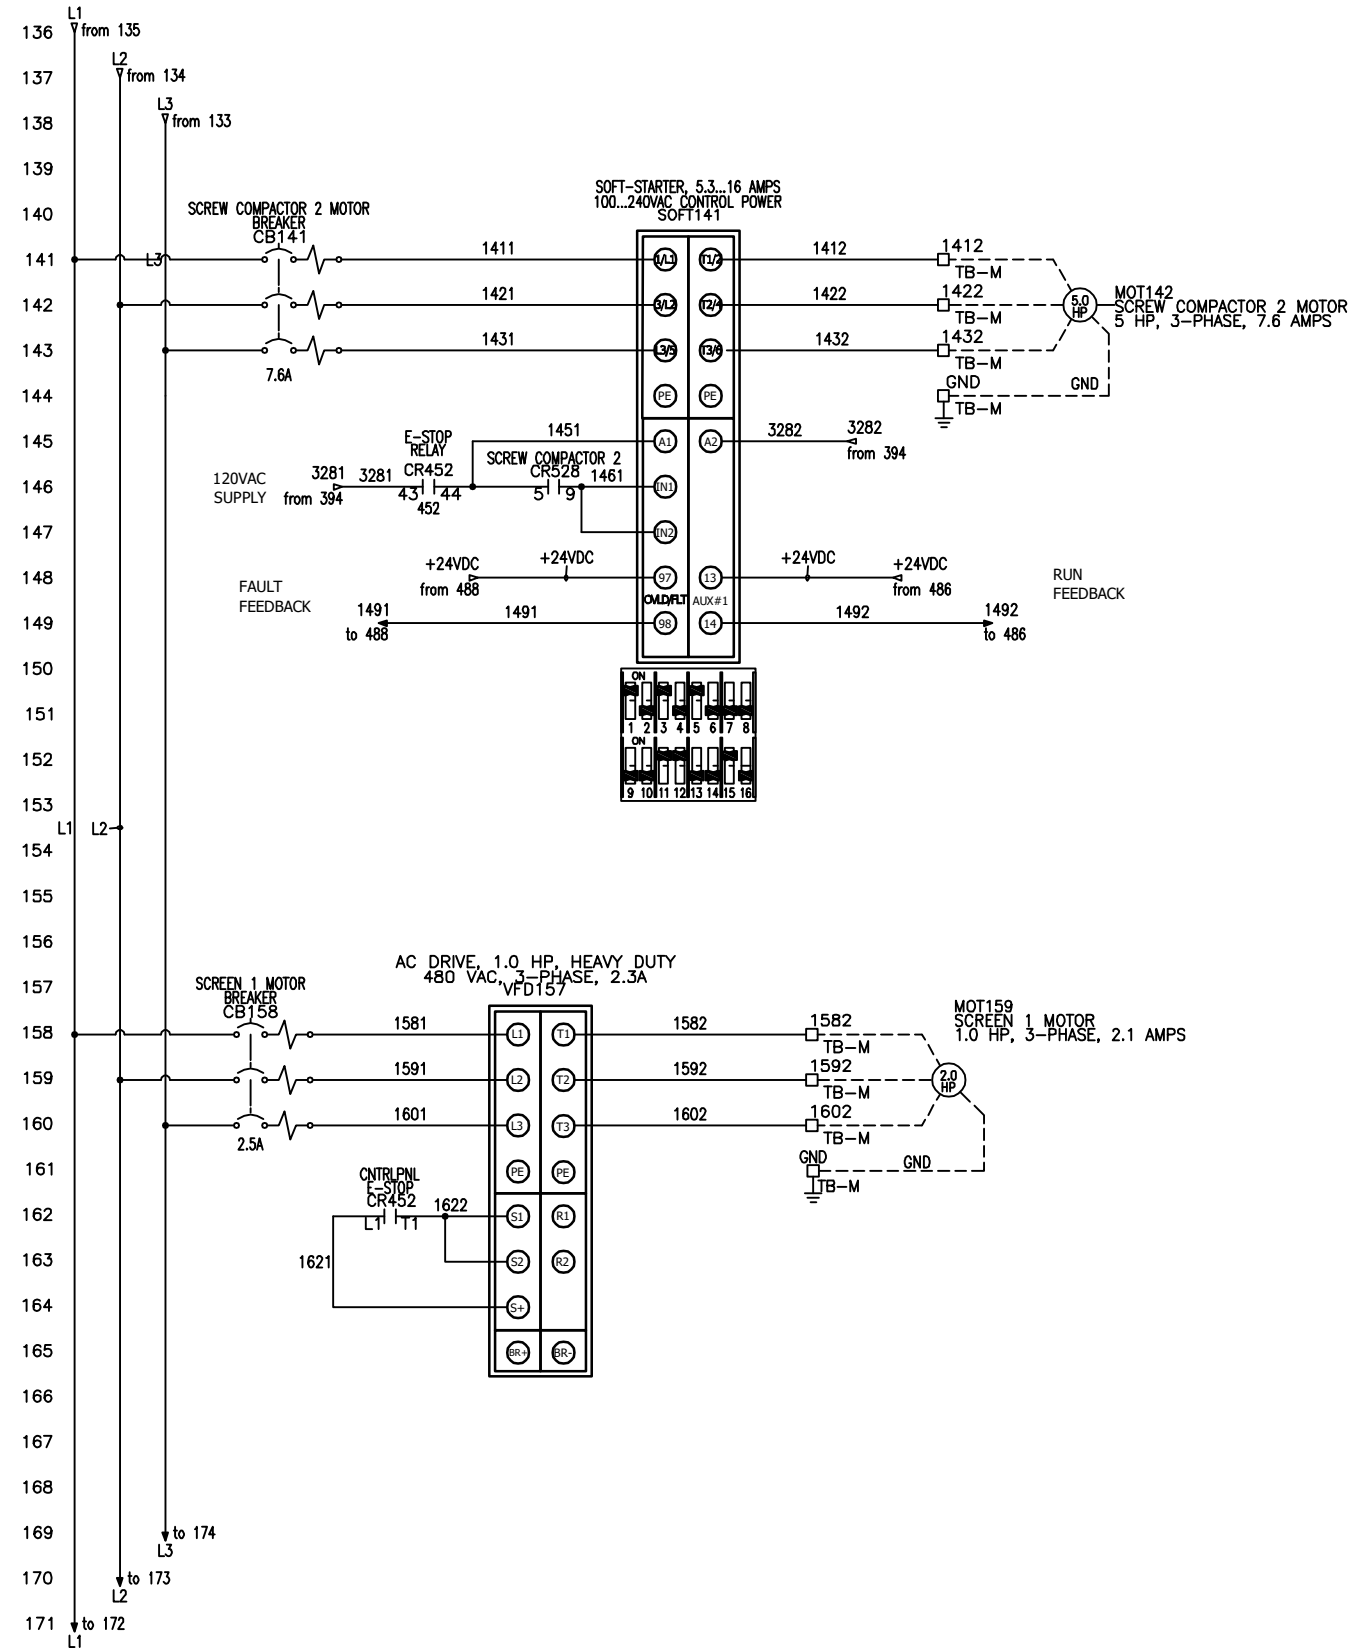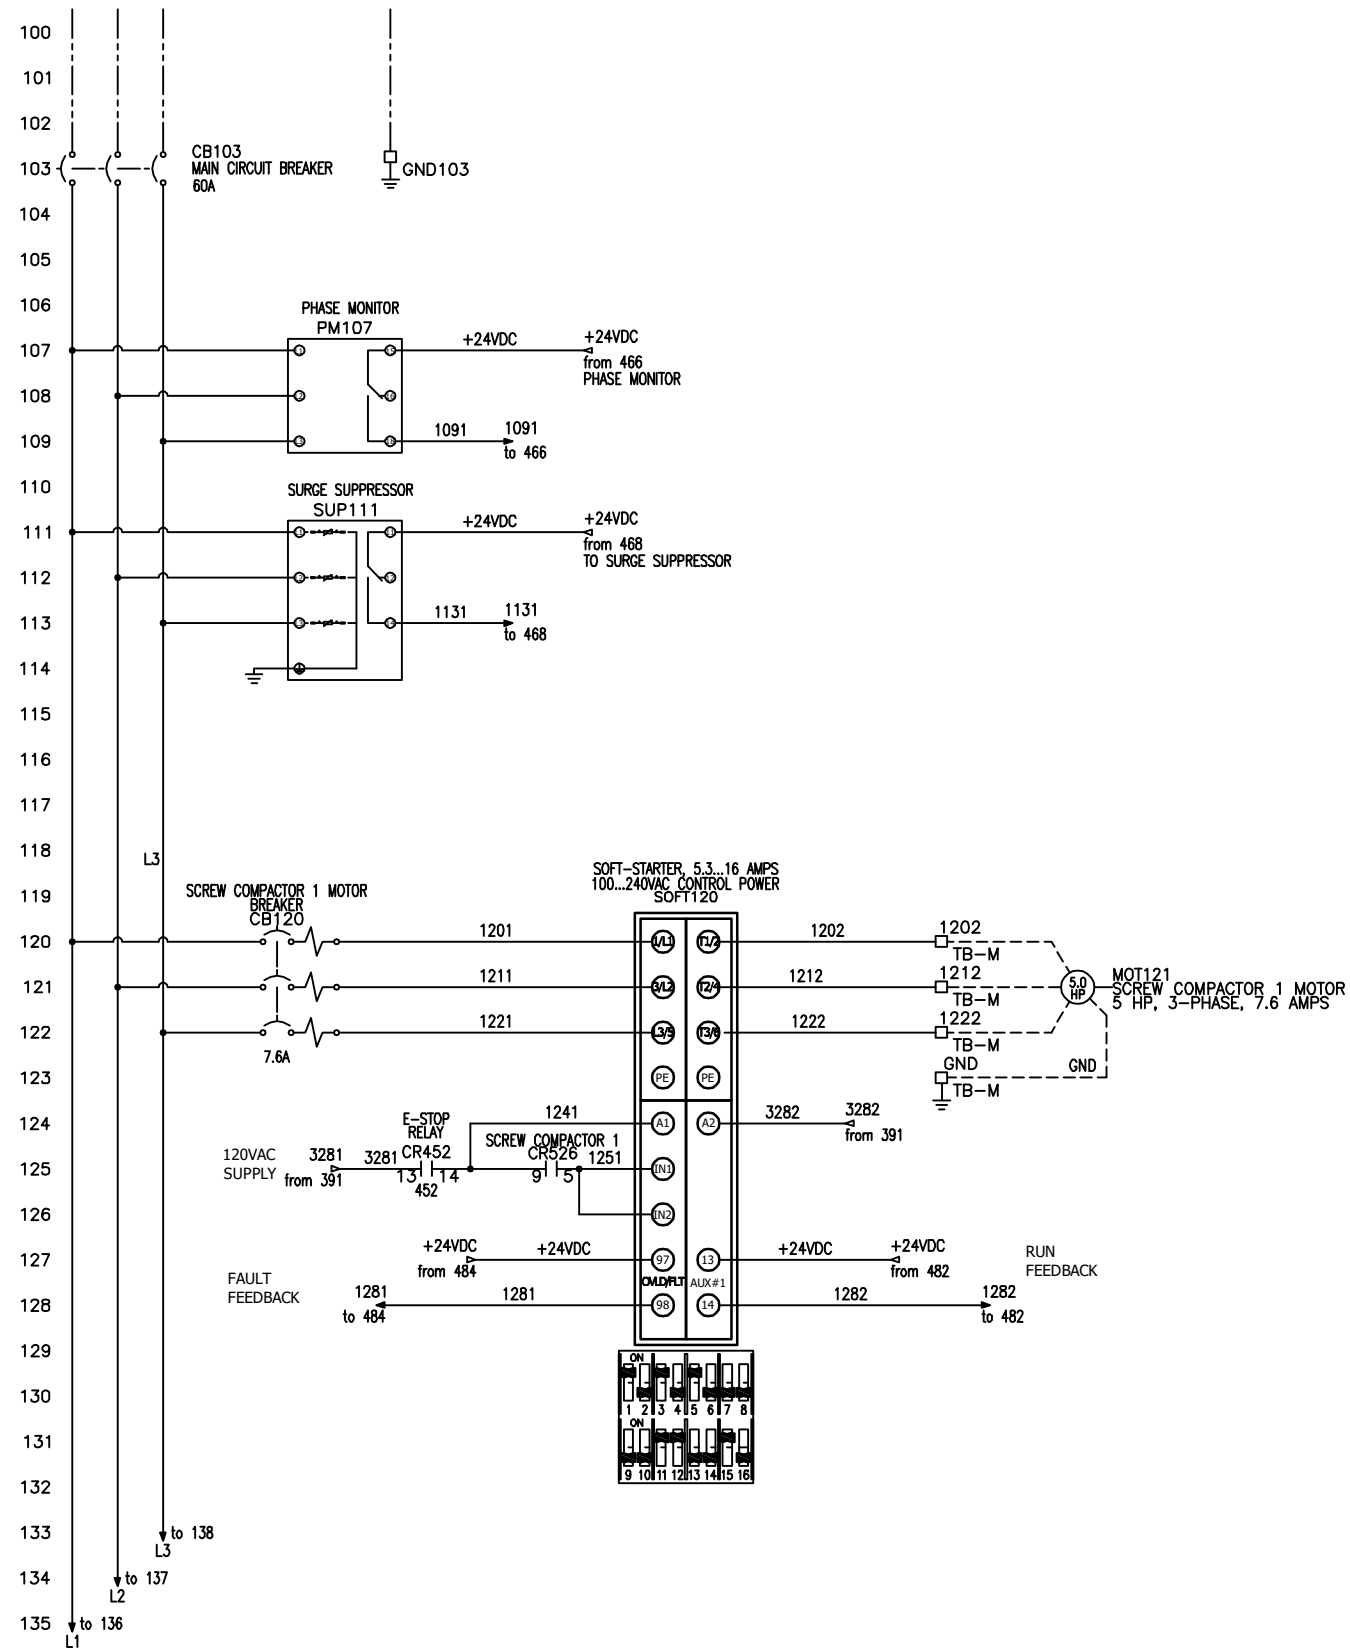

MAIN POWER SCHEMATIC 1





CSW1927-121

SHEET 11 OF 23

REVISION B

THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY INFORMATION OF OVVO AND ITS AFFILIATES AND IS NOT TO BE DISCLOSED NOR TO BE USED EXCEPT FOR EVALUATING PROPOSALS OF OVVO OR INSTALLING, OPERATING OR MAINTAINING OVVO EQUIPMENT UNLESS OTHERWISE AUTHORIZED IN WRITING BY OVVO. UNCONTROLLED COPY & PRINTED. ALL RIGHTS RESERVED.

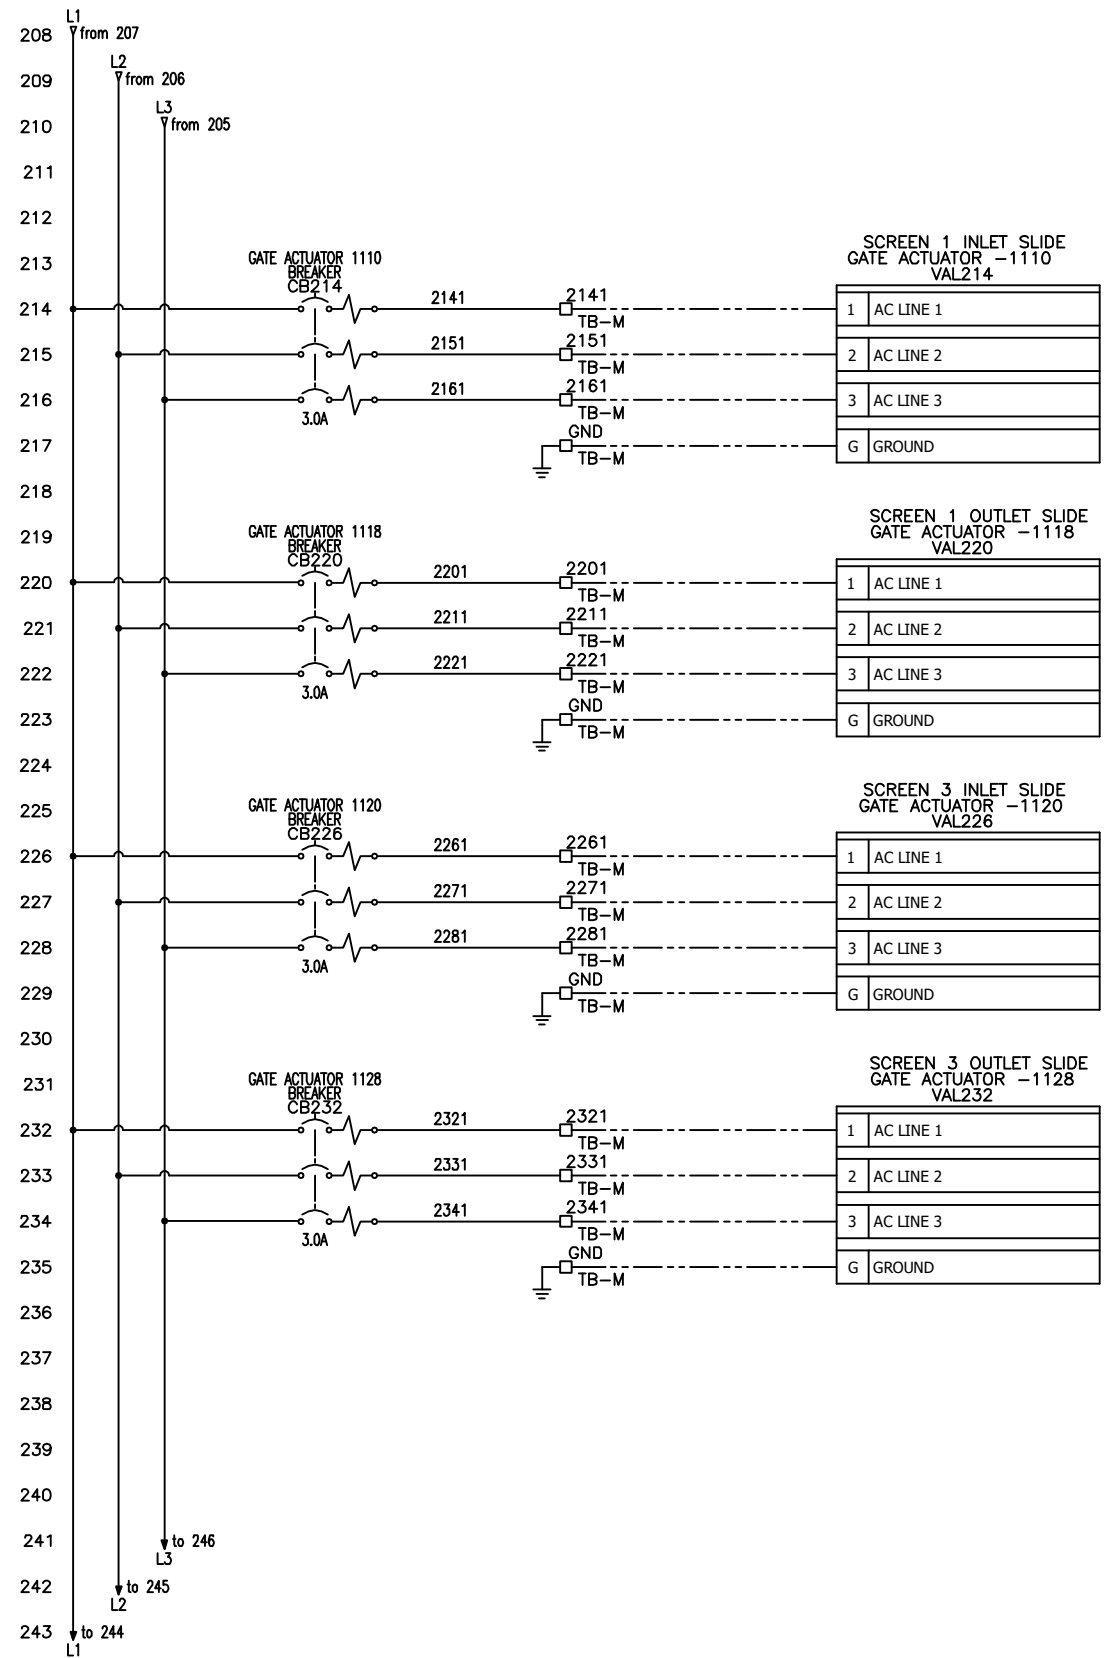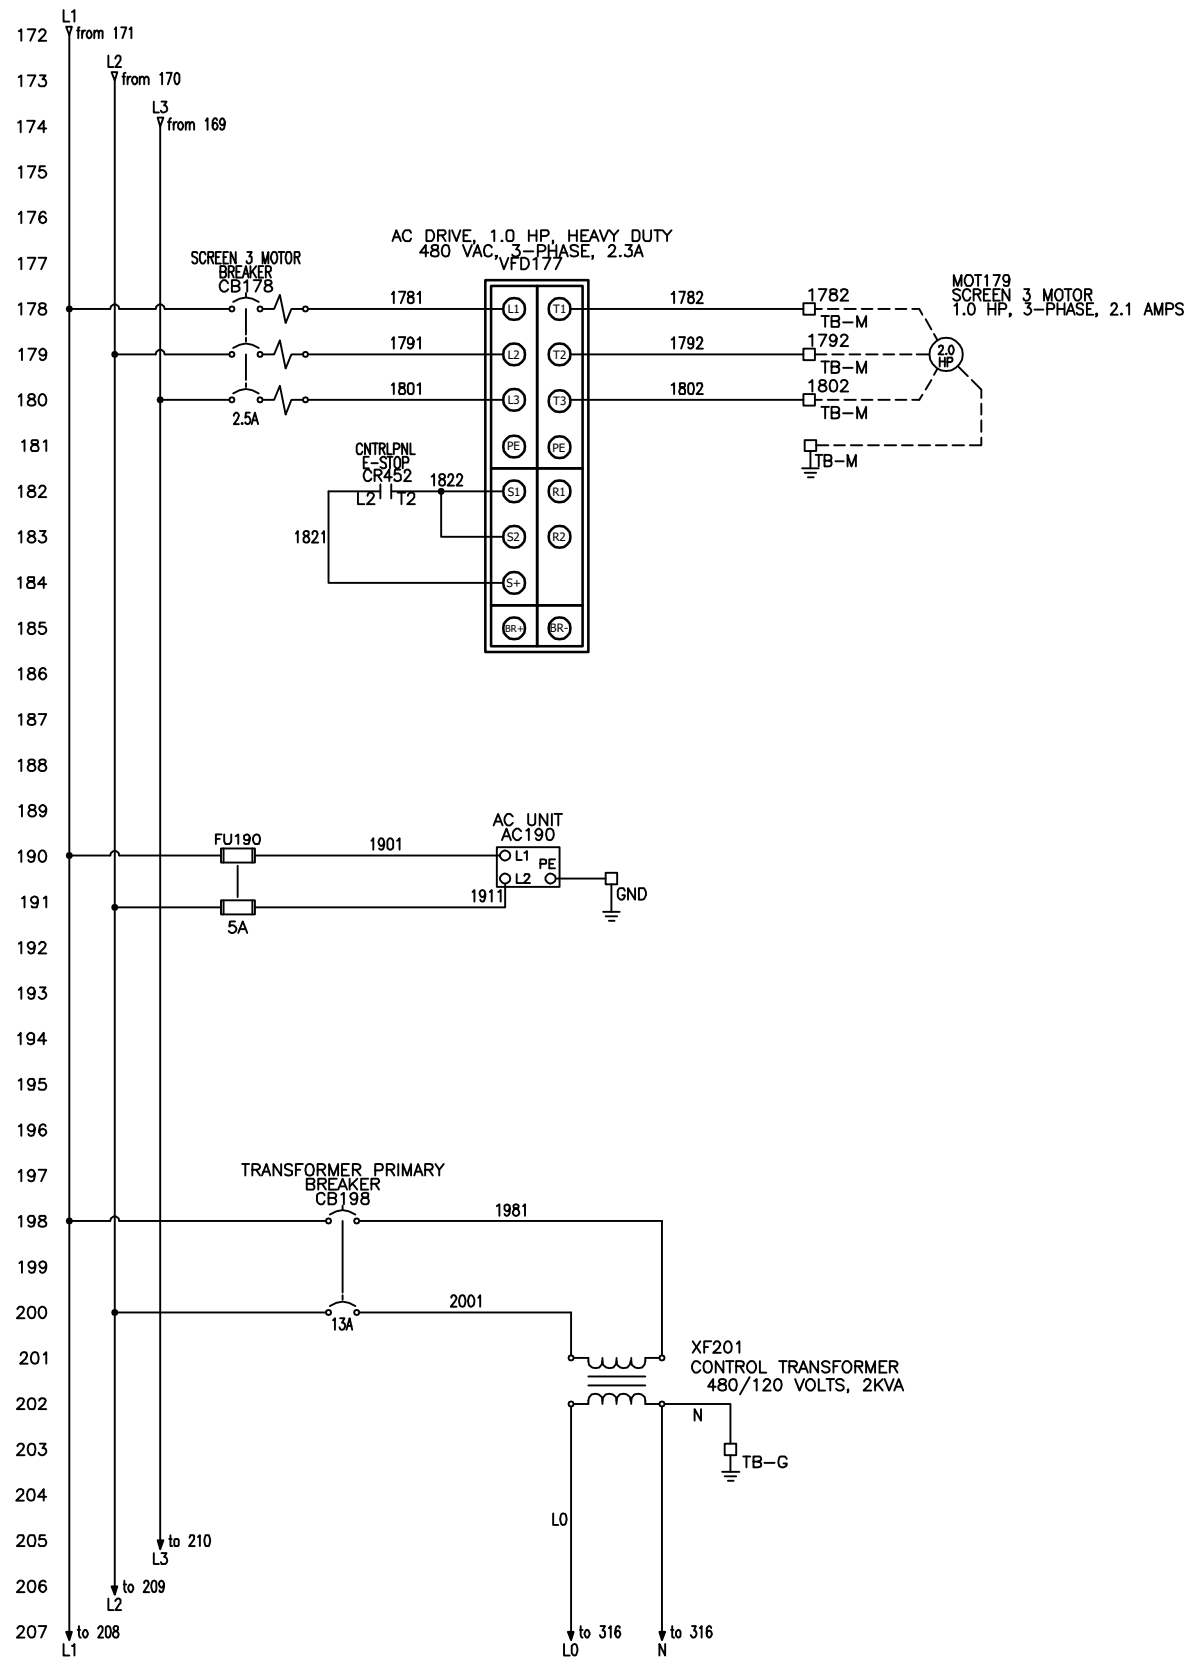

MAIN POWER SCHEMATIC 2




CSW1927-121



SHEET
12 OF 23

REVISION
B



THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY INFORMATION OF OVIVO AND ITS AFFILIATES AND IS NOT TO BE DISCLOSED NOR TO BE USED EXCEPT FOR EVALUATING PROPOSALS OF OVIVO OR INSTALLING, OPERATING OR MAINTAINING OVIVO EQUIPMENT UNLESS OTHERWISE AUTHORIZED IN WRITING BY OVIVO. UNCONTROLLED COPY # PRINTED: 6/2024 OVIVO. ALL RIGHTS RESERVED.

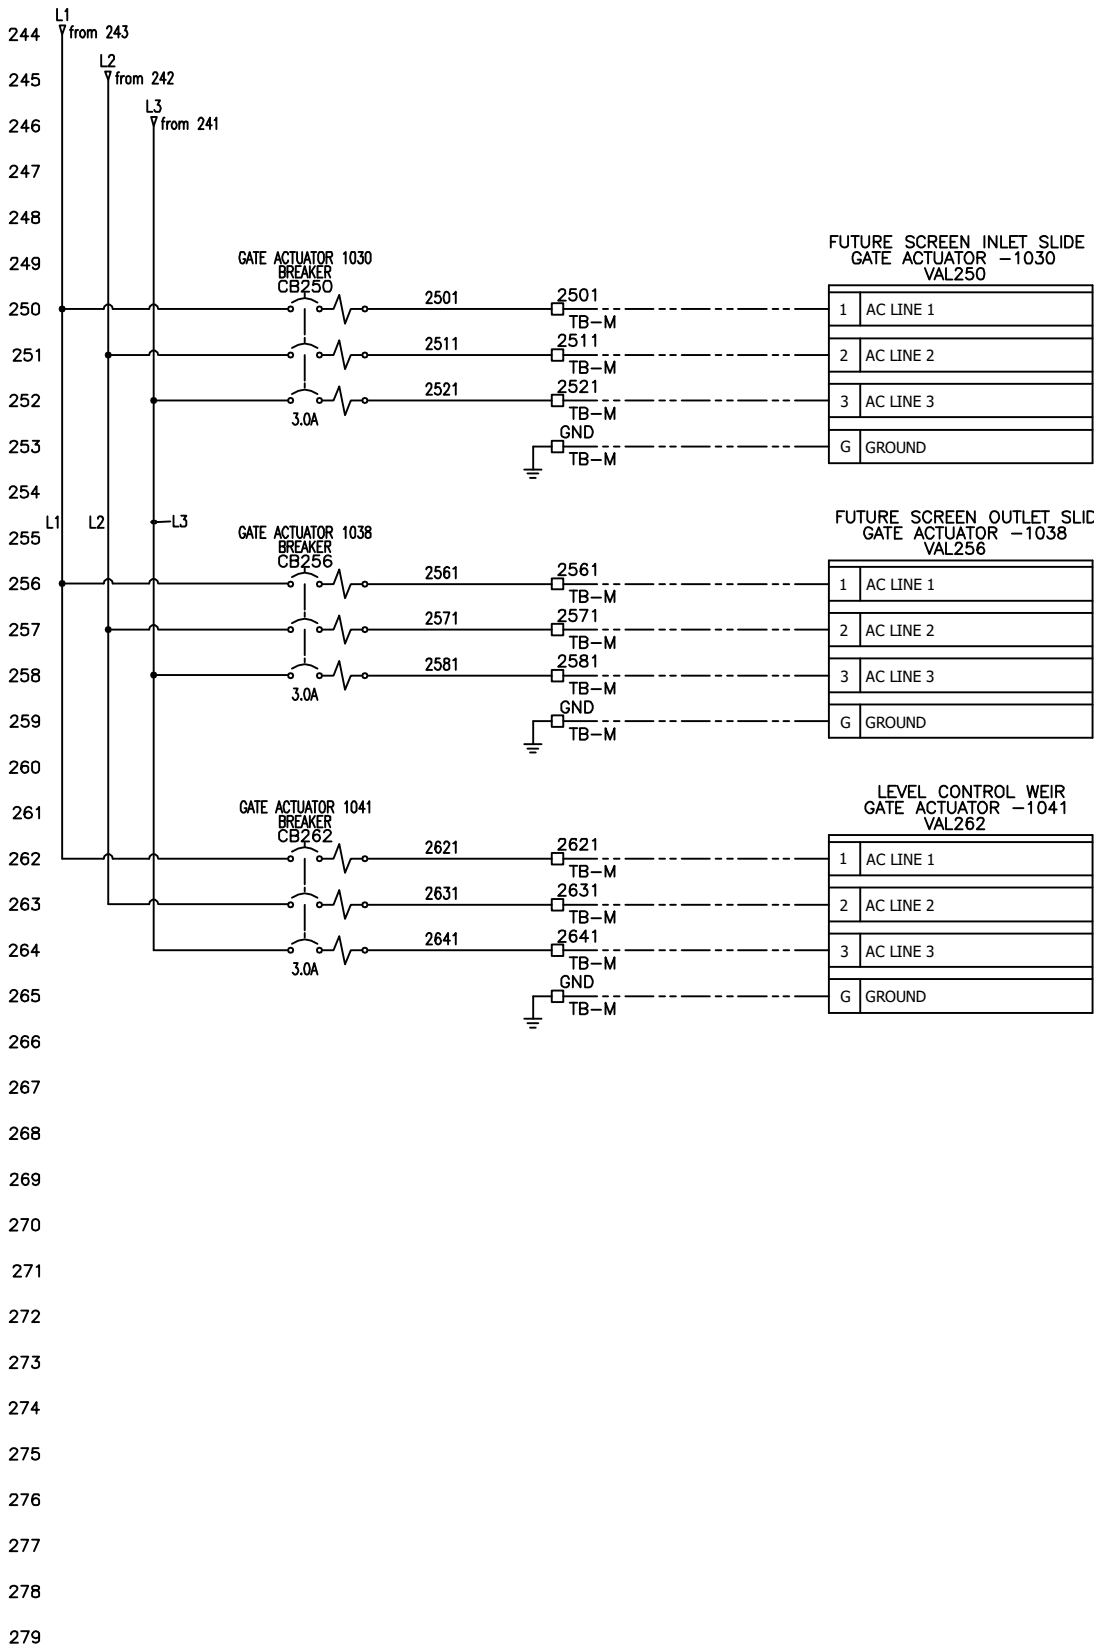

INTENTIONALLY LEFT BLANK

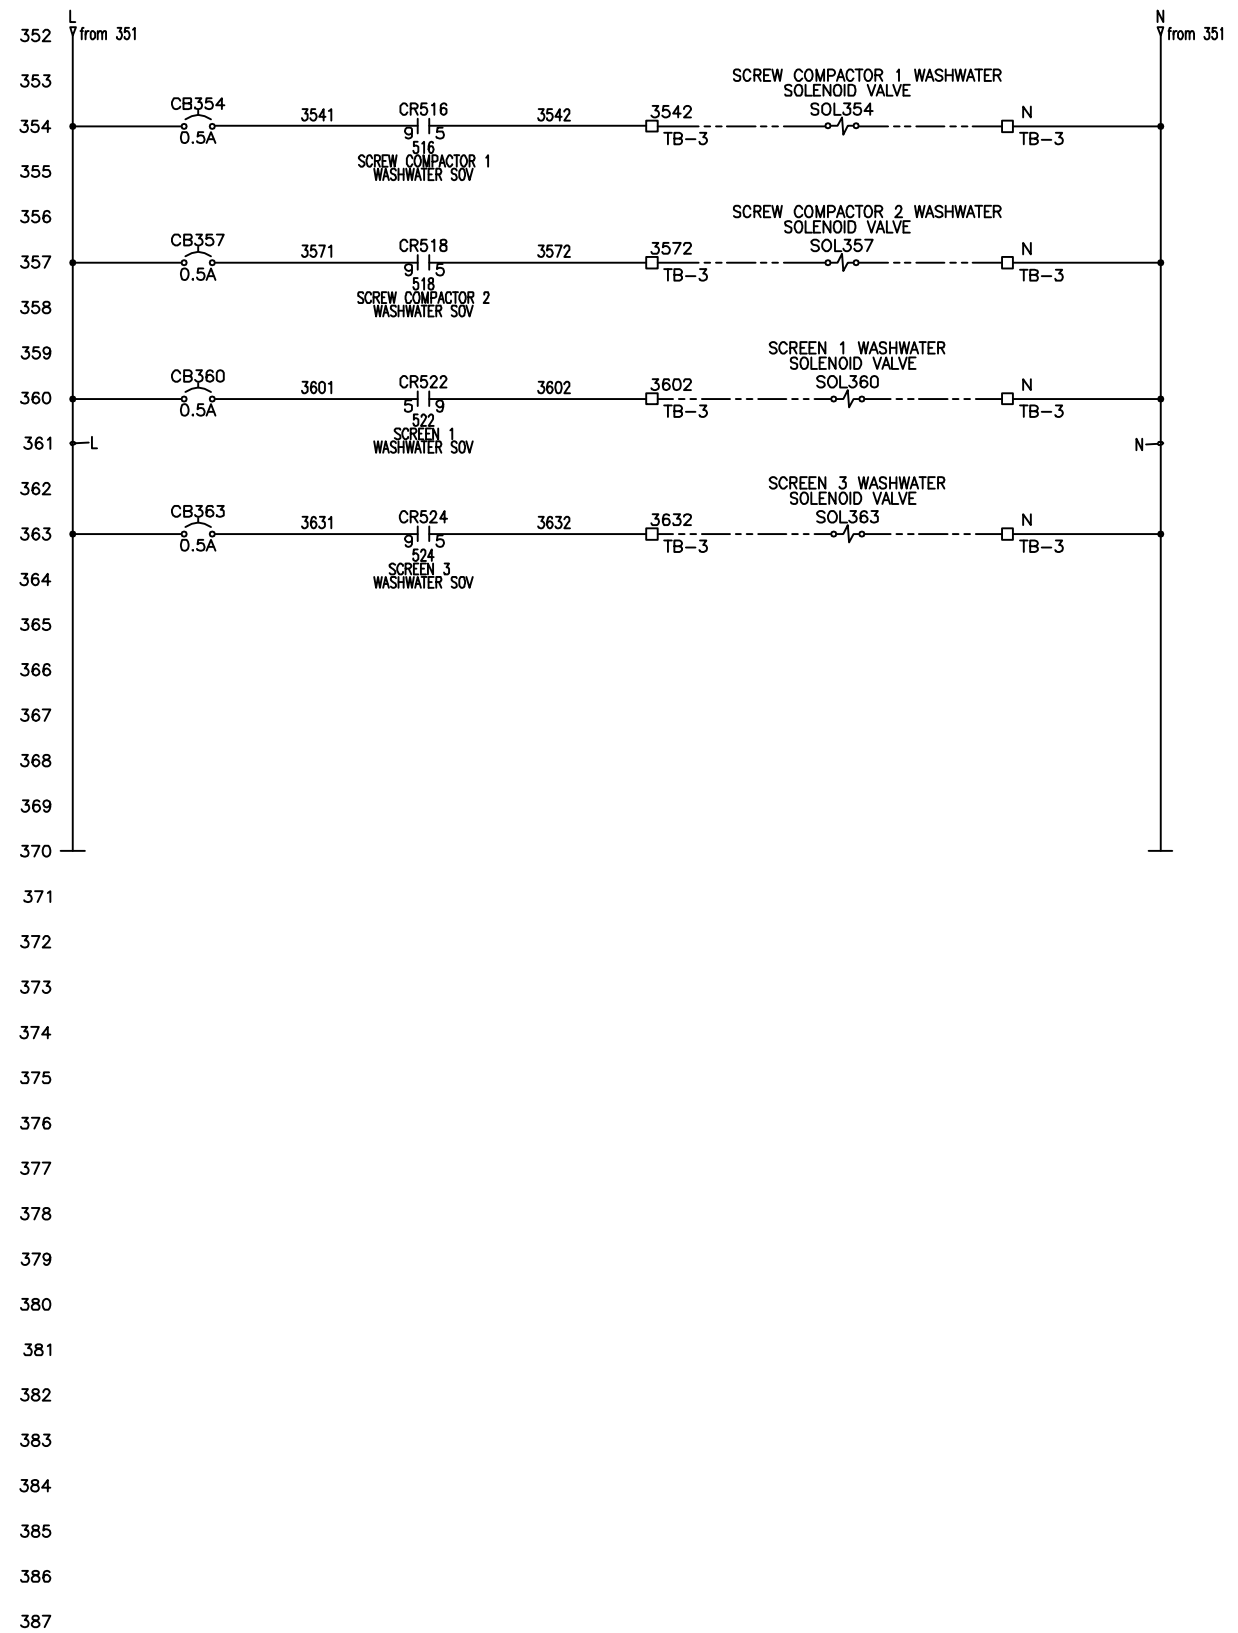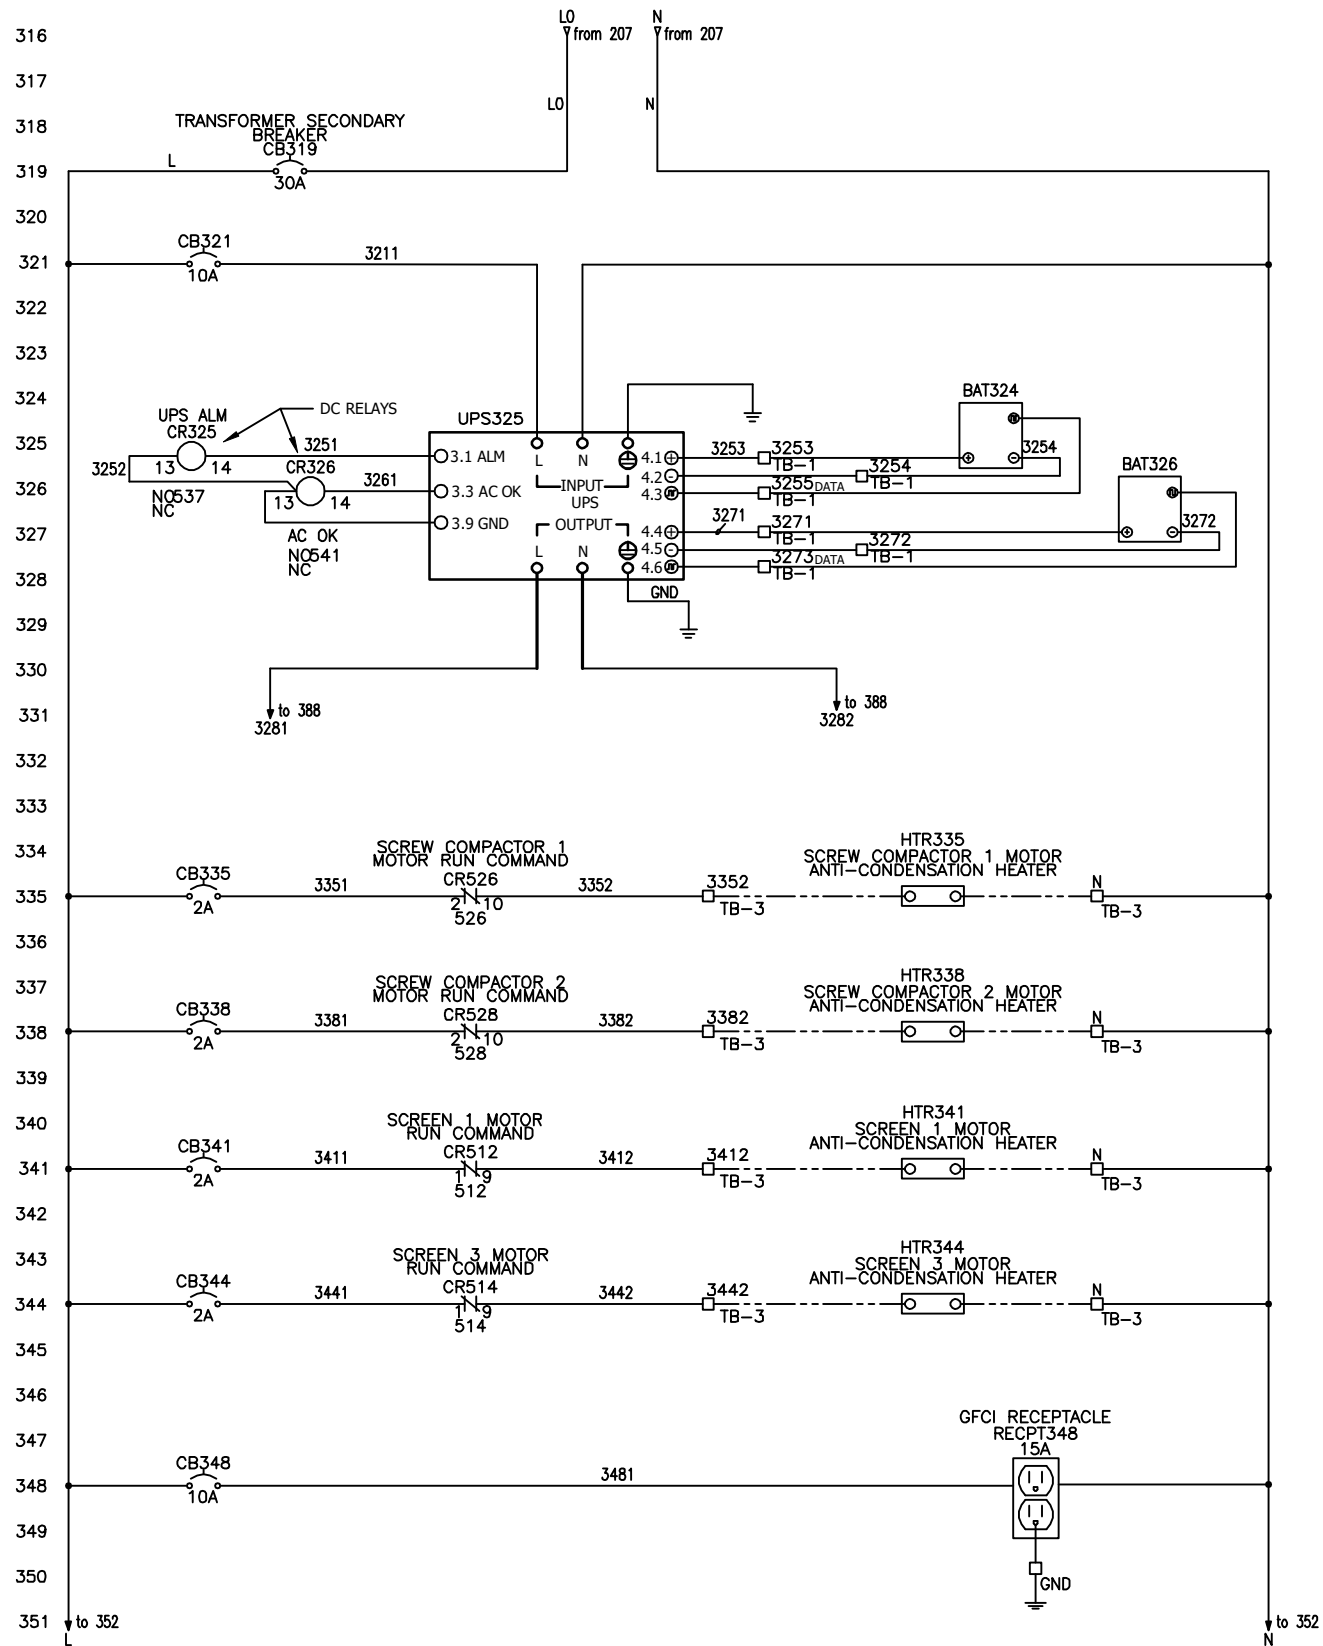

CONTROL POWER SCHEMATIC SHEET 1

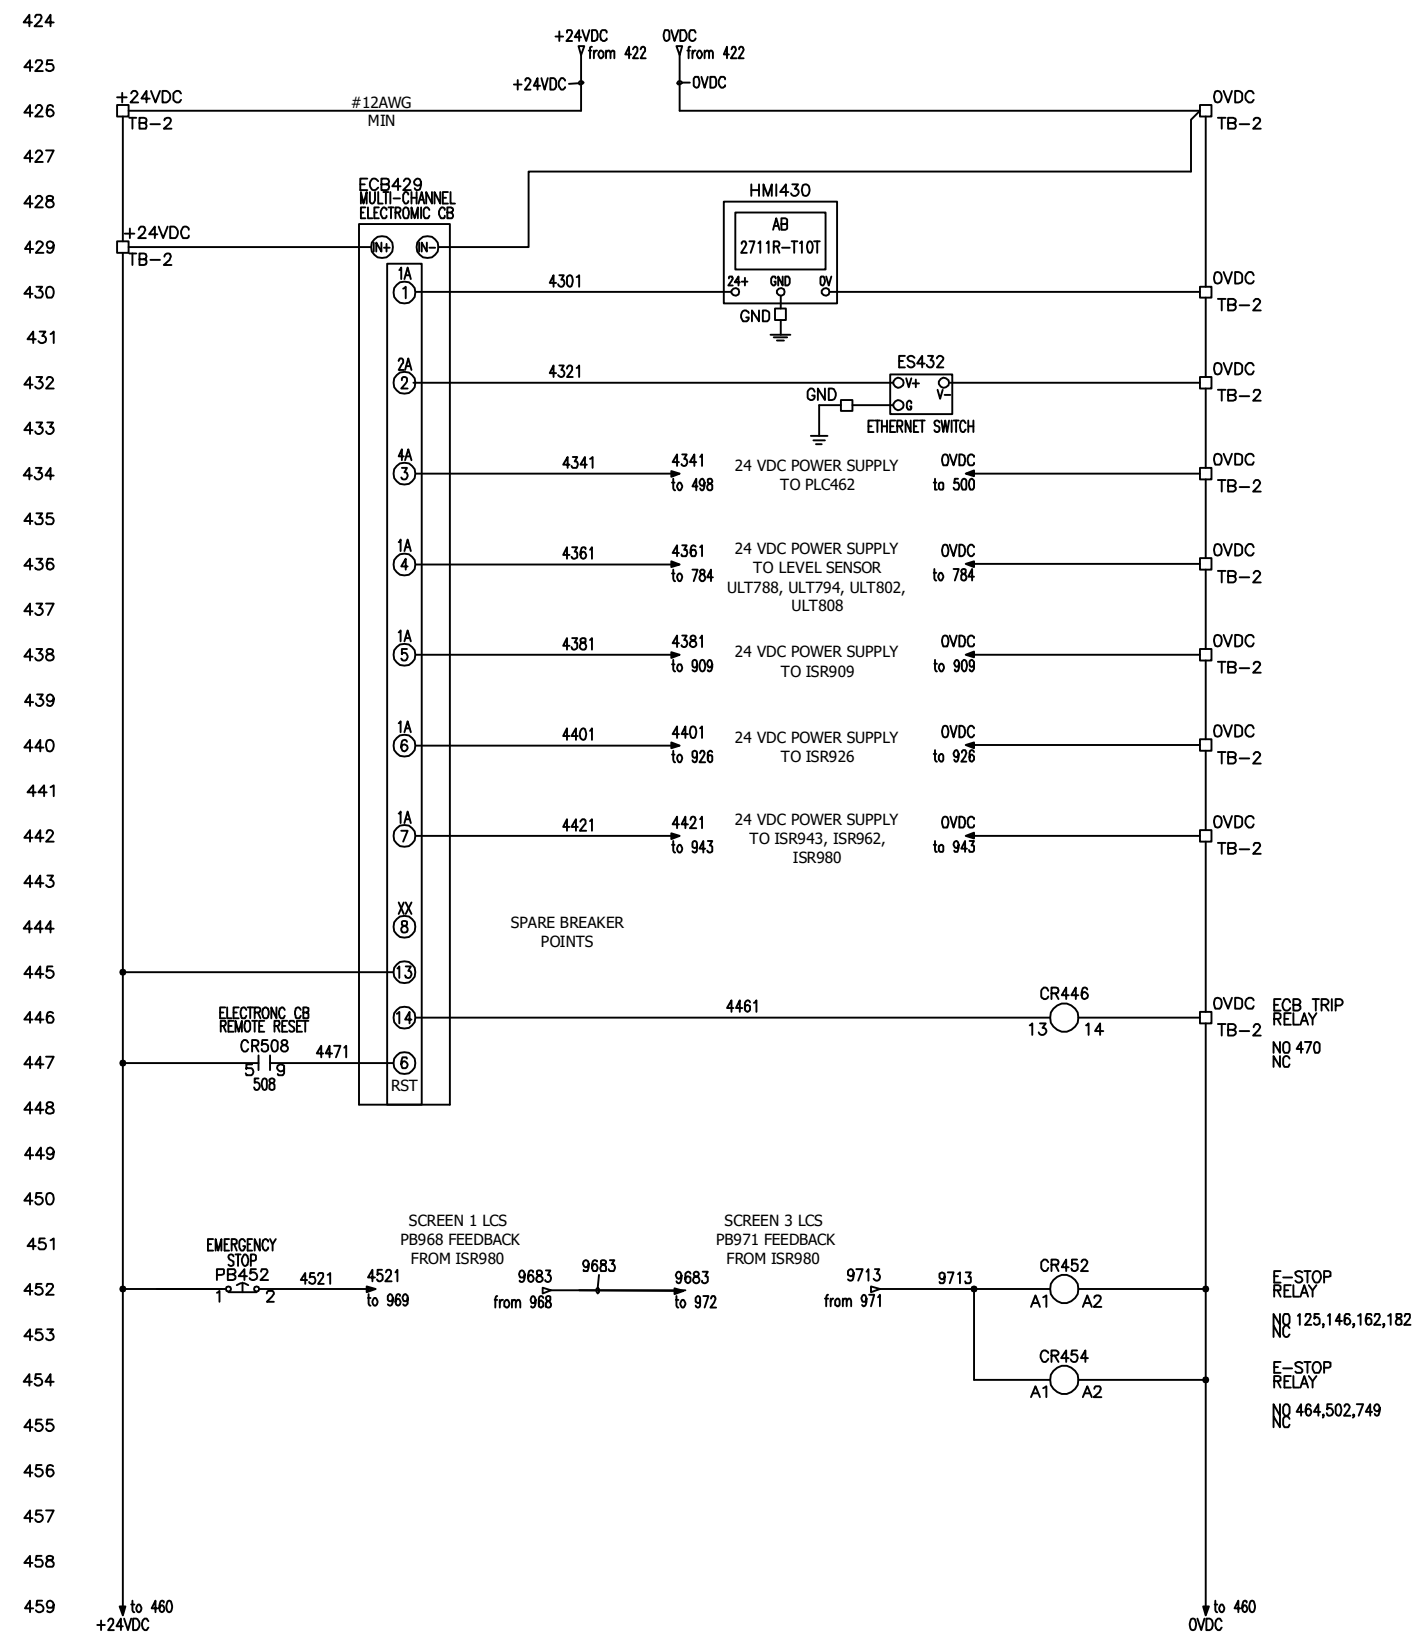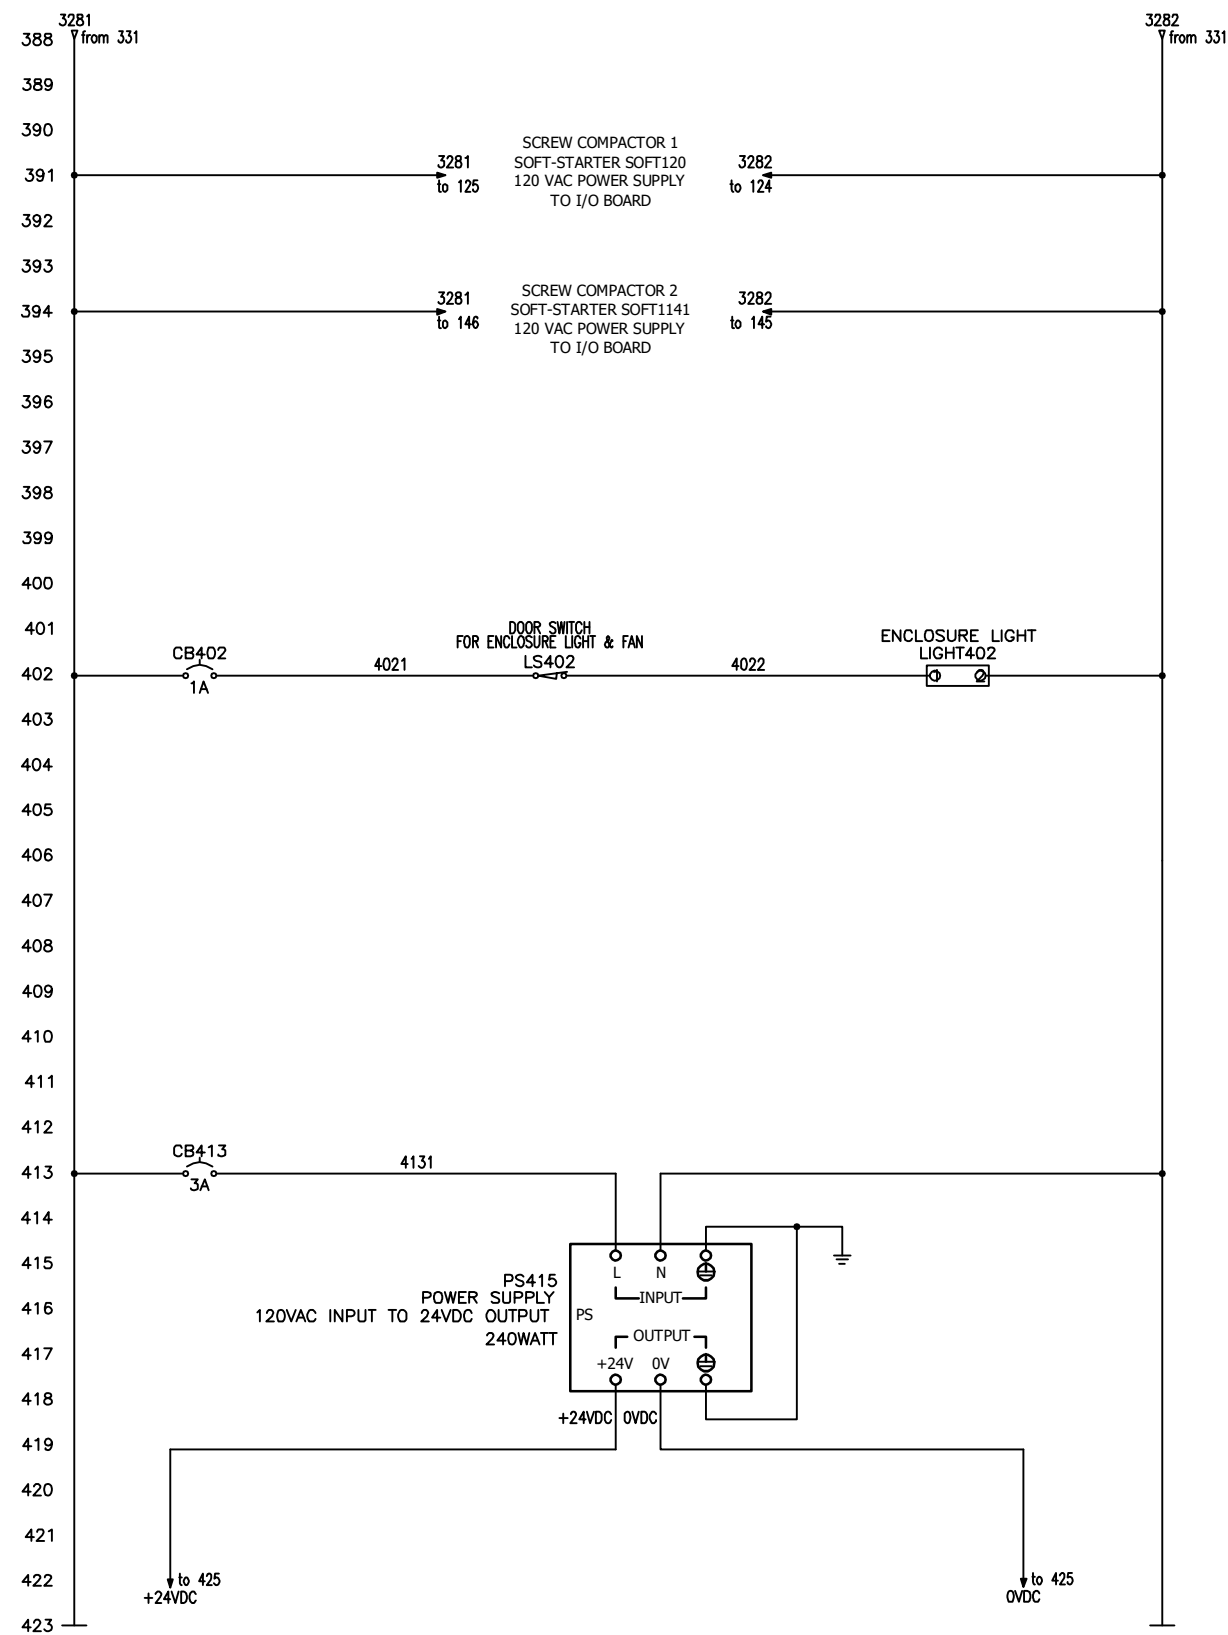

CONTROL POWER SCHEMATIC SHEET 2





CSW1927-121


SHEET **B**
15 OF 23

B



THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY INFORMATION OF OMVIO AND ITS AFFILIATES AND IS NOT TO BE DISCLOSED NOR TO BE USED EXCEPT FOR EVALUATING PROPOSALS OF OMVIO OR ITS AFFILIATES, OPERATING OR MAINTAINING OMVIO EQUIPMENT UNLESS OTHERWISE AUTHORIZED IN WRITING BY OMVIO. UNCONTROLLED COPY IS PROHIBITED.

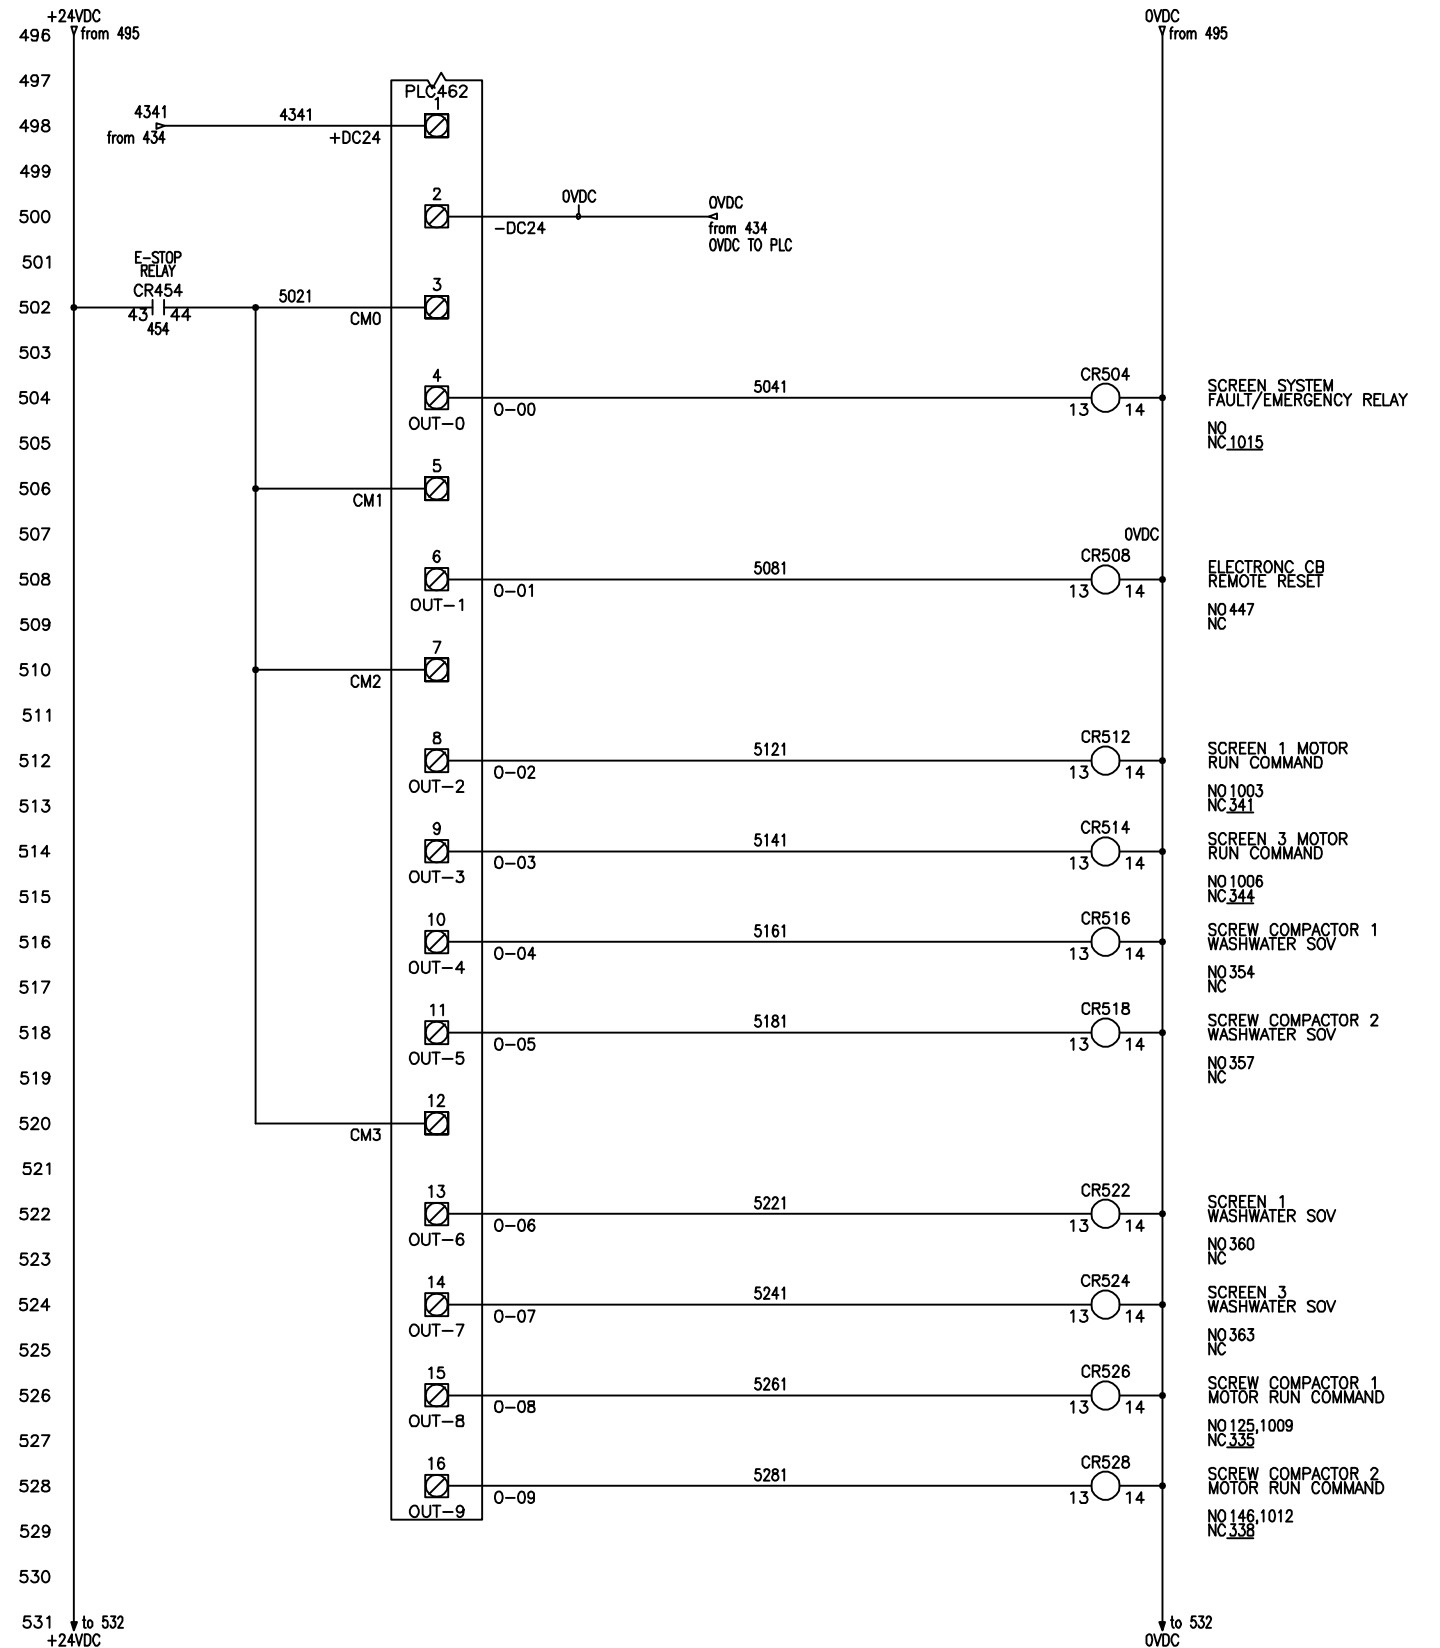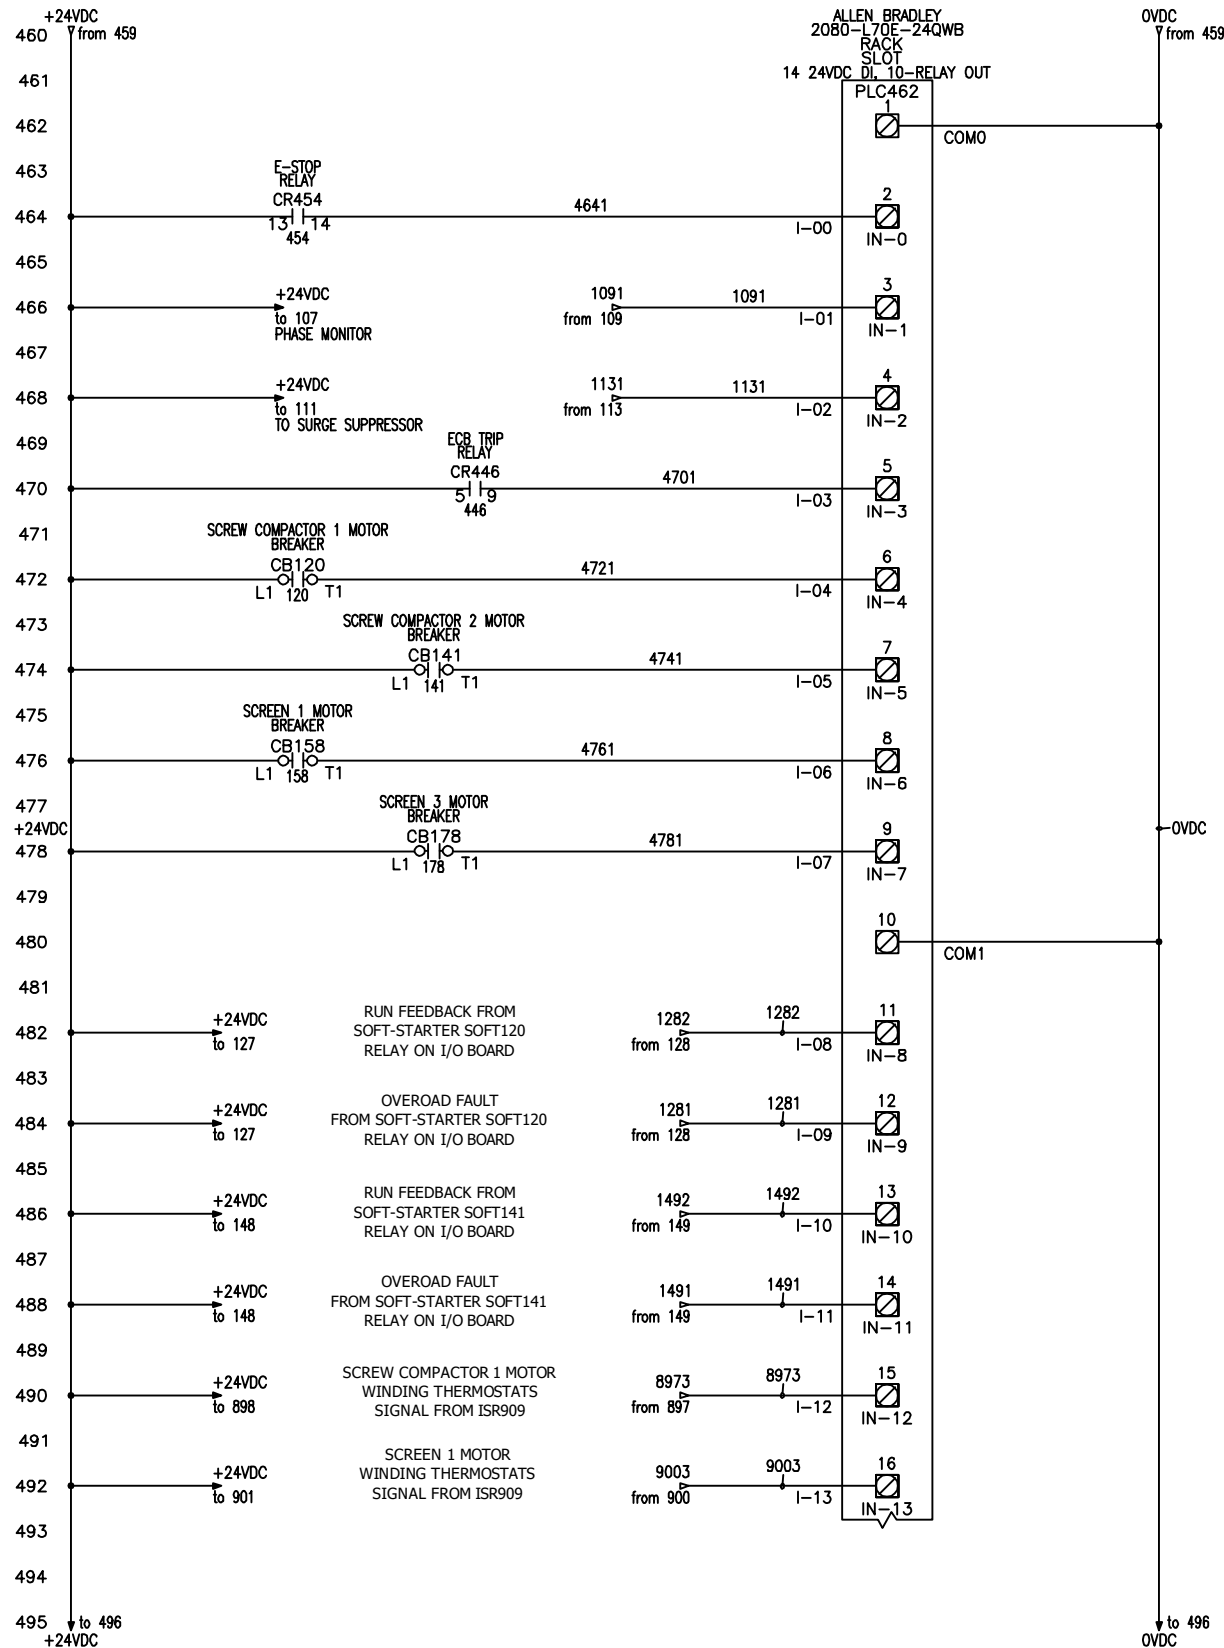

CONTROL POWER SCHEMATIC SHEET 3

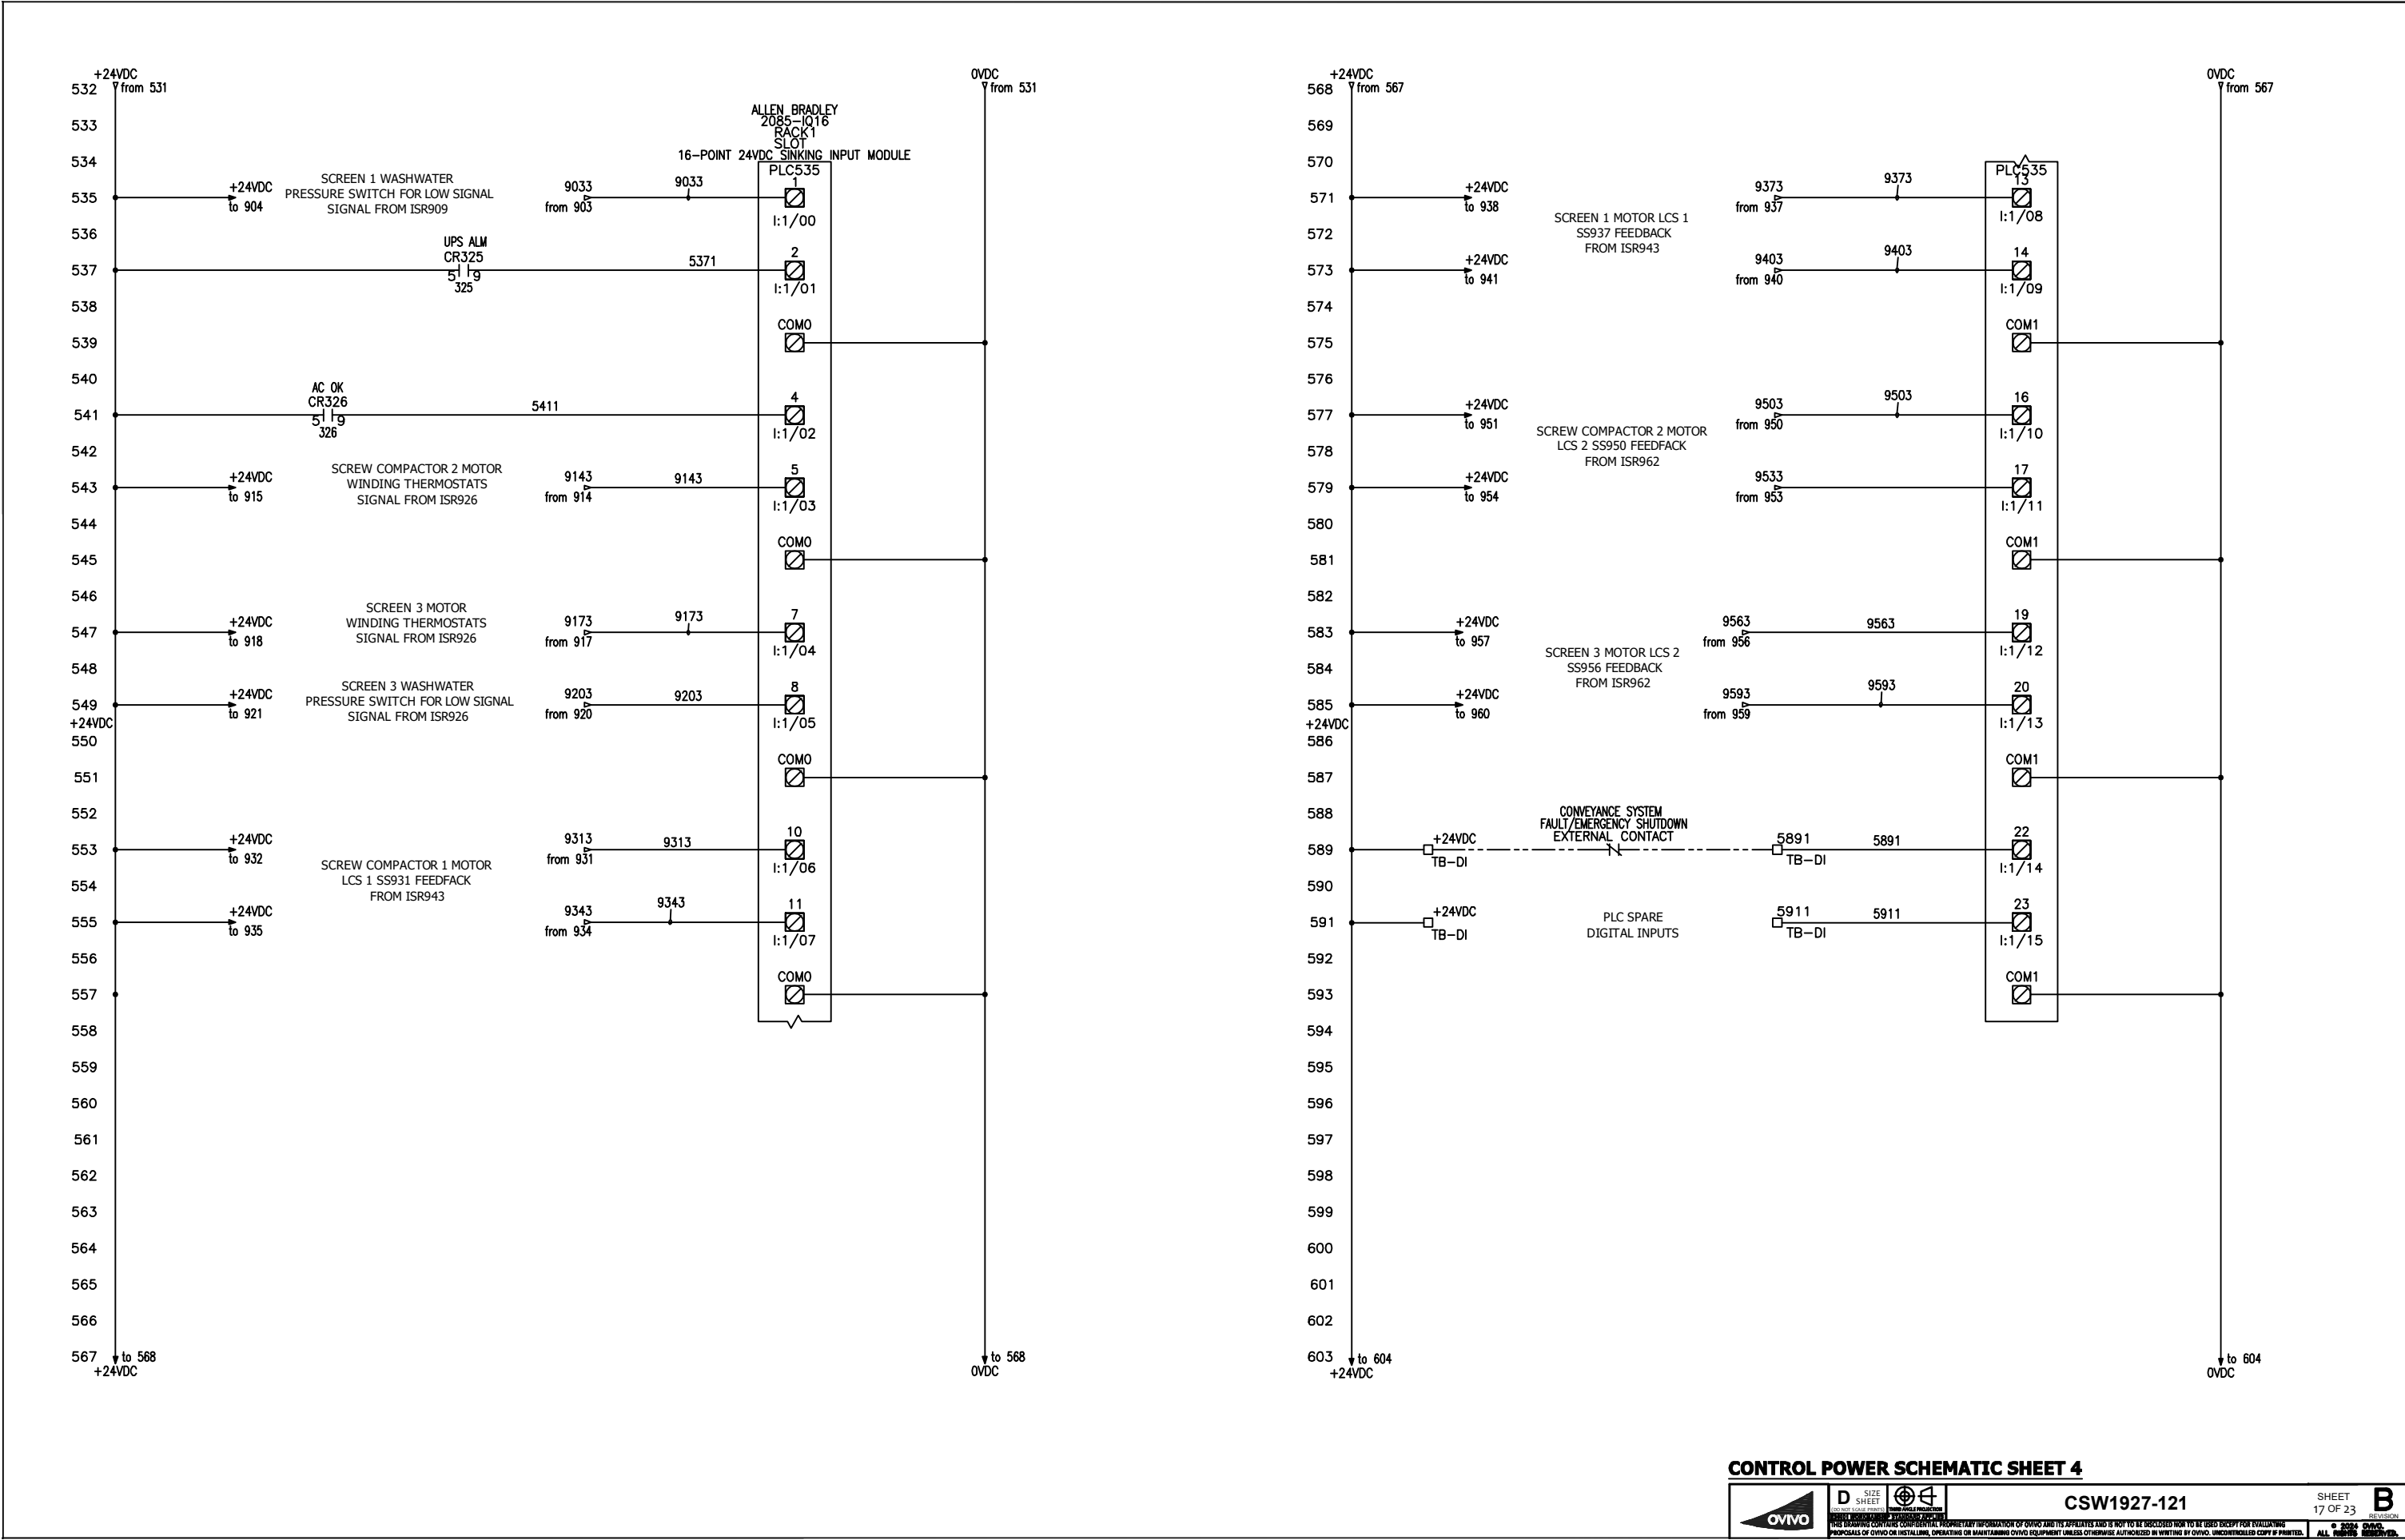

CONTROL POWER SCHEMATIC SHEET 4

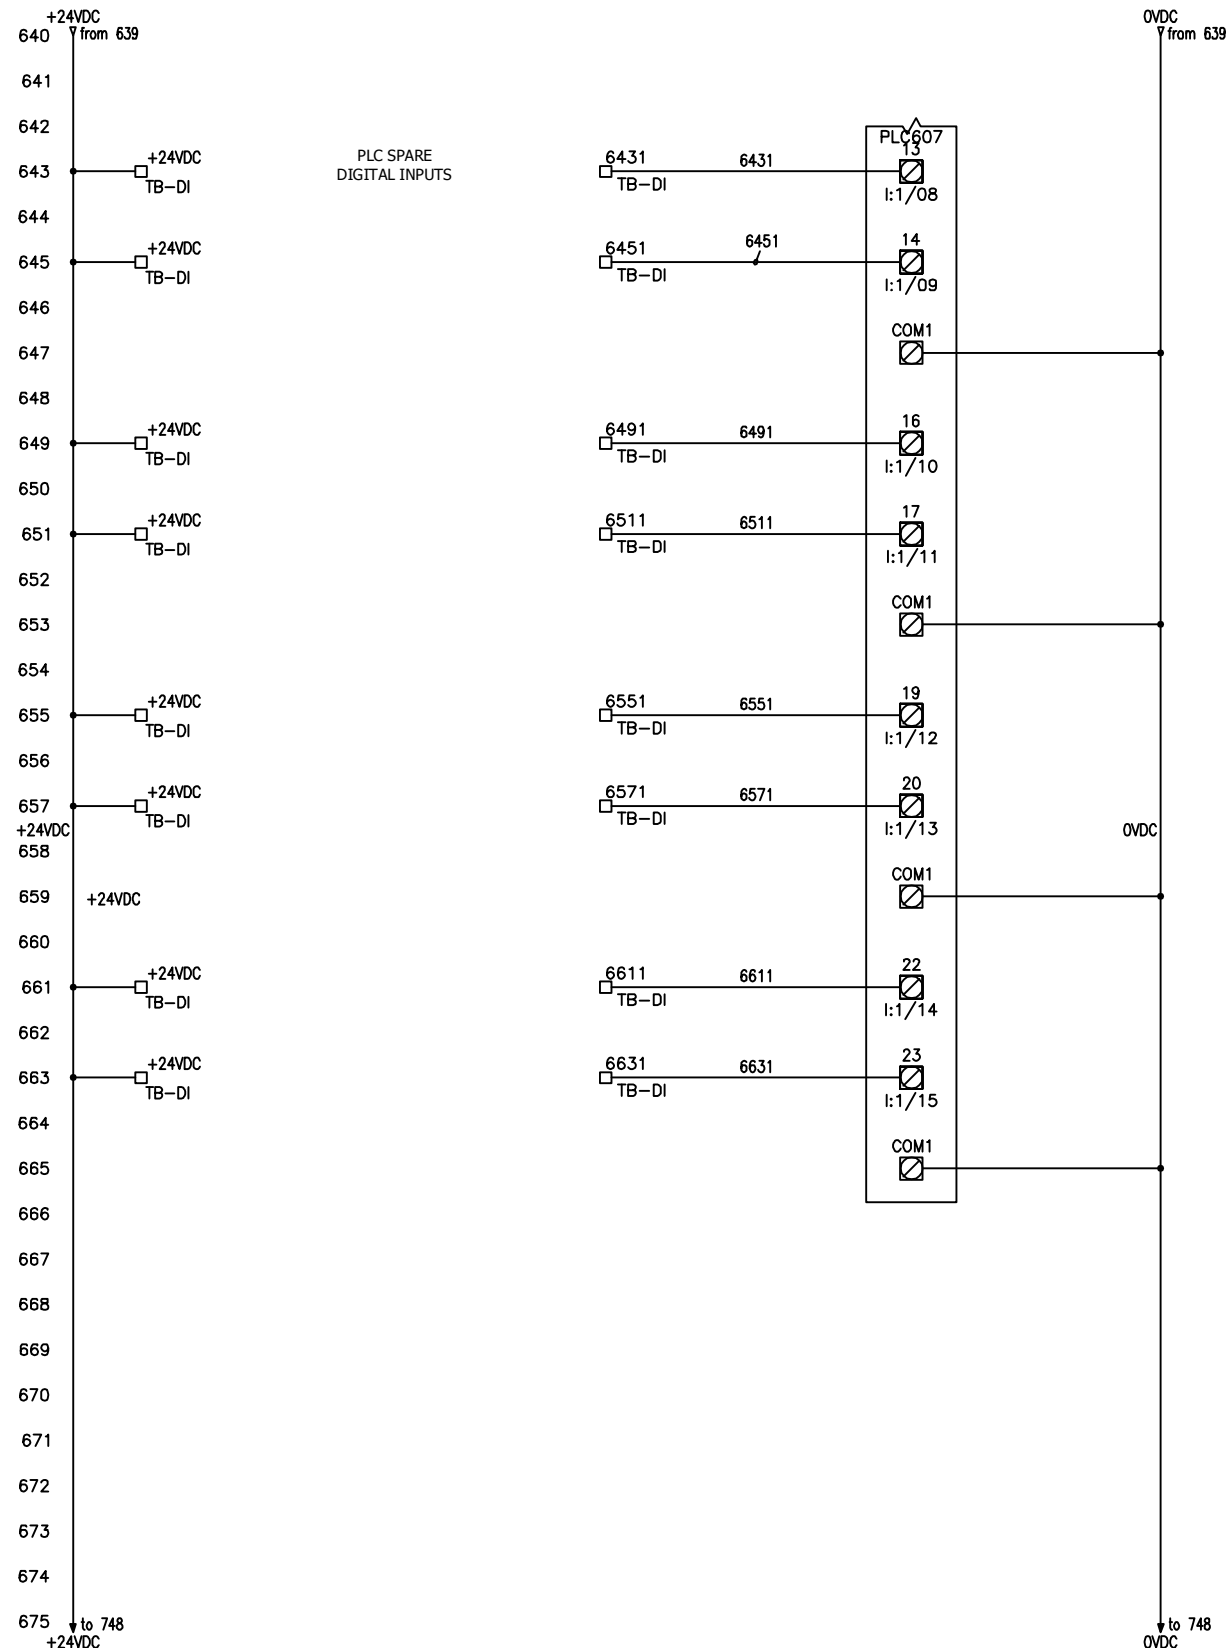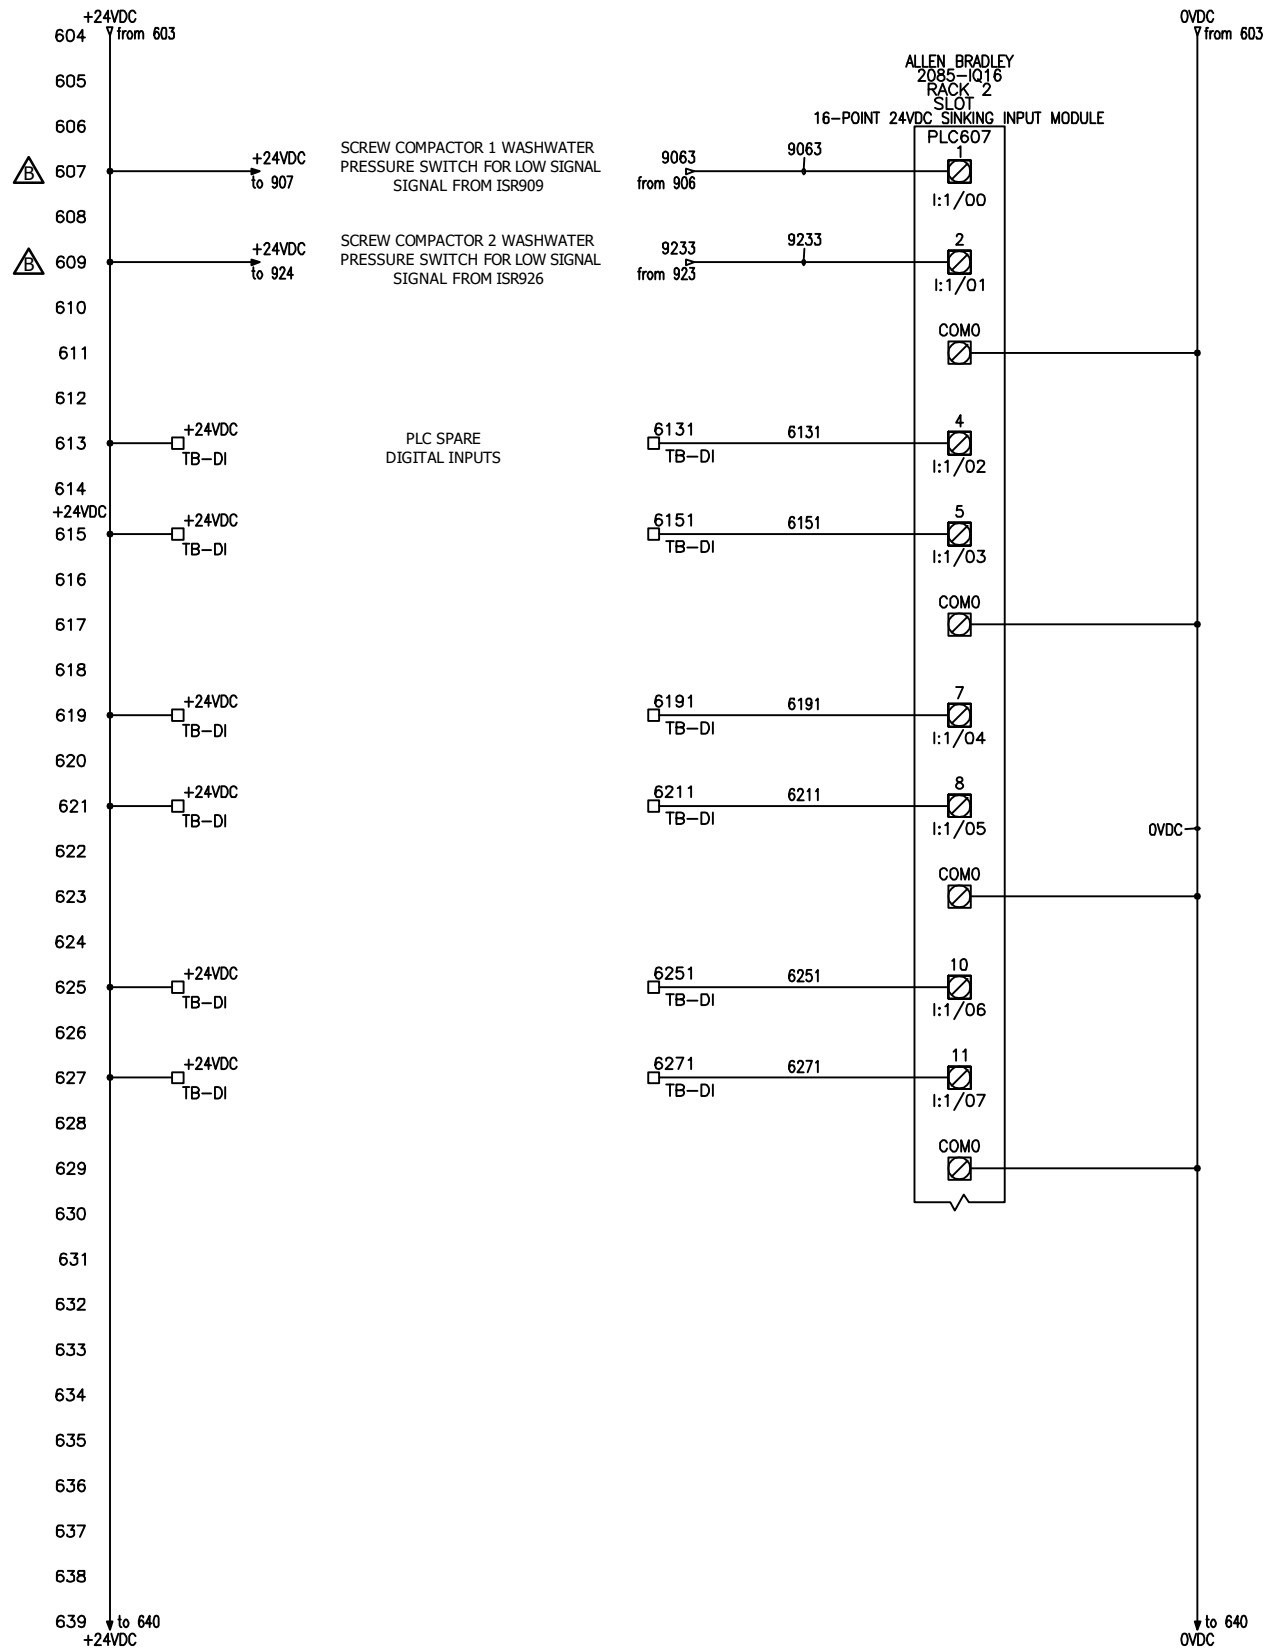

CONTROL POWER SCHEMATIC SHEET 5


676
677
678
679
680
681
682
683
684
685
686
687
688
689
690
691
692
693
694
695
696
697
698
699
700
701
702
703
704
705
706
707
708
709
710
711

INTENTIONALLY LEFT BLANK

712
713
714
715
716
717
718
719
720
721
722
723
724
725
726
727
728
729
730
731
732
733
734
735
736
737
738
739
740
741
742
743
744
745
746
747

INTENTIONALLY LEFT BLANK

820
821
822
823
824
825
826
827
828
829
830
831
832
833
834
835
836
837
838
839
840
841
842
843
844
845
846
847
848
849
850
851
852
853
854
855

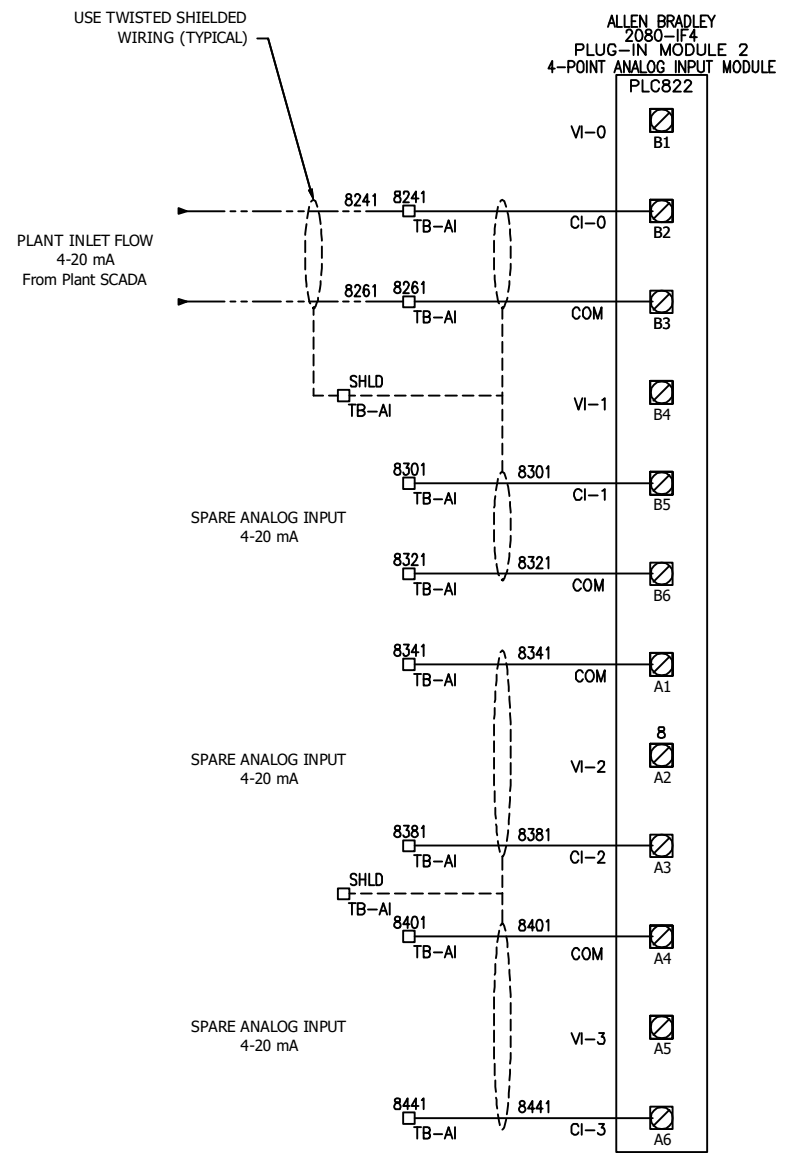


NOTE:
DO NOT LAND DRAIN WIRE AT DEVICE.


856
857
858
859
860
861
862
863
864
865
866
867
868
869
870
871
872
873
874
875
876
877
878
879
880
881
882
883
884
885
886
887
888
889
890
891

INTENTIONALLY LEFT BLANK

INTRINSIC SAFE ISOLATORS

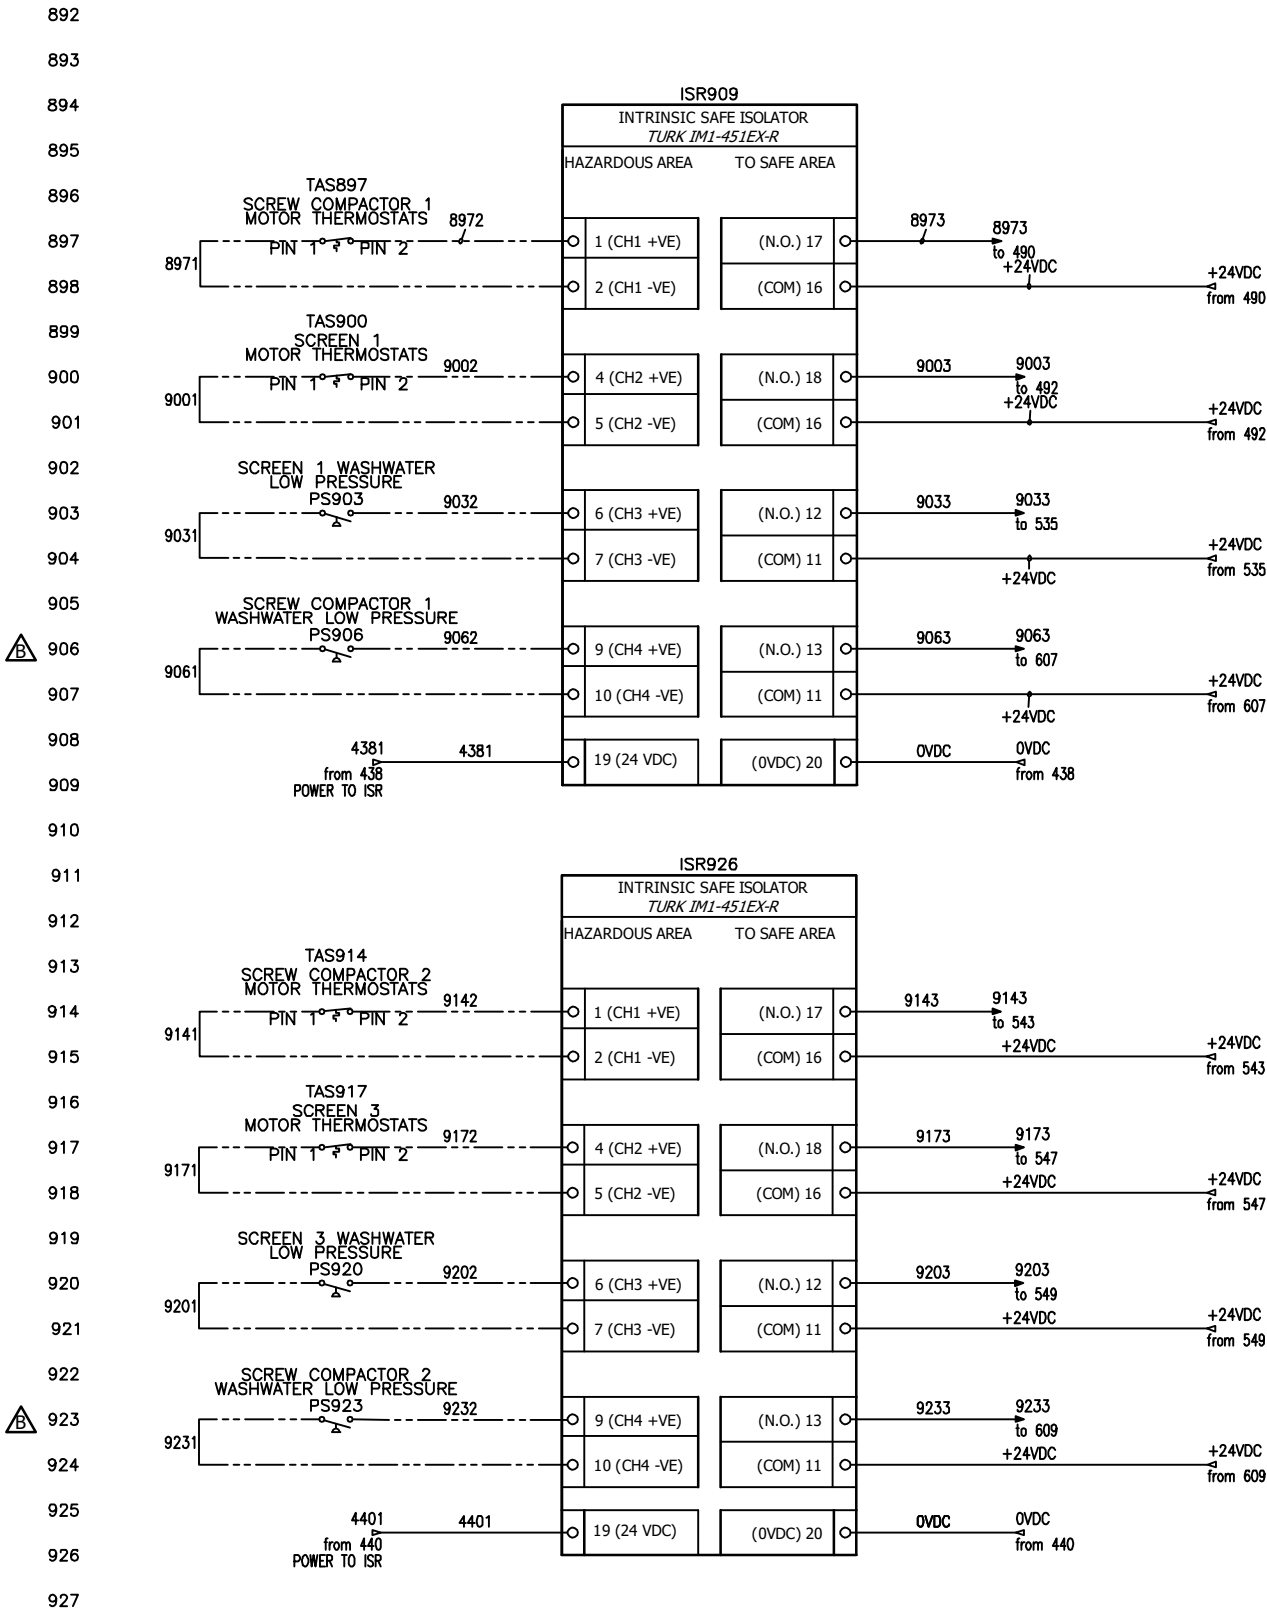

INTRINSIC SAFE ISOLATORS

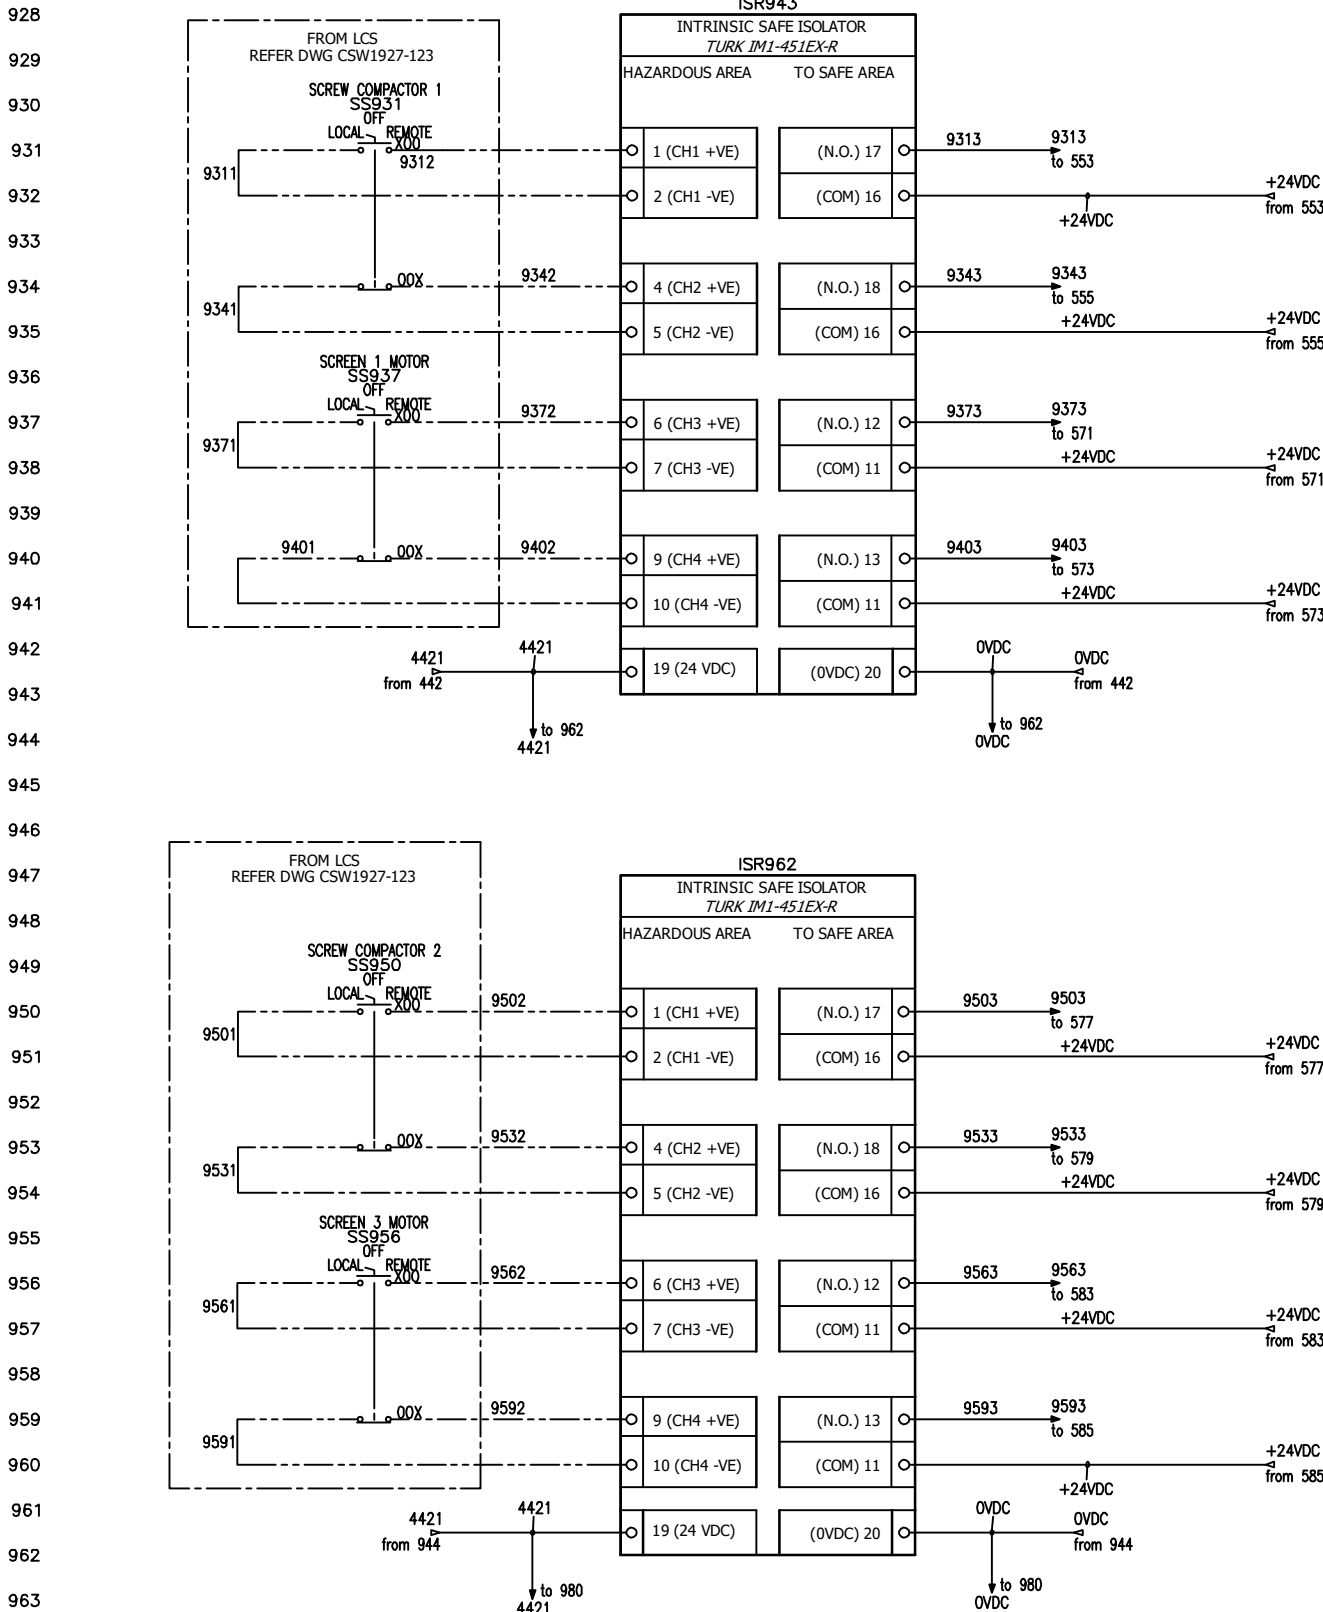

CONTROL POWER SCHEMATIC SHEET 9



CSW1927-121


SHEET
22 OF 23



THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY INFORMATION OF OVVO AND ITS AFFILIATES AND IS NOT TO BE DISCLOSED NOR TO BE USED EXCEPT FOR EVALUATING PROPOSALS OF OVVO OR INSTALLING, OPERATING OR MAINTAINING OVVO EQUIPMENT UNLESS OTHERWISE AUTHORIZED IN WRITING BY OVVO. UNCONTROLLED COPY # PRINTED.

REVISION
B

964
965
966
967
968
969
970
971
972
973
974
975
976
977
978
979
980
981
982
983
984
985
986
987
988
989
990
991
992
993
994
995
996
997
998
999

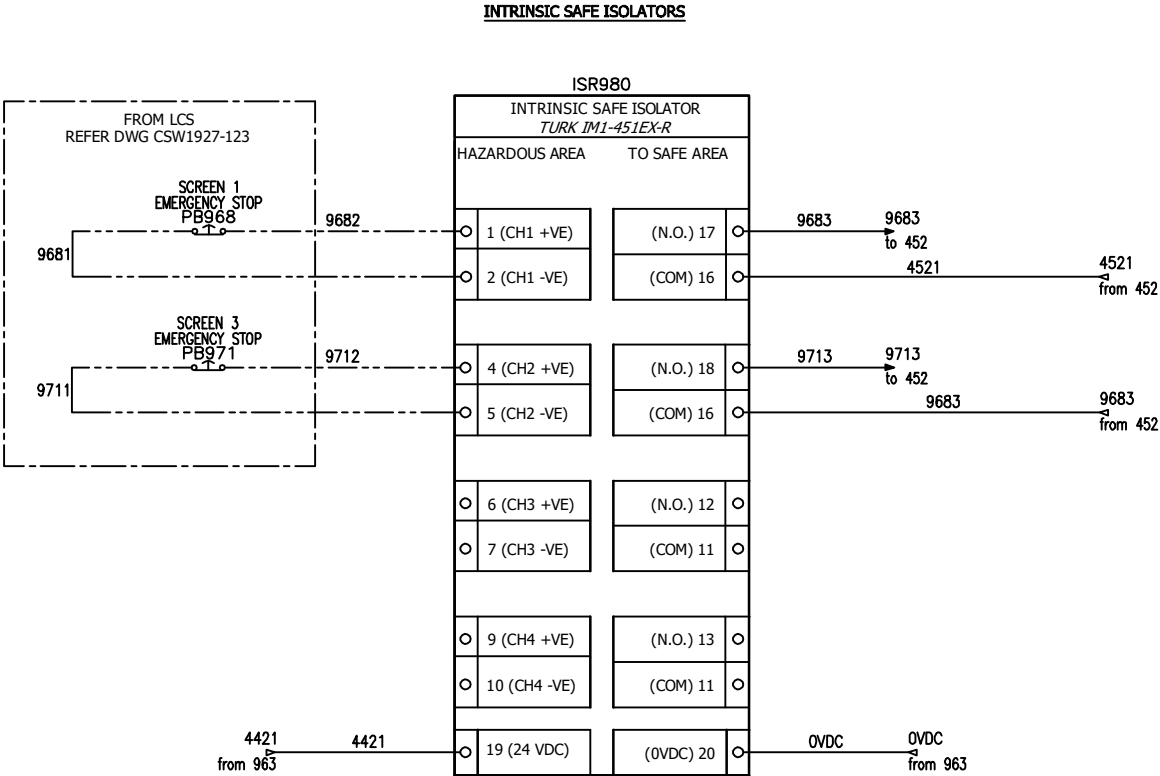

1000
1001
1002
1003
1004
1005
1006
1007
1008
1009
1010
1011
1012
1013
1014
1015
1016
1017
1018
1019
1020
1021
1022
1023
1024
1025
1026
1027
1028
1029
1030
1031
1032
1033
1034
1035

