

MATRIX SYSTEMS

5591 LEO PARK RD
WEST JORDAN, UT 84081
(801) 930-9492



Project Number:
Project Name: Secret Panel
Drawing Number:
Product ID: PP_001
Product Description:

Customer:
Customer Job No.:
Commission:
Manufacturing Date:

Power Supply 480 Vac / 3Φ / 60 Hz
Main Breaker Rating
SCCR
Min Feeder Size
Control Voltage 120 VAC

Env. Protection Rating
Largest Motor
Static Heat Load
Duty Heat Load
Weight

Created 2026-05-20 CARLO
Last Modified 2026-05-22 CARLO

REV	REVISION COMMENT	DATE	DESIGNER
01	Parts List and Model Views	2026-05-20	Carlo Flores

☐ APPROVED
☐ APPROVED W/ REVISIONS NOTED
☐ REJECTED, RESUBMIT REQUIRED

APPROVED BY (PRINT NAME)

POSITION

SIGNATURE

DATE

NOTE: APPROVAL SIGNATURE IS REQUIRED BEFORE PROCUREMENT, FABRICATION OR PRODUCTION WILL BEGIN. ANY COMMERCIAL IMPACT IN THE FORM OF CHANGES, REVISIONS, OR MODIFICATIONS MADE AFTER PRODUCTION STARTS MAY RESULT IN DELAYS OR ADDITIONAL COSTS.

NOTES:

Bill of Materials: (PP_001)

Idx	Qty	Part Number	Part Description	Manufacturer	Supplier	Customer Supplied	Device Tag	Location	Remarks
1	1 ea	800H-QRH2G	30.5mm Type 4/4X/13 Pilot Light, No Test Option, LED, Green, 12...130V AC/DC	Allen-Bradley	COD		P47		
2	1 ea	855F-VMS20B24Y3L3Y8Y4Y6	855 Control Tower Stack Lights	Allen-Bradley			U534		
3	2 ea	1489-M1C030	Bulletin 1489 Miniature Circuit Breaker, Standard configuration, AC, 1 Pole Configuration, Trip Curve C, UL/CSA Max. Voltage: 277V AC, 48V DC ; IEC/EN Max. Voltage: 230V AC,3 A	Allen-Bradley	COD		F70		
4	1 ea	25B-D2P3N104	PowerFlex 525 AC Drive, with Embedded EtherNet/IP and Safety, 480 VAC, 3 Phase, 1.0 HP, 0.75 kW Normal Duty; 1.0 HP, 0.75 kW Heavy Duty, Frame A, IP20 NEMA / Open Type, No Filter	Allen-Bradley (NFPA Data)			A28		
5	4 ea	800H-AR6A	30.5mm Type 4/4X/13 Mom. Contact PB, Non-Illum., Red, Flush Hd, 1 NO-1 NC	Allen-Bradley (NFPA Data)	COD		S13...S16		
6	2 ea	800T-J2	800T 3 Position, Knob/Wing Lever, , White, Std. Knob Maint., Cam and Contact Blocks, 3 Position	Allen-Bradley (NFPA Data)			258;259		
7	1 ea	KXT1HTC-3	HTC XT1 3p TERMINAL COVERS HIGH 2pcs	ABB			Q18		
8	2 ea	KXTBRHEBFP	Mechanism for Thru-Door Operation, for Use w/XT1, XT3 Breaker, RHE_B, Does not Include Shaft or Handle	ABB	IFS		Q18;U534		
9	1 ea	OHB65L10B	Pistol Handle, UL Type 4X	ABB	IFS		252		
10	1 ea	OXPI0X500	Operating Shaft, 10mmSq x 500mmL, For Use with Pistol Style Handle	ABB	IFS		Q18		
11	1 ea	XT1NU3015AAA000XXX (1SDA074634R1)	XT1N 125 TMF 15-500 3p F F UL/CSA	ABB	IFS		Q18		
12	1 ea	350TR-120	Model 350TR Vibratone® Horn produces a loud tone by the electro-mechanical vibration of the diaphragm.	Federal Signal			230		
13	1 ea	SP250ACP	Hammond control transformer, open core, 250 VA, 1-phase, 480/600 VAC, 120/240 VAC secondary, 60 Hz, panel mount.	Hammond			.2		
14	1 ea	A3AXFN	Compact Axial Fan 3-inch Lead Wires, 115VAC 27CFM, Black, Steel	Nvent Hoffman			257		
15	1 ea	ABRKT3	Fan Bracket for 3-inch Compact Axial Fan, 4.50x3.50x1.50, Mill, Aluminum	Nvent Hoffman			U534		
16	1 ea	Unkown	Side mounted exhaust	Nvent Hoffman			U534		
17	1 ea	CP3024	Concept Panel, fits 30.00x24.00 inch Enclosure, White, Mild Steel	nVent Hoffman	RWE		U534		
18	1 ea	CSD302412SS	Concept Wallmount 1/4-Turn Latch Type 4X, 30x24x12, Brushed, Stainless 304	nVent Hoffman	RWE		U534		
19	2 ea	RH2B-ULC-AC120V	RELAY, DPDT, 10A, 120VAC COIL, 8 PIN BLADE TERMINALS, w/ INDICATOR LIGHT, PLUG IN, SOLDER OR QUICK CONNECT	IDEC	IFS		CR;CR.1		
20	1 ea	RH4B-ULCAC120V	Relay, DPDT, 4-Pole, 120VAC Coil, 14 Pin Blade, Indicator light, Check Button, 10A Contacts	IDEC	IFS		.1		
21	1 ea	RTE-P2D12	Timer 11-pin Plug-In DPDT 10A	IDEC			U534		
22	2 ea	SH2B-05	Relay Socket, 8 Pin, 2 Pole, 10 A, 300 V, DIN Rail, M3.5 Screw, RH Series	IDEC	IFS		249;250		
23	1 ea	SH4B-05C	Relay Socket, 14 Pin, 4 Pole, 10 A, 300 V, DIN Rail, M3.5 Screw, RH Series, Touch Safe	IDEC	IFS		251		
24	1 ea	SR3P-05	Socket DIN Mount Screw Type, RR Relay Sockets	IDEC			U534		
25	7 ea	1912	Operator Label, 30.5 mm, Custom Text	Matrix Systems	MTX		U534		
26	1 ea	DUCT,COVER,1,GREY	Wiring Duct Cover, 1 Inches, Gray PVC	Matrix Systems	RWE		U537		
27	5 ft	Duct, 1x3 , Gray	Wiring Duct Narrow Slot, 1 Inches x 3 Inches, Gray PVC	Matrix Systems	RWE		U535...U538		
28	1 ea	Custom Bracket	Custom Bracket for mounting precision digital to backpanel	Precision Digital Corporation			U534		
29	1 ea	PD6100-6R7	PD6100 ProVu Strain Gauge, Load Cell & mV Digital Panel Meter	Precision Digital Corporation	PDC		247		
30	8 ea	0800886	End bracket, material: PA, color: gray	Phoenix Contact			U450		
31	4 ea	1004306	Terminal strip markers, for strip marking, snap onto end bracket E/UK or CLIPFIX 35, lettering field size: 25 x 6 mm	Phoenix Contact	RWE		U534		
32	1 ea	1096432	Primary-switched power supply unit, UNO POWER, Screw connection, DIN rail mounting, input: 1-phase, output: 24 V DC / 10 A, adjustable from 24 V DC ... 28 V DC	Phoenix Contact	RWE		A29		
33	1 ea	3022218	Quick mounting end clamp for NS 35/7,5 DIN rail or NS 35/15 DIN rail, with marking option, width: 9.5 mm, color: gray	Phoenix Contact	PXC		260		
34	52 ea	3044102	Feed-through terminal block, nominal current: 32 A, number of connections: 2, Screw connection, color: gray	Phoenix Contact	RWE		X27		
35	2 ea	3044814	Double-level terminal block, nom. voltage: 800 V, nominal current: 30 A, connection method: Screw connection, 1st and 2nd level, Rated cross section: 4 mm², cross section: 0.14 mm² - 6 mm², mounting type: NS 35/7,5, NS 35/15, color: gray	Phoenix Contact			X28;X29		
36	3 ft	DIN, 35MM, STANDARD	DIN rail, material: steel galvanized and passivated with a thick layer, perforated, height 7.5 mm, width 35 mm, length: 2000 mm	Phoenix Contact	RWE		U539;U540		
37	1 ea	8018445	Window Kits Stainless steel	Rittal			U533		
38	1 ea	PK27GTA	Load center accessory, QO/Homeline, ground bar kit, 27 terminals	Schneider Electric			U534		
39	1 ea	PKOGTA6	4.61 Inch 14 to 1/0 AWG Copper/Aluminum 6-Terminal Load Center Ground Bar Kit	Schneider Electric			U534		

NOTES

DRAWING REV 01	PROJECT NO.
DESIGNER Carlo Flores	CUST JOB ID
APPD BY	INSTALLATION
DATE	PANEL ID PP 001


PAGE	Bill of Materials: PP_001
TITLE	Secret Panel





5591 LEO PARK RD
WEST JORDAN, UT 84081

SIZE B	DWG NO.	SHEET 2 / 8
-----------	---------	----------------


OUTPUT CONTROL SYMBOLS

SYMBOL	DESCRIPTION
	RELAY COIL (CR) CONTACTOR (M)
	SOLENOID (SOL)
	PILOT LIGHT X = COLOR (LT) or (PBL)
	ALARM HORN (AH)
	HEATING ELEMENT (HTR)

INPUT CONTROL SYMBOLS

NORMALLY OPEN	NORMALLY CLOSED	DESCRIPTION
		PUSHBUTTON (PB) or (PBL)
		SELECTOR SWITCH (SS) or (SSL)
		MUSHROOM PUSHBUTTON (PB) or (PBL)
		LIMIT SWITCH (LS)
		AUXILIARY CONTACT

POWER DIST. SYMBOLS

SYMBOL	DESCRIPTION
	DISCONNECT SWITCH (DS)
	CIRCUIT BREAKER (CB)
	FUSE (FU)
	MOTOR OVERLOAD (OL)
	MOTOR STARTER (M)
	3-PHASE MOTOR (MTR)

WIRING COLORS

Ungrounded Power Circuits	Black	(BLK)
Grounded AC Power Circuits	White	(WHT)
Protective wire	Green	(GRN)
Ungrounded AC Control Circuits	Red	(RED)
Grounded AC Control Circuits	White	(WHT)
Ungrounded DC Control Circuits	Blue	(BLU)
Grounded DC Control Circuits	White/Blue	(W/B)
External Voltage Source	Orange	(ORG)
Excepted Circuits	Orange	(ORG)

MIN WIRING SIZES

CIRCUIT	SIZE	MAX AMPACITY
Power Circuits	14 AWG	15 A
Control Circuits	16 AWG	10 A
	18 AWG	7 A
PLC I/O	20 AWG	5 A
	22 AWG	3 A
	24 AWG	2 A
NOTE: Wire sizes must comply with UL 508A sections 29.6 and 38.2. Use Table 28.1 to determine correct wire sizes for loads that exceed the max ampacity listed here. For circuits that are less than 100A, use the 60° F column. For circuits greater than 100A, use the 75° F column.		

Symbols in accordance with UL 508A

NOTES

DRAWING REV
01

PROJECT NO.

PAGE Technical Requirements

DESIGNER
Carlo Flores

CUST JOB ID

TITLE
Secret Panel

APPD BY

INSTALLATION

DATE

PANEL ID
PP 001



5591 LEO PARK RD
WEST JORDAN, UT 84081

SIZE
B

DWG NO.

SHEET

3 / 8

Table of contents

Page	Page Description	Notes	Date	Edited by
1	Cover Page		2026-05-20	CARLO
2	Bill of Materials: PP_001		2026-05-20	CARLO
3	Technical Requirements		2026-03-12	CARLO
4	Table of Contents		2026-05-20	CARLO
5	Panel Layout		2026-05-20	CARLO
6	Enclosure Dimensions		2026-05-20	CARLO
7	Mounting Panel Layout		2026-05-20	CARLO
8	Door Dimmensions		2026-05-20	CARLO

NOTES

DRAWING REV 01	PROJECT NO.
DESIGNER Carlo Flores	CUST JOB ID
APPD BY	INSTALLATION
DATE	PANEL ID PP 001



PAGE Table of Contents
TITLE Secret Panel




MATRIX
SYSTEMS

5591 LEO PARK RD
WEST JORDAN, UT 84081


SIZE B	DWG NO.	SHEET 4 / 8
-----------	---------	----------------

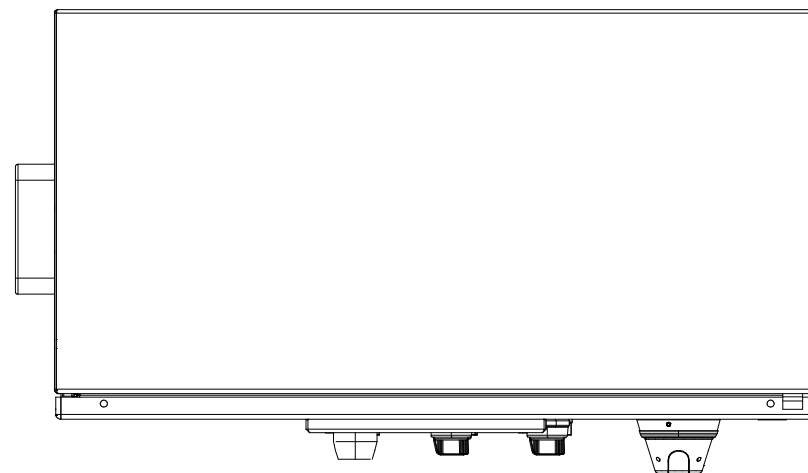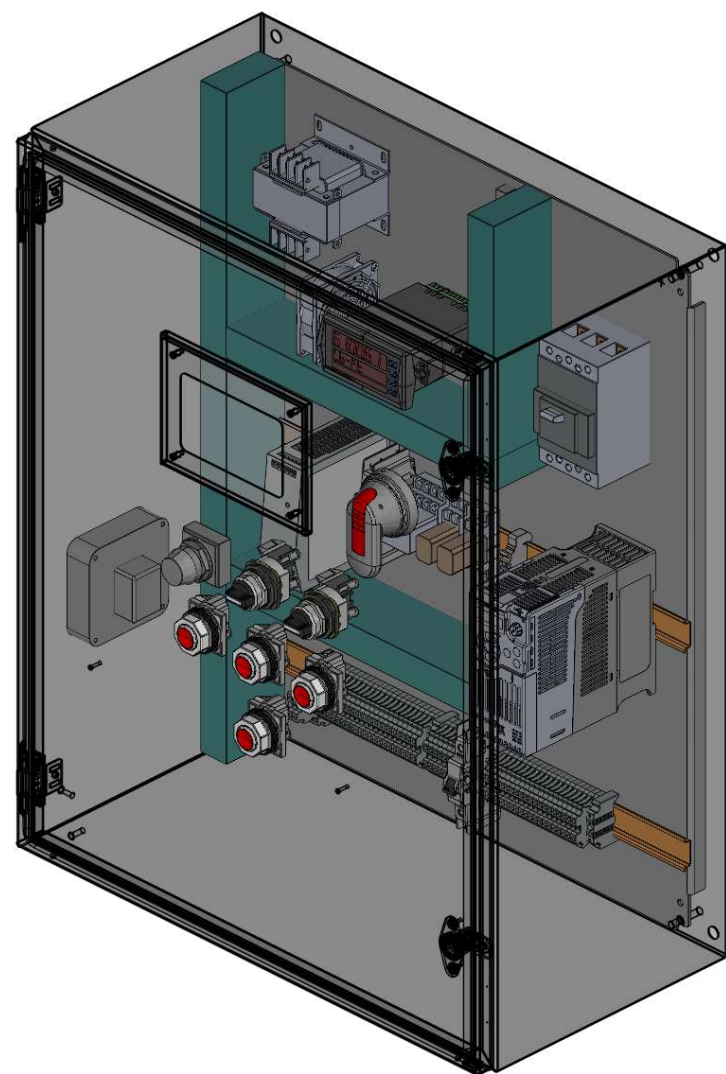

Top

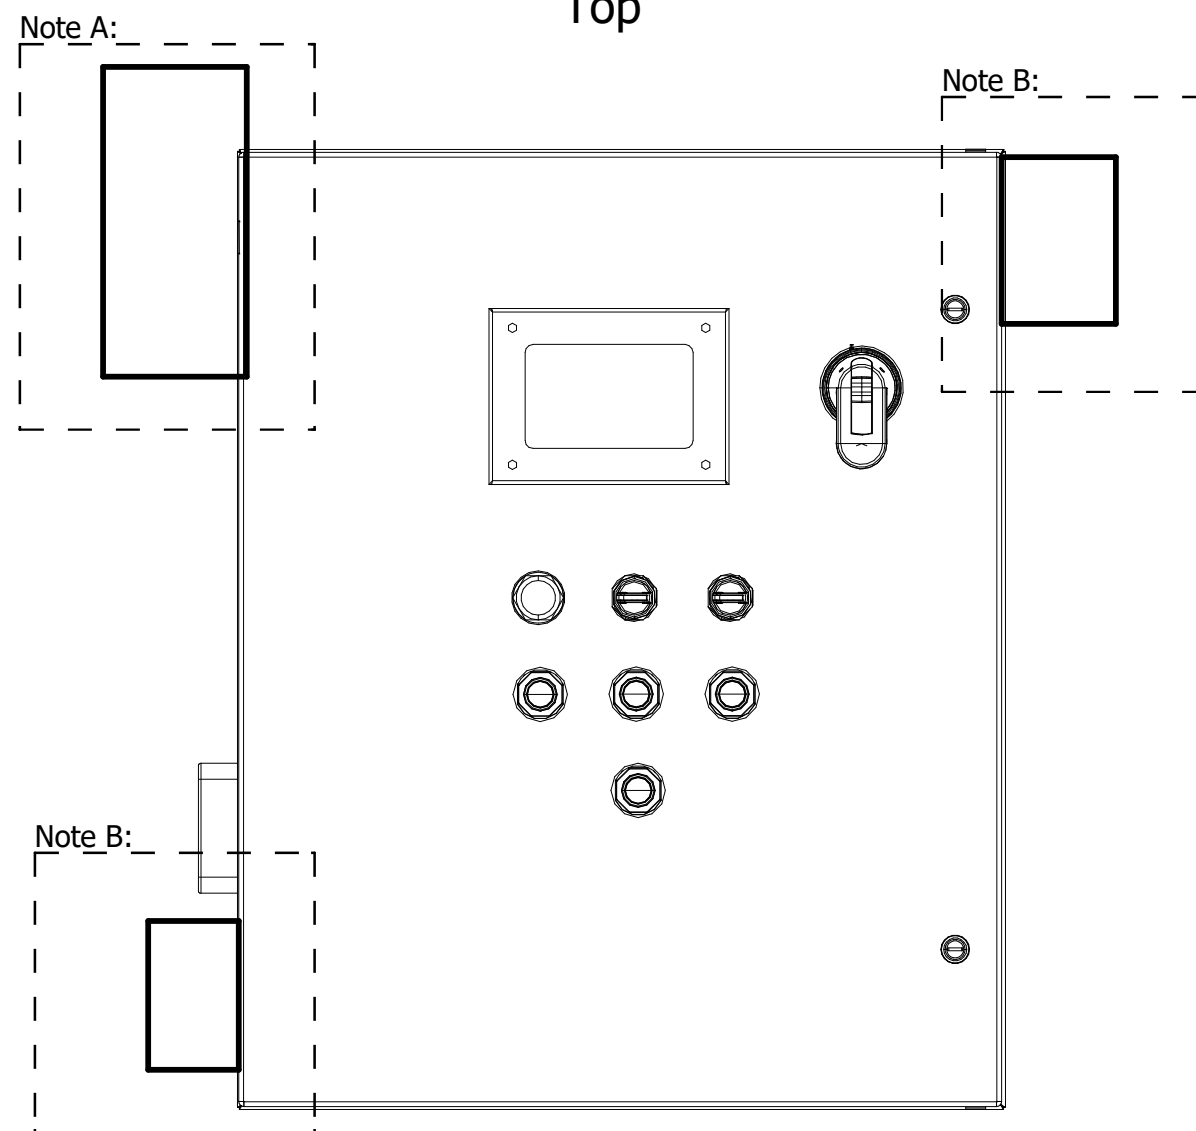

Front



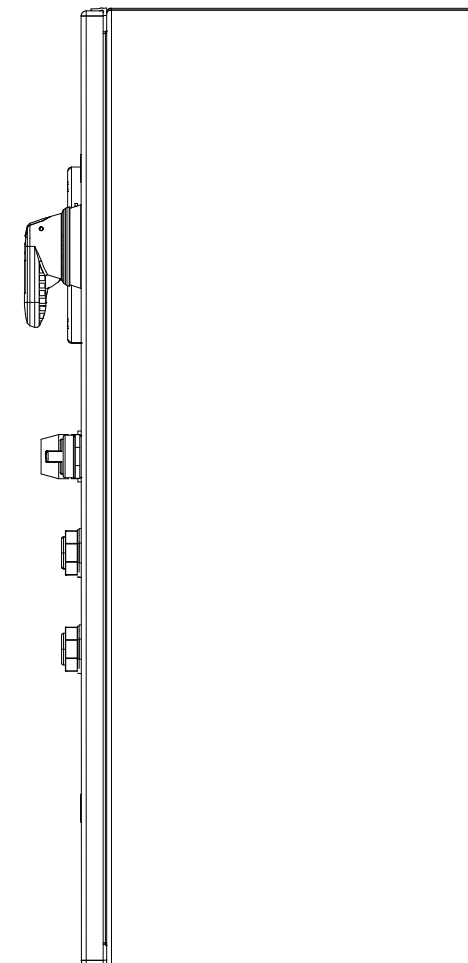


Right

NOTES

Note A: Tower ligths mounted here
Note B: Ventilation mounted on
either side of enclosure

DRAWING REV 01	PROJECT NO.	PAGE Panel Layout	 5591 LEO PARK RD WEST JORDAN, UT 84081
DESIGNER Carlo Flores	CUST JOB ID	TITLE Secret Panel	
APPD BY	INSTALLATION		
DATE	PANEL ID PP 001		
SIZE B	DWG NO.	SHEET 5 / 8	

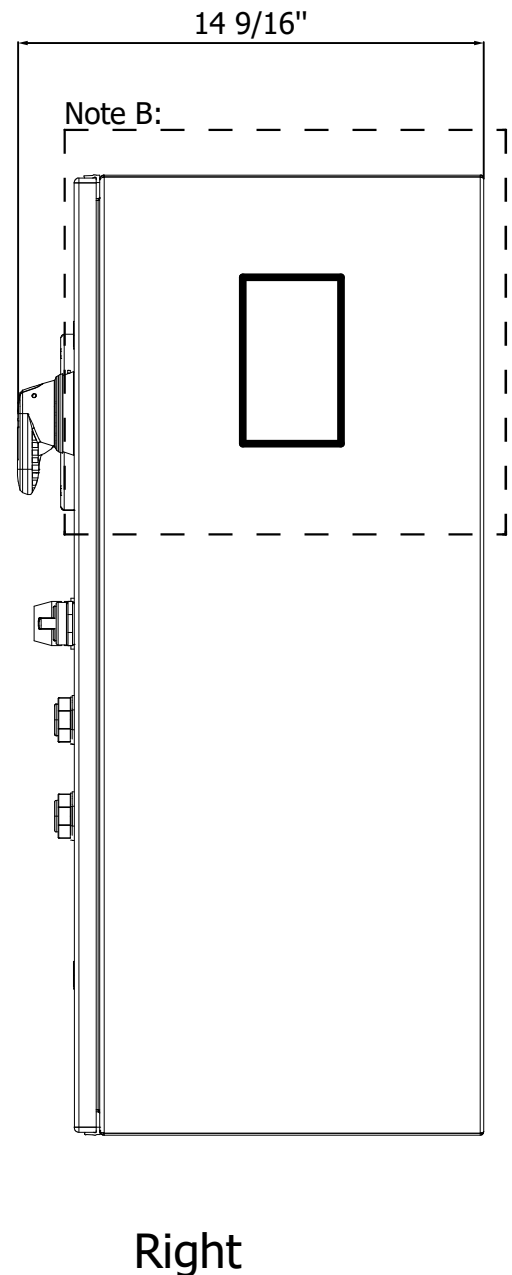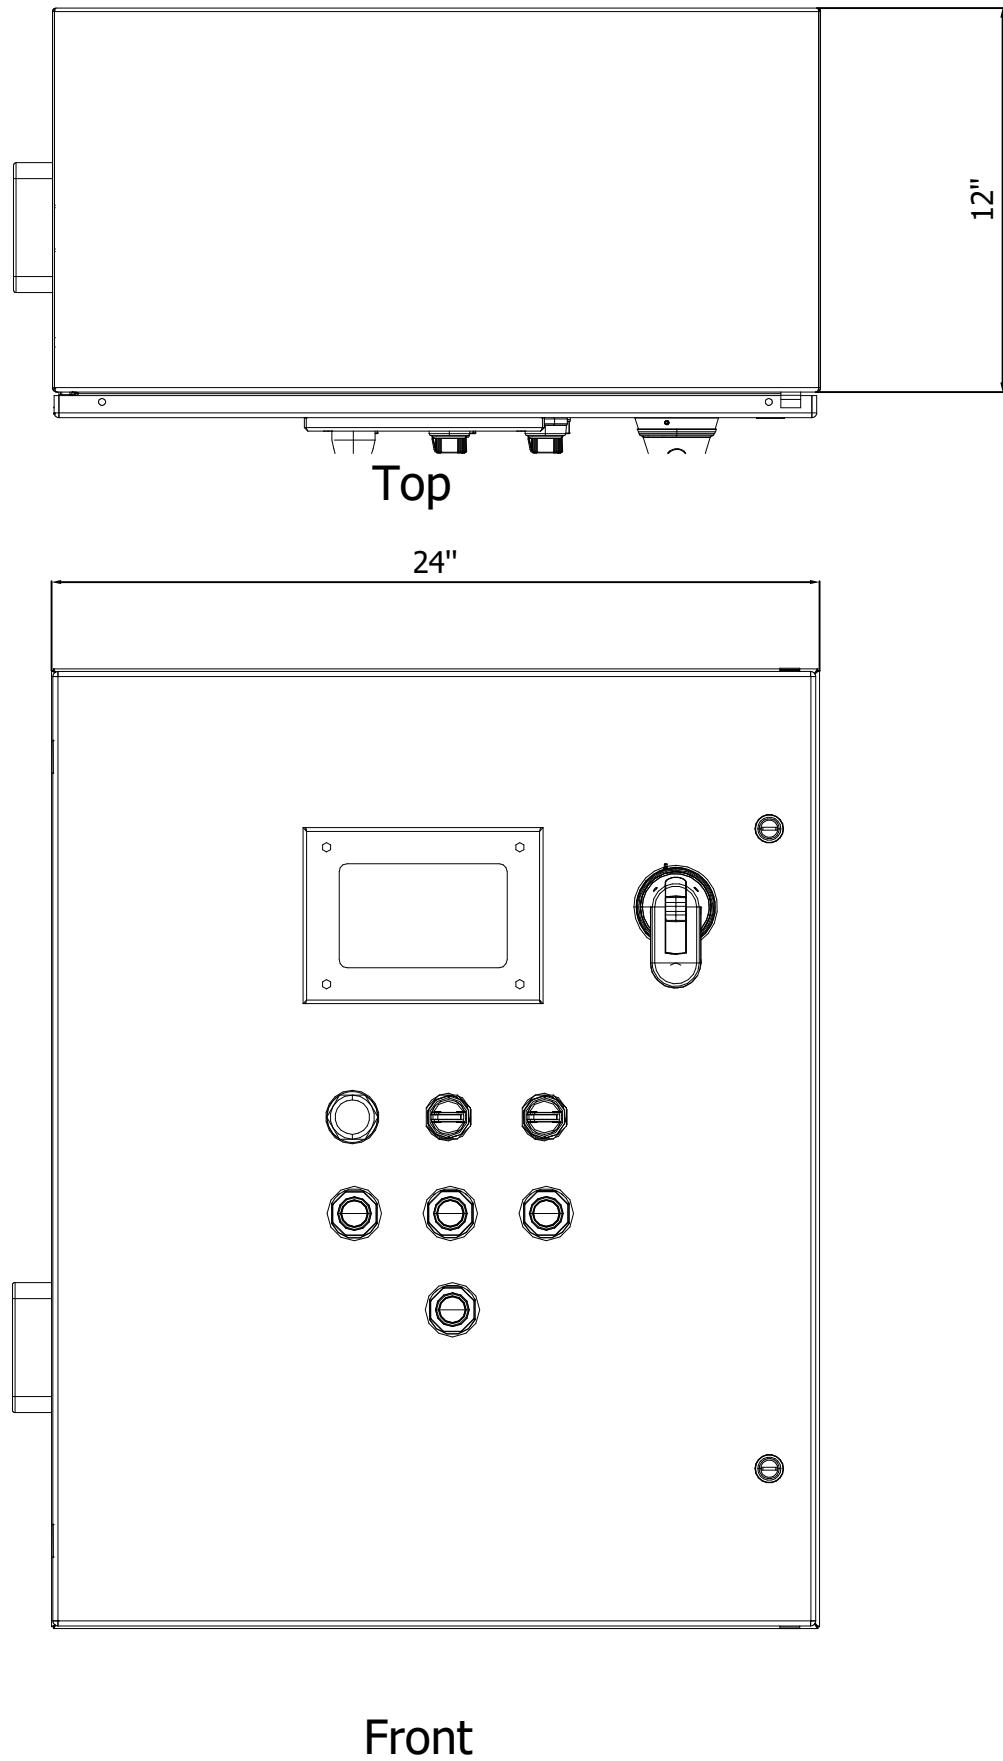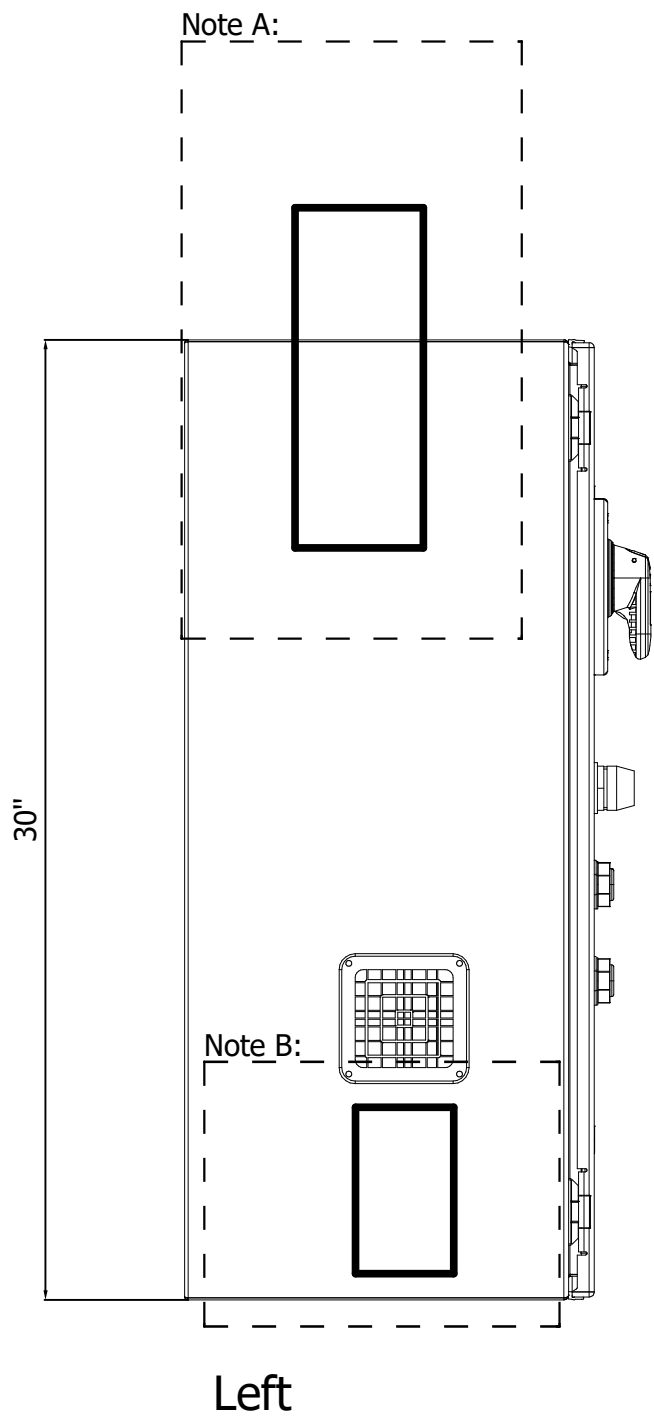

NOTES


Note A: Tower ligths mounted here
Note B: Ventilation mounted on
either side of enclosure

DRAWING REV 01	PROJECT NO.	PAGE Enclosure Dimensions
DESIGNER Carlo Flores	CUST JOB ID	TITLE Secret Panel
APPD BY	INSTALLATION	
DATE	PANEL ID PP 001	




5591 LEO PARK RD
WEST JORDAN, UT 84081

SIZE B	DWG NO.	SHEET 6 / 8
-----------	---------	----------------

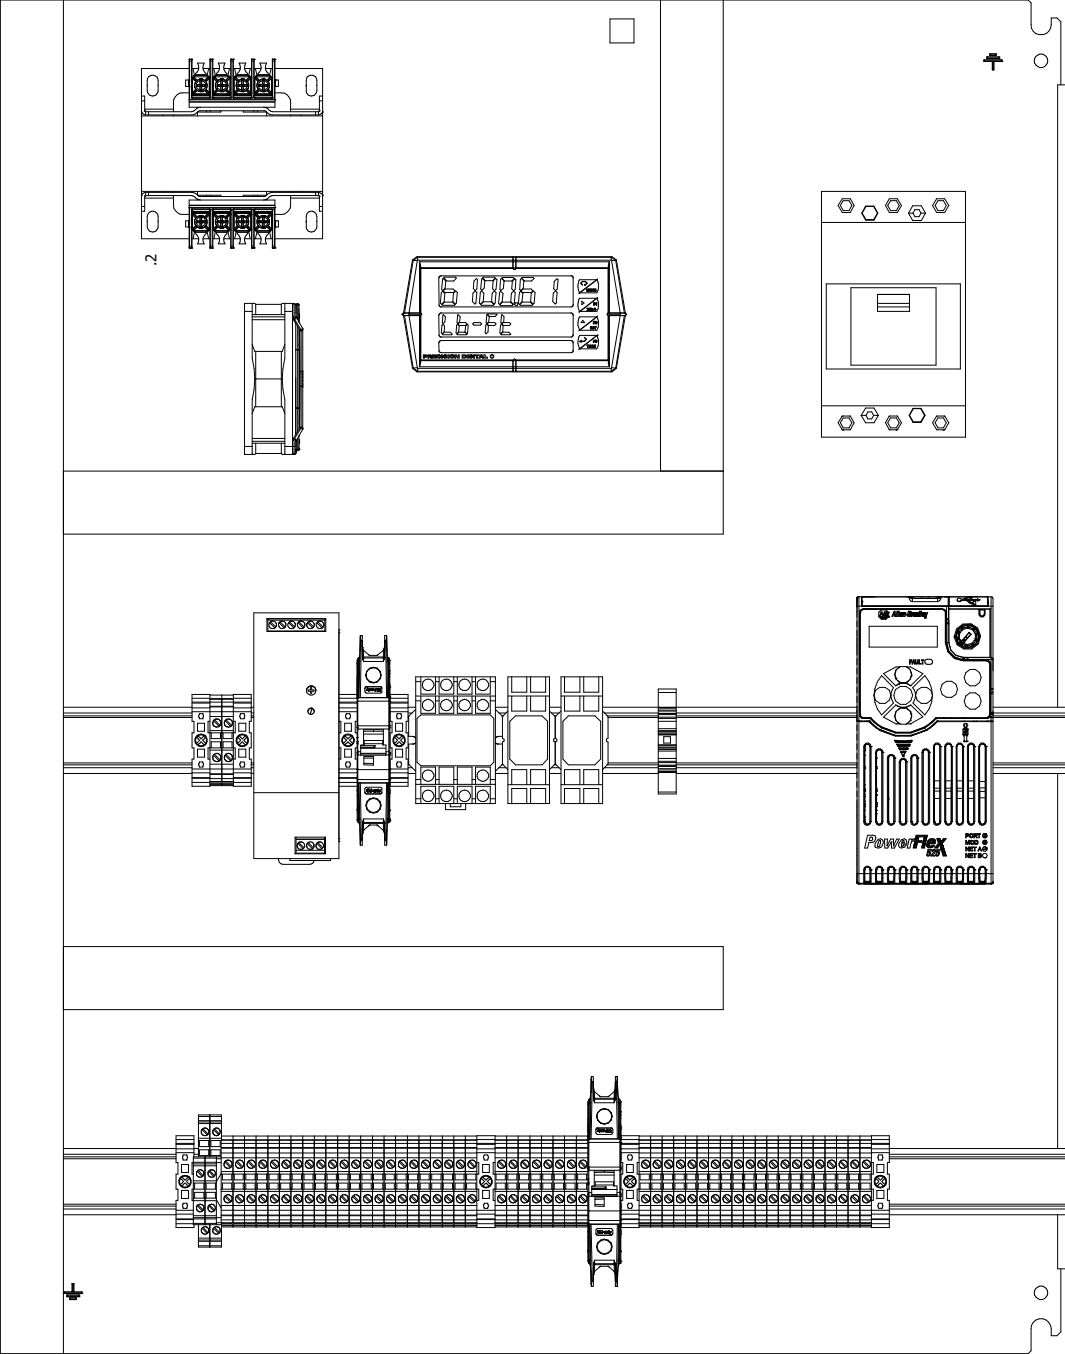

Internal General Arrangement

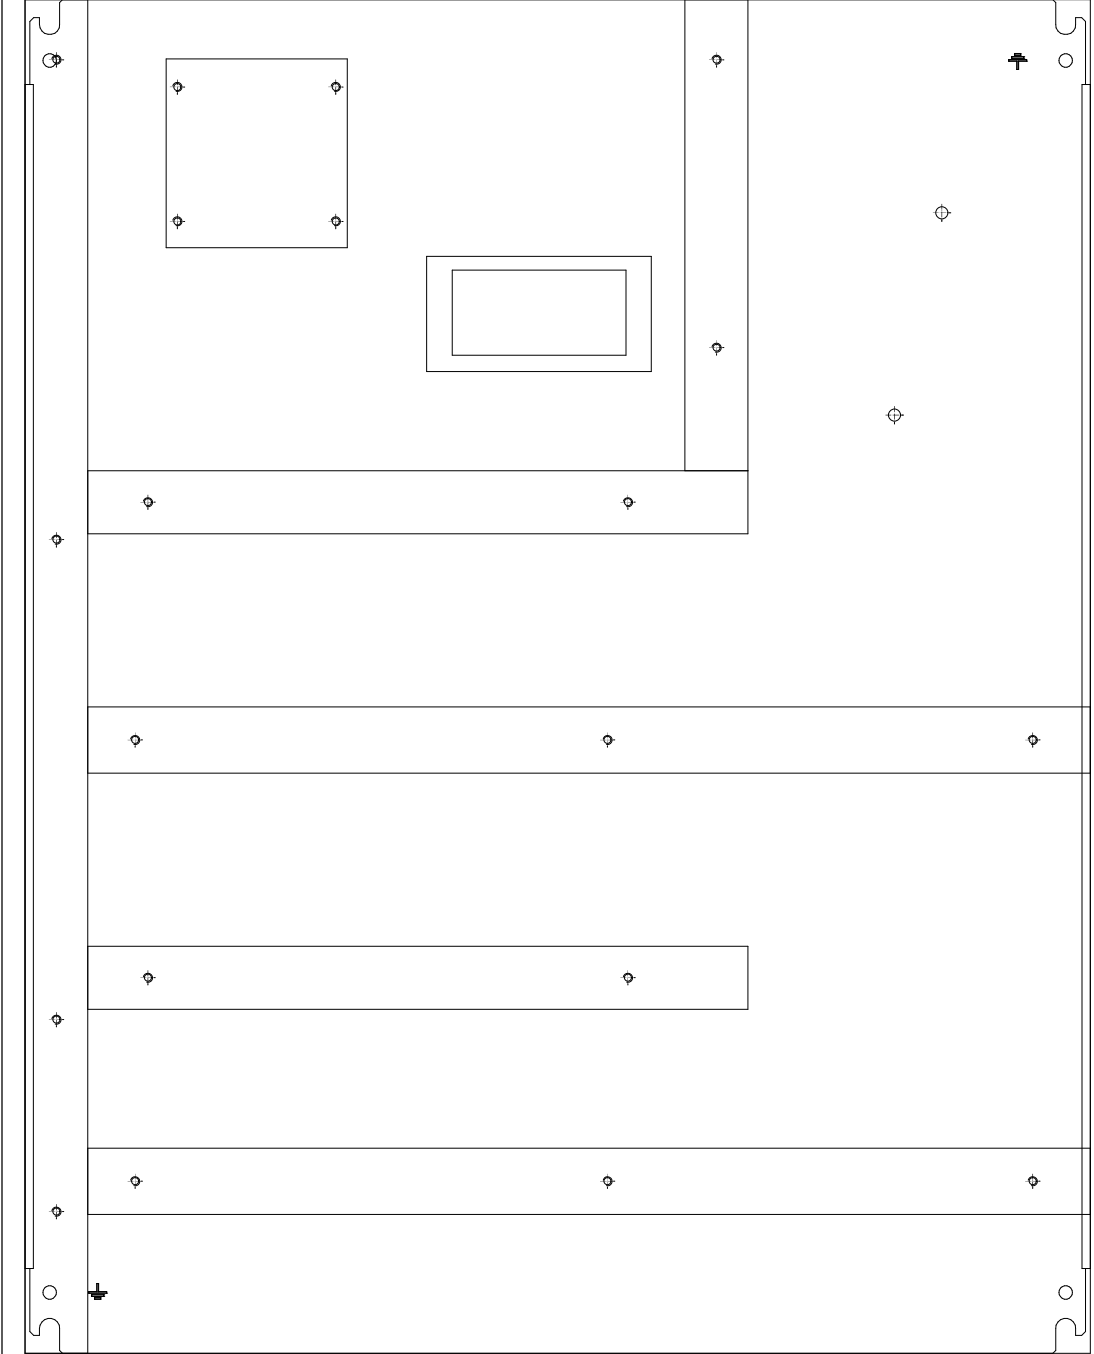

NOTES


DRAWING REV 01	PROJECT NO.
DESIGNER Carlo Flores	CUST JOB ID
APPD BY	INSTALLATION
DATE	PANEL ID PP 001

PAGE Mounting Panel Layout
TITLE Secret Panel



5591 LEO PARK RD
WEST JORDAN, UT 84081

SIZE B	DWG NO.	SHEET 7 / 8
-----------	---------	----------------

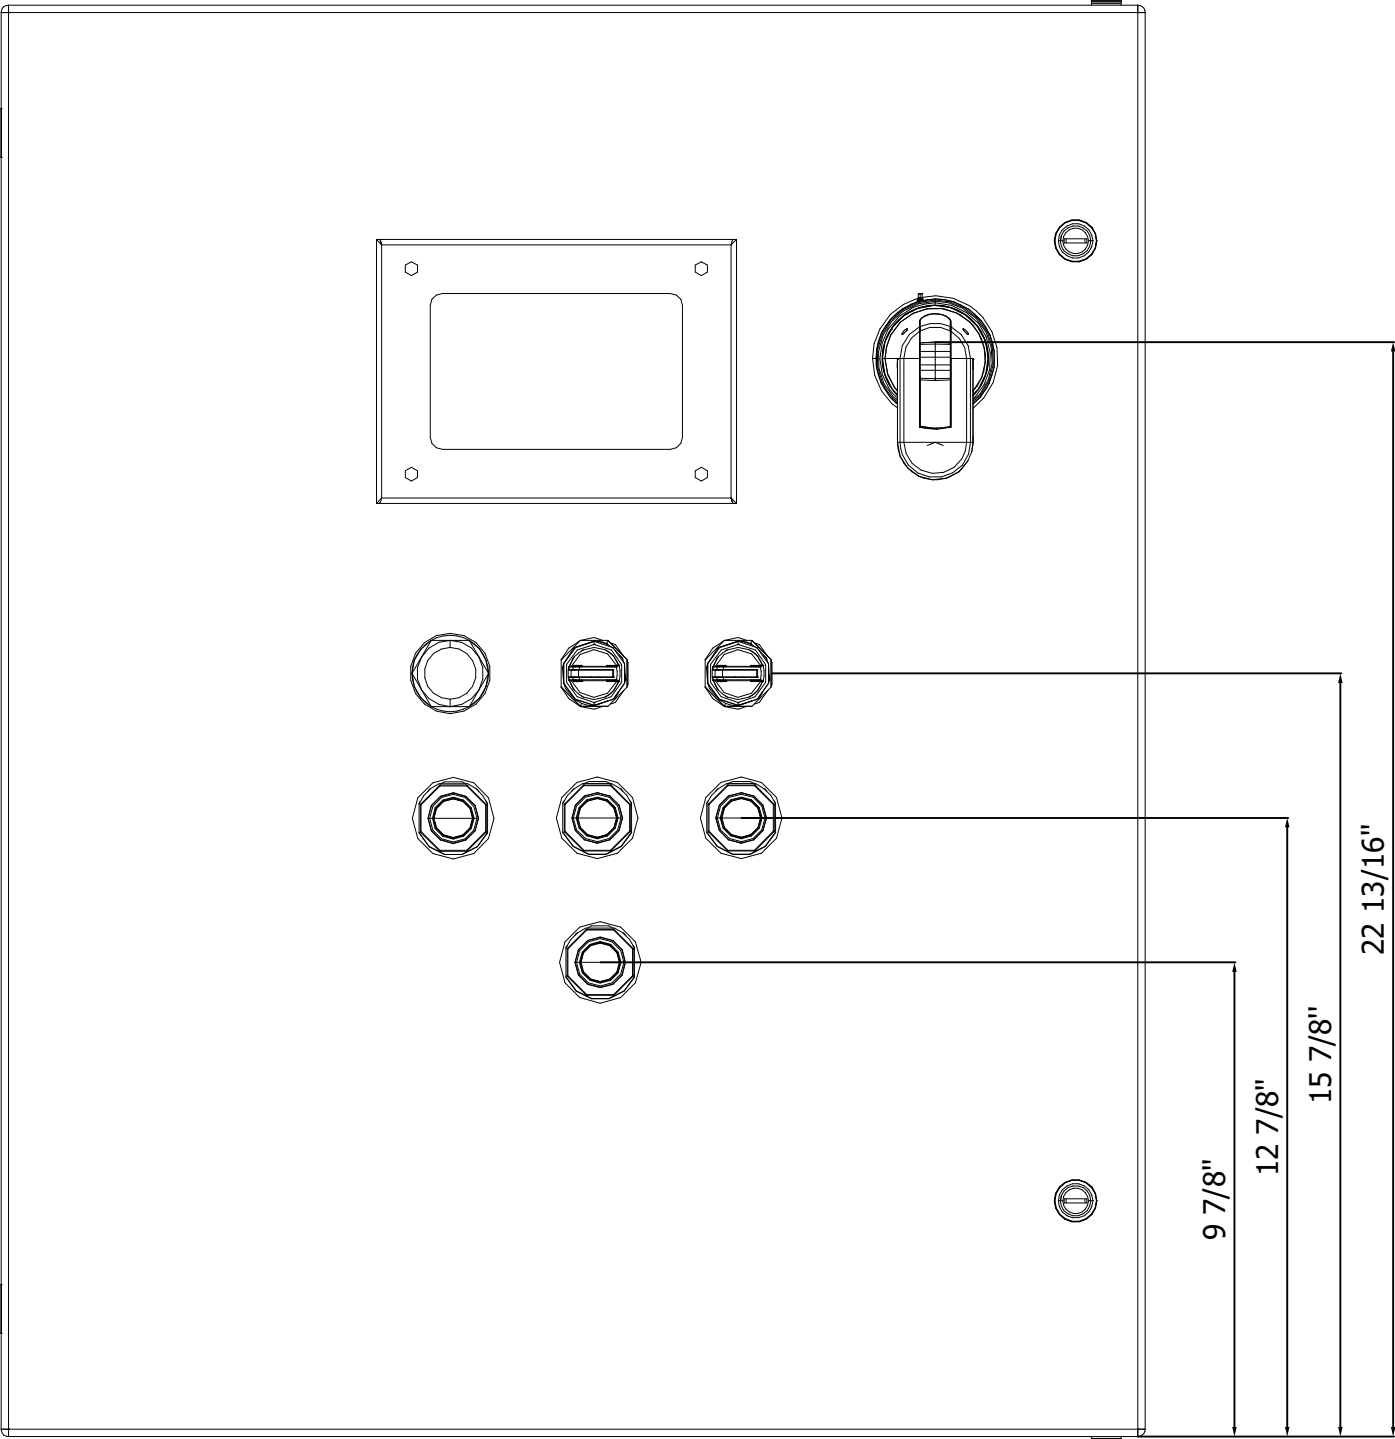

Door

NOTES

DRAWING REV 01	PROJECT NO.
DESIGNER Carlo Flores	CUST JOB ID
APPD BY	INSTALLATION
DATE	PANEL ID PP 001

PAGE Door Dimmensions
TITLE Secret Panel



MATRIX
SYSTEMS

5591 LEO PARK RD
WEST JORDAN, UT 84081

SIZE
B

DWG NO.

SHEET

8 / 8