



Bringing water to life®

SOUTH FLORIDA WMD, FL
TRASH RAKE SYSTEM MAIN
CONTROL PANEL

ELECTRICAL DRAWING INDEX	
DWG #	SHEET
RSD0203-121 SHEET 1	COVER SHEET INCLUDING TABLE OF CONTENTS, PANEL DESIGNATIONS
RSD0203-121 SHEET 2	GENERAL DRAWING NOTES
RSD0203-121 SHEET 3	ONE LINE 120 VAC
RSD0203-121 SHEET 4	HOT RAIL SYSTEM OVERVIEW
RSD0203-121 SHEET 5	NETWORK LAYOUT INCLUDING IP ADDRESS
RSD0203-121 SHEET 6	CONTROL PANEL ASSEMBLY
RSD0203-121 SHEET 7	DOOR OPERATORS LAYOUT
RSD0203-121 SHEET 8	INTERIOR PANEL DETAIL VIEW SHEET 01
RSD0203-121 SHEET 9	BILL OF MATERIALS
RSD0203-121 SHEET 10	MAIN POWER SCHEMATIC 01
RSD0203-121 SHEET 11	MAIN POWER & CONTROL SCHEMATIC
RSD0203-121 SHEET 12	CONTROL SCHEMATIC

UPDATED AS PER COMMENTS	026605	AB	AC	02/02/26
INITIAL RELEASE	026271	SMM	AC	11/11/25
REVISION	EN/ECO	BY	CHECK'D	DATE

DRAWN BY	SMM
CHECKED BY	AC
DATE	11/10/25
PROJECT	RSD0000203-01
REF	RSD0122-121



THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY INFORMATION OF OVIVO AND ITS AFFILIATES AND IS NOT TO BE DISCLOSED NOR TO BE USED EXCEPT FOR EVALUATING PROPOSALS OF OVIVO OR INSTALLING, OPERATING OR MAINTAINING OVIVO EQUIPMENT UNLESS OTHERWISE AUTHORIZED IN WRITING BY OVIVO. UNCONTROLLED COPY # 1. PRINTED: ALL RIGHTS RESERVED.

SOUTH FLORIDA WMD, FL
TRASH RAKE SYSTEM MAIN CONTROL PANEL



RSD0203-121

SHEET
1 OF 12

B
REVISION

CONSTRUCTION NOTES

CONTROL PANEL SPECIFICATIONS

1.

COMPONENTS SPECIFIC

1.1 ENCLOSURE TO BE NEMA 12 CONSTRUCTION.

1.2 ATTACH NAMEPLATES WITH MANUFACTURER'S RECOMMENDED ADHESIVE TO MAINTAIN NEMA STANDARD OF ENCLOSURE

1.3 CONTROL PANEL SHALL BE LABELED WITH SERIALIZED UL LABEL

1.4 PANEL WILL BE LABELED WITH IDENTIFICATION PLATE AS NOTED ON ENCLOSURE DRAWING.

1.5 ALL RELAY CONTACTS ARE RATED AT 10 AMPS UNLESS OTHERWISE NOTED BY THE PART MANUFACTURER.

1.6 COMPONENT IMAGES MAY NOT ACCURATELY REPRESENT THE ACTUAL DEVICE IN SOME INSTANCES. DIMENSIONS OF DEVICES, HOWEVER, WILL BE ACCURATE FOR PURPOSES OF LAYOUT AND SPACING.

1.7 SUBSTITUTIONS FOR COMPONENTS MAY BE PERMITTED UPON APPROVAL BY OVIVO ENGINEERS.
2.

WIRE SIZING & TYPE

WIRE SIZING SHALL BE NO LESS THAN AS FOLLOWS (UNLESS OTHERWISE NOTED):

480 3 PHASE - 12 AWG TYPE: MTW

120 1 PHASE - 14 AWG TYPE: MTW

24 VDC - 14 AWG TYPE: MTW
3.

WIRE COLOR

WIRE COLOR SHALL BE AS FOLLOWS:

POWER (480 VOLTS)

GREEN - GROUND

BLACK - ALL PHASES

CONTROL (120 VAC)

RED - LOAD WIRES FOR ALL LOCAL CONTROL CIRCUITS

WHITE - NEUTRAL FOR ALL LOCAL CONTROL CIRCUITS

YELLOW - FOREIGN POWER IN PANEL

CONTROL (24 VDC)

BLUE - LOAD WIRES FOR ALL LOCAL CONTROL CIRCUITS

WHITE W/BUE STRIPE - COMMON FOR ALL LOCAL CONTROL CIRCUITS
4.

CONNECTIONS

4.1 ALL CONNECTIONS SHALL BE POINT TO POINT WITHOUT SPLICES. EXCEPTIONS APPLY TO SOLENOIDS AND MOTORS AND FACTORY WIRED COMPONENTS.

4.2 ALL CONDUCTORS MUST BE MARKED WITH MACHINE PRINTED TAGS AT EACH TERMINATION. MARKERS SHALL BE OF HEAT SHRINK TYPE.
5.

DOCUMENTATION

5.1 FABRICATOR SHALL PROVIDE ONE COPY OF ALL DOCUMENTS SUPPLIED WITH THE COMPONENTS SUPPLIED BY THE FABRICATOR. THIS INFORMATION INCLUDES BUT IS NOT LIMITED TO MANUFACTURERS SPECIFICATIONS, INSTALLATION MANUALS AND OPERATION MANUALS.

5.2 ANY OVIVO APPROVED CHANGES OR MARK-UPS TO THE SCHEMATICS, PANEL LAYOUTS AND ANY OTHER PERTAINING DOCUMENTS SHALL BE MAINTAINED AND DELIVERED TO OVIVO AT ACCEPTANCE OF THE PANEL
6.

TESTING

6.1 OVIVO ENGINEERS OR OVIVO APPROVED FABRICATOR, WILL PERFORM A POINT TO POINT CONTINUITY TEST ON THE PANEL.

6.2 WHEN APPLICABLE, THE FABRICATOR WILL ALSO PROVIDE POWER TO THE 120VAC CIRCUITS FOR VERIFICATION AND TESTING. FABRICATOR SHALL ALLOW A MINIMUM OF 2 HOUR OF ACCESS TO THE CONTROL PANEL BY ENGINEER FOR THIS AND PREVIOUSLY STATED TEST. IF POSSIBLE 3 PHASE POWER WILL BE PROVIDED FOR TESTING.
7.

WIRING CONNECTIONS

7.1 INTERNAL PANEL WIRING


7.2 FIELD WIRING (NOT OVIVO SCOPE)

7.3 FIELD WIRING (PROVIDED BY OVIVO, INSTALLATION BY OTHERS)


7.4 COMMUNICATION

GENERAL DRAWING NOTES

120 VAC 1-PHASE POWER DISTRIBUTION

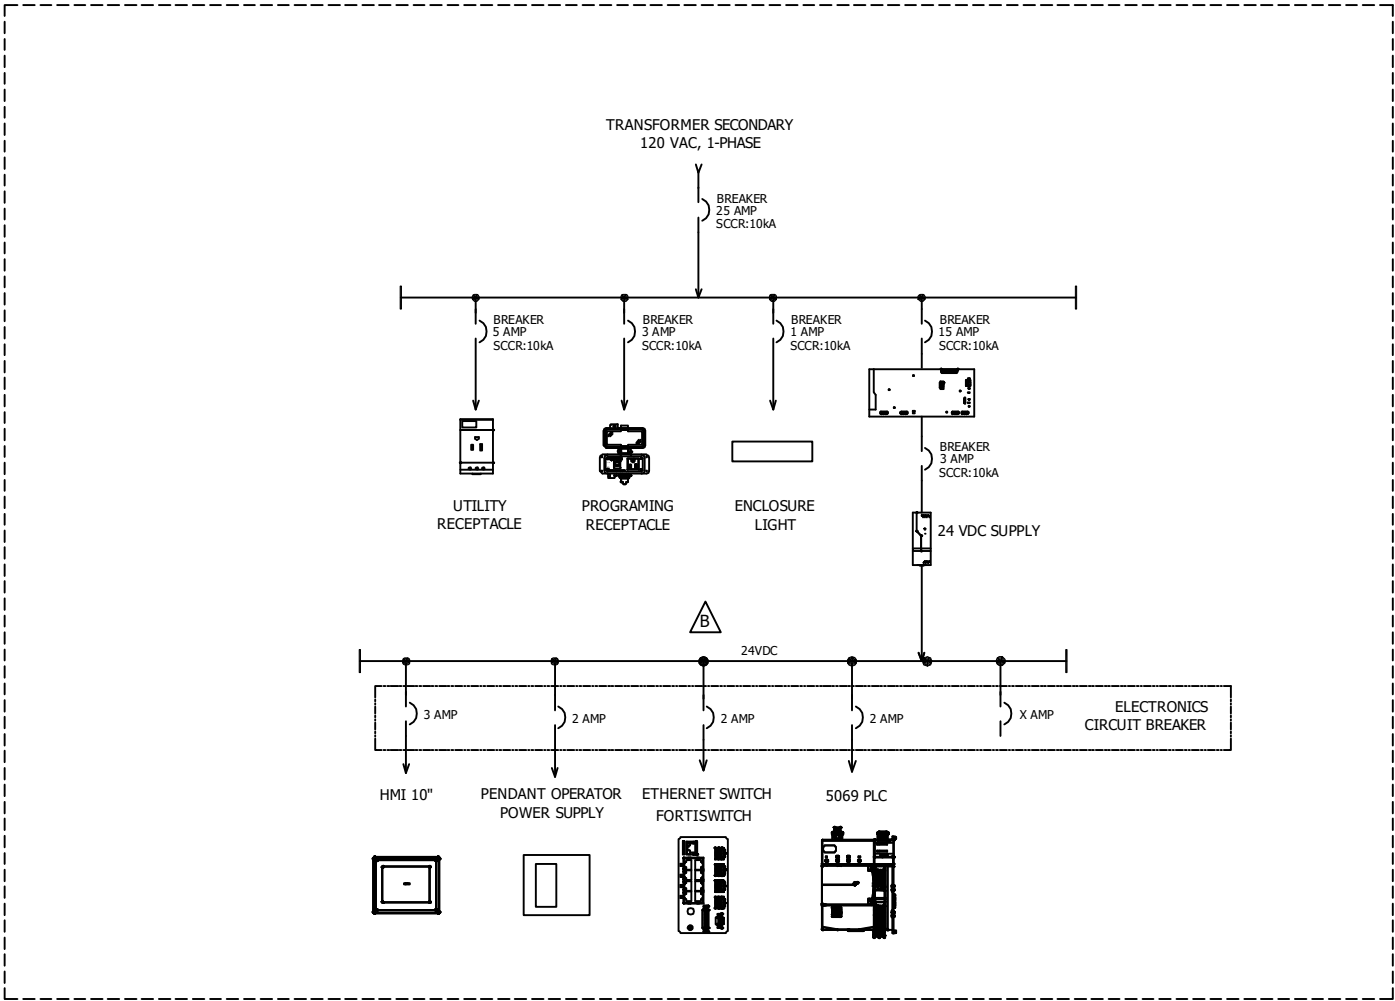

ONE LINE 120 VAC

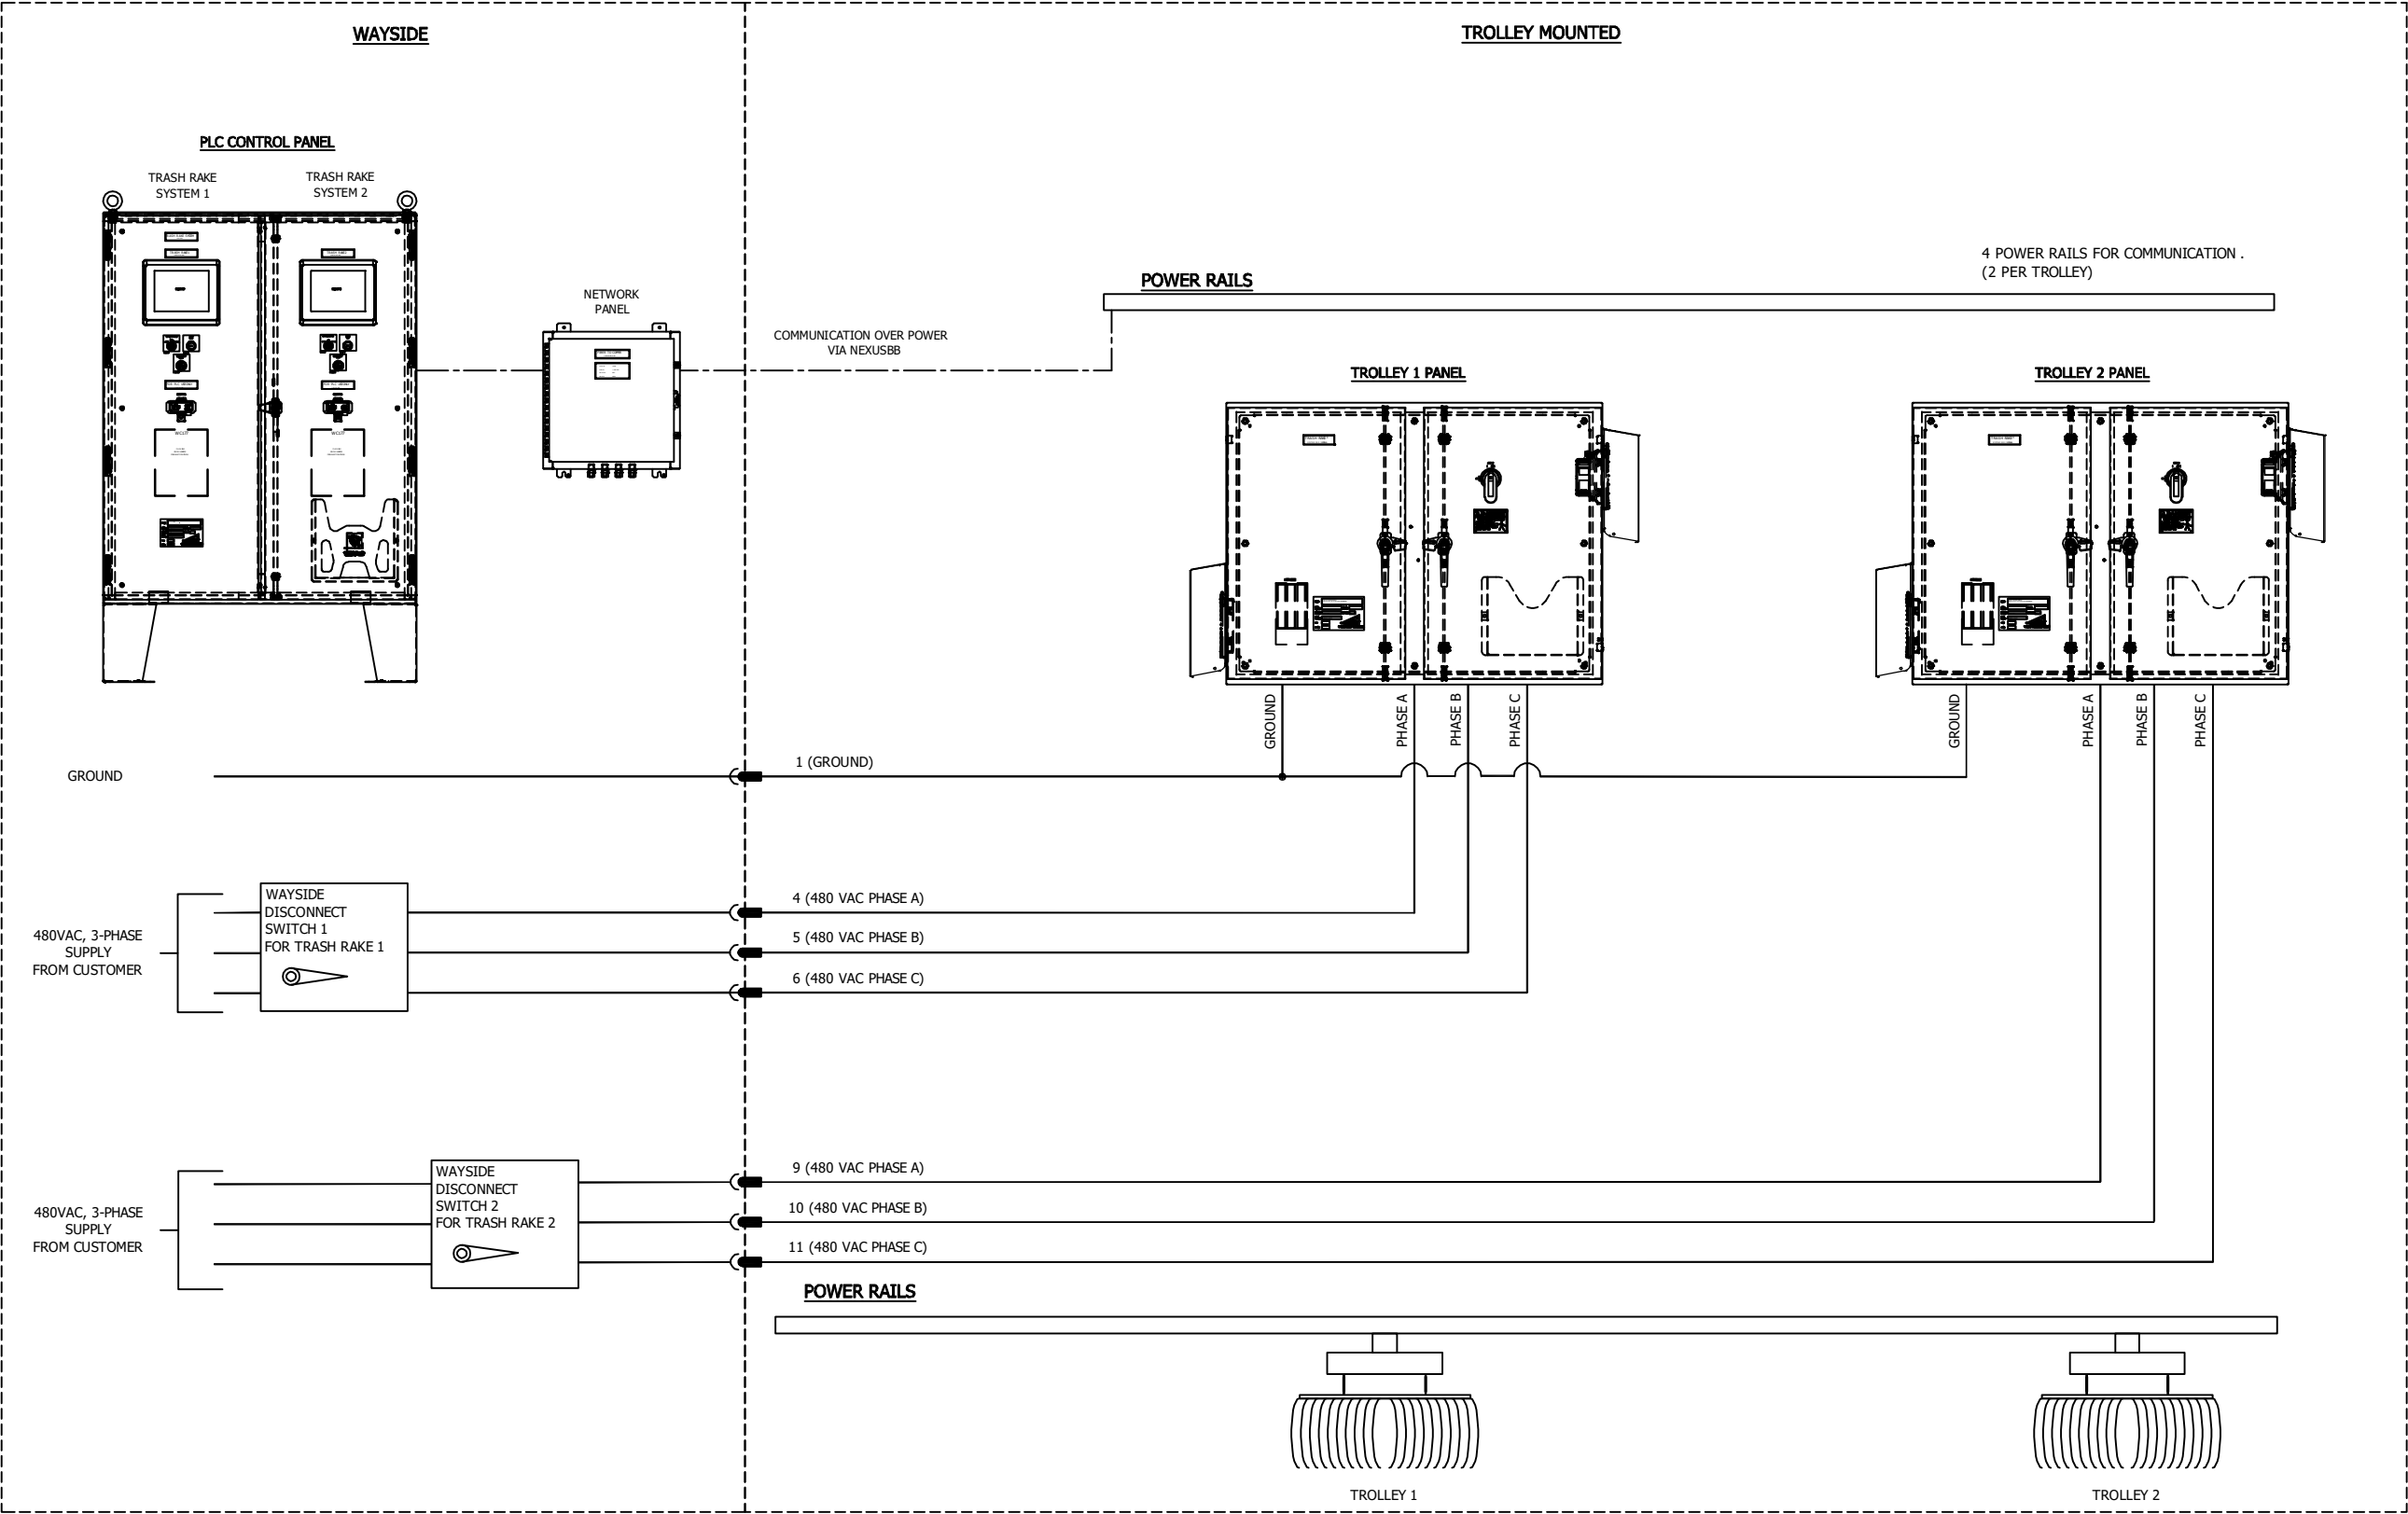

SYSTEM OVERVIEW


HOT RAIL SYSTEM OVERVIEW

NETWORK COMMUNICATIONS LAYOUT

FO NETWORK PANEL

DEVICE NAME: ES120
EQUIPMENT: FO/CU N/W SWITCH
LOCATION: FO N/W PANEL
TYPE: N/W SWITCH
PART NUMBER: 102MCE-SC-15
MANUFACTURER: RED LION
IP ADDRESS: TBD
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -
SPEED: 1000 MBPS
DUPLEX: FULL
TYPE: FIBER OPTIC

FOR TRASH RAKE TROLLEY 1 PANEL

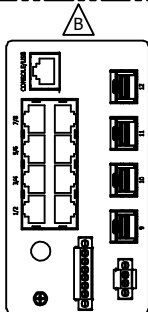

ES181 (12-PORT SWITCH)
IP: 192.168.1.20

DEVICE NAME: PLC212
EQUIPMENT: MAIN PLC
LOCATION: PLC PANEL
TYPE: PLC PROCESSOR
PART NUMBER: 5069-L320ER
MANUFACTURER: ALLEN BRADLEY
IP ADDRESS: 192.168.1.10
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: HM1179
EQUIPMENT: TOUCHSCREEN
LOCATION: PLC PANEL
TYPE: HMI INTERFACE
PART NUMBER: 2711P-T10C2D9P
MANUFACTURER: ALLEN BRADLEY
IP ADDRESS: 192.168.1.13
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: RECPT112
EQUIPMENT: PROGRAMING RECEPT.
LOCATION: PLC PANEL
TYPE: RECEPTACLE
PART NUMBER: P-R2-F2R0
MANUFACTURER: GRACE PORT
IP ADDRESS: 192.168.1.50
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER


DEVICE NAME: SPARE
EQUIPMENT: -
LOCATION: -
TYPE: -
PART NUMBER: -
MANUFACTURER: -
IP ADDRESS: -
SUBNET ADDRESS: -
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: SPARE
EQUIPMENT: -
LOCATION: -
TYPE: -
PART NUMBER: -
MANUFACTURER: -
IP ADDRESS: -
SUBNET ADDRESS: -
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: SPARE
EQUIPMENT: -
LOCATION: -
TYPE: -
PART NUMBER: -
MANUFACTURER: -
IP ADDRESS: -
SUBNET ADDRESS: -
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: SPARE
EQUIPMENT: -
LOCATION: -
TYPE: -
PART NUMBER: -
MANUFACTURER: -
IP ADDRESS: -
SUBNET ADDRESS: -
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

FOR TRASH RAKE TROLLEY 2 PANEL

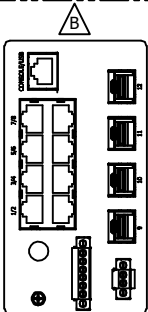

ES181 (12-PORT SWITCH)
IP: 192.168.1.21

DEVICE NAME: PLC212
EQUIPMENT: MAIN PLC
LOCATION: PLC PANEL
TYPE: PLC PROCESSOR
PART NUMBER: 5069-L320ER
MANUFACTURER: ALLEN BRADLEY
IP ADDRESS: 192.168.1.11
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: HM1179
EQUIPMENT: TOUCHSCREEN
LOCATION: PLC PANEL
TYPE: HMI INTERFACE
PART NUMBER: 2711P-T10C2D9P
MANUFACTURER: ALLEN BRADLEY
IP ADDRESS: 192.168.1.14
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: RECPT112
EQUIPMENT: PROGRAMING RECEPT.
LOCATION: PLC PANEL
TYPE: RECEPTACLE
PART NUMBER: P-R2-F2R0
MANUFACTURER: GRACE PORT
IP ADDRESS: 192.168.1.51
SUBNET ADDRESS: 255.255.255.0
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: SPARE
EQUIPMENT: -
LOCATION: -
TYPE: -
PART NUMBER: -
MANUFACTURER: -
IP ADDRESS: -
SUBNET ADDRESS: -
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: SPARE
EQUIPMENT: -
LOCATION: -
TYPE: -
PART NUMBER: -
MANUFACTURER: -
IP ADDRESS: -
SUBNET ADDRESS: -
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: SPARE
EQUIPMENT: -
LOCATION: -
TYPE: -
PART NUMBER: -
MANUFACTURER: -
IP ADDRESS: -
SUBNET ADDRESS: -
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: SPARE
EQUIPMENT: -
LOCATION: -
TYPE: -
PART NUMBER: -
MANUFACTURER: -
IP ADDRESS: -
SUBNET ADDRESS: -
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

DEVICE NAME: SPARE
EQUIPMENT: -
LOCATION: -
TYPE: -
PART NUMBER: -
MANUFACTURER: -
IP ADDRESS: -
SUBNET ADDRESS: -
GATEWAY ADDRESS: -
SPEED: 100 MBPS
DUPLEX: FULL
TYPE: COPPER

NETWORK COMMUNICATION




RSD0203-121


SHEET 1 OF 12



THIS DRAWING CONTAINS CONFIDENTIAL PROPRIETARY INFORMATION OF OVVO AND ITS AFFILIATES AND IS NOT TO BE DISCLOSED NOR TO BE USED EXCEPT FOR EVALUATING PROPOSALS OF OVVO OR INSTALLING, OPERATING OR MAINTAINING OVVO EQUIPMENT UNLESS OTHERWISE AUTHORIZED IN WRITING BY OVVO. UNCONTROLLED COPY # PRINTED: 6/25/24

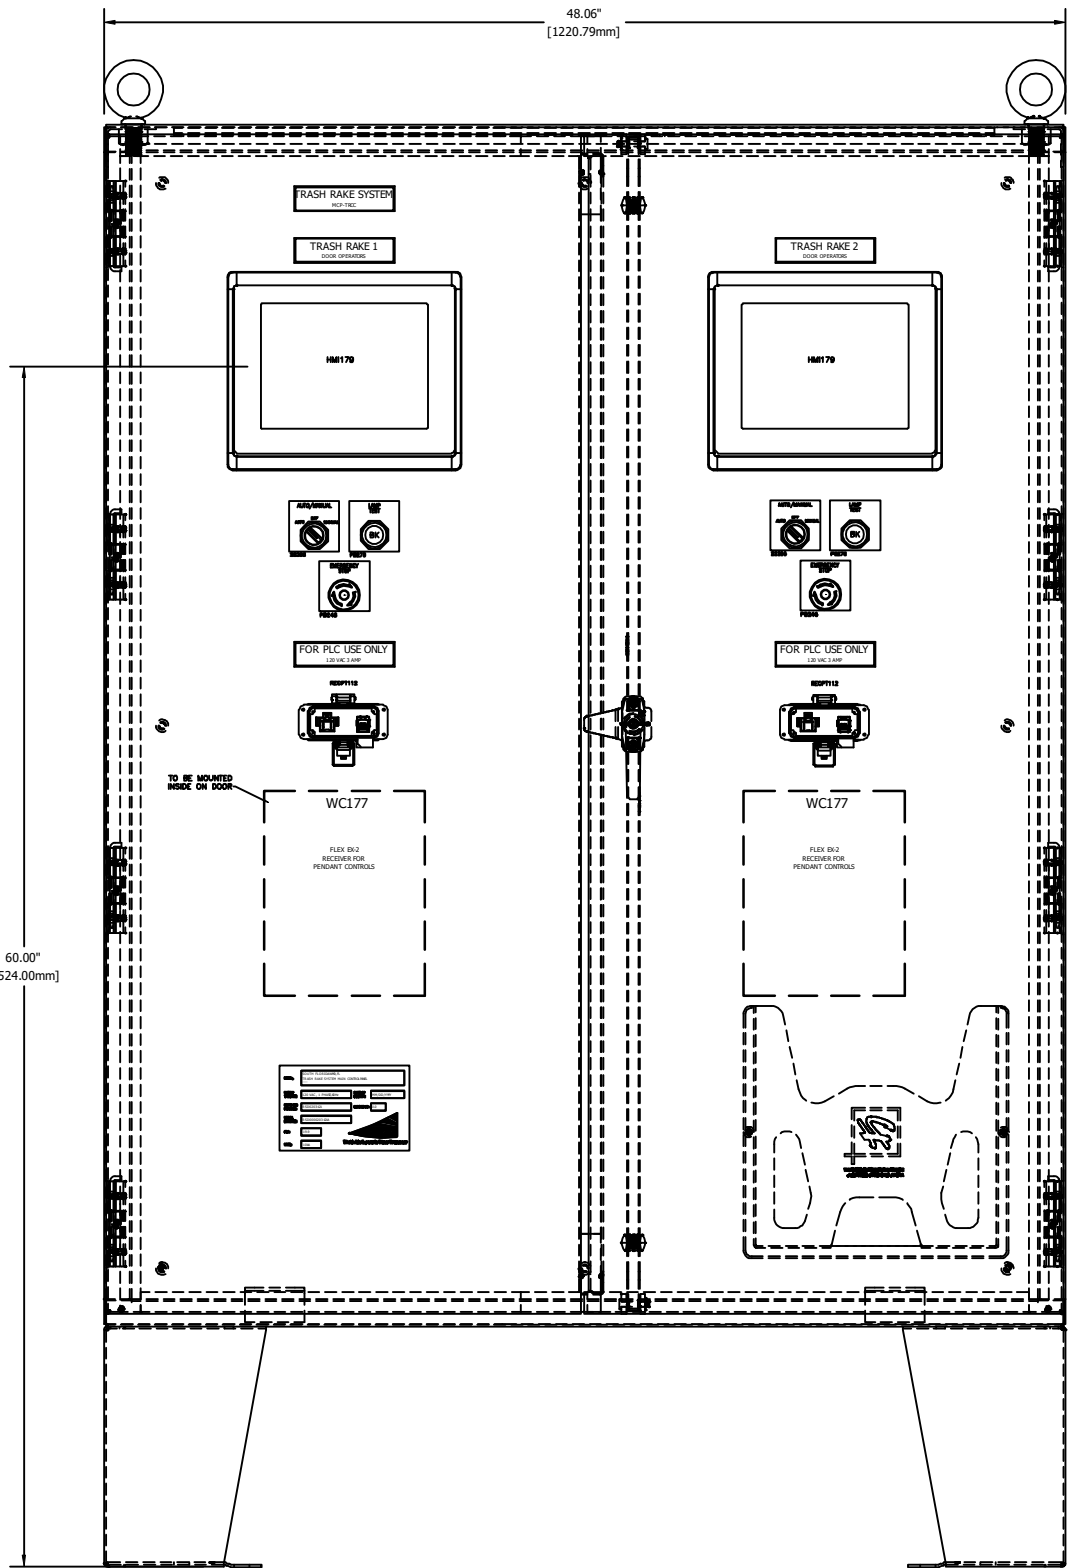


FRONT VIEW

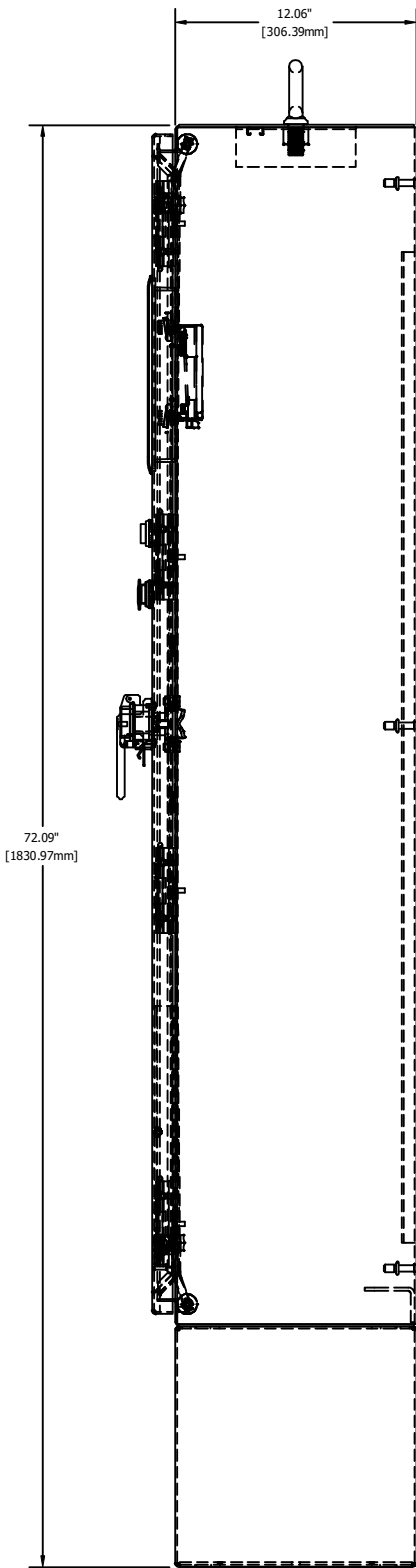


SIDE VIEW

ENCLOSURE LAYOUT

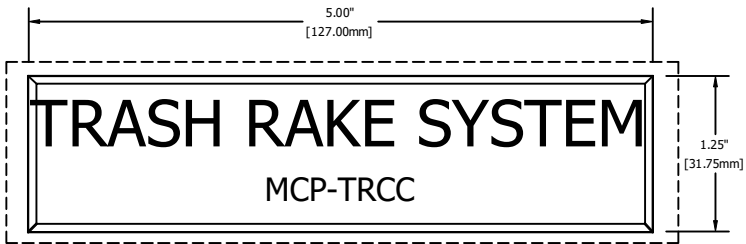


OVIVO NAMEPLATE
ENGRAVE AS SHOWN

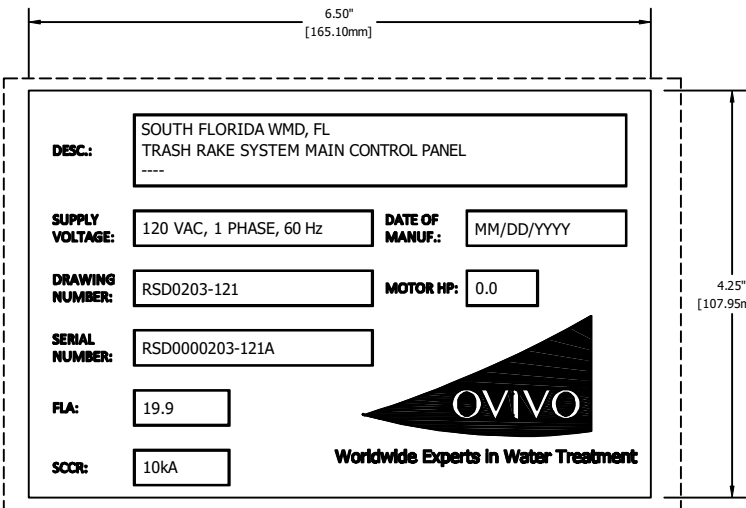


OVIVO NAMEPLATE
ENGRAVE AS SHOWN

CONTROL PANEL ASSEMBLY

**DOOR OPERATORS LAYOUT
FOR TRASH RAKE 1**

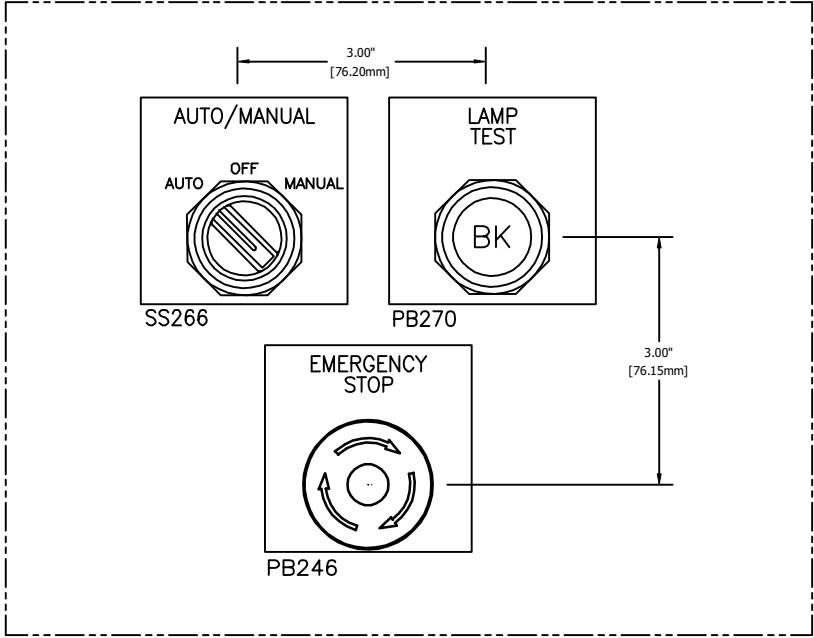

**DOOR OPERATORS LAYOUT
FOR TRASH RAKE 2**

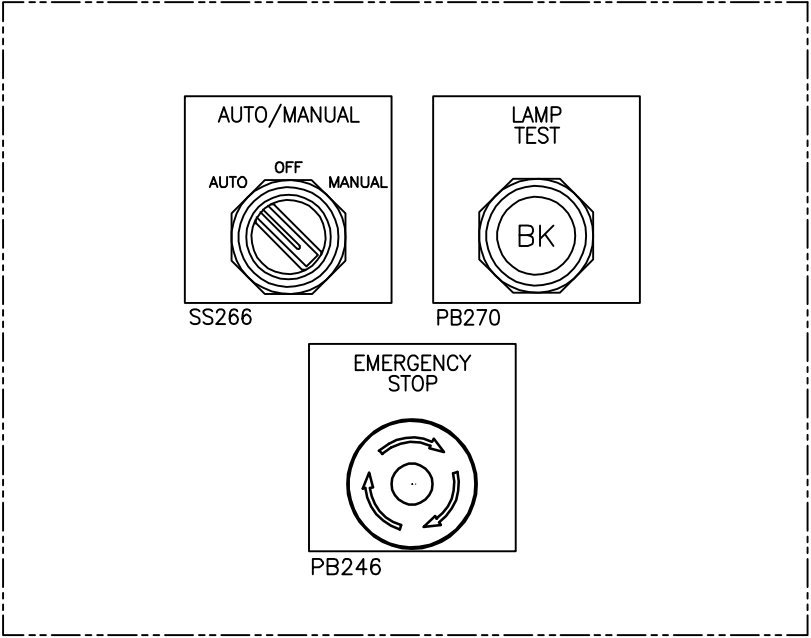

DOOR OPERATORS LAYOUT





BILL OF MATERIAL
(FOR TRASH RAKE 1 & 2 PLC PANEL)

SR.NO	QTY	TAG	CATALOG	MAKE	DESCRIPTION
1	1	ENCLOSURE	A604812LPG	HOFFMAN	TWO-DOOR FLOORSTAND GRAY INSIDE TYPE 12, 60.06X48.06X12.06, GRAY, STEEL
2	1	ENCLOSURE	A60P48	HOFFMAN	PANEL FOR TYPE 3R 4 4X 12 13 ENCLOSURE, FITS 60X48, WHITE, STEEL
3	2	LT116	EL900D	HOFFMAN	LED ENCLOSURE LIGHT, 900 LM, 100-240VAC
4	2	LT116	ELCN1	HOFFMAN	CONNECTORS FOR LED ENCLOSURE LIGHT, AC, INPUT AND OUTPUT
5	2	LT116	ELC3001DU	HOFFMAN	CABLE DOOR SWITCH FOR LED ENCLOSURE LIGHTS, 9.8 FEET
6	2	LT116	ELA02MF	HOFFMAN	MOUNTING ACCESSORIES FOR EL LED ENCLOSURE LIGHTS, MAGNET MOUNTING TYPE
7	2	LS116	ELD0801U	HOFFMAN	ENCLOSURE, DOOR SWITCH
8	2	GROUND	UGB2/0-414-6	PANDUIT	UNIVERSAL GROUNDING BAR
9	2	GROUND-ISO	UGB2/0-414-6 W/UGB-IN-SO	PANDUIT	UNIVERSAL GROUNDING BAR W/ISOLATION STAND-OFF
10	2	SUP101	1790753	PHOENIX CONTACT	SURGE PROTECTIVE DEVICE, REPLACEABLE SURGE PROTECTION PLUG WITH LOCAL STATUS INDICATOR, 1 PHASE POWER SUPPLY NETWORKS WITH NEUTRAL CONDUCTOR FOR 120VAC, PLUG IN REMOTE SIGNALING
11	2	CB102	1489-M1C250	ALLEN BRADLEY	MINIATURE MOLDED CASE CIRCUIT BREAKER, 1-POLE, 25AMP
12	2	CB144	1489-M1C150	ALLEN BRADLEY	MINIATURE MOLDED CASE CIRCUIT BREAKER, 1-POLE, 15AMP
13	2	CB108	1489-M1C050	ALLEN BRADLEY	MINIATURE MOLDED CASE CIRCUIT BREAKER, 1-POLE, 5AMP
14	4	CB112, CB153	1489-M1C030	ALLEN BRADLEY	MINIATURE MOLDED CASE CIRCUIT BREAKER, 1-POLE, 3AMP
15	2	CB116	1489-M1C010	ALLEN BRADLEY	MINIATURE MOLDED CASE CIRCUIT BREAKER, 1-POLE, 1AMP
16	2	PS156	1606-XLB240E	ALLEN BRADLEY	POWER SUPPLY, 240W, 24-28VDC OUTPUT, 1-PHASE, 10A, 90-264VAC INPUT
17	2	UPS146	2320283	PHOENIX CONTACT	UNINTERRUPTABLE POWER SUPPLY, QUINT 4, 1-PHASE AC TO 1-PHASE AC, 1KVA
18	4	BATT146, BATT148	1274117	PHOENIX CONTACT	BATTERY MODULE (DEVICE WITH BATTERY), VRLA-AGM, 24 V DC, 4 AH, AUTOMATIC DETECTION AND COMMUNICATION WITH QUINT UPS-IQ
19	2	WC177	FLEX-8EX2-15-2T	MAGNETEK	ONE 9-36 VDC RECEIVER AND TWO TRANSMITTERS WITH EIGHT 2-SPEED PUSHBUTTONS (4-MOTION, 2-SPEED WITH E-STOP, OFF/ON/START), 24VDC, WIRELESS
20	2	ECB176	2905744	PHOENIX CONTACT	8-CHANNEL, ELECTRONIC CIRCUIT BREAKER WITH ACTIVE CURRENT LIMITATION FOR PROTECTING EIGHT LOADS AT 24 V DC IN THE EVENT OF OVERLOAD AND SHORT CIRCUIT. WITH NOMINAL CURRENT ASSISTANT AND ELECTRONIC LOCKING OF THE SET NOMINAL CURRENTS. FOR INSTALLATION ON DIN RAILS.
21	2	PLC212	5069-L320ER	ALLEN BRADLEY	COMPACTLOGIX 5380 CONTROLLER, WITH 2 MB MEMORY 16 I/Os, 40 NODES
22	2	PLC212	5069-RTB64-SCREW	ALLEN BRADLEY	TERMINAL BLOCK, FOR CONTROLLER MOD POWER, 4-PIN, AND SA POWER, 6-PIN
23	2	PLC246	5069-RTB18-SCREW	ALLEN BRADLEY	TERMINAL BLOCK, FOR I/O MODULES, 18-PIN
24	2	PLC246	5069-IB16	ALLEN BRADLEY	COMPACTLOGIX DIGITAL INPUT MODULE, 16-POINT, 24VDC
25	2	PLC ACCESSORY	5069-ECR	ALLEN BRADLEY	TERMINAL END CAP, RIGHT SIDE
26	2	HMI179	2711P-T10C22D9P	ALLEN BRADLEY	OPERATOR INTERFACE, TOUCH SCREEN, PANELVIEW PLUS 7, PERFORMANCE, COLOR TERMINAL, 10.4 INCH, STANDARD COMMUNICATION: ETHERNET AND RS-232, 512 MB NONVOLATILE MEMORY, 512 MB RAM, DC POWER
27					
28					
29	2	PB270	800H-AR2A	ALLEN BRADLEY	PUSH BUTTON -BOOTLESS FLUSH HEAD, NEMA 4/4X, BLACK, WITH 1 N.O. + 1 N.C. CONTACTS
30	2	SS266	800H-JR2B	ALLEN BRADLEY	3-POSITION SELECTOR SWITCH, MAINTAINED, NEMA 4/4X, BLACK WITH WHITE INSERT, WITH 2 N.O.+ 2 N.C. CONTACTS
31	2	PB246	800H-TFRXT6A	ALLEN BRADLEY	PUSH BUTTON - STANDARD 45MM MUSHROOM HEAD, NEMA 4X/13 RED, TWIST RELEASE, WITH 1 N.O. + 1 N.C. CONTACTS
32	6	ALL ABOVE DOOR OPERATORS	GRAVOPLY ULTRA	GRAVOGRAPH	GENERIC OPERATOR TAG - ENGRAVE AS SHOWN
33	2	RECPT112	P-R2-F2R0	GRACEPORT	ETHERNET PORT CONNECTOR, CATEGORY 5 RJ-45 F/F BULKHEAD, AND ONE 120 VAC, 15 AMP RECEPTACLE, WITH NEMA 4X GASKETED HOUSING, WITH HINGED COVER
34	2	RECPT108	0804155	PHOENIX CONTACT	RECEPTACLE, 120VAC 15AMPS MAX
35	4	CR146, CR147	2966210	PHOENIX CONTACT	PLC INTERFACE RELAY, CONSISTING OF A RELAY BASE AND PLUGGABLE POWER CONTACT RELAY WITH MANUAL OPERATION, INTEGRATED LED, PUSH-IN-CONNECTION, SPST, N.O. CONTACT, 24VDC COIL VOLTAGE
36	76	TB-1, TB-2, TB-DI	2771010	PHOENIX CONTACT	DOUBLE-LEVEL TERMINAL BLOCK, NOM. VOLTAGE: 500 V, NOMINAL CURRENT: 24 A, CONNECTION METHOD: SCREW CONNECTION, 1ST AND 2ND LEVEL, RATED CROSS SECTION: 2.5 MM2, CROSS SECTION: 0.2 MM2 - 4 MM2, MOUNTING TYPE: NS 35/7,5, NS 35/15, NS 32, COLOR: GRAY
37	8	AS SHOWN	2771023	PHOENIX CONTACT	END COVER, GRAY COLOR
38	A/R	TB-1, TB-2, TB-DI	1050004	PHOENIX CONTACT	ZB 5 :UNBEDRUCKT - ZACK MARKER STRIP
39	10	TB-GND	441012	PHOENIX CONTACT	PROTECTIVE CONDUCTOR TERMINAL BLOCK, CONNECTIONS: 2, NUMBER OF POSITIONS: 1, CONNECTION METHOD: SCREW CONNECTION, RATED CROSS SECTION: 4 MM2, CROSS SECTION: 0.2 MM2 - 4 MM2, MOUNTING TYPE: NS 35/7,5, NS 35/15, NS 32, COLOR: GREEN-YELLOW
40	50	AS SHOWN	3022276	PHOENIX CONTACT	QUICK MOUNTING END CLAMP, DIN RAIL MOUNT, WITH MARKING OPTION AND PARKING OPTION , GRAY COLOR
41	A/R	AS SHOWN	1007219	PHOENIX CONTACT	MARKER CARD, CARD, WHITE, UNMARKED, CAN BE LABELED WITH: MARKER PEN, PERFORATED, MOUNTING TYPE: SNAP INTO TALL MARKER GROOVE, SNAP INTO FLAT MARKER GROOVE, FOR TERMINAL BLOCK WIDTH: 5 MM
42	A/R	FOR TERMINAL ORGANIZATION	0811969	PHOENIX CONTACT	TERMINAL STRIP MARKER CARRIER, HEIGHT ADJUSTABLE, FOR END BRACKETS CLIPFIX 15, 35, 35-5
43	A/R	AS SHOWN	0807012	PHOENIX CONTACT	SYMMETRICAL DIN RAIL, 35MMX7.5MM,1M LONG, ZINC PLATED CELAR CHROMATED STEEL
44	A/R	AS SHOWN	TYD2X3WPW6 WITH COVER TYD2CPW6	THOMAS & BETTS BY ABB	WIDE SLOT WIRING DUCT, PVC, 2 INCHES X 3 INCHES, WHITE WITH COVER
45	2	ENCLOSURE NAMEPLATE	679001	OVIVO PROPRIETARY TAG	ENCLOSURE NAMEPLATE
46	1	ENCLOSURE TAG	592273	OVIVO PROPRIETARY TAG	ENCLOSURE IDENTIFICATION TAG "TRASH RAKE SYSTEM CONTROL PANEL" ENGRAVE AS SHOWN

NOTE:
FORTISWITCH RUGGED FSR-112F-POE SWITCH WILL BE PROVIDED BY OTHERS
FOR INSTALLATION DURING PANEL BUILD.

BILL OF MATERIALS

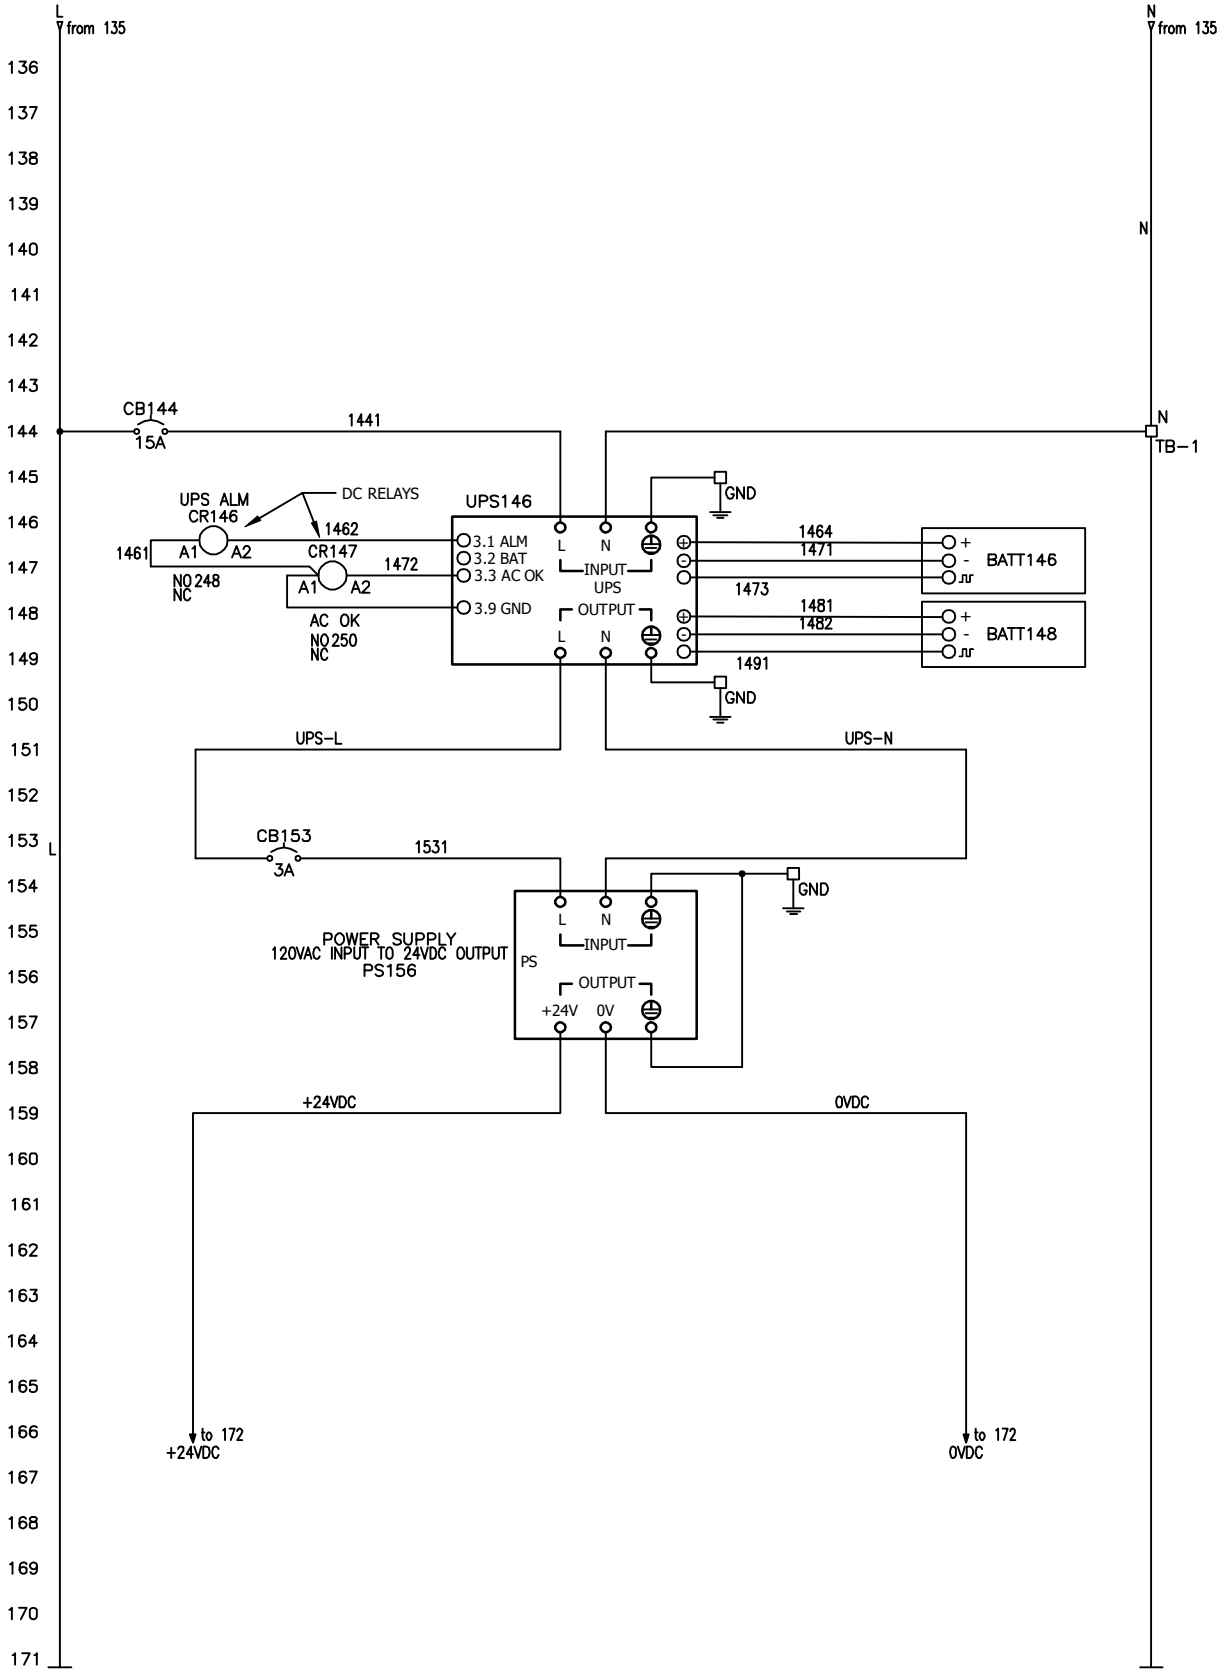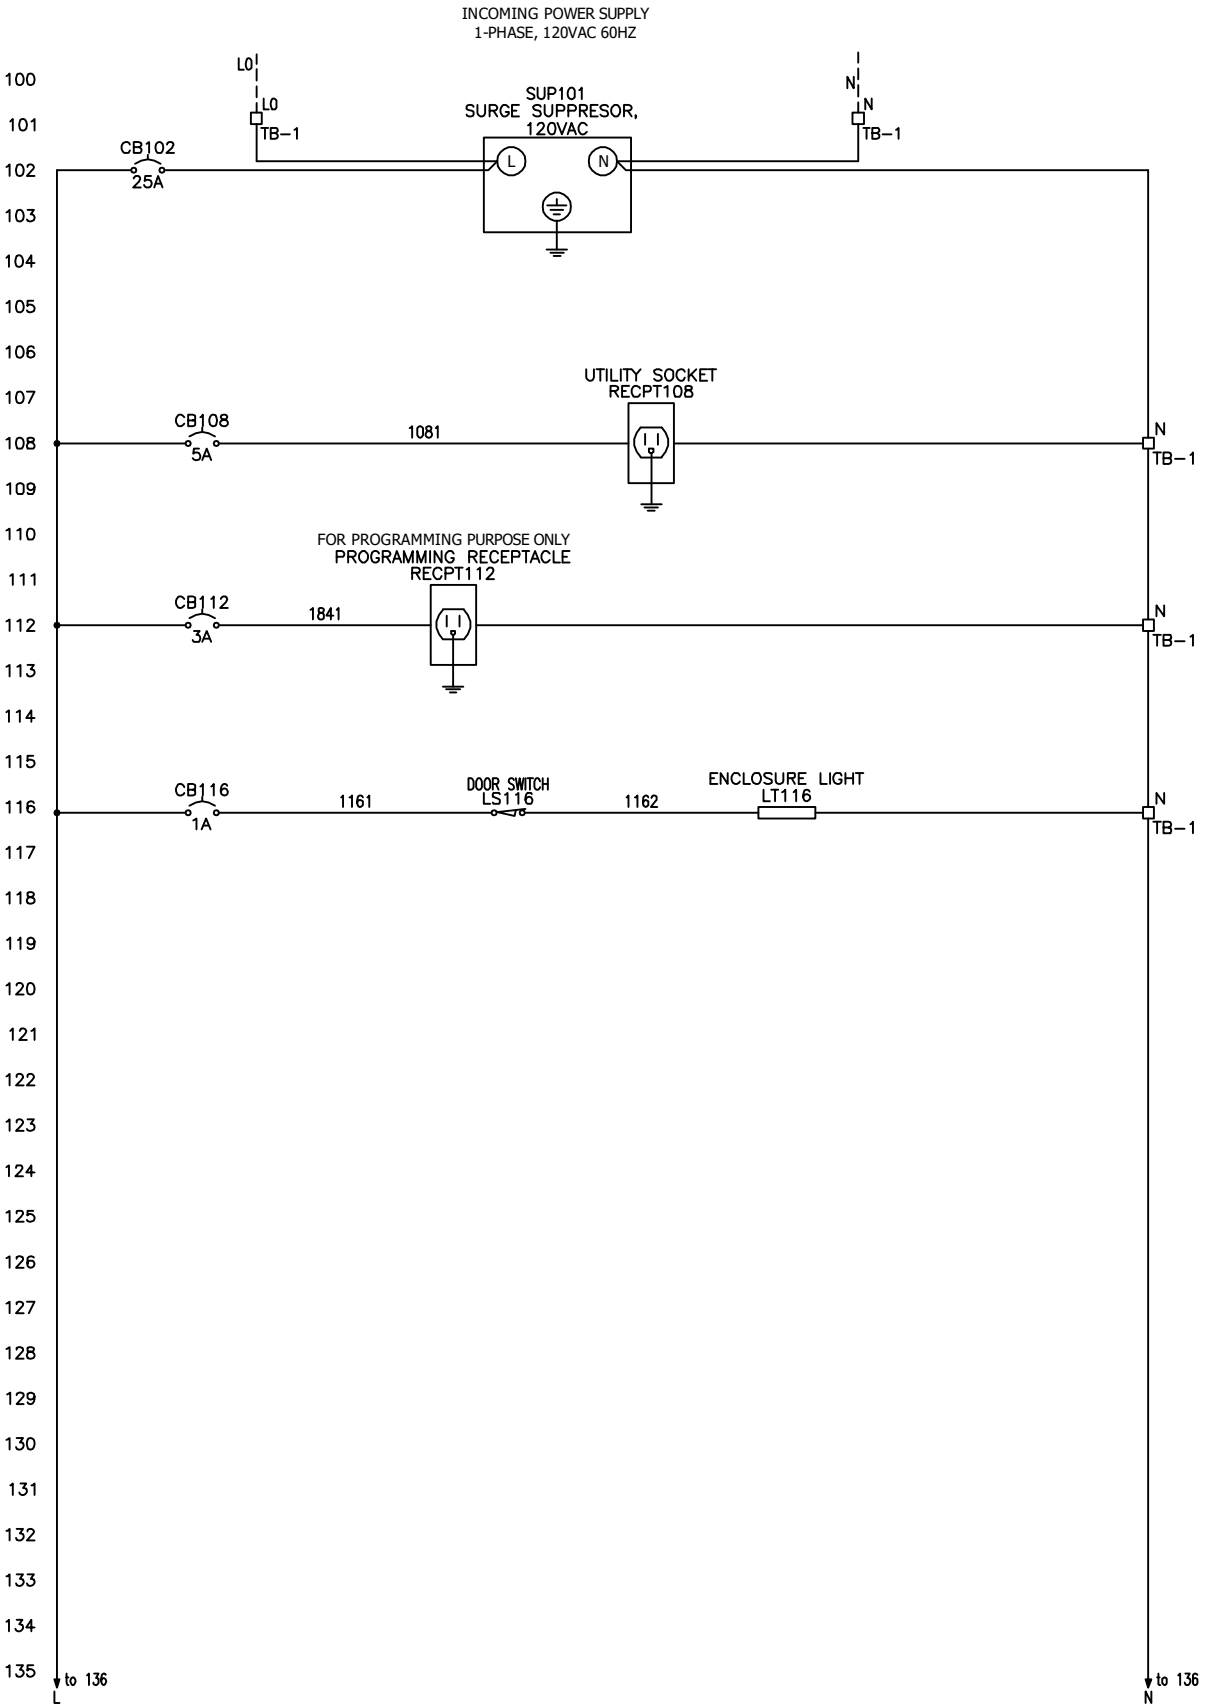

MAIN POWER SCHEMATIC 01

