Job Safety Training Outline

Built to align with DAFI 91-202 paragraph 14.1 requirements.

Unit: 113 Maintenance Squadron

Work Center: AIS

Office Symbol: CMF/MXMVT

Supervisor: Michael Touchette, MSgt, Avionics Back Shop Supervisor

Phone: 312-857-6298

Reviewer: Scott Morrill

Review Date: 2026-05-17

Effective Date: 2026-05-19

WORK CENTER OVERVIEW

The Avionics Intermediate Shop (AFSC: 2A0X1) Personnel perform and manage avionics test station functions and activities for F-16 aircraft. Personnel operate, inspect, maintain, program, and calibrate computer and manually operated avionics test equipment, support equipment, and aircraft avionics systems components. Certain components that are tested emit radio frequency radiation. Electrical hazards include high voltage and high amperage. Repair actions include soldering, utilization of hazmat for cleaning and adhesive purposes. Compressed Air and Compressed Nitrogen are used for cleaning and testing purposes. Personnel also process supplies through the supply system. This requires loading and unloading wooden crates and reusable cardboard containers of often heavy weight. Mobility requirements involve pallet building.

REQUIRED TRAINING TOPICS

Workplace Hazards | Personal Protective Equipment | Emergency Action and Fire Prevention | Reporting Unsafe Conditions | Reporting Mishaps and Occupational Injury/Illness | CA-10 and LS-201 | DAF Traffic Safety Program | DAFVA 91-209 | DAFSMS Responsibilities

- **Hazards and controls:** Address task hazards, environmental hazards, governing instructions, and hierarchy of controls including elimination, engineering, substitution, and administrative controls.
- **PPE:** Cover required protective equipment, wear/use procedures, cleaning, maintenance, storage, disposal, and supervisor notification concerns.
- **Emergency response:** Cover emergency action, fire prevention, alarms, AEDs, extinguishers, evacuation, shelter, active shooter response, and emergency contact procedures.
- **Reporting:** Explain unsafe condition reporting, injury/illness reporting, DAF Form 457, SAFEREP access, and anti-retaliation protections.
- **Program awareness:** Include CA-10 / LS-201 location, traffic safety program requirements, DAFVA 91-209 location, and DAFSMS responsibilities.

Hierarchy of Controls

Apply these controls from most effective to least effective when reducing workplace hazards under DAFI 91-202 paragraph 14.1.2.1.4.

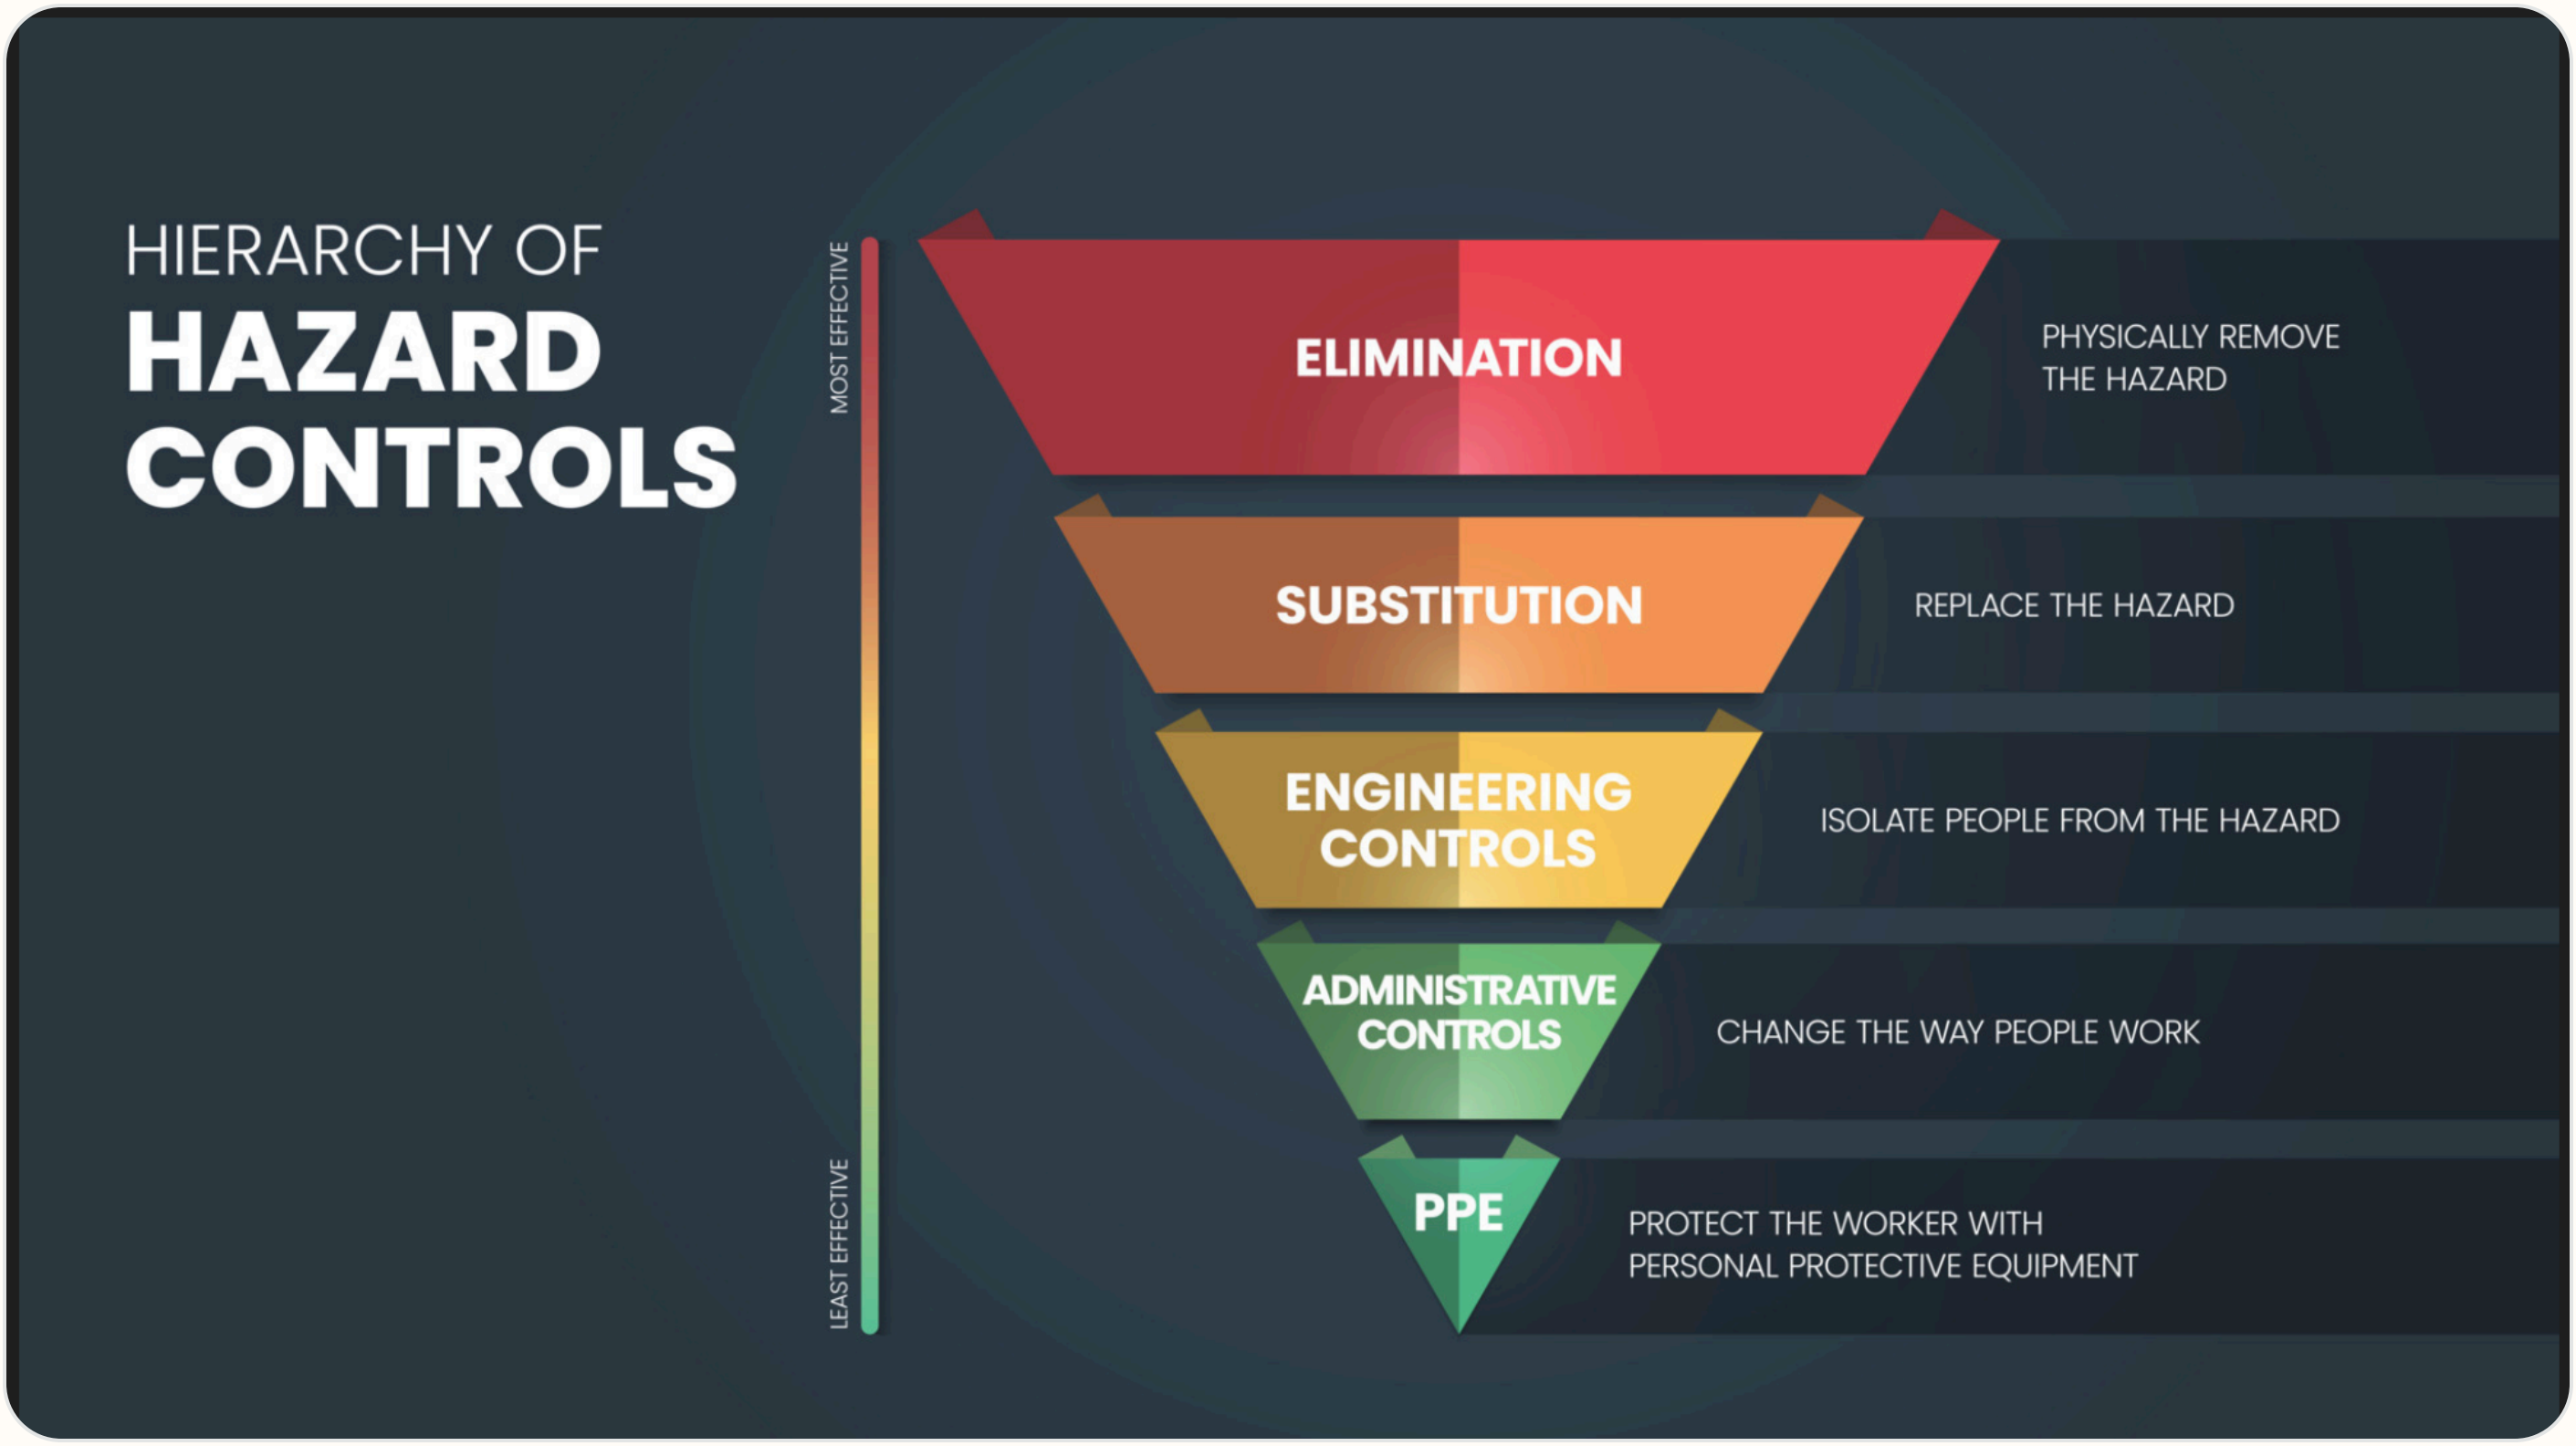

Use the highest level of control feasible first. PPE should protect workers only after elimination, substitution, engineering, and administrative controls have been considered.

Active Shooter Response

In the event of an active shooter, individuals should employ the **Avoid, Deny, Defend** response method. This strategy is adaptable to the specific situation and environment.

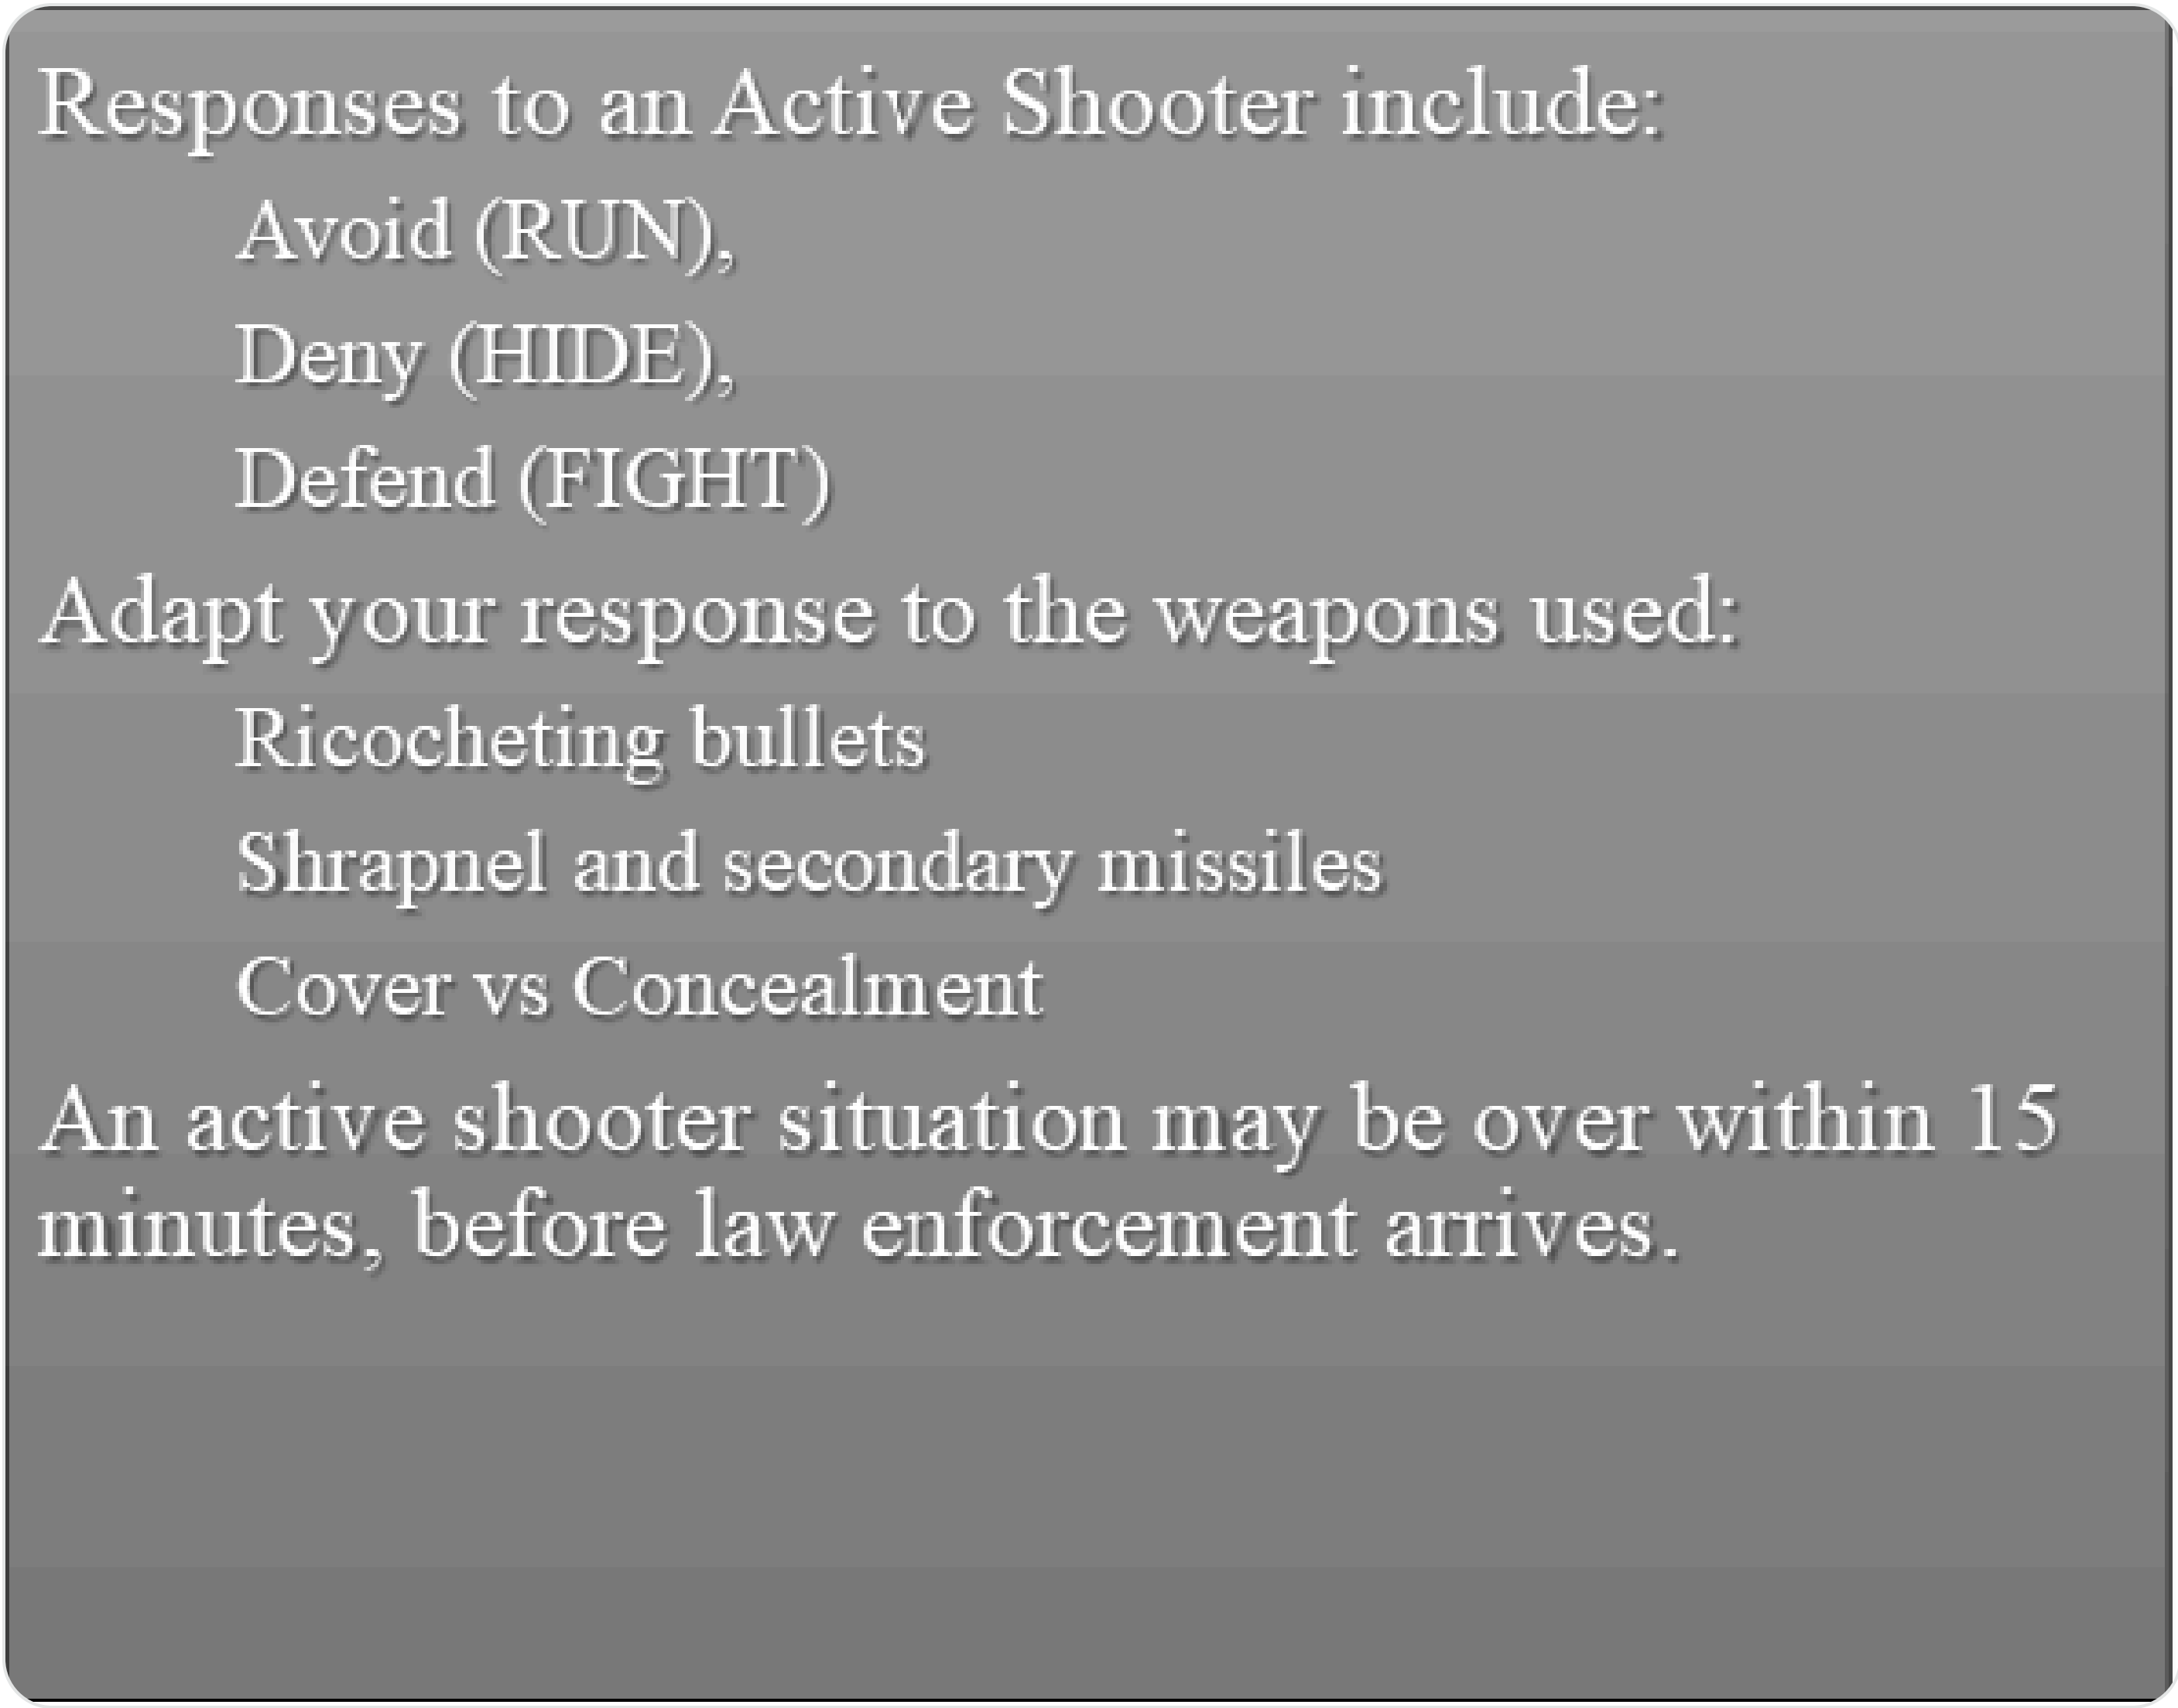

Avoid (Run): The first and preferred course of action is to evacuate the area if a safe route is available. Maintain awareness of your surroundings and have an escape route planned. Leave your belongings, evacuate regardless of whether others follow, and do not attempt to move wounded people. Once you have reached a safe location, call 911 and provide any information you have.

Deny (Hide): If you cannot evacuate, your next priority is to deny the attacker access to your location. This involves more than just hiding; it means securing your position. Lock and blockade doors with heavy furniture, turn off lights, silence your phone, and remain out of the shooter's view. Remember that concealment only hides you, while cover can offer protection from bullets.

Defend (Fight): As a last resort, when your life is in immediate danger, you must be prepared to defend yourself. Act aggressively and take action against the shooter. Improvise weapons from your surroundings and commit to your actions. Taking action may be risky, but it could be your best or only chance for survival.

When law enforcement arrives: Remain calm, follow all instructions, keep your hands visible with fingers spread, and be prepared to provide information about the shooter's location, number, and description.

DAFSMS FRAMEWORK

DAFSMS uses four pillars and the DAFSMS framework to structure the mishap prevention program through continuous improvement and the Plan-Do-Check-Act model.

Policy and Leadership

Provides the structure for a proactive mishap prevention program through policy, active leadership engagement, and clearly defined responsibilities at every level.

Risk Management

Integrates hazard identification, assessment, and control decisions into daily operations to reduce mishaps and strengthen safety culture.

Assurance

Uses evaluations, monitoring, reviews, and data to confirm the mishap prevention program is implemented and improving over time.

Promotion, Education, and Training

Ensures Airmen and Guardians receive safety awareness information, embedded training, effective risk controls, and active engagement in mishap prevention.

1. Purpose. DAFSMS utilizes the four pillars and the DAFSMS framework to structure the mishap prevention program. Activities associated with each pillar set policy, identify and mitigate hazards and risk, and reduce the occurrence and cost of injuries, illnesses, fatalities, and property damage through continuous improvement and the PDCA model.

2. Policy and Leadership. Safety policy provides the structure for a sound and proactive mishap prevention program. Active leadership involvement in implementation and execution is critical at all levels of command.

3. Risk Management. Ensure the RM process is fully integrated into all safety-related activities to enhance mishap prevention and sustain a proactive safety culture. Refer to DAFI 90-802 and DAFPAM 90-803 for additional detail.

4. Assurance. Safety assurance is how commanders determine whether mishap prevention elements are implemented and guides continuous improvement through evaluation, monitoring, and review.

5. Promotion, Education, and Training. Ensure Airmen and Guardians are provided safety awareness information, organizations have embedded ongoing training into the mishap prevention program, effective risk controls are implemented, and personnel remain actively engaged.

SAFEREP


Report it on
SAFEREP
HAZARDS ARE EVERYWHERE.
SAFEREP
WHAT ARE YOU DOING TO
PREVENT INJURY OR DEATH?
More info about SAFEREP
www.safety.af.mil/home/saferep

SAFEREP is the Department of the Air Force's (DAF) premiere digital safety reporting tool and mobile app. It allows Airmen and Guardians to easily report hazardous conditions, near-misses, unintentional errors, or safety concerns across all disciplines, including workplace, traffic, industrial, flight, weapons, and space safety, directly from their devices anytime and anywhere.

Fully integrated with the Air Force Safety Automated System (AFSAS), it replaces the earlier Airman Safety App and serves as the DAF's only fully digital safety reporting avenue. Users simply answer a short series of questions to submit reports that reach the appropriate Major Command (MAJCOM) safety office quickly and efficiently.

Key Benefits for Job Safety Training:

- **Empowers everyone:** Turns every Airman or Guardian into a proactive sensor for hazard identification, encouraging a strong safety culture where people feel comfortable speaking up without barriers like paperwork or word-of-mouth delays.
- **Prevents mishaps:** Enables early mitigation of risks before they lead to incidents, capturing minor events and near-misses that offer the greatest prevention potential.
- **Simple and accessible:** Mobile-first design makes reporting fast, more efficient than traditional methods, and available on the spot through the app on Google Play and the Apple App Store.
- **Broad coverage and integration:** Supports multiple safety areas and includes specialized features such as Aviation Safety Action Program reporting, improving visibility, tracking, and overall risk management across the force.

This tool strengthens operational readiness by fostering a proactive, data-driven approach to safety. You can download it from the app stores or access it through the official SAFEREP site for more details.

SAFEREP portal: https://saferep.safety.af.mil

Learn more: https://www.safety.af.mil/Home/SAFEREP/

REPORTING UNSAFE EQUIPMENT, CONDITIONS, OR PROCEDURES

Employees must report unsafe equipment, conditions, or procedures to their supervisor immediately. This includes any hazard that could injure personnel, damage equipment, or create an unsafe work process.

Personnel must also be notified that unsafe conditions, work-related injuries, and illnesses may be reported **without fear of retaliation**. Immediate supervisor involvement remains the primary reporting path, with SAFEREP and formal hazard-report channels available when needed.

What To Report

- Unsafe equipment that is broken, damaged, unserviceable, or missing required guards or controls.
- Unsafe conditions or procedures that create a hazard to personnel, operations, or facilities.
- Work-related injuries, illnesses, near-misses, and hazards needing immediate attention.

Immediate Actions

- Notify the supervisor or responsible area lead immediately.
- If the hazard can be safely controlled, stop use and isolate the equipment or area until corrected.
- If the danger is imminent to life or health, evacuate the area and activate emergency response procedures.

Tag use examples: Use the appropriate danger, caution, out-of-order, or do-not-start tag to keep unsafe equipment out of service until the hazard has been corrected and the responsible supervisor authorizes return to use.

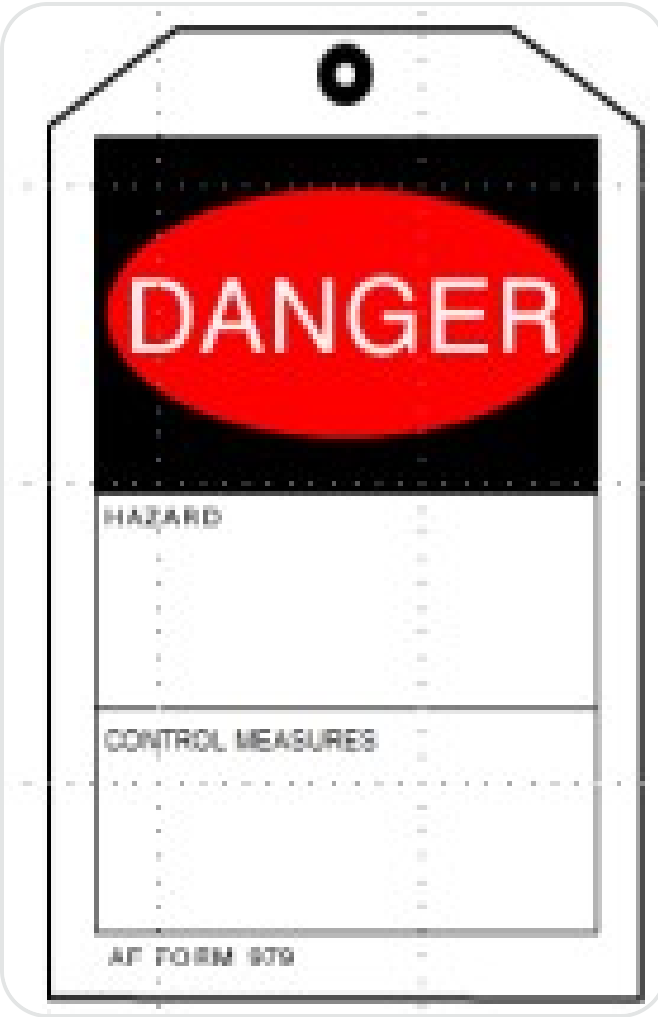

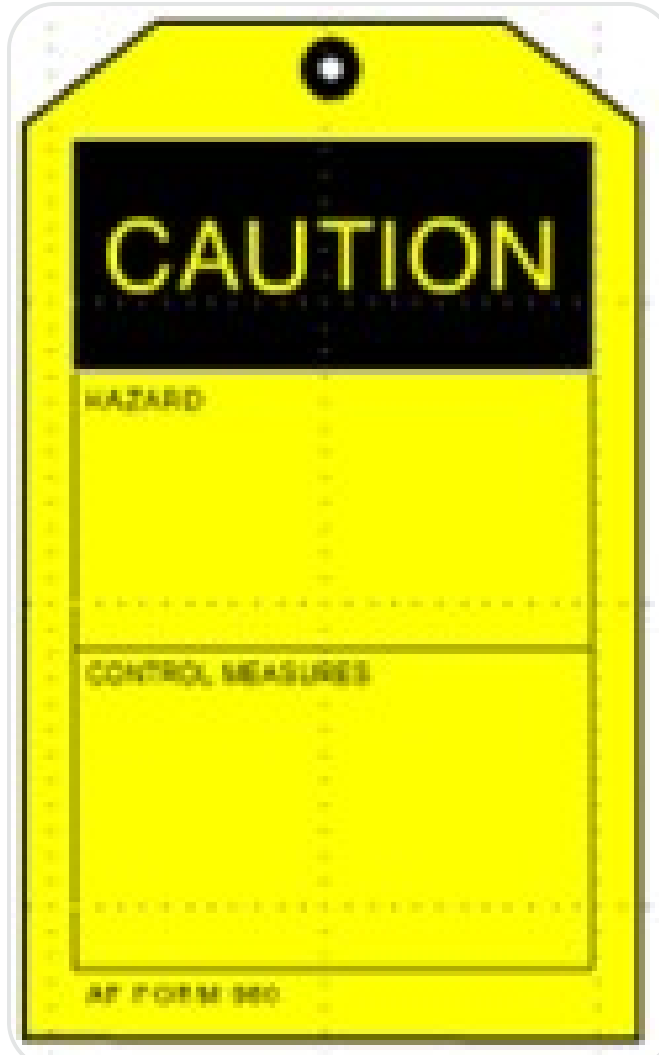

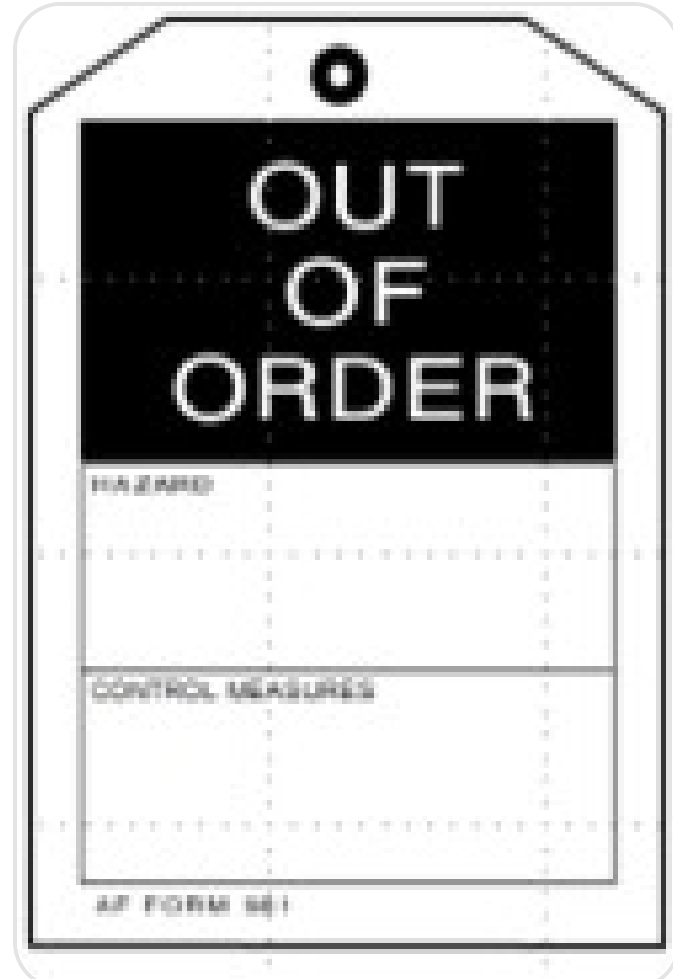

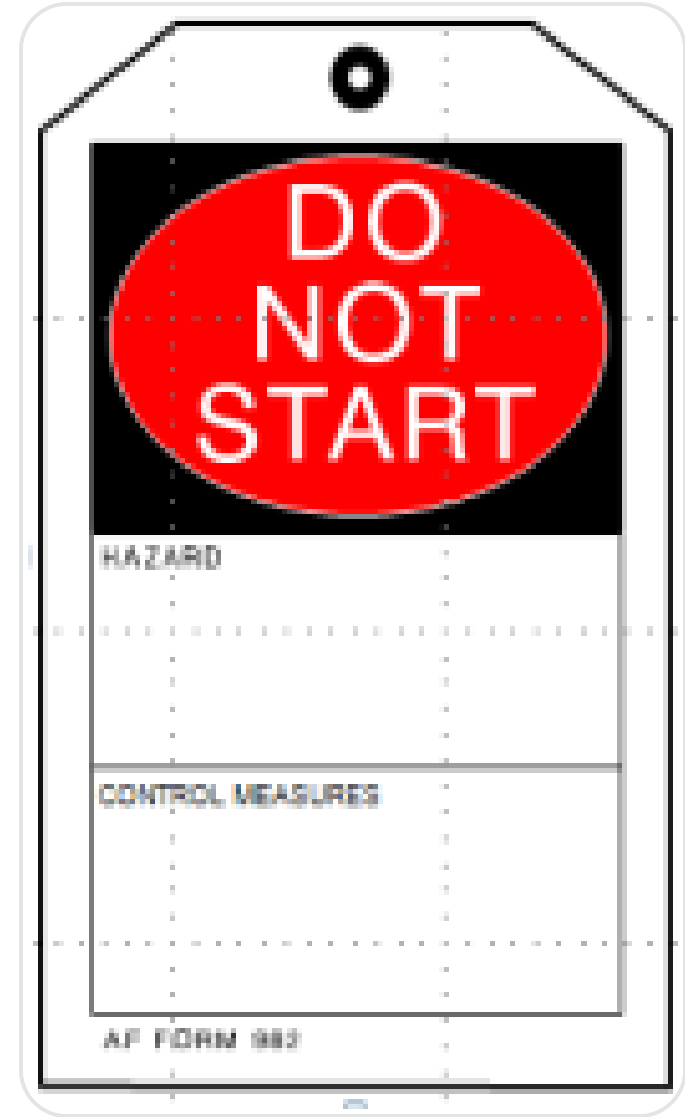

Escalation: If the issue cannot be resolved at the lowest level, elevate it through the unit safety representative, DAF Form 457 process, or SAFEREP as appropriate.

USE OF PORTABLE FIRE EXTINGUISHERS

Portable fire extinguishers are intended for small, incipient-stage fires only. Personnel should use an extinguisher only when they have been trained, the fire is small and contained, the correct extinguisher is available, and there is a clear evacuation path behind them.

Use the **PASS** method when operating a portable fire extinguisher: **Pull** the pin, **Aim** at the base of the fire, **Squeeze** the handle, and **Sweep** side to side.

If the fire grows, smoke conditions worsen, or the extinguisher does not control the fire immediately, evacuate the area, activate the local emergency response process, and report the incident to emergency services and supervision.

WORK AREA HAZARD ANALYSIS

EMFR, Electrical hazards, Soldering, Hazmat, Compressed Air and Compressed Nitrogen, and Heavy Lifting. Refer to BioEnviromental Survey for controls.

RISK MANAGEMENT FUNDAMENTALS

Reference: DAFSMS and local RM program guidance.

Address hazard identification, control selection, local escalation expectations, and when RM refresher training must be completed for this work center.

Document how the work center covers RM fundamentals, where refresher files or briefing materials are stored, and how personnel access those resources.

JOB SPECIFIC TRAINING ITEMS

Hazardous Energy Control | **Hazard Communication** | **Hearing Conservation** | **Confined Space Program** | **Respiratory Protection Program** | **CPR Training** | **Electromagnetic Field Training** | **Ladder Safety** | **Active Shooter Response** | **Government Vehicle / Utility Vehicle Use** | **Manual Lifting and Material Handling** | **Fire Protection and Prevention** | **Ergonomics / Office and Administrative Workstation Safety** | **Jewelry / Loose Articles Restrictions** | **Thermal Stress / Heat and Cold Stress**

- **Hazardous Energy Control:** DAFMAN 91-203 establishes a formal Hazardous Energy Control Program with dedicated training, documented procedures, and periodic self-inspections before servicing or maintenance work is performed. Train authorized employees on hazardous energy sources, magnitude, and isolation methods; affected employees on the purpose and use of procedures; and other nearby employees on restart/reenergization prohibitions. Retrain when assignments, equipment, processes, or procedures change, or when inspections show gaps. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards Chapter 21; 29 CFR 1910.147 - The control of hazardous energy (lockout/tagout)
- **Hazard Communication:** Employees potentially exposed to chemical hazards must complete HAZCOM training upon initial assignment and whenever a new hazard or chemical is introduced or new tasks create new hazards. Supervisors must ensure SDS access for chemicals used in the work process. Provide effective training at initial assignment and whenever a new chemical hazard is introduced. Cover where hazardous chemicals are present, the written program, labels and SDS access, how releases are detected, hazard types, protective measures, emergency procedures, and required PPE. AFI 90-821 - Hazard Communication (HAZCOM) Program; 29 CFR 1910.1200 - Hazard Communication
- **Hearing Conservation:** Hazardous noise concerns must be evaluated and controls recommended through the occupational health risk assessment process. Use the AF Hearing Conservation Program as the training and control basis when shop noise hazards are identified. Provide a hearing conservation training program for employees exposed at or above the action level, repeat it annually, and update it when equipment or work processes change. Cover hearing effects, protector selection and care, and the purpose of audiometric testing. AFI 48-127 - Occupational Noise and Hearing Conservation Program
- **Confined Space Program:** Employees entering confined spaces must be trained to safely accomplish assigned duties and rescue procedures for the specific permit-required space entered.

Safety observers and attendants must also be trained on rescue procedures for each type of permit-required confined space. Train affected employees before first assignment, before duty changes, when permit-space operations introduce new hazards, and when deviations or inadequate knowledge are identified. Training must establish proficiency and be documented by employee, trainer, and date. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards Chapter 23; 29 CFR 1910.146 - Permit-required confined spaces

- **Respiratory Protection Program:** Respiratory hazards must be evaluated by Bioenvironmental Engineering and respiratory protection used where required by the occupational health assessment. Use the AF Respiratory Protection Program for controls, fit testing, and local training requirements. Provide comprehensive, understandable respirator training before use and at least annually thereafter. Cover why the respirator is needed, limitations, emergency use, inspection, donning and seal checks, maintenance and storage, and symptoms that may limit safe use. DAFI 48-137 - Respiratory Protection Program; AF Form 2767 - Occupational Health Training & Protective Equipment Fit Testing
- **CPR Training:** Initial first aid and CPR training must be completed before assigning duties that require it, refresher training must occur before certification expires, and CPR training must include PAD instruction. Remote or high-risk work must have an immediate medical response plan. Where work conditions require trained first-aid responders, ensure personnel are adequately trained and available. OSHA 2254 links first-aid and CPR availability to certain work settings, but local mission risk and AF requirements should define who must hold current CPR credentials. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards Chapter 1
- **Electromagnetic Field Training:** Employees with implanted medical devices must notify their supervisors before work and seek medical assessment before duties in EMF environments. Use AF EMF program controls and local work restrictions as the training basis. Use AF EMF program guidance for source identification, posted restrictions, exposure boundaries, and work controls. The closest OSHA 2254 crosswalk is electrical safety training for employees exposed to shock or electrical hazards and the electric power standard’s job-assignment-specific safety practices and emergency procedures. AFI 48-109 - Electromagnetic Field Radiation (EMFR) Occupational and Environmental Health Program
- **Ladder Safety:** Personnel using ladders at any working height must be trained when first assigned, and that training must include hands-on instruction covering ladder defects, electrocution hazards, positioning, and placement for various job sites. Training must be documented under DAFI 91-202. Use local ladder lesson plans, manufacturer instructions, and AF walking-working surface guidance. OSHA 2254 (2015 edition) does not provide a dedicated general-industry ladder training summary in the same way it does for lockout, forklifts, or confined spaces, so this remains primarily AF/local-driven. Common local training item often broken out separately with fixed and portable ladder rules
- **Active Shooter Response:** Tie this to the local emergency action plan, shelter/lockdown locations, notification methods, and commander-directed response procedures. Local emergency response briefing and lockdown procedures
- **Government Vehicle / Utility Vehicle Use:** Document local licensing, route restrictions, spotter use, rollover protection, and unit-specific operating rules. OSHA 2254 does not provide a direct GOV/UTV training excerpt here. Local GOV, GVO, or UTV operating rules and licensing expectations
- **Manual Lifting and Material Handling:** Supervisors must ensure thorough training on proper manual lifting techniques, required PPE, and the use of manual lifting devices. Training must use both verbal and written materials, include practice on proper motions, and be documented under DAFI 91-202. Cover shop-specific lifting limits, two-person lift triggers, hand truck and lifting-device use, and when supervisors require assisted handling. No direct OSHA 2254 standalone manual-lifting module is mapped here. Manual lifting techniques and available lifting devices
- **Fire Protection and Prevention:** Facility managers and supervisors must establish and maintain a fire prevention training program through the JSTO so employees understand their fire prevention and protection responsibilities in their work areas. This is fulfilled through job safety training and

documentation under DAFI 91-202. Review the fire prevention plan with employees when the plan is developed, when responsibilities change, and when the plan changes. If extinguishers are provided for employee use, train employees on the general principles of extinguisher use and the hazards of incipient-stage firefighting at initial assignment and at least annually. Train designated users on the specific equipment they are expected to use. Local extinguisher, pull station, and fire reporting procedures

- **Ergonomics / Office and Administrative Workstation Safety:** Use DAFMAN 91-203 office safety and ergonomics guidance to brief administrative and computer-based workers on musculoskeletal disorder risk factors, workstation adjustment, posture, repetitive motion controls, manual handling of office materials, and supervisor follow-up for ergonomic concerns. Cover workstation setup, chair adjustment, monitor height and distance, keyboard and mouse position, neutral posture, repetitive motion, micro-pauses or task variation, safe lifting of office supplies, file cabinet and storage safety, early reporting of discomfort, and how to request a BE ergonomic assessment when needed. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards; OSHA ergonomics guidance; local Bioenvironmental Engineering or Occupational Health guidance
- **Jewelry / Loose Articles Restrictions:** Use local shop rules and hazard analysis to define where jewelry, loose clothing, or unsecured items are prohibited around moving parts, climbing, electrical work, or snag hazards. Workplace-specific limits on rings, necklaces, watches, and loose items
- **Thermal Stress / Heat and Cold Stress:** Use the occupational health risk assessment, local BE recommendations, and supervisor hazard controls to brief personnel on thermal stress hazards and controls for hot, cold, humid, outdoor, flight line, industrial, or PPE-intensive work areas. Cover heat stress, cold stress, WBGT or locally directed exposure monitoring, acclimatization, hydration, work/rest cycles, buddy checks, PPE or clothing considerations, symptom recognition, supervisor notification, and emergency response actions for suspected heat illness or cold injury. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards; DAFI 48-145 - Occupational and Environmental Health Program; local Bioenvironmental Engineering or Occupational Health guidance

Ergonomics Workstation Posture Guide:

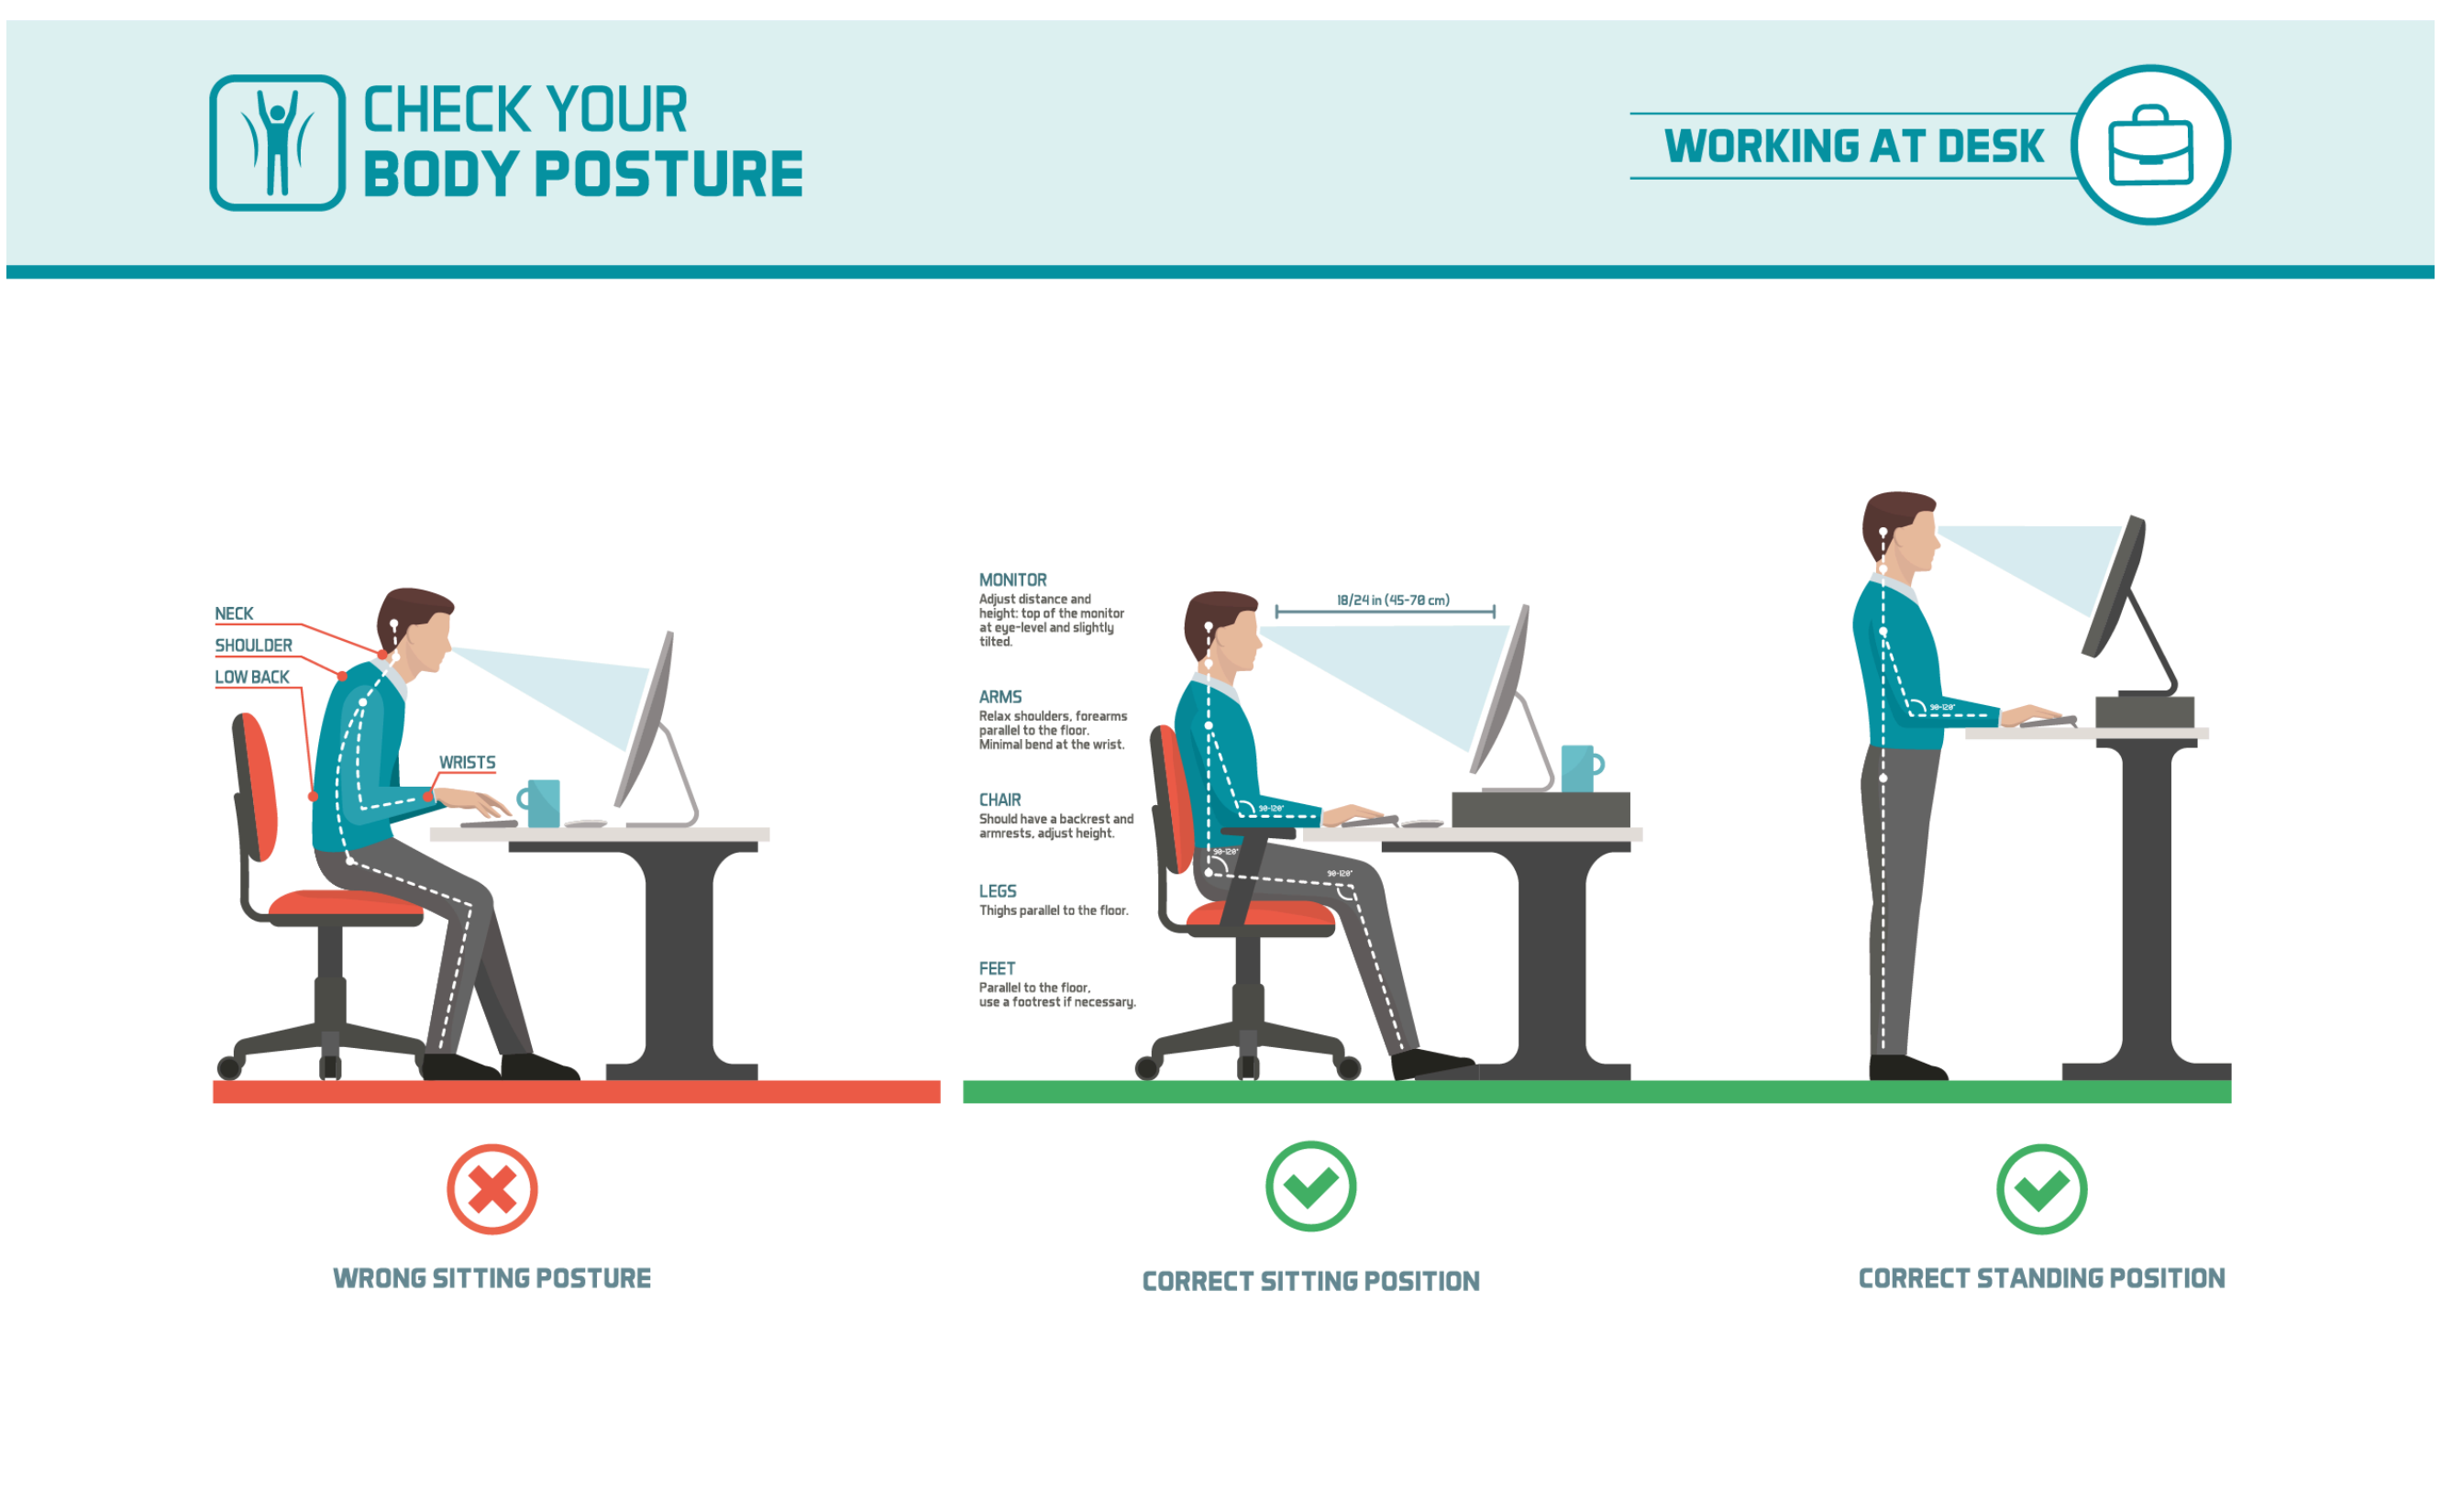

Use this guide while briefing office and administrative workstation setup.

REFERENCES

dafi48-109, dafi48-109_113MXGSUP, T.O. 00-25-234, T.O. 00-25-259, T.O. 1-1A-15, T.O. 00-25-223, T.O. 1-1-312
DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards
OSHA 2254 - Training Requirements in OSHA Standards
29 CFR 1910.147 - The control of hazardous energy (lockout/tagout)
AFI 90-821 - Hazard Communication (HAZCOM) Program
29 CFR 1910.1200 - Hazard Communication
AFI 48-127 - Occupational Noise and Hearing Conservation Program
29 CFR 1910.95 - Occupational noise exposure
29 CFR 1910.146 - Permit-required confined spaces
DAFI 48-137
AF Form 2767 - Occupational Health Training & Protective Equipment Fit Testing
29 CFR 1910.134 - Respiratory protection
29 CFR 1910.151 - Medical services and first aid
AFI 48-109 - Electromagnetic Field Radiation (EMFR) Occupational and Environmental Health Program
29 CFR 1910.332 - Training
29 CFR 1910.39 - Fire prevention plans
DAFI 48-145

REQUIRED DOCUMENTS

- CA-10
  What a Federal Employee Should Do When Injured at Work. Use this as the workplace reference for employee injury reporting and follow-up actions.
- DAF Form 457
  Hazard Report. Use this form to identify, document, and elevate unsafe conditions, equipment, or procedures in the workplace.
- DAFVA 91-209 **UNITS MUST FILL IN THEIR OWN DAFVA 91-209 POSTING/LOCATION INFORMATION.**
  Department of the Air Force Occupational Safety and Health Program visual aid. Keep this available so personnel know the core safety rights, responsibilities, and reporting expectations.
  Location Posted: AIS front office, Bldg. 3109 Room 130, on the shop safety board.
- LS-201
  Notice of Employee's Injury or Death (Non-Appropriated Funds). Use this when applicable for NAF employee injury or death reporting.

DAF TRAFFIC SAFETY PROGRAM

Reference: DAFI 91-207. Requirements of the DAF traffic safety program include mandatory use of seat belts and helmets, speed limits, local traffic hazards, spotters while backing, and vehicle training requirements.
Additionally, brief prohibition or restrictions on electronic-device use while operating vehicles on- or off-base, and discuss motorcycle safety training requirements before riding a motorcycle.

On-Base / Vehicle Operations

- Obey posted speed limits, traffic control devices, and local roadway rules.
- Use installed seat belts and occupant restraints as designed by the manufacturer.

Electronic Devices / Headphones

- Do not use non-hands-free electronic devices while operating a motor vehicle.
- Stop in a safe location before using a phone if hands-free operation is not available.

- Use spotters while backing when required by local policy, task conditions, or vehicle type.
- Complete required GOV, GVO, golf cart, low-speed vehicle, or mission-specific vehicle training before operation.

- Do not wear headphones or listening devices in ways that interfere with hearing traffic, alarms, or emergency warnings.

Motorcycle / ATV Safety

- Complete required motorcycle rider training before riding on a roadway.
- Wear required PPE including helmet, eye protection, gloves, protective clothing, and over-the-ankle footwear.
- Carry proof of required training when applicable and comply with state licensing requirements.

Pedestrian / Bicycle Awareness

- Use caution at crossings, follow traffic controls, and wear visibility gear when exposed to roadway hazards.
- Use required lighting and reflective equipment during darkness, reduced visibility, or inclement weather.

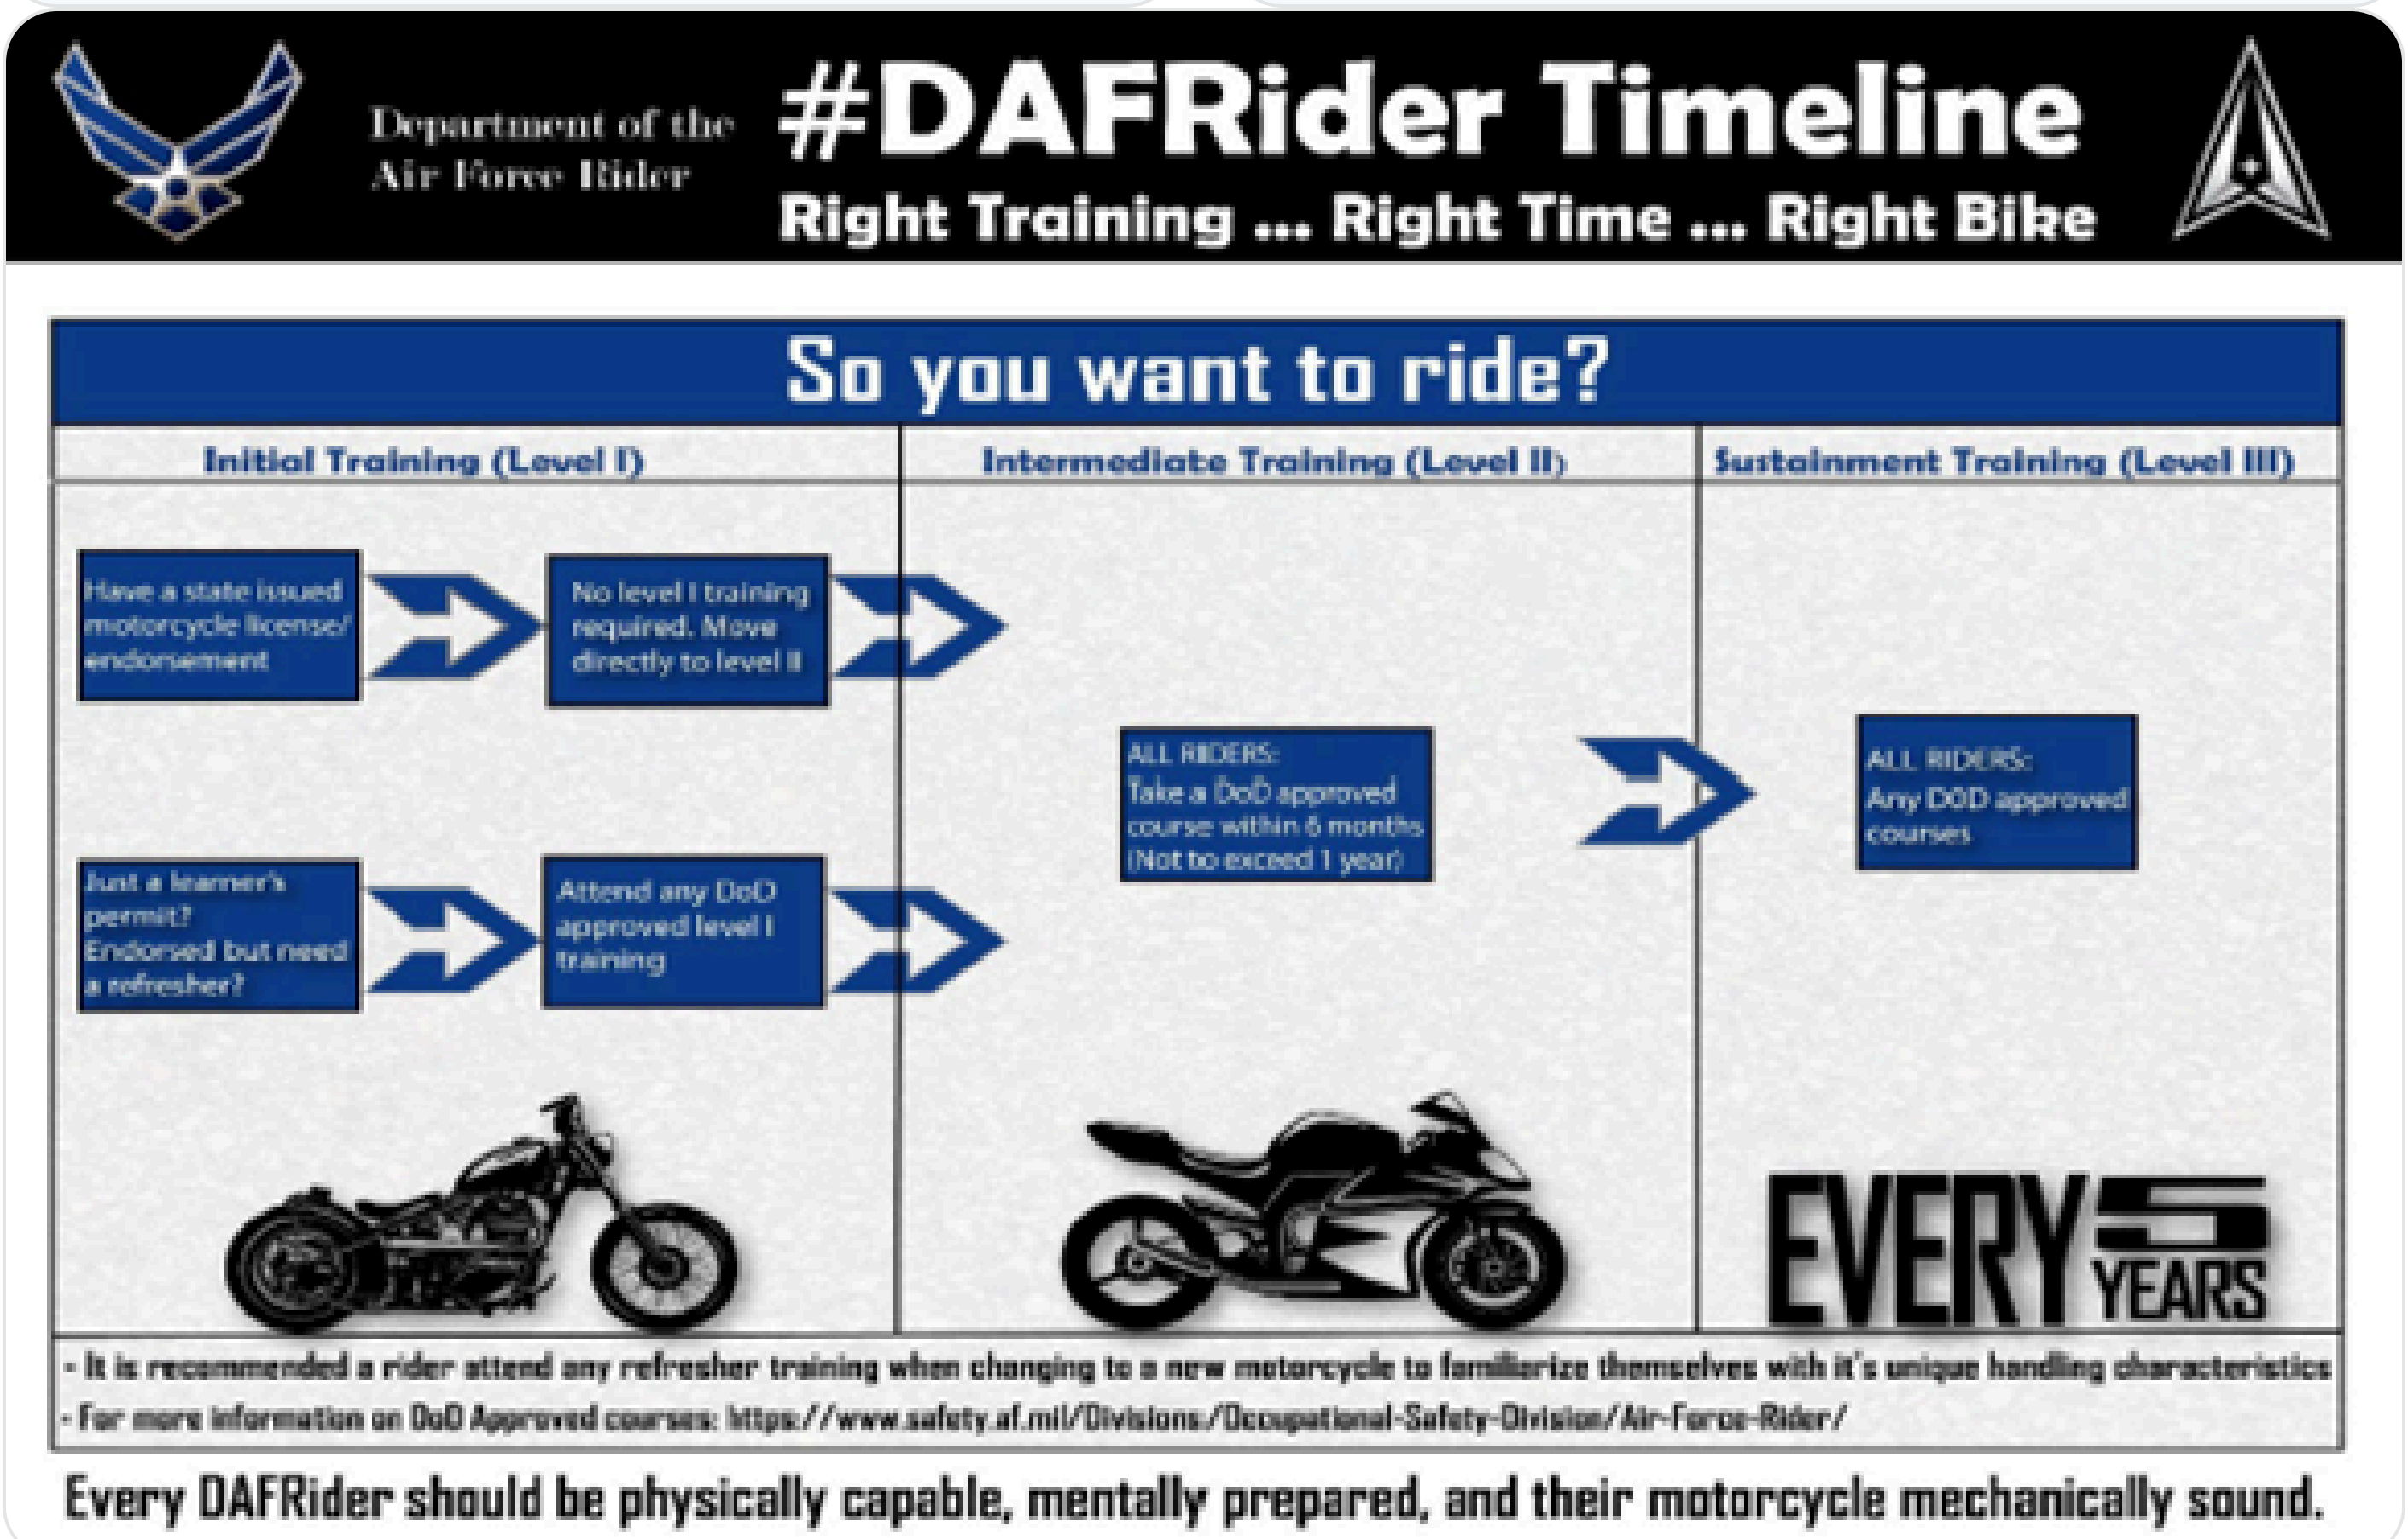

Local Traffic Hazards / Vehicle Notes:
Enter local gate hazards, base-specific traffic concerns, spotter rules, and where vehicle training is documented.

Motorcycle Safety Representatives / Traffic Contacts:
List unit or group motorcycle safety representatives, traffic safety contacts, and local rider briefing requirements.

No GVO risk assessment files uploaded.

EMERGENCY INFORMATION

- **Emergency Numbers:**
  Not entered
- **Medical Facility / Treatment:**
  Malcolm Grow
- **Evacuation / Muster Point:**
  Follow the nearest exit and meet at the Gazebo at the SE corner of Hangar 16 (Bldg. 3119)
- **Shelter in Place:**
  Building 3109, Room 112
- **Active Shooter Response Methods:**
  Not entered
- **Adverse Weather Shelter:**
  Not entered

No evacuation route image uploaded.

EMERGENCY EQUIPMENT AND SAFETY BOARD

Safety Bulletin Board Location: Bldg 3109 Hallway across from the bathrooms.

List fire pull stations, extinguishers, power cutoffs, eyewash stations, AEDs, foam systems, and any local fire/emergency equipment notes.

Emergency Equipment Maps / Photos:

PDF

Bldg 3109 Fire Escape Map.pdf

Embedded PDF preview.

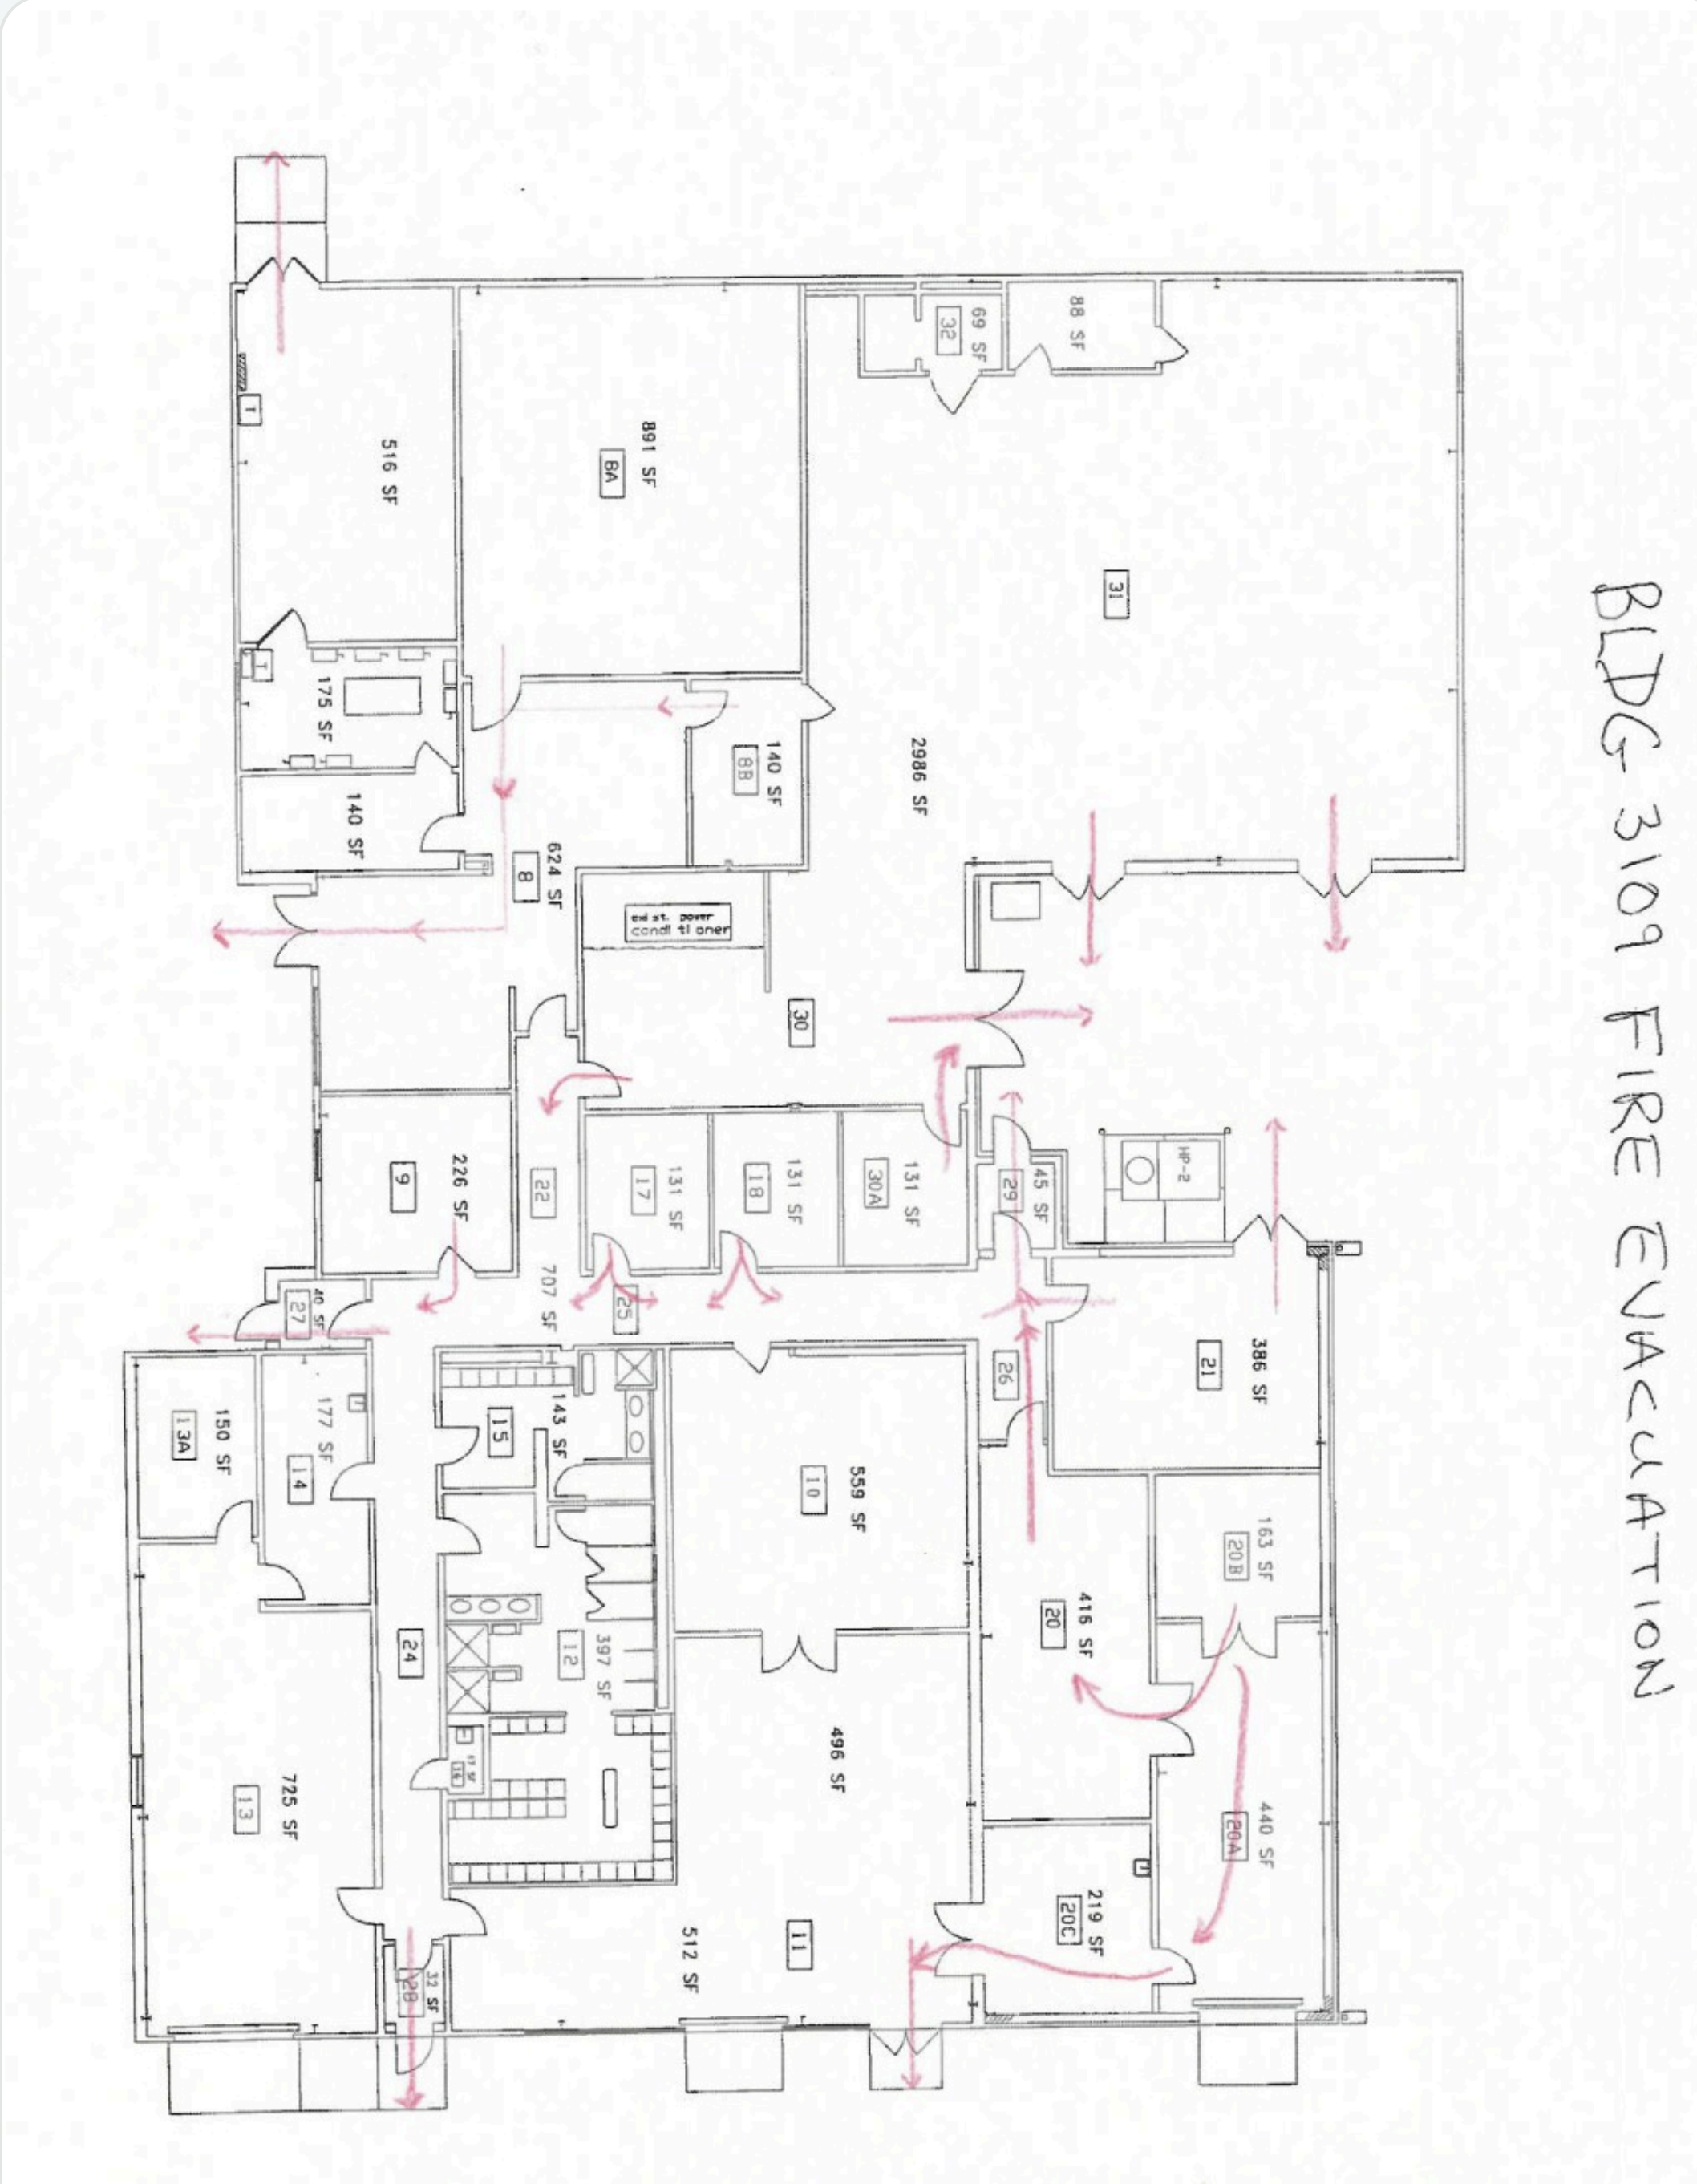

FILE

Fire Extinguisher Inspection (2026).docx

Attachment included with this JSTO export.

Open file

DOCUMENTATION AND REVIEW

af form 55 is utilized and kept in the AIS shared drive.

No DAF Form 1118 files uploaded.

Bioenvironmental Workplace Survey:

142A-113th_Avionics Intermediate_OEH Survey Rpt_2024.pdf

Embedded PDF preview.

DEPARTMENT OF THE AIR FORCE
316TH MEDICAL GROUP (AFDW)

30 Jun 2024

MEMORANDUM FOR 113 MXS/CC
ATTN: MSGT SCOTT MORRILL

FROM 316 OMRS/SGXB

SUBJECT: Comprehensive Health Risk Assessment, 113th MXS, Avionics Intermediate Shop, WPID: 142A, Bldg 3109

1. **Introduction:** On 7 Jun 2024, SSgt Jaime Suarez Berrocal and A1C Evelin Castillo from Bioenvironmental Engineering (BE), conducted a Health Risk Assessment (HRA) of your workplace IAW DAFI 48-145, *Occupational and Environmental Health Program*, and DAFMAN 48-146, *Occupational and Environmental Health Management*. **Comprehensive HRAs are now conducted every 3 years. However, all "high risk" processes and programs will be evaluated annually.** MSgt Scott Morrill was our point of contact.

2. **Purpose:** BE conducted this assessment to review all processes for potential hazards and to identify any special surveillance required to better characterize workplace hazards and controls. The Occupational and Environmental Health Routine Letter Attachment (**Attachment 1**) briefly summarizes what your shop does and lists all identified processes (tasks), their applicable hazards, and the required controls. Any deficiencies and significant exposures are also identified on this attachment.

3. **Deficiencies:** Currently, there are no deficiencies assigned to your unit. BE allows 60 days to resolve occupational health deficiencies. If deficiencies are not resolved within this timeframe, BE will no longer track administrative deficiencies. IAW DAFI 48-145 para 4.3.4, "Unit commanders, workplace supervisors, facility managers and mission owners shall monitor, report and track any identified deficiencies until closure".

4. **Summary of Changes:** The following are the changes identified during this assessment.

   a. Personnel Listing was updated.
   b. Double Hearing Protection (Plugs & Muffs) control added to FOD Walks process.
   c. Foam Ear Plugs control added to FOD Walks process.
   d. Equipment Maintenance & Repair process description was updated.

5. **Conclusion:** All workers must be informed of the contents of this report and be able to view this report at any time upon request. The information contained in this report should be posted on your safety bulletin board and briefed to all employees. Employees have the right to view their individual exposure records. Any questions may be addressed to the BE Flight at 857-3380.

VAN.ANTIONE.KEIMON.1506129784 Digitally signed by VAN.ANTIONE.KEIMON.1506129784 Date: 2024.09.16 12:21:19 -04'00'

ANTIONE K. VAN, TSgt, USAF
NCOIC Bioenvironmental Engineering

Attachment:
Occupational and Environmental Health Routine Letter

cc:
316 OMRS/SGXB (jordan.l.loveless.mil@health.mil)
316 OMRS/SGXB (antione.k.van.mil@health.mil)
316 OMRS/SGXB (zachary.a.garcia6.mil@health.mil)
316 OMRS/SGXM (denise.r.rious.civ@health.mil)
316 OMRS/SGXM (michelle.n.lenz.mil@health.mil)
113 MDG/PH (darryl.cousin.4@us.af.mil)
113 WG/SEG (jose.g.otero.mil@mail.mil)
113 MXS/MXMVT (scott.morrill@us.af.mil)

Annual Review History:
Each annual review entry is shown in the table below.

Supervisor Name	Date Reviewed	Contact Info
Scott Morrill	05/17/2026	312-857-6298