Job Safety Training Outline

Built to align with DAFI 91-202 paragraph 14.1 requirements.

Unit: 436 CES

Work Center: Electric/Alarm Shop

Work Area / Office Symbol: CEOFE

Phone: (302) 677-4843

Supervisor: Giancarlo Cornejo/ TSgt/ Section Chief

Reviewer: SSgt Alvin Sosa

Review Date: 2026-10-02

Effective Date: 2026-10-02

Work Center Overview

1.1. Background
This Job Safety Training Outline (JSTO) meets the requirements of DAFI 91-202 (The US Air Force Mishap Prevention Program), Chapter 14. It
covers mandatory general safety items as well as work-center-specific hazards for Civil Engineer Electrical Systems personnel. It incorporates
requirements applicable to Dover AFB, the 436th Airlift Wing, and Air Mobility Command (AMC).
1.2. Implementation

The immediate/frontline supervisor must brief this JSTO to all newly assigned military and civilian personnel prior to performing work in the shop or
field. Additional briefings are required whenever new equipment, processes, chemicals, or revised safety/fire/health directives are introduced. Work
center supervisors (NCOICs, Shop Chiefs, Foremen) will review, update, and re-certify this JSTO annually or upon any operational change.

1.3. Mandatory Items

The 10 mandatory safety items outlined in DAFI 91-202, paragraph 14.1, must be briefed and understood by all personnel prior to unsupervised
work.

1.4. Job-Specific Items

Shop-specific training modules based on the mission requirements of the Electrical Systems Shop (CEOFE) must be instructed to the application
level and fully documented prior to performing unsupervised tasks.

1.5. Methods of Documentation

Training completion is documented on the AF Form 55 (Employee Safety and Health Record) or through an approved digital equivalent (e.g., Air
Force Safety Automated System / myLearning). The form requires digital or physical signatures from both the trainee and supervisor and must be
retained in shop records.

Work Area Hazard Analysis / JHA Notes

Aircraft & Flightline Environment (Airfield Electrical & Snow Removal Operations)

Governing Directives: DAFMAN 91-203; AFI 21-101, AMC Sup 1; 436 AW Airfield Driving Instruction; Latest Annual BE Industrial Hygiene
Survey.

Procedures: Strictly observe all flightline and airfield safety rules. When accessing active taxiways or runways (for runway lighting,
PAPI/VASI maintenance, airfield vaults, or snow clearance), maintain two-way radio contact with the Dover Air Traffic Control Tower and
Base Operations/Airfield Management. State exact vehicle call sign, location, and requested access route/runway.

Flightline Speed Limits:

General-purpose vehicles: 15 MPH

Special-purpose vehicles / towing: 10 MPH

Within 50 feet of aircraft: 5 MPH

Aircraft parking ramp: 15 MPH

Vehicle parking areas: 5 MPH

Snow/ice removal equipment: Safe operating speed dictated by surface conditions and visibility.

Seasonal Weather Extremes

Governing Directives: DAFMAN 91-203; 436 AW Severe Weather OIs.

Hazards & Controls: Dover AFB experiences mid-Atlantic extremes—freezing rain, heavy snow, high winds, hurricane/tropical storm force
winds, thunderstorms, lightning (Lightning within 5 nautical miles requires cessation of outside aerial/high-reach and airfield electrical
maintenance), high summer heat index, and sunburn. Dress in authorized layers, hydrate, utilize sunscreen, and seek shelter during
inclement weather advisories.

General Electrical Safety Awareness

Governing Directives: DAFMAN 91-203; AFMAN 32-1065; UFC 3-560-01 (Electrical Safety, O&M); NFPA 70E.

Controls: Recognize and respect electrical hazards including arc flash, arc blast, electrical shock, phase shorts, damaged cable insulation,

and faulty disconnects. Never work on energized circuits without an approved Energized Electrical Work Permit and proper PPE rated for the
incident energy exposure. Inspect tools, extension cords, GFCI devices, and protective equipment prior to every use.

Mechanical Safety & Shop Equipment

Governing Directives: DAFMAN 91-203.

Controls: Follow established safety protocols when operating shop drill presses, conduit benders, pipe threaders, hydraulic knockout sets,
and powered machinery. Ensure all safety guards and interlocks are in place before operation. Wear appropriate eye and hand protection.

Material Handling & Lifting Techniques

Governing Directives: DAFMAN 91-203.

Controls: Lift with the legs, keeping loads close to the body; do not twist during lifting. Utilize mechanical lifting aids (hand trucks, pallet
jacks, hoists, forklift support) for transformers, heavy conduit bundles, switchgear components, and reels of cable. Utilize team lifts for items
exceeding individual lifting limits or awkward dimensions.

Compressed Gas & High-Pressure Elements

Governing Directives: DAFMAN 91-203.

Controls: Secure all compressed gas cylinders (nitrogen, calibration gases) upright with safety chains or approved brackets. Cylinder caps
must remain installed when not connected for use. Never direct compressed gas at skin or clothing. When supporting environmental or
emergency response, review chemical flammability, toxicity, and pressure hazards.

Confined Space Awareness

Governing Directives: DAFMAN 91-203, Chapter 23; 436 AW Confined Space Program.

Shop Policy: The 436 CES Electrical Systems Shop does not operate under a Master Entry Plan (MEP) because entries into electrical
manholes, pull boxes, and vaults are non-routine.

Entry Protocol: Any entry into a permit-required confined space requires prior coordination with Bioenvironmental Engineering (BEE),
436 AW Occupational Safety (SEG), and the Dover Fire Emergency Services (FES). A current AF Form 1024 (Confined Space Entry
Permit) must be completed, signed by all three agencies, and retained on file for one year. Rescue gear (e.g., tripod/winch coordinated with
the WFSM shop) and calibrated atmospheric monitors must be on site and tested prior to breaking the plane of any manhole or vault.

Waste Disposal & Environmental Compliance

Governing Directives: DAFBI 48-101; AFI 90-821; 436 CES Environmental Management Guidelines.

Procedures: Dispose of hazardous wastes (transformer oils, dielectric fluids, degreasers, solvent-soaked rags) strictly per environmental
guidelines. The CEOFE shop maintains universal-waste collection containers for lead-acid/lithium/Ni-Cad batteries, fluorescent lamps, high
pressure sodium (HPS) and metal-halide bulbs, and empty aerosol cans. Keep all waste containers closed, labeled, and dated.

Hazardous Noise

Governing Directives: DAFMAN 48-20; 436 OMRS/Bioenvironmental Engineering Survey.

Controls: Wear approved hearing protection (pre-molded earplugs or sound-attenuating earmuffs) when operating equipment generating 85
dBA or higher (e.g., concrete saws, power tools, large generators, or when working on the flightline near operating C-5M Super Galaxy or C
17 Globemaster III aircraft). Custom or replacement hearing protection is coordinated through Public Health.

Foreign Object Damage (FOD) Prevention

Governing Directives: DAFBI 21-105; 436 AW FOD Prevention Program.
Controls: Strict tool and hardware accountability is mandatory on the flightline and airfield. Conduct 100% foreign object sweeps before
departing airfield vaults, runway/taxiway lighting fixtures, or aircraft parking ramps. Secure all wire clippings, screws, connectors, and tools in
closed tool bags.
Civil Engineer Fall Protection & Elevated Work
Governing Directives: DAFMAN 91-203, Chapter 13 & 14; 29 CFR 1910 / 1926.
Shop Application: Fall protection is mandatory when working at heights of four (4) feet or more in general industry settings or six (6) feet
or more during facility construction/maintenance, including work on utility poles, aerial bucket trucks, scissors lifts, facility roofs, high-bay
hangar light fixtures, and substations.
Controls: Inspect full-body harnesses, shock-absorbing lanyards, self-retracting lifelines (SRLs), and anchor straps prior to use. Personnel
operating bucket trucks or boom lifts must be tied off to approved anchor points 100% of the time while in the basket. Ensure an approved
rescue plan is established before any elevated operation begins.
Walking-Working Surfaces & Housekeeping
Governing Directives: DAFMAN 91-203.
Controls: Keep all aisles, electrical panel clear zones (minimum 36-inch clearance), exit doors, and shop floors free of cords, tools, scrap
metal, oil slicks, and debris. Clean up spills immediately. Report exterior ice/snow hazards around Building 615 entrances to facility
managers.
Electrically Powered Tools & Shop Equipment
Governing Directives: OSHA 29 CFR 1910; NFPA 70E; NFPA 101; DAFMAN 91-203.
Controls: Inspect all portable tools and cords before use for broken pins, frayed cords, or cracked casings. Never defeat ground pins or
daisy-chain power strips/surge protectors. Personally owned electrical tools and appliances are prohibited without supervisor authorization.
Space heaters and high-draw breakroom appliances must be plugged directly into wall outlets, never into modular furniture or extension
cords.
Hazardous Chemicals & Hazard Communication (HAZCOM)
Governing Directives: AFI 90-821; 29 CFR 1910.1200; DAFMAN 91-203.
Controls: Review Safety Data Sheets (SDSs) for all dielectric oils, cable pulling lubricants, spray solvents, insulating varnishes, and battery
acids prior to handling. Ensure secondary containers have GHS-compliant labels displaying product identifier, hazard statements, signal
words, and pictograms. Use mandatory chemical-resistant PPE (nitrile/neoprene gloves, splash goggles, aprons).
Hazardous Energy Control (Lockout / Tagout - LOTO)
Governing Directives: DAFMAN 91-203, Chapter 21; UFC 3-560-01.
Controls: Zero Energy State must be verified using the "Test-Before-Touch" principle with a calibrated, properly rated multimeter. Only
qualified Authorized Employees may perform LOTO. Use standardized locksets and AF Form 983 (Danger - Equipment Lockout Tag) or AF
Form 979 (Danger Tag). Never remove another worker's lock or tag without following the formal emergency removal procedure approved by
the Section Chief/Squadron Commander.


Required Training Topics

Workplace HazardsPersonal Protective EquipmentEmergency Action and Fire PreventionReporting Unsafe Equipment, Conditions, or ProceduresMishap, Occupational Injury, and Illness ReportingCA-10 and LS-201DAF Traffic Safety ProgramDAFVA 91-209 Location and ContentDAFSMS Responsibilities

- **Workplace hazards:** Describe crushing, burn, chemical, ladder, weather, flight line, and noise hazards specific to the work center, plus the technical orders, JHAs, and instructions workers must follow.
- **Personal protective equipment:** Train employees on required PPE, including donning, doffing, cleaning, maintenance, storage, disposal, and reporting contact-lens or medical issues that could affect wear.
- **Emergency action and fire prevention:** Cover alarms, AEDs, extinguishers, evacuation routes, shelter locations, and response procedures tied to the work center.
- **Reporting unsafe conditions:** Instruct personnel to report unsafe equipment, conditions, procedures, and injuries without fear of reprisal, including use of DAF Form 457 and applicable reporting channels.
- **Mishap / injury / illness reporting:** Explain on-duty and off-duty reporting requirements, medical treatment procedures, and emergency response contacts.
- **Traffic safety:** Brief seat belt, speed limit, spotter, electronic device, and motorcycle safety requirements applicable to the work center.
- **DAFVA 91-209 and DAFSMS:** Review the location of DAFVA 91-209 and how workers contribute to the unit safety management system.

Hierarchy of Controls


Apply these controls from most effective to least effective when reducing workplace hazards under DAFI 91-202 paragraph 14.1.2.1.4.

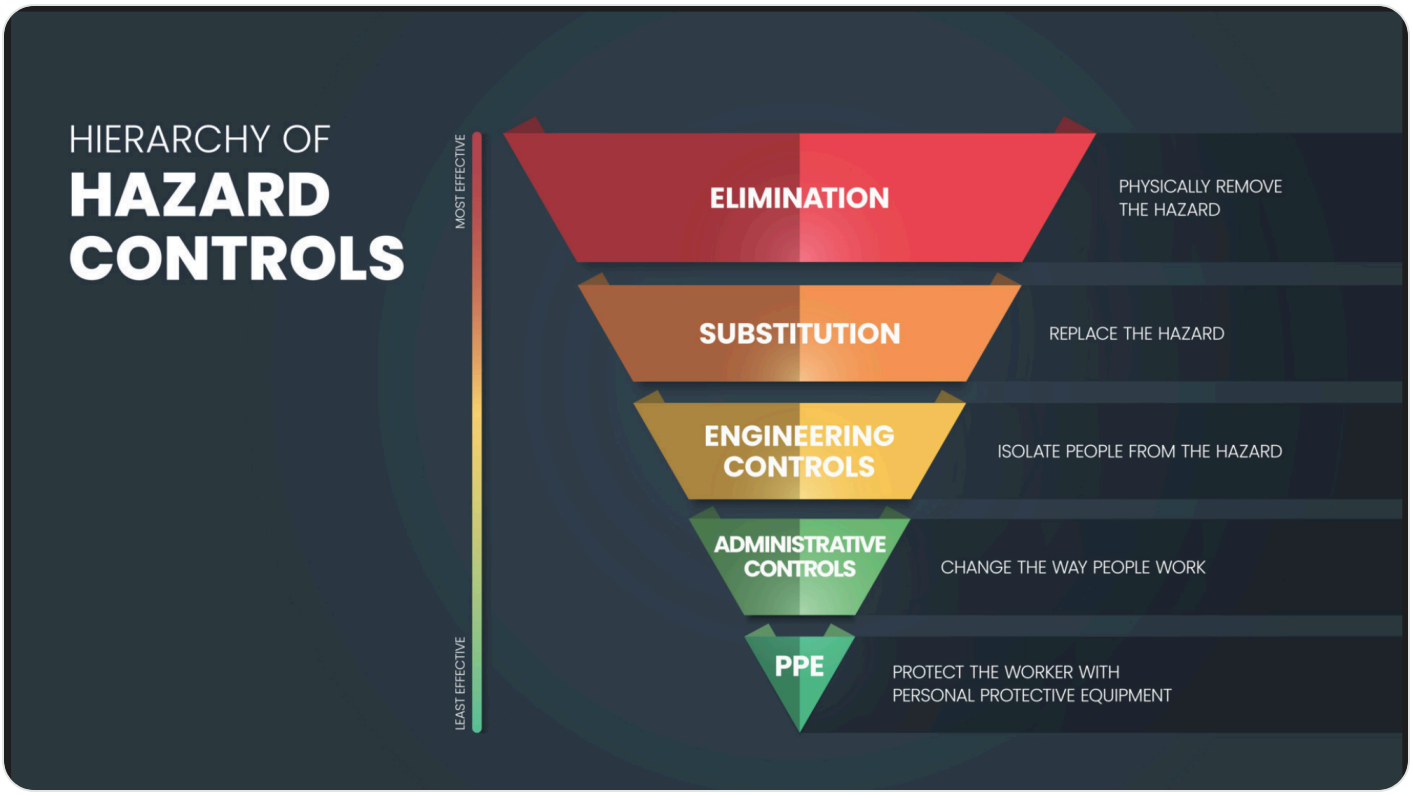

Use the highest level of control feasible first. PPE should protect workers only after elimination, substitution, engineering, and administrative controls have been considered.

Active Shooter Response

In the event of an active shooter, individuals should employ the **Avoid, Deny, Defend** response method. This strategy is adaptable to the specific situation and environment.

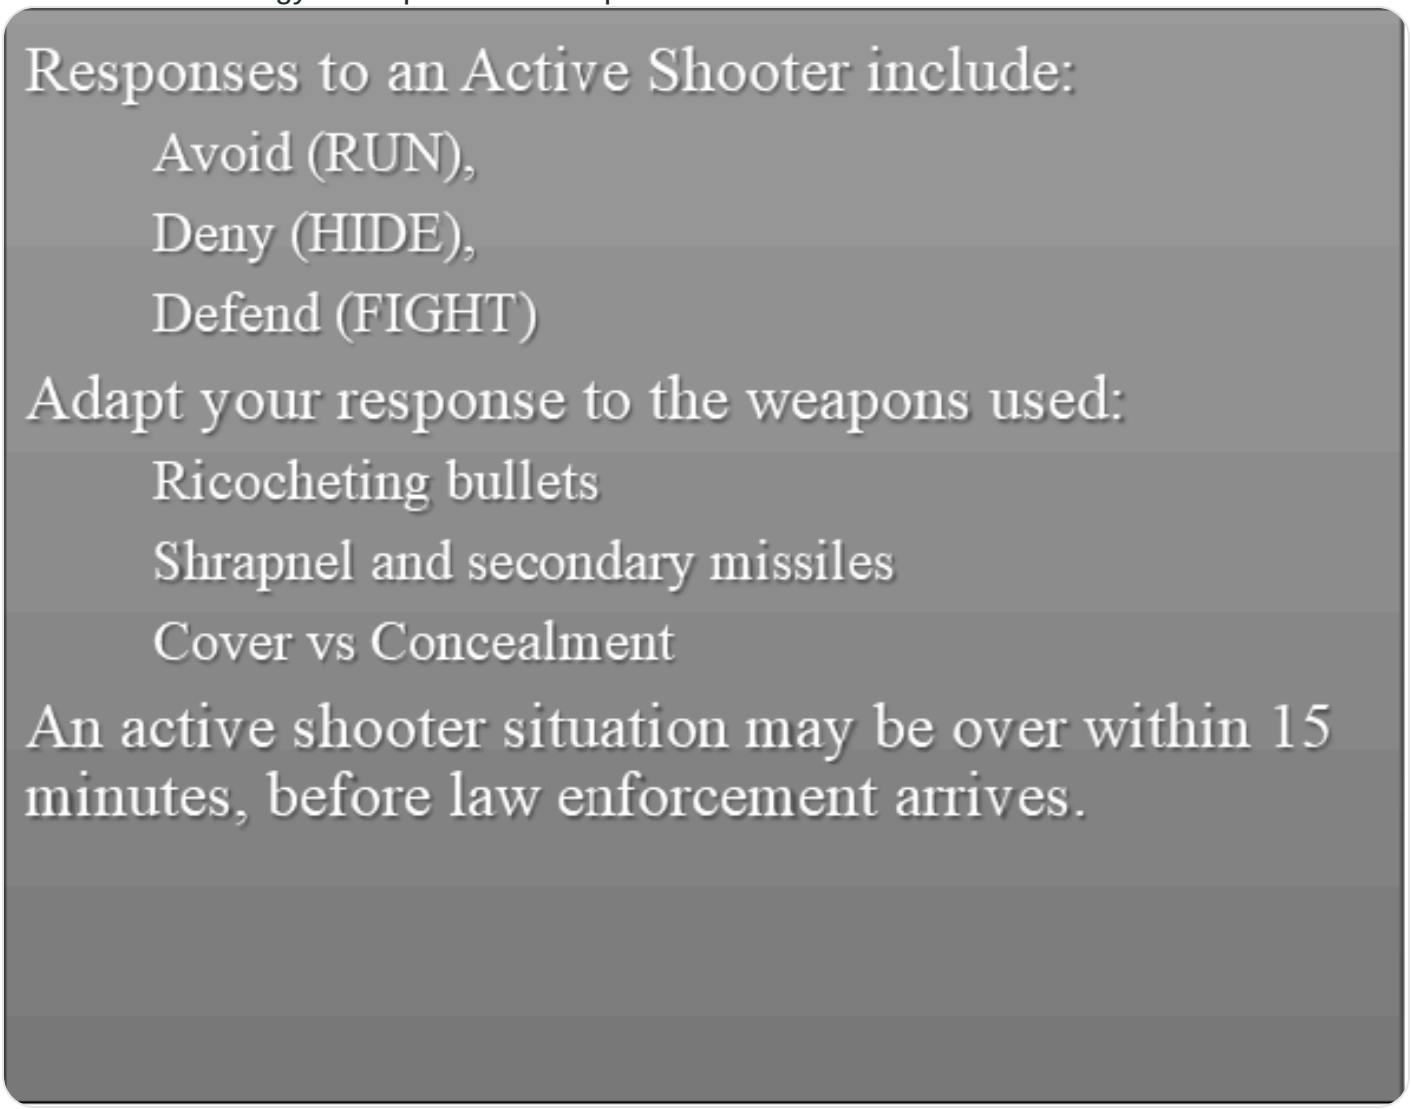

Avoid (Run): The first and preferred course of action is to evacuate the area if a safe route is available. Maintain awareness of your surroundings and have an escape route planned. Leave your belongings, evacuate regardless of whether others follow, and do not attempt to move wounded people. Once you have reached a safe location, call 911 and provide any information you have.


Deny (Hide): If you cannot evacuate, your next priority is to deny the attacker access to your location. This involves more than just hiding; it means securing your position. Lock and blockade doors with heavy furniture, turn off lights, silence your phone, and remain out of the shooter's view. Remember that concealment only hides you, while cover can offer protection from bullets.

Defend (Fight): As a last resort, when your life is in immediate danger, you must be prepared to defend yourself. Act aggressively, improvise weapons from your surroundings, and commit fully to your actions. Taking action may be risky, but it could be your best or only chance for survival.

When law enforcement arrives: Remain calm, follow all instructions, keep your hands visible with fingers spread, and be prepared to provide information about the shooter's location, number, and description.

DAFSMS Framework

DAFSMS uses four pillars and the DAFSMS framework to structure the mishap prevention program through continuous improvement and the Plan-Do-Check-Act model.

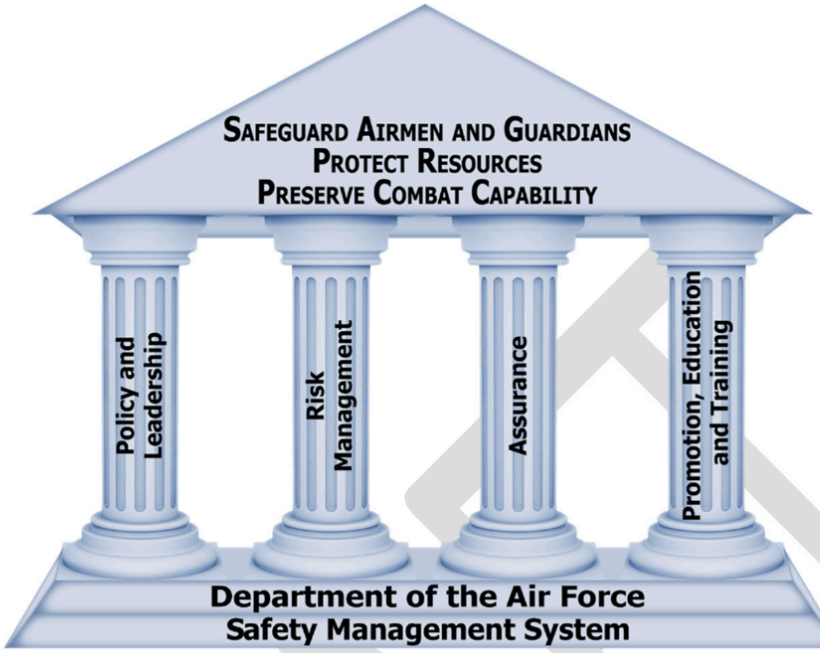

Policy and Leadership

Safety policy provides the structure for a proactive mishap prevention program. Active leadership involvement at every level is critical to implementation and sustained execution.

Risk Management

Integrate risk management into all safety-related activities so hazards are identified early, controls are implemented, and the safety culture stays proactive.

Assurance

Use evaluations, monitoring, and review processes to measure conformance to standards and drive continuous improvement across the mishap prevention program.

Promotion, Education, and Training

Provide safety awareness, embed ongoing training, implement effective controls, and keep airmen and guardians actively engaged in mishap prevention.

Department of the Air Force SMS Framework

Policy and Leadership

- Leadership planning, organization, direction, and control
- Management roles, responsibilities, and relationships
- Procedures and controls that are developed, documented, maintained, and monitored
- Safety and quality balance, integration, and goal setting

Risk Management

- Hazard identification through mission/task analysis and hazard lists
- Hazard assessment using exposure, probability, severity, and risk level
- Control options, effects, prioritization, selection, and decisions
- Implementation, communication, accountability, support, supervision, and feedback

Assurance

- Performance requirements, expectations, and control effectiveness
- Continuous monitoring, self-inspections, internal and external inspections
- Mishap and event investigation, reporting, metrics, and improvement opportunities
- Change management and continuous improvement actions

Promotion, Education, and Training

- Culture built on informed, flexible, learning, just, and reporting behaviors
- Competency through training and education
- Awareness through internal communication, external communication, and information access

Job Specific Training Items

The following modules apply to this work center and should be reviewed with trainees before task performance.

Hazardous Energy ControlHazard CommunicationBloodborne PathogensHearing ConservationConfined Space ProgramManual and Powered HoistsFall Arrest SystemsPole / Tower ClimbingCPR TrainingFlight Line DrivingFetal Protection ProgramLadder SafetyActive Shooter ResponseGovernment Vehicle / Utility Vehicle UseRisk Management FundamentalsFire Protection and PreventionJewelry / Loose Articles RestrictionsPersonal Protective Equipment (PPE)


- **Hazardous Energy Control:** Document initial and refresher training when job assignments, machines, processes, or energy control procedures change, or when inspections show employee knowledge gaps. Train authorized employees to recognize hazardous energy sources, the type and magnitude of energy present, and the methods and means for isolation and control. Train affected employees on the purpose and use of lockout/tagout procedures, and instruct all other employees on the prohibition against restarting locked or tagged equipment. DAFMAN 91-203 - Air

Force Occupational Safety, Fire and Health Standards, Chapter 21; 29 CFR 1910.147 - The control of hazardous energy (lockout/tagout)

- **Hazard Communication:** Provide HazCom training upon initial assignment, whenever a new chemical hazard is introduced, and when new tasks expose workers to different hazardous materials. Ensure workers know how to access local SDS information and labeling guidance. Train personnel on hazardous chemicals in their work area, labeling systems, safety data sheets, and the measures they can take to protect themselves during normal operations and foreseeable emergencies. DAFI 90-821; 29 CFR 1910.1200 - Hazard Communication
- **Bloodborne Pathogens:** Enroll applicable workers in the local bloodborne pathogens program and ensure exposure control plan requirements, reporting actions, and PPE procedures are covered before task performance. Provide bloodborne pathogens training at initial assignment and at least annually thereafter, covering exposure control, modes of transmission, and protective measures. 29 CFR 1910.1030 - Bloodborne Pathogens
- **Hearing Conservation:** Ensure workers enrolled in hearing conservation understand noise hazard areas, double-hearing protection requirements, and local follow-up actions tied to occupational health evaluations. Train noise-exposed employees annually on the effects of noise, the purpose of hearing protectors, the advantages and disadvantages of various protectors, and the purpose of audiometric testing. DAFI 48-127; 29 CFR 1910.95 - Occupational noise exposure
- **Confined Space Program:** IAW DAFMAN 91-203 and the CSPT lead, Ms. Bellamy, it was determined on 19 Feb 2026 that The Electrical Systems Shop at Dover AFB no longer holds a Confined Space Program due to the lack of entries performed yearly (less than 12). In the event of a Confined Space Entry requirement, the team will coordinate with Bio Environmental, Fire Department and Wing Safety to establish an entry and complete Form 1024 along with obtaining a rescue Tripod from the WFMS shop and coordinate with Shop Foreman to establish an Entry Supervisor, Attendant and Entrant.
- **Manual and Powered Hoists:** Use local lesson plans or manufacturer instructions to cover pre-use inspections, operator limitations, suspended-load controls, and maintenance reporting requirements. Provide task-specific training on safe use, load limits, inspections, and operating procedures before workers use hoists in material handling operations. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards, Chapter 35
- **Fall Arrest Systems:** Cover anchorage selection, rescue planning, and equipment inspections before personnel use personal fall arrest systems in assigned tasks. Train employees exposed to fall hazards to recognize fall hazards and the procedures to minimize them, including use and inspection of fall arrest systems. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards, Chapter 13; 29 CFR 1910.66 - Powered platforms for building maintenance; 29 CFR 1926.503 - Training requirements
- **Pole / Tower Climbing:** Ensure workers complete certification, recurring refresher training, and rescue requirements with records maintained for climbing qualification. Provide climbing safety, fall protection, rescue, and equipment inspection training before employees climb poles or towers. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards, Chapter 30
- **CPR Training:** Ensure designated responders maintain current certification and understand location and use of local AED assets under the unit mishap prevention program. Provide CPR and AED training before assignment where required, and refresh qualification before expiration. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards, Chapter 1
- **Flight Line Driving:** Use installation or unit-approved training and certification for airfield/fight line operations, to include local speed, spotter, and no-lone-zone requirements. Provide local flight line driving rules, markings, vehicle lighting requirements, restricted areas, and aircraft hazard awareness before granting driving privileges. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards, Chapter 24
- **Fetal Protection Program:** Use occupational and environmental health guidance to discuss declaration options, exposure review, and local work restriction procedures. Provide job-specific hazard awareness for reproductive health risks where occupational exposures may affect pregnant workers or fetuses. DAFMAN 48-146

- **Ladder Safety:** Provide hands-on ladder safety training at first assignment, including local storage, damaged-tag procedures, and fall prevention expectations. Train workers to inspect ladders before use, maintain three points of contact, set ladders on stable surfaces, and avoid overreaching or using damaged ladders. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards, Chapter 7
- **Active Shooter Response:** Use local emergency response procedures, shelter locations, and mass notification methods applicable to the duty location. Brief personnel on how to recognize an active shooter event, how to summon help, and how to apply local run-hide-fight guidance based on the facility layout. Installation emergency management guidance / local procedures
- **Government Vehicle / Utility Vehicle Use:** Brief operators on unit-specific government vehicle training requirements, local route restrictions, low-speed vehicle rules, and documentation of qualification. Train vehicle operators on seat belts, speed limits, local traffic hazards, spotter use while backing, and restrictions on electronic device use while driving. DAFI 91-207; local procedures
- **Risk Management Fundamentals:** Use the DAF risk management process to discuss local hazard reporting, supervisor involvement, and integration into routine tasks. Train workers to identify hazards, assess risk, implement controls, supervise the task, and re-evaluate controls during and after operations. DAFI 90-802; DAFPAM 90-803
- **Fire Protection and Prevention:** Use the JSTO and local fire prevention plan to brief workers on work-center fire hazards, alarm reporting, extinguisher use, and evacuation accountability. Train personnel on fire hazards, reporting procedures, extinguisher locations, evacuation routes, pull stations, and local emergency response actions. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards; local fire prevention plan
- **Jewelry / Loose Articles Restrictions:** Use local work-center restrictions and equipment guidance to define prohibited items and exceptions for mission-essential tasks. Train workers on removing jewelry and securing loose articles when working around machinery, electrical hazards, rotating equipment, or snag hazards. Local procedures / equipment guidance
- **Personal Protective Equipment (PPE):** Use the work-center JHA, BE occupational health assessment, manufacturer instructions, DAFMAN 91-203 Chapter 14, and local safety office guidance to identify PPE requirements. Supervisors must ensure PPE is provided, used, cleaned, inspected, maintained in sanitary and serviceable condition, and documented in JSTO training records. Cover eye and face protection, head protection, foot protection, hand protection, protective clothing, and respiratory or hearing protection when those programs apply. Train each affected worker on when PPE is necessary, what PPE is necessary, how to properly don, doff, adjust, and wear PPE, the limitations of assigned PPE, and the proper care, maintenance, useful life, and disposal of PPE. Require workers to demonstrate understanding and proper use before performing work requiring PPE, and retrain when workplace conditions, job assignments, PPE types, or worker knowledge gaps make prior training obsolete. DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards, Chapter 14; 29 CFR Part 1910 - Occupational Safety and Health Standards (General Industry Standards) Subpart I; 29 CFR 1910.132; 29 CFR 1910.133; 29 CFR 1910.135; 29 CFR 1910.136; 29 CFR 1910.138

Ergonomics Workstation Posture Guide:

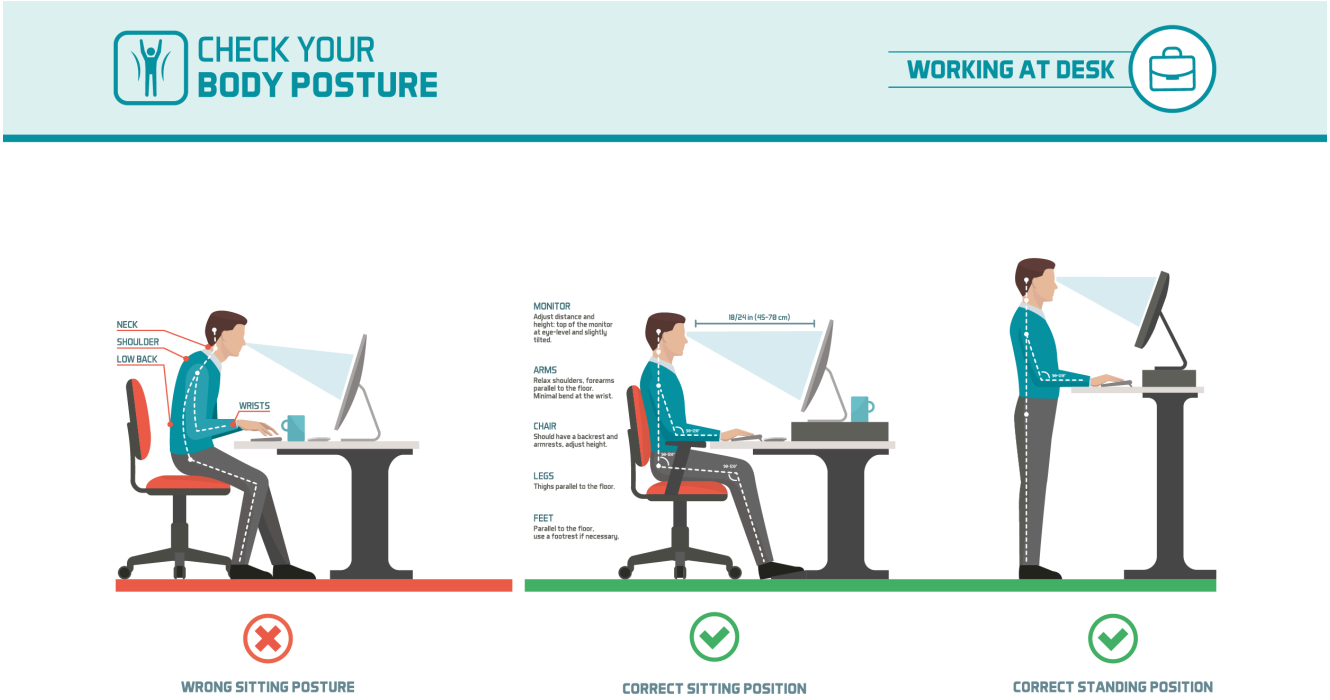

Use this guide while briefing office and administrative workstation setup.

References

DAFI 91-202 - The Department of the Air Force (DAF) Mishap Prevention Program: The US Air Force Mishap Prevention Program
DAFMAN 91-203 - Air Force Occupational Safety, Fire and Health Standards: Air Force Occupational Safety, Fire, and Health Standards
AFI 21-101, AMC Supplement 1: Aircraft and Equipment Maintenance Management
436 AW Airfield Driving Instruction (ADI) & Local Wing Safety Instructions
AFMAN 32-1065: Grounding and Electrical Systems
UFC 3-560-01: Electrical Safety, O&M
NFPA 70E: Standard for Electrical Safety in the Workplace
AFI 90-821 - Hazard Communication (HAZCOM) Program: Hazard Communication (HAZCOM) Program
AFI 90-802 / DAFPAM 90-803: Risk Management (RM) Principles & Guidelines
OSHA 29 CFR Part 1910 - Occupational Safety and Health Standards (General Industry Standards) & 1926: General Industry and Construction Safety Standards

Required Documents

- CA-10
  What a Federal Employee Should Do When Injured at Work. Use this as the workplace reference for employee injury reporting and follow-up actions.
- DAF Form 457
  Hazard Report. Use this form to identify, document, and elevate unsafe conditions, equipment, or procedures in the workplace.
- DAFVA 91-209 **UNITS MUST FILL OUT THEIR OWN LOCATION POSTED**
  Department of the Air Force Occupational Safety and Health Program visual aid. Keep this available so personnel know the core safety rights, responsibilities, and reporting expectations.
  Location Posted: Enter where DAFVA 91-209 is posted for this work center.

- LS-201
  Notice of Employee’s Injury or Death (Non-Appropriated Funds). Use this when applicable for NAF employee injury or death reporting.


Emergency Information

- **Emergency Numbers:** Organization / Agency
  All Emergencies (Fire, Medical, Security) Contact Number
  911 (Base / Cell)
  Dover Base Defense Operations Center (BDOC / Security Forces) Commercial: (302) 677-6664 / 677-2100
  Dover Fire Emergency Services (FES - Non-Emergency / Dispatch) Commercial: (302) 677-4407
  Emergency Management (EM / Disaster Preparedness) Commercial: (302) 677-6218
  436 AW Command Post (CP) Commercial: (302) 677-4201
  Bioenvironmental Engineering (BEE - 436 OMRS) Commercial: (302) 677-2595
  Public Health Flight (PH) Commercial: (302) 677-2564
  436 CES Unit Control Center (UCC) / Service Call Desk Commercial: (302) 677-4840 / 677-4841
  Airfield Management (Base Operations) Commercial: (302) 677-4183
  Maintenance Operations Control Center (MOCC) Commercial: (302) 677-5436 / 677-4217
- **Medical Facility / Treatment:** First Aid, Eyewash & AED Locations
  First Aid Station: Main hallway adjacent to Electrical Planning (Room 114) and Breakroom 111.
  Automated External Defibrillator (AED): Mounted on the hallway wall outside Room 111 / Room 107.
  Emergency Eyewash & Shower: Located in the Electrical Glove Testing / Battery Room (Room 112). Inspected and flushed weekly.
- **Evacuation / Muster Point:** Emergency Facility Evacuation & Muster Point
  Evacuation Route: Exit through nearest clear exterior door as indicated on the facility evacuation floor plan.
  Designated Assembly / Muster Point: The grassy area northeast of Building 615, clear of primary vehicle drive lanes and emergency
  response apparatus. Account for all personnel and report status immediately to the Shop Foreman / Section Chief.Emergency Facility Evacuation & Muster Point
  Evacuation Route: Exit through nearest clear exterior door as indicated on the facility evacuation floor plan.
  Designated Assembly / Muster Point: The grassy area northeast of Building 615, clear of primary vehicle drive lanes and emergency
  response apparatus. Account for all personnel and report status immediately to the Shop Foreman / Section Chief.
- **Shelter in Place:** Shelter-In-Place (SIP) Procedures (Chemical, Biological, or Toxic Spill Incident)
  Designated SIP Room: Building 615, Planning Room 114.
  SIP Execution Protocol:
  1. Notify all shop and office personnel to report immediately to Room 114.
  2. Close and lock all exterior facility doors and windows; display exterior "Shelter-in-Place" placard.
  3. Retrieve SIP Kit, portable emergency radio, first aid kit, and serviceable fire extinguisher.
  4. Seal door seams, window edges, and HVAC vents using pre-cut plastic sheeting and duct tape from the SIP kit.
  5. Shut down facility HVAC systems immediately (or set thermostats to off/safe setting per CE checklist).
  6. Monitor the base emergency notification network / SIP radio for situation updates.
  7. Check in with the 436 CES Unit Control Center (UCC) to report accountability and status. Do not break seal until the formal "All Clear"
  is announced by the 436 AW Command Post.
- **Active Shooter Response Methods:** In the event of an active threat or workplace violence incident at Dover AFB:

AVOID (Run): Evacuate immediately if an accessible escape path is clear. Leave belongings behind. Keep hands visible with fingers spread.
Call 911 or Dover Base Defense Operations Center (BDOC) once in a safe location.
DENY (Hide): If evacuation is unsafe, seek a secure room (e.g., lockable interior office). Lock and barricade doors with heavy shop
equipment/furniture. Turn off lights, silence cell phones and radios, stay away from windows, and maintain silence.
DEFEND (Fight): As an absolute last resort when in imminent danger, commit fully to incapacitating the shooter using aggressive action,
improvised weapons (tools, fire extinguishers, heavy conduit), and team intervention.
Upon Law Enforcement Arrival: Remain calm, keep hands visible and empty at all times, avoid sudden movements or pointing, and follow
all Security Forces instructions immediately.

- **Adverse Weather Shelter:** Severe Weather / Tornado Shelter
  Primary Shelter Location: Interior windowless core areas of Building 615—specifically Latrine 109, Latrine 110, and the interior Locker
  Room 107. Stay clear of exterior windows and high-ceiling shop bays.

Emergency Evacuation Route Image:

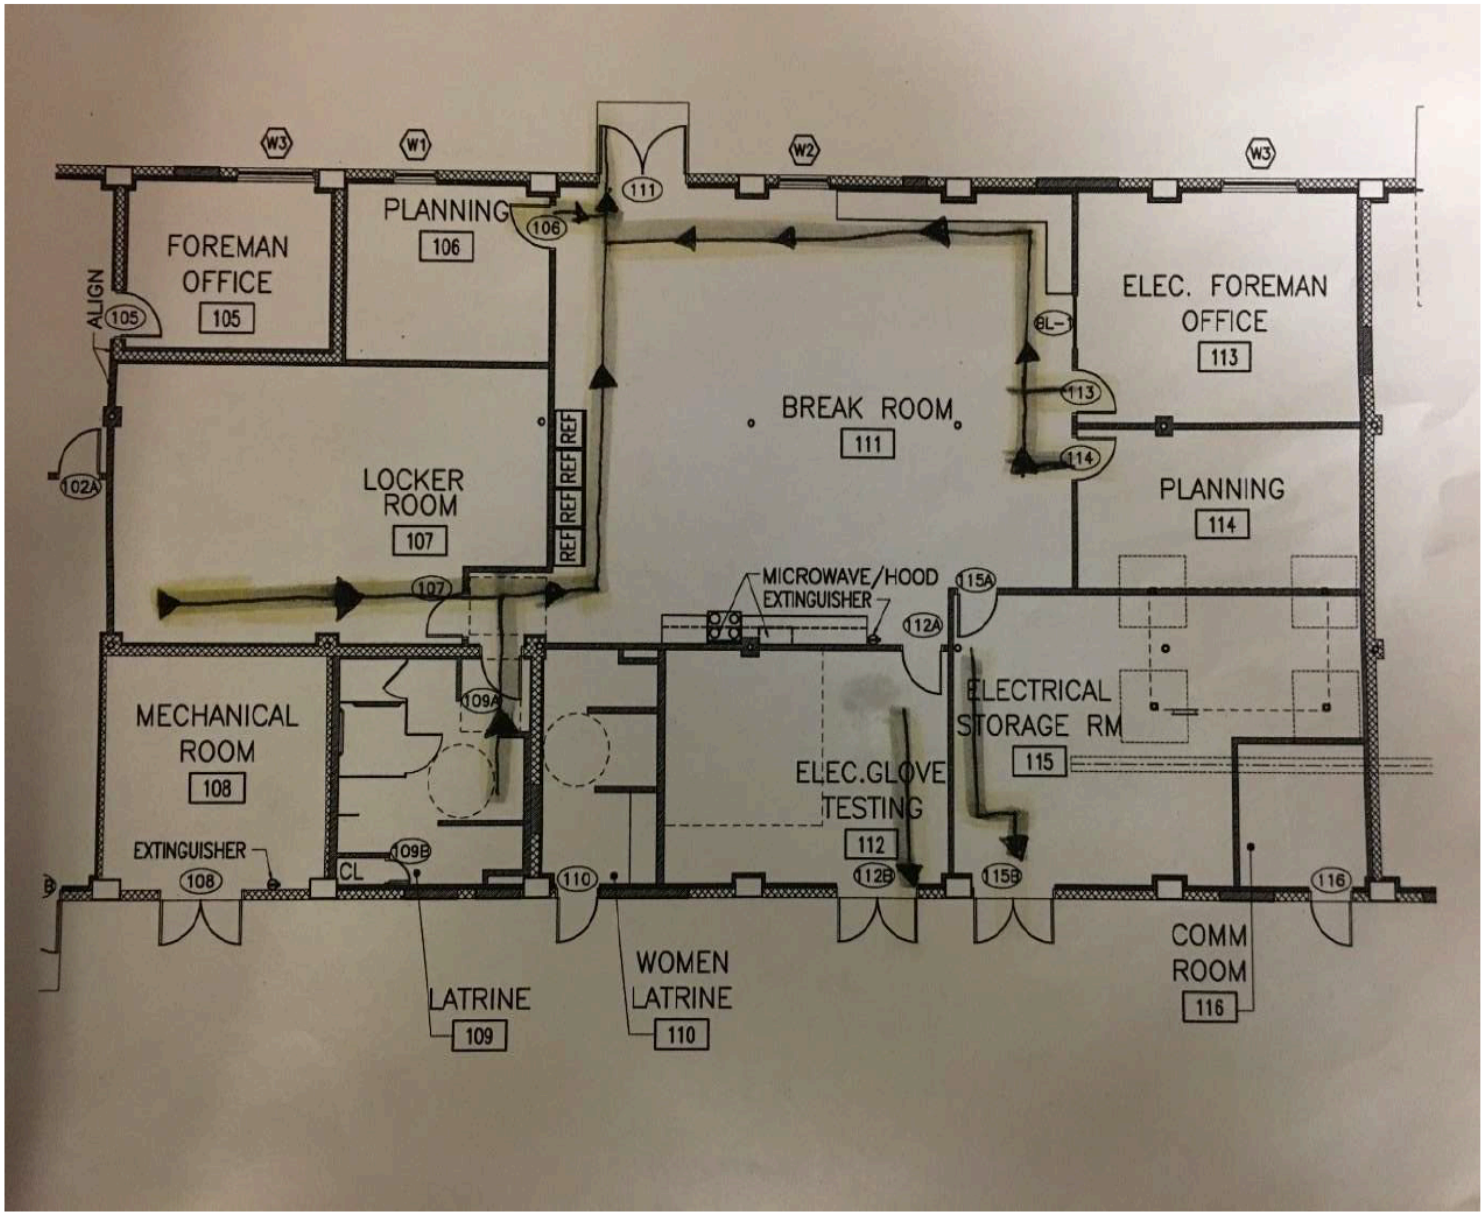

Evacuation map Electrical.png

Emergency Equipment and Safety Board

Safety Bulletin Board Location: Safety Visual Aid (DAFVA 91-209) Location
Posted Location: Building 615, Main Safety Information Board located in Breakroom 111.

List fire pull stations, extinguishers, power cutoffs, eyewash stations, AEDs, foam systems, and any local fire/emergency equipment notes.

No emergency equipment maps or location photos uploaded.

Traffic Safety Program

DAF Traffic Safety Program (DAFI 91-207): Train personnel on mandatory use of seat belts and helmets, speed limits, local traffic hazards, spotters while backing, vehicle training requirements, and restrictions on electronic device use while operating vehicles on- or off-base.


Seat Belts / Occupant Restraints: All persons operating or riding in motor vehicles must wear installed restraint systems as prescribed by the manufacturer. Drivers are responsible for ensuring all passengers are briefed on and use required restraints.

Motorcycle / ATV Training: Personnel must complete required safety training before riding a motorcycle, and local units should address required PPE, licensing, refresher training, and safety representative contacts.

Pedestrian / Bicycle Awareness: Emphasize local roadway crossing hazards, visibility requirements, spotter use, and other pedestrian or bicycle precautions specific to the installation.

Local Traffic Hazards / Vehicle Notes:
Enter local gate hazards, base-specific traffic concerns, spotter rules, and where vehicle training is documented.

Motorcycle Safety Representatives / Traffic Contacts:
List unit or group motorcycle safety representatives, traffic safety contacts, and local rider briefing requirements.

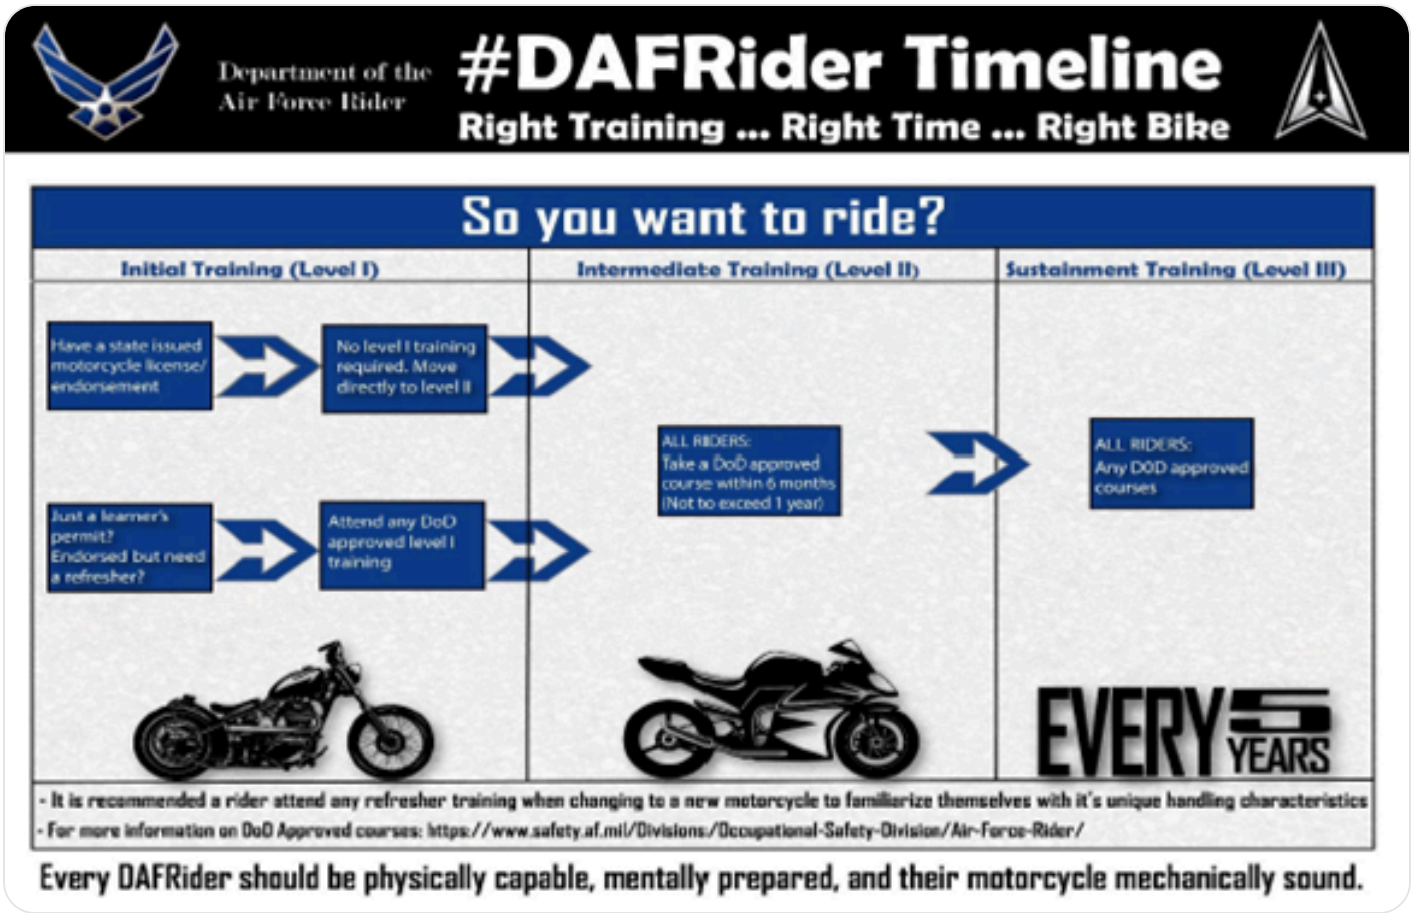

No routine-use GVO risk assessment files uploaded.

Reporting Unsafe Equipment, Conditions, or Procedures

Notify the supervisor immediately when unsafe equipment, conditions, or procedures are identified. Personnel may report hazards without fear of retaliation, coercion, discrimination, or reprisal.

- **DAF Form 457:** Use to document and elevate unsafe conditions, equipment, or processes.
- **SAFEREP:** Use the approved mishap or hazard reporting channel for additional reporting when directed by local procedures.











Reporting Unsafe Equipment Reference Files:

SUPERVISOR MISHAP REPORT

Authority: Executive Order 12196, 29 CFR 1960, 10 USC 9013, DoDI 6055.07 and DAFI 91-204. **Privacy Act:** This form requires collecting and maintaining information protected by the Privacy Act of 1974. Form will be safeguarded from unauthorized disclosure. **Purpose:** To assist safety professionals in identification of individuals and to obtain required personal information to complete mishap reports. **Routine Use:** Used to (a) Establish the severity of injury/illness and to ensure proper reporting accountability within the Department of the Air Force; (b) Identify causes of illness/injuries so supervisors and functional managers can take appropriate action to eliminate or control unsafe and unhealthy conditions; (c) Prepare statistical and historical reports as required by Executive Order 12196 and Department of Defense; (d) Provide documentation for cumulative summation of treatment causes. **Disclosure:** Voluntary, however failure to provide requested information may delay appropriate corrective action to ensure personal safety and reporting mishaps to AFSEC.

SECTION I: EVENT INFORMATION (Required)

1. Date of Mishap	2. Time of Mishap	3. On/Off Installation	4. Specific mishap location

5. What was the employee doing just before the mishap occurred? Describe the activity, as well as the tools, equipment, or material the employee was using. Be specific. *Examples: Climbing a ladder while carrying roofing materials., Spraying chlorine from hand sprayer., Daily computer key-entry.*

6. What happened? Tell us how the injury occurred. *Examples: When ladder slipped on wet floor, worker fell 20 feet., Worker was sprayed with chlorine when gasket broke during replacement., Worker developed soreness in wrist over time.*

7. What object or substance directly harmed the employee? *Examples: concrete floor, chlorine, radial arm saw. If this question does not apply to the incident, leave it blank.*

8. Witnesses ◯ YES ◯ NO (Witness Information, name, address, contact number, email etc.)

SECTION II: EMPLOYEE INFORMATION (as applicable)

9. Name (Last, First MI)	10. Grade/Rank	11. Job title	12. Age	13. Sex	14. DoD ID #

15. Address (Street, City, State & Zip) Type: ◯ Home ◯ Work	16. Phone

17. Organization	18. DoD Employee Type	19. On/Off duty	20. Duty status	21. Unit

22. Office symbol	23. Deployed Unit	24. Deployed Office	25. DAFSC/Occ series	26. Date hired (Civilian)

27. Time shift started	28. # Days since last deployment/TDY	29. # Days Deployed/ TDY in last 365	30. Operating object?	31. MUSTT Account?

SECTION III: MEDICAL & INJURY INFORMATION (as applicable)

32. Treatment (Select all that apply)

☐ No Medical Treatment Needed ☐ Refused Medical Treatment ☐ First/Self Aid Only

☐ Medical Treatment Greater than First Aid ☐ Prescription Medication ☐ Treated at Medical Facility

☐ Inpatient Hospitalization ____ # of days ☐ Job Transfer ____ # of days ☐ Days Away from Work ____ # of days

☐ Returned to Restricted Duties ____ # of days

33. What was the injury or illness? Tell us the part of the body that was injured and how it was affected. *Examples: strained back, chemical burn, left hand, carpal tunnel syndrome. (Be sure to include side i.e, left shoulder, right index finger, etc.)*

34. If treatment was provided away from worksite, where was it administered? (Facility, Street, City, State & Zip)

35. Name of physician or health care professional	36. TOX test?

SECTION IV: OBJECT, PROPERTY, MOTOR VEHICLE & DAMAGE INFORMATION (as applicable)

37. Object, property or vehicle description (*Include manufacturer, model, designator, part number, serial number, vehicle year, etc. as applicable*)

Show/Hide Instructions

The information herein contains **CONTROLLED UNCLASSIFED INFORMATION (CUI)** which must be protected under the Freedom of Information Act (5 U.S.C. 552) and/or the Privacy Act of 1974 (5 U.S.C. 552a). Unauthorized disclosure or misuse of this **PERSONAL INFORMATION** may result in disciplinary action, criminal and/or civil penalties.

DAF Form 978, 20250224
Prescribed by: DAFI 91-204

PREVIOUS EDITIONS ARE OBSOLETE.

Adobe® Designer
OPR: HQ AFSEC/SEGS

- 980 pic.png

38. Description of damage to object, property, or vehicle listed above					
39. Owning organization (unit, private, unknown, etc.)	40. Estimated damage cost?	41. Fire or explosion?	42. Was object WRM?	43. Was object NCE?	44. Was object a trainer?

SECTION V: TRAINING

45. Was employee trained in the task involved in the mishap? ◯ YES ◯ NO (Indicate relevant training below, add rows as needed)

Action	Date	Training
+ ▲ ▼ -		

SECTION VI: EVENT CIRCUMSTANCES (as applicable)

46. Weather	47. Lighting	48. Surface Type	49. Surface Condition	50. Activity Type

51. Was a safety brief or risk assessment completed before mishap? ◯ YES ◯ NO List who completed briefing/assessment below attach if written

52. PPE Usage/Required (Check all that apply/add rows as needed)	PPE (Type/Model/Description)
+ ▲ ▼ - ☐ Required ☐ Used ☐ Deficient	

SECTION VII: ATTACHMENTS (as applicable)

ADD ATTACHMENTS (Include documents/photos and/or relevant files **NON HIPAA**)

Add File/Photo | Remove File/Photo | Open File/Photo

SECTION VIII: ADDITIONAL COMMENTS

SECTION IX: DISTRIBUTION/NOTIFICATION (as applicable/pursuant to local policy)

(Add as needed)	Office	Grade/Rank	Name
Commander			
+ ▲ ▼ -			

SECTION X: SUPERVISOR INFORMATION (required to be provided to installation/tenant safety office within 5 workdays)

Initial corrective actions taken to prevent re-occurrence / Supervisor Comments

Supervisor's name, grade/rank, duty phone	Date	Signature

SECTION XI: SAFETY OFFICE USE ONLY

Date received	Reportable/Recordable	Mishap class	AFSAS #	If employee died, date?

Reasoning for Non-Reportable/Recordable (do not include Privileged Safety Information (PSI))

Reviewer name, grade/rank, duty phone	Date	Signature

Show/Hide Instructions

The information herein contains **CONTROLLED UNCLASSIFED INFORMATION (CUI)** which must be protected under the Freedom of Information Act (5 U.S.C. 552) and/or the Privacy Act of 1974 (5 U.S.C. 552a). Unauthorized disclosure or misuse of this **PERSONAL INFORMATION** may result in disciplinary action, criminal and/or civil penalties.

DAF Form 978, 20250224
Prescribed by: DAFI 91-204

PREVIOUS EDITIONS ARE OBSOLETE.

Adobe® Designer
OPR: HQ AFSEC/SEGS

- 980 pt 2.png

Documentation and Review

Document initial, refresher, and task-specific training in the work center record, review annually or when work conditions change, and maintain records per local records management requirements.

Bioenvironmental Workplace Survey: No Bioenvironmental Workplace Survey uploaded.

Applicable Job Hazard Analyses: No Job Hazard Analysis files uploaded.

Annual Review Log:
Record the supervisor annual review history here.

Trainee Name	Employee ID / Last 4	Date Trained	Trainer / Supervisor Signature