


work order: 22683  
date: 7.30.15

property: 18th & Walnut  
address:  
city & state: Kansas City, MO zip: 64108  
contact: ph:

customer: Lankford Fendler  
address: 1730 Walnut  
city & state: Kansas City, MO zip: 64108  
contact: Greg Fendler ph:

this inspection performed in accordance with the applicable portions of nfpa 25 as defined in jayhawk fire sprinkler's performance specifications

Hydrant #:	21	25						
Location:	Between 18th & 19th. Middle of block	19th & Walnut						
Nozzle:	2-1/2"	2-1/2"						
Static:	134	138						
Residual:	119	120						
Pitot:	45	47						
Flow:	1126	1150	0	0	0	0	0	0
Calculation @ 20 psi:	3365	3175	#NUM!	#NUM!	#NUM!	#NUM!	#NUM!	#NUM!

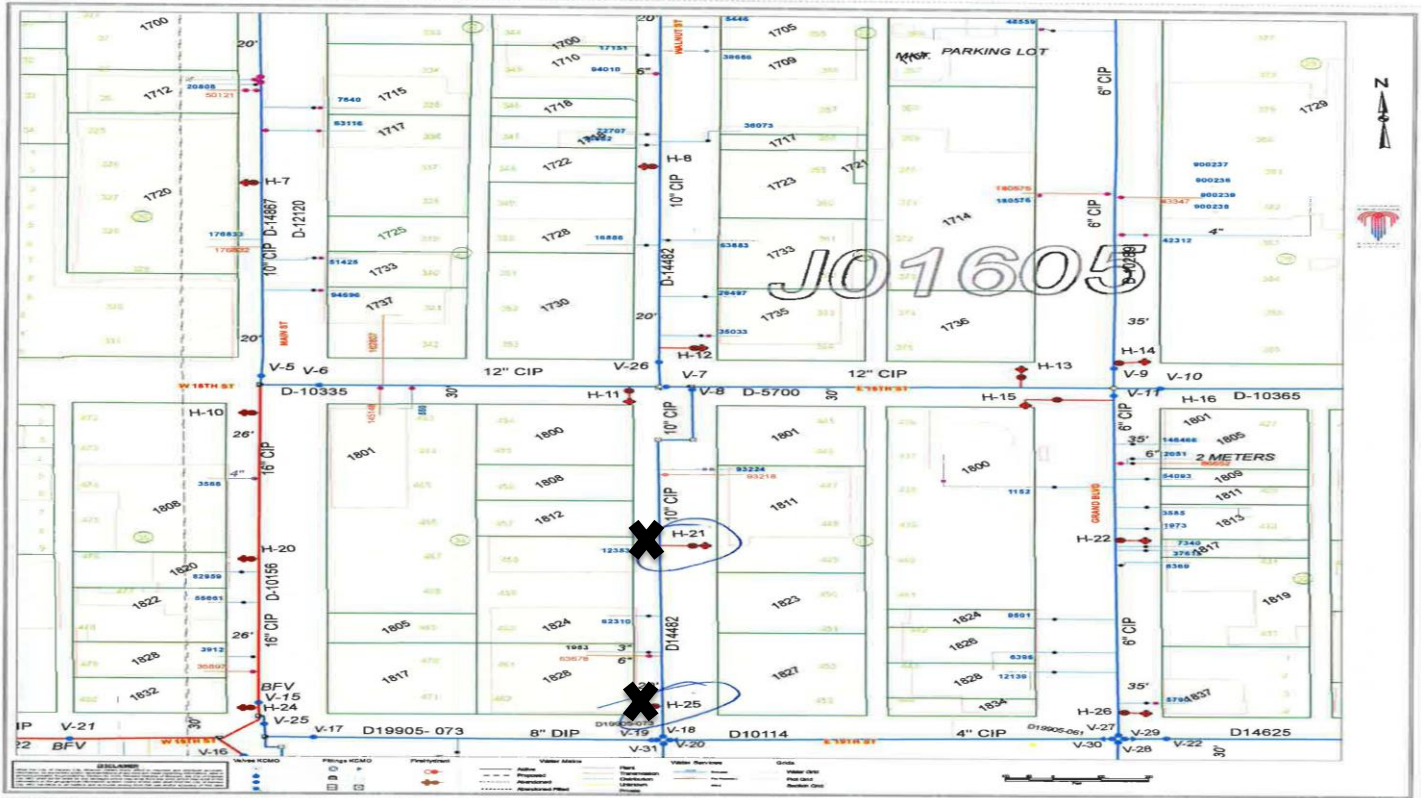

inspector's signature: Ben Moberly Nicet Cert

date: 7.30.15

owner/repres. signature:

date: 7.30.15