



A Adapters preserve clinical role before normalization

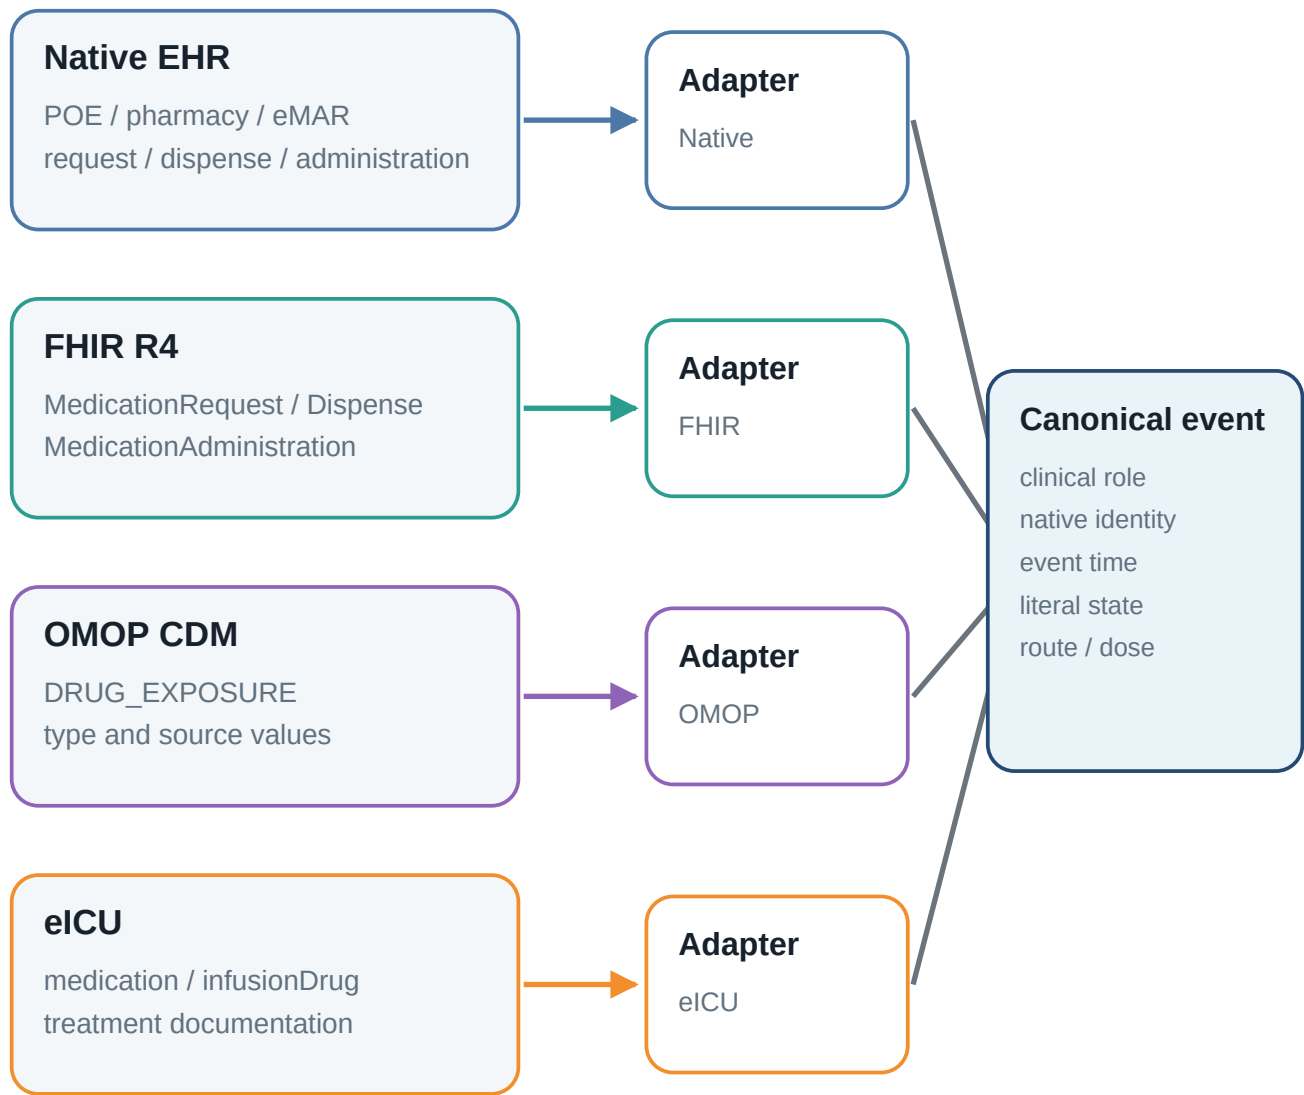

Identifiers remain local; public outputs are aggregate-only

B Five dimensions compile to four auditable states

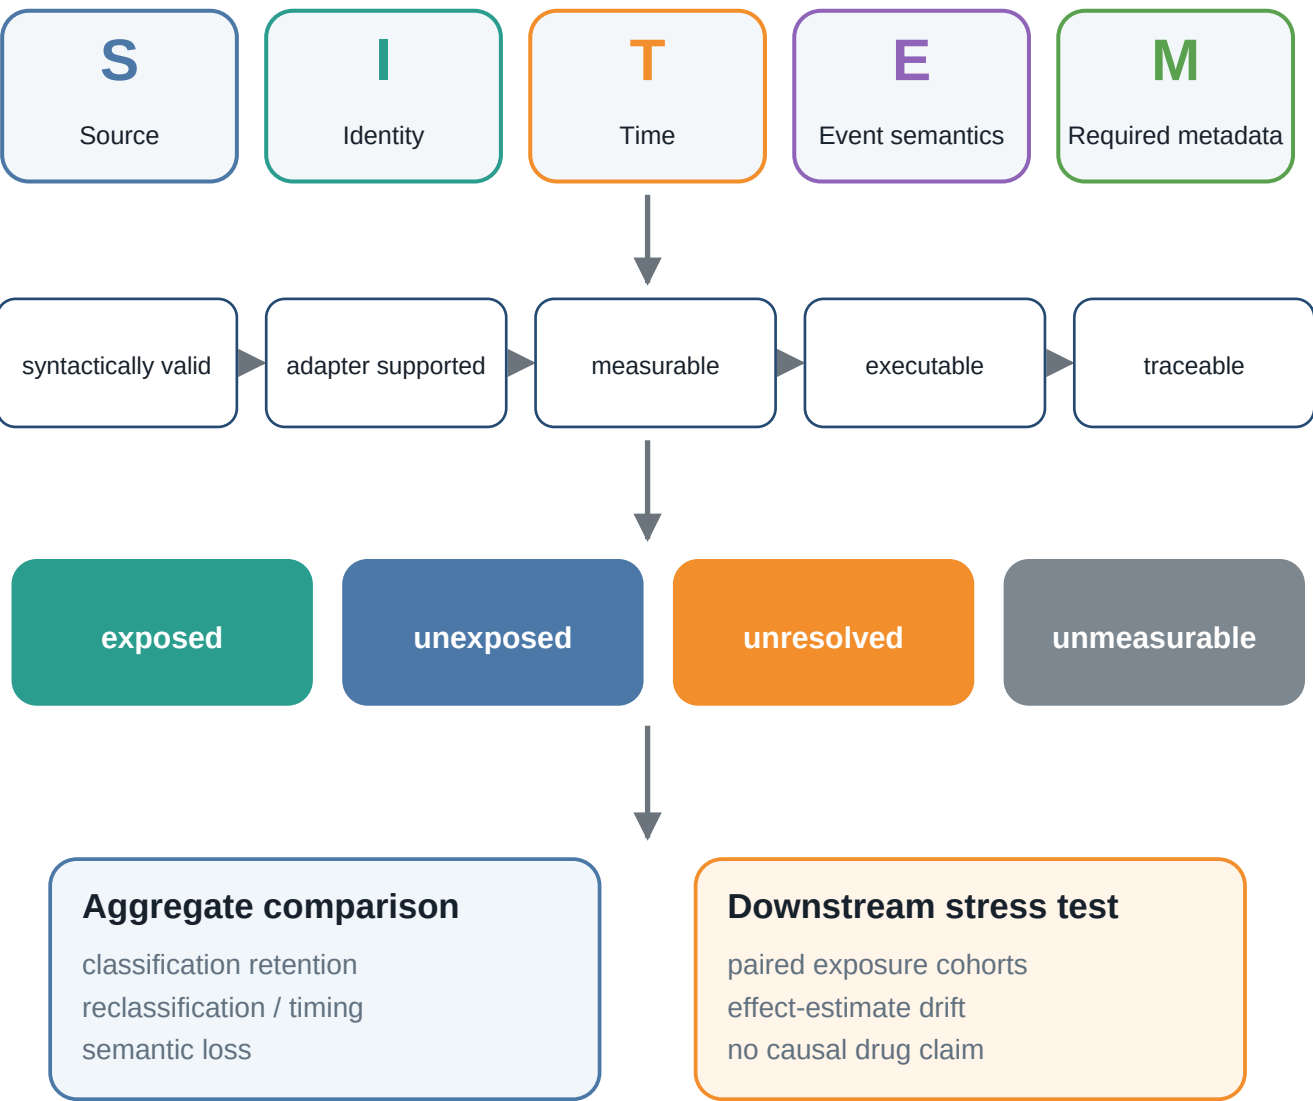

O = (S, I, T, E, M); C(u) is deterministic for each analysis unit